

Technical Note 1: Water Neutrality Statement

Site: Land Adjacent to Pucks Croft Cottage, Rusper, RH12 4PR
Prepared by: Phil Allen
Approved by: Laura Jagiela
Date: 17th September 2025

motion
84 North Street
Guildford
GU1 4AU
Tel: 01483 531300
www.motion.co.uk

1.0 Introduction

- 1.1 This Water Neutrality Strategy (WNS) has been produced by Motion on behalf of their client, BPH Plant Hire Ltd. It supports the proposed development of four residential dwellings, plus the extension to the existing two-bed dwelling on site to become a three-bed dwelling on the land south of Pucks Croft Cottage, which is on Horsham Road, Rusper, West Sussex. A site location plan of the proposed development can be seen in [Appendix A](#) and a layout of the proposed development can be seen in [Appendix B](#).
- 1.2 Following the issue of Natural England's (NE's) Position Statement on Water Neutrality within the Sussex North Water Supply Zone (SNWSZ), all new, reserved matter and Section 73 planning applications for development within Horsham District are required to demonstrate that they can be water neutral. NE's Position Statement can be found in full within [Appendix C](#).
- 1.3 The SNWSZ covers part of Horsham District and parts of the neighbouring Chichester, Arun and Crawley Districts as well as South Downs National Park. A plan showing the supply area can be found in [Appendix D](#).
- 1.4 This WNS will set out the following:
 - The existing site's water demand;
 - Changes in water demand as a result of the proposed residential development;
 - Possible mains water use reduction measures, such as water efficient fixtures and fittings and rainwater harvesting;
 - Measures required to offset any remaining deficit following the above, and;
 - Whether water neutrality has been achieved within the SNWSZ.

2.0 Existing Water Demand

- 2.1 The majority of the site is undeveloped and is considered as a greenfield sit and there is currently no water use associated with it.
- 2.2 However, because the existing property that will be extended from a 2-bed to a 3-bed is within the site boundary, the water use associated with this dwelling should be considered and included within the baseline water use of the site.
- 2.3 The existing dwelling is currently empty. There are no white goods present in the property, and most fixtures and fittings are either not functioning (seized tap heads) or have been removed (such as the bath). Therefore, it has not been possible to carry out a conclusive flow survey. The water feed to the property is functioning and the flow rate of the water feed to the property has been measured at 15 – 16 litres/minute, but this does not relate to the water consumption of individual brass goods, white goods, toilet cisterns, baths, etc., as the water consumption of these items is dictated by capacity and, often, the head of water provided by the water tanks within the property.
- 2.4 Therefore, following advice from the LPA, the 'existing' water use of the property has been calculated using the standard 'maximum fittings consumption' figures of Building Regulations Part G and these have been input into the Part G water efficient flow calculator. This can be seen in Table 2.1, below.
- 2.5 The maximum fittings consumption approach would be commensurate with the fixtures and fittings in place on the property, which were anecdotally quite old and inefficient.

Table 2.1 – Maximum consumption water consumption calculator

Fixture/Fitting	Capacity/ Flow Rate	Units	Total Water Usage (l/p/day)
WC (full flush)	6	litres	8.76
WC (part flush)	4	litres	11.85
Taps (Excluding Kitchen)	6	litres/second	11.06
Bath	185	litres	20.35
Shower	10	litres/second	43.70
Kitchen Taps	8	litres/second	13.88
Washing Machine	8.17	litres/kg	17.16
Dishwasher	1.25	litres/place setting	4.50
Total			131.25
Normalisation Factor			0.91
Total			119.43
External Water Use			5.00
Total			124.43

2.6 This water consumption of 124.43 litres/day has formed the basis for the existing site's current water demand. The full calculation of existing water demand will be based on the census-based occupancy levels for the existing dwelling. This follows HDC's guidance, which states that where existing dwellings are empty, it is appropriate to use census-based population.

2.7 The 2011 local census data is summarised in Table 2.1, below.

Table 2.1 – Average district occupancy levels per dwelling size

Housing Type	One-bed	Two-bed	Three-bed	Four-bed
Census Occupancy	1.32	1.88	2.47	2.86

2.8 Because the existing property has two bedrooms, the 'baseline' water use of the dwelling with an occupancy of 1.88 persons when multiplied by 124.43 litres/day is 233.93 litres/day.

3.0 Development Proposals and Population

3.1 The proposed development is for four residential dwellings, plus the extension to the existing two-bed dwelling on site to become a three-bed dwelling, including plus parking, access and landscaping.

3.2 The housing mix of the development, with the population of the units applied to the housing mix (as per the census data in Table 2.1), can be seen in Table 3.1, below, to understand what the total census-based population of the development will be.

Table 3.1 – Development Housing Mix

Bedrooms	No. of Units	Census-Based Population Increase Per Unit	Development Population Increase
Two-Bed	2	1.88	3.76
Four-Bed	2	2.86	5.72
Two-Bed to Three-Bed Ext'n	1	0.59 (2.47 – 1.88)	0.59
Total:	5	N/A	+ 10.07

4.0 Additional Demand

- 4.1 The development proposals outlined above have been assessed to determine the total water consumption and increase in water demand that the development will represent.

The Four New Dwellings

- 4.2 Building Regulations Part G sets out that *'Reasonable provision must be made by the installation of fittings and fixed appliances that use water efficiently for the prevention of undue consumption of water'*. Part G of the current Building Regulations recommends that all developments achieve a 'water efficient' consumption of 125 litres per person per day.
- 4.3 However, Strategic Policy 9 (Water Neutrality) of HDC's Regulation 19 Local Plan lists the emerging plans and policies concerning new developments. It is stated within the Regulation 19 Local Plan that sites within the SNWSZ should adopt a water efficiency target of 85 litres of mains supplied water per person per day.
- 4.4 Therefore, it is proposed that the new dwellings will achieve a water efficiency of less than 85 litres per person per day of mains water to be in accordance with HDC's emerging Regulation 19 Local Plan. This will be achieved using water efficient fixtures and fittings that reduce the overall consumption of wholesome water.
- 4.5 A water calculation in accordance with Buildings Regulations Part G has been carried out, which confirms that the proposed development can achieve a water consumption of 79.91 litres per person per day, which includes an allowance of five litres per person per day for external water usage.
- 4.6 A copy of the Part G calculation is summarised in Table 4.1, on the next page.

Table 4.1 – Part G Calculation of Proposed Water Usage Per Person in the new dwellings

Fixture/Fitting	Capacity/ Flow Rate	Units	Total Water Usage (l/p/day)
WC (full flush)	4	litres	5.84
WC (part flush)	2	litres	5.92
Taps (Excluding Kitchen)	3	litres/second	6.32
Bath	120	litres	13.20
Shower	5	litres/second	21.85
Kitchen Taps	4	litres/second	12.12
Washing Machine	6.43	litres/kg	13.50
Dishwasher	0.99	litres/place setting	3.56
Total			82.32
Normalisation Factor			0.91
Total			74.91
External Water Use			5.00
Total			79.91

- 4.7 Using the Part G water consumption figure of 79.91 litres per person per day and the population of the development within the new dwellings (9.48) it is estimated that the overall domestic water usage of the four new houses will be 757.55 litres/day.

The Existing Dwelling

- 4.8 The extension to the existing dwelling also represents an increase in population on site. As displayed in Table 2.1, an increase from a two-bed dwelling to a three-bed dwelling represents an additional 0.59 people according to census data.
- 4.9 The existing dwelling has a calculated water use of 233.93 litres/day.
- 4.10 If the new dwelling has an increased population of 0.59 people, and the proposed dwelling is fitted with the same water efficient fixtures and fittings as the proposed dwellings, then the increase in water use will be 47.15 litres/day (0.59 x 79.91).

Summary

- 4.11 When the water use increase of the new dwellings (757.55 litres/day) is added to the water use increase of the extension to the existing dwelling (47.15 litres/day) this results in a total water use increase as a result of the development of 804.70 litres/day, prior to any rainwater harvesting or offsetting.

5.0 Rainwater Harvesting Systems

- 5.1 To help mitigate the above-stated increase in mains water demand it is proposed to incorporate rainwater harvesting to the proposed new dwellings.
- 5.2 Water collected by rainwater harvesting systems can be utilised for flushing toilets, within washing machines, and be used for other external applications. All fixtures and fittings that require potable water will be mains fed.
- 5.3 Table 5.1 on the following page sets out the water uses, as detailed in the Part G calculation and shows the split between the mains water usage and water supplied by the rainwater harvesting system.

Table 5.1: Water Usage of Rainwater Harvesting System

Fixture/Fitting	Mains Water Usage (l/p/day)	RWH System Usage (l/p/day)
WC (full flush)		5.84
WC (part flush)		5.92
Taps (Excluding Kitchen)	6.32	
Bath	13.20	
Shower	21.85	
Kitchen Taps	12.12	
Washing Machine		13.50
Dishwasher	3.56	
Total	57.05	25.26
Normalisation Factor	0.91	0.91
Total	51.92	22.99
External Water Use		5.00
Total	51.92	27.99

- 5.4 Table 5.2 confirms that 27.99 litres/person/day can be supplied by rainwater harvesting systems, leaving just 51.92 litres/person/day to be drawn from the mains supply.
- 5.5 The four new proposed dwellings will have a total population of 9.48 persons. When this figure is multiplied by the proposed residual mains water demand in litres/person/day of 51.92 it results in the total water demand of the proposed new dwellings being reduced from 757.55 litres/day to 492.20 litres/day.
- 5.6 As stated in Paragraph 4.10 the extension to the existing dwelling will result in an increase in water use of that dwelling of 47.15 litres a day over the baseline figure. This figure cannot individually be reduced by rainwater harvesting. To reduce this figure the existing dwelling would need to be retrofitted with a rainwater harvesting system. This is not the wish of the client, so the increase in water demand of the existing dwelling will remain at 47.15 litres/day, noting that it will be fitted with water efficient fixtures and fitting so that the total water consumption will be less than 85 litres/person/day.
- 5.7 When this is added to the proposed increase in water demand of the new dwellings of 492.20 litres/day, it results in an overall increase in water demand on the site of 539.35 litres/day.
- 5.8 How the residual mains water demand of 539.35 litres/day will be offset will be discussed in Section 6, below. Prior to that, the size and specification of the rainwater harvesting tanks needed to supply recycled rainwater to the new dwellings will be discussed.

Rainwater Harvesting Tanks

- 5.9 To supply the proposed new properties with harvested rainwater, the rainwater harvesting tanks must sized using the calculation set out in BS EN 16941-1:2018 so that they are large enough to store 9.6% of the Annual Water Demand. This will ensure that the tanks will provide at least 35 days of storage for periods of drought, as required by HDC.
- 5.10 Each property requires 27.99 litres/person/day of recycled rainwater, and each property will require a rainwater harvesting tank that meets the drought requirements outlined above.
- 5.11 The sizing calculation for the rainwater harvesting tanks for proposed dwellings are summarised in Table 5.2, below, and the full calculations can be found in [Appendix E](#).

Table 5.2 Rainwater Harvesting Tank Sizing for the Proposed New Dwellings

Unit	Population	Roof Area (m ²)	9.6% Annual Rainwater Yield (litres)	9.6% Annual Water Demand (litres)	Minimum Tank Size (litres)
Plot 2 (4-bed)	2.86	71m ²	4,602.77	2,804.93	3,400
Plot 3 (2-bed)	1.88	57m ²	3,695.18	1,843.80	2,600
Plot 4 (2-bed)	1.88	57m ²	3,695.18	1,843.80	2,600
Plot 5 (4-bed)	2.86	87m ²	5,640.01	2,804.93	3,400

- 5.12 The key information to calculate the required tank sizes is the annual average rainfall for the area and the roof area. This defines the potential rainwater yield. The annual average rainfall data for Rusper has been taken from the nearest Met Office weather station (North Heath), which provides the average rainfall for the area from 1991 – 2020. This is 858.70mm/year. This data can be seen in [Appendix F](#).
- 5.13 It can be seen that the 9.6% of the annual rainwater yield is in excess of the 9.6% annual demand, so the roof areas of each dwelling are great enough to be able to supply the occupants with the required amount of rainwater.
- 5.14 Because the tank sizes must provide enough storage for 9.6% of the annual demand as a minimum, they will, in fact, provide more rainwater storage than this. Indeed, as an example, it can be seen that on Plots 3 and 4 that 9.6% of the annual demand is 1,843.80 litres, but the nearest suitable tank size is 2,600 litres. This means that these tanks will provide 13.5% of the annual demand, or 49 days. This increases the systems' resilience to drought.
- 5.15 The details of the 2,600-litre and 3,400-litre tanks can be found in [Appendix G](#) of this report. It is recommended that the two tanks are provided by SDS.
- 5.16 A typical layout and specification for a rainwater harvesting system is shown in [Appendix H](#). The illustration shows how the rainwater will be collected, filtered and then returned to the property for re-use.
- 5.17 The rainwater harvesting systems will be managed and maintained by a management company and this will be secured in the S106 agreement. A Management and Maintenance Plan is included in [Appendix I](#).
- 5.18 The rainwater harvesting system will contain the UV-DS55 filter manufactured by Silverline UK Limited, or similar approved. The specification of the UV filter can be found in [Appendix J](#).

6.0 Offsetting Measures

- 6.1 To ensure the development can demonstrate water neutrality in accordance with the NE Position Statement, a residual mains water demand of at least 539.35 (540) litres per day will need to be offset. This must come from an off-site offsetting scheme and the details of this are below.

The South Lodge Hotel Offsetting Scheme

- 6.2 The client is proposing to offset the development against an offsetting scheme at South Lodge Hotel, Brighton Road, Lower Beeding, Horsham, RH13 6PS. The full details of the mains water offsetting scheme at South Lodge Hotel as it currently stands can be seen in [Appendix K](#) of this report, but is summarised below for ease of reference.
- 6.3 South Lodge Hotel is a luxury hotel and spa with three metered mains supplies. These are:

- The Main Hotel (Meter Number: 11M50090);
 - The Spa (Meter Number: 17MS000318) and;
 - The Gatehouse (Meter Number: 11AC001166).
- 6.4 The 'Main Hotel' water supply provides the following:
- Staff and guest toilet and washing facilities
 - Cleaning and laundry
 - Kitchens and bars
 - Garden irrigation
- 6.5 'The Spa' water supply provides the following:
- Staff and guest toilet and washing facilities
 - Cleaning
 - Pools and spas
 - Kitchen
 - Garden irrigation
- 6.6 'The Gatehouse' water supply provides the following:
- Staff toilet and washing facilities
 - Cleaning and laundry
 - Kitchens
 - Garden irrigation
- 6.7 The quantity of water used at each of these metred supplies and the period over which they have been monitored is detailed in Tables 6.1 to 6.3, on the next page.

Table 6.1: Existing Water Use for meter 11M50090 (The Main Hotel)

Start Date	22/08/2022
End Date	16/08/2023
Start Sub-Meter Read	163,810
End Sub-Meter Read	179,340
Total Days	359
Total Water Consumption (m3)	15,530
Total Water Consumption (litres)	15,530,000
Water Consumption (litres per day)	43,259

Table 6.2: Existing Water Use for meter 17MS000318 (The Spa)

Start Date	22/08/2022
End Date	16/08/2023
Start Sub-Meter Read	5,920
End Sub-Meter Read	8,572
Total Days	359
Total Water Consumption (m3)	2,652
Total Water Consumption (litres)	2,652,000
Water Consumption (litres per day)	7,387

Table 6.3: Existing Water Use for meter 11AC001166 (The Gatehouse)

Start Date	13/06/2022
End Date	16/08/2023
Start Sub-Meter Read	9,184
End Sub-Meter Read	10,054
Total Days	429
Total Water Consumption (m3)	870
Total Water Consumption (litres)	870,000
Water Consumption (litres per day)	2,028

- 6.8 Overall, South Lodge Hotel and Spa has an existing water usage of 43,259 litres per day at the Main Hotel, 7,387 litres per day at The Spa and 2,028 litres per day at the Gatehouse. This gives a total water consumption across the site of 52,674 litres per day.
- 6.9 It is proposed to supplant some of the existing water demand at South Lodge Hotel and Spa with water derived from an onsite borehole, which will extract aquiferous water that is not hydraulically connected to the Hardham abstraction.
- 6.10 To understand the potential yield of boreholes on the South Lodge Hotel and Spa site, two boreholes (BH1 and BH2) were drilled between the 11th and 22nd April 2024. They were both drilled to a depth of 62m into the Upper Tunbridge Wells Sand Formation.

- 6.11 BH1 has been tested and can achieve an average rate of 20.8m³ (20,800 litres) per day. An Environment Agency licence has been applied for should the abstraction go above 20.0m³ per day but, at this stage, BH1 has only been tested for the purposed of an unlicensed supply (less than 20m³) as it is only proposed to abstract 19.99m³ per day.
- 6.12 BH2 has not been yield tested. The offsetting scheme only proposes to use 19.99m³ per day and this is fully supplied by BH1, thus yield from BH2 is not currently needed.
- 6.13 The South Lodge offsetting scheme will provide 19.99m³ per day for potable use within the Main Hotel. By supplying potable water from an onsite borehole (BH1), mains water demand within the SNWSZ will be reduced by 19.99m³ per day and allows this saving to be offered to developments as a system of credits.
- 6.14 The mains water supply will continue to provide water to the Main Hotel Area for all demand in excess of 19.99m³ per day. How this is managed is detailed in the report in [Appendix J](#).

Offsetting the Proposed Development

- 6.15 The borehole abstraction at The South Lodge Hotel is making 19.99m³ per day available or offsetting mains water demand within the SNWSZ. At one credit per litre, 19,999 credits are available.
- 6.16 As stated in Section 5 of this WNS, the proposed development will have a total water demand of 539.35 litres per day and requires a minimum of 540 credits for the development to be water neutral.
- 6.17 The development on the land adjacent to Pucks Croft has been formally allocated 586 credits (540 credits plus a 46-credit buffer, which is equal to 8%) from the South Lodge offsetting scheme to allow the development to be water neutral. This allocation is balanced with the other developments that are also using the scheme to offset their mains water demand. The offsetting requirement and allocation at South Lodge and details of the other developments using the scheme are detailed in [Appendix K](#).

7.0 Summary and Conclusion


- 7.1 In summary, BPH Plant Hire Ltd and the proposed development on land adjacent to Pucks Croft will reduce mains water demand on-site through the use of water efficient fixtures and fittings and rainwater harvesting and the residual mains water demand of the development will be offset through credits allocated as part of the significant offsetting scheme at South Lodge Hotel. Therefore, the residual mains water requirement of the development of 539.35 litres per day has been fully offset. This means that there will be no additional mains water requirement within the SNWSZ because of the development, which will be water neutral.

Appendix A

Site Location Plan

Millfield House

Millfield Cottage

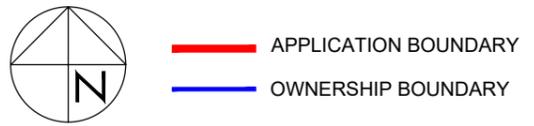

Ordnance Survey, (c) Crown Copyright 2020. All rights reserved. Licence number 100022432
 © ECE Architecture Limited. No dimensions to be scaled from drawing except for the purposes of Planning Applications. The contractor should check all dimensions on site. It is the contractors responsibility to ensure compliance with Building Regulations.

Client's Name
BPH Plant Hire

Job Title
Land adjacent to Pucks Croft Cottage, Rusper

Drawing Title
Location Plan

Scale
1:1250 @ A3

Drawn KB	Checked MG	Date 14.05.24
Job No 7436	Drawing No PL-01	Rev C
Status	APPROVAL	

Rev	Date	Revision Details	Dr	Ch
C	19.05.25	Boundary Updated	AE	MG
B	04.04.25	Boundary Updated	AX	MG
A	20.11.24	Boundary Updated	KP	MG

London:	76 Great Suffolk Street London, SE1 0BL
Sussex:	64 - 68 Brighton Road, Worthing West Sussex, BN11 2EN
Bristol:	Westworks, Beacon Tower Colston Street, Bristol, BS1 4XE

ECE Architecture
www.ecearchitecture.com

CAD Plot date: 18/05/2025 - 12:01:27

Appendix B

Development Layout

- Site Boundary (0.29Hectare)
- RPA
- - - Thames Water public sewer



Proposed pedestrian crossing

Access to adjoining field

3m easement (both sides) to Thames Water public sewer

Indicative surface water detention basin

Existing hedgerow to be retained and improved with management plan across site and integrated into proposed scheme. Refer to Lizard's Tree Retention Protection Plan

Public Right of Way

Refer to Motion (highways consultant) drawings for proposed access visibility splays drawing

Extension to existing 2B4P house to become a 3B5P house

T05 & T06 cat. C existing trees to be removed. Refer to Lizard's Tree Retention Protection Plan

Refuse and Fire vehicle turning

Recondition existing barn and building footprint into residential dwelling

Visitor parking

New 2m mixed native species hedgerow planted to site boundary. See Landscape Architect's information

G	28.05.25	Site layout amended.	AE	MG
F	13.05.25	Site layout amended.	AX	MG
E	04.04.25	Site boundary updated. Proposed trees location updated. Site area amended	AX	MG
D	26.09.24	Updated landscape	LG	MG
C	12.08.24	Attenuation basin moved and swale added	LG	MG
B	15.07.24	Drainage strategy updated to suit Thames Water sewer	LG	MG
A	06.07.24	Issued for information	LG	MG
Rev	Date	Revision Details	Dr	Ch

ECE Architecture
 www.ecearchitecture.com

London: 76 Great Suffolk Street, London, SE1 0BL
 T 0207 928 2773 E london@ecearchitecture.com
 Sussex: Brooklyn Chambers, 11 Goring Road, Worthing, West Sussex, BN12 4AP
 T 01903 248777 E sussex@ecearchitecture.com
 Bristol: Westworks, Colston Tower, Colston Street, Bristol, BS1 4XE
 T 0117 214 1101 E bristol@ecewestworks.com

Client's Name
BPH Plant Hire

Job Title
Land adjacent to Pucks Croft Cottage, Rusper

Drawing Title
Proposed Site Plan

Scale
1:250 @ A1 / 1:500 @ A3

Drawn	Checked	Date
LG	MG	14.05.25

Job No	Drawing No	Rev
7436	PL-03	G

Status
APPROVAL



Appendix C

Natural England Position Statement



Natural England's Position Statement for Applications within the Sussex North Water Supply Zone

September 2021 – Interim Approach

Please take the following as Natural England's substantive advice for all applications which fall within Sussex North's Water Supply Zone.

Sussex North Water Supply Zone

Arun Valley SPA, SAC and Ramsar Site- Sussex North Water Supply Zone

The Sussex North Water Supply Zone includes supplies from a groundwater abstraction which cannot, with certainty, conclude no adverse effect on the integrity of;

- Arun Valley Special Area Conservation (SAC)
- Arun Valley Special Protection Area (SPA)
- Arun Valley Ramsar Site.

As it cannot be concluded that the existing abstraction within Sussex North Water Supply Zone is not having an impact on the Arun Valley site, we advise that developments within this zone must not add to this impact. This is required by recent caselaw, [Case C-323/17 People over wind and Sweetman. Ruling of CJEU](#) (often referred to as sweetman II) and Coöperatie Mobilisation for the Environment and Vereniging Leefmilieu Case C-293/17 (often referred to as the Dutch Nitrogen cases).

Between them these cases require Plans and Projects affecting sites where an existing adverse effect is known (i.e. the site is failing its conservation objectives), to demonstrate certainty that they will not contribute further to the existing adverse effect or go through to the latter stages of the Regulations (no alternatives IROPI etc).

Developments within Sussex North must therefore must not add to this impact and one way of achieving this is to demonstrate water neutrality.

In addition, the Gatwick Sub regional Water Cycle Study concluded that water neutrality is required for Sussex North to enable sufficient water to be available to the region.

The definition of water neutrality is the use of water in the supply area before the development is the same or lower after the development is in place.

Strategic approach

Natural England has advised that this matter should be resolved in partnership through Local Plans across the affected authorities, where policy and assessment can be agreed and secured to ensure water use is offset for all new developments within Sussex North. To achieve this Natural England is working in partnership with all the relevant authorities to secure water neutrality collectively through a water neutrality strategy.

Whilst the strategy is evolving, Natural England advises that decisions on planning applications should await its completion. However, if there are applications which a planning authority deems critical to proceed in the absence of the strategy, then Natural England advises that any application needs to demonstrate water neutrality. We have provided the following agreed interim approach for demonstrating water neutrality;

Minimising water use of new builds.

- Complete a water budget (based on occupancy)
- All new builds to demonstrate that they can achieve strict water targets (e.g., 85L/pp/day*)
This can be achieved by measures such as:
 - Grey water recycling (advantage of being reliable in hot dry weather);
 - Rainwater harvesting;
 - Water efficient fixings (such as shower aerators) to demonstrably reduce demand-this would need to be suitably certain.

In addition, water offsetting is required

- One way to achieve this is retrofitting of council owned properties/commercial buildings-located within Sussex North. Examples include:
 - Grey water recycling- (for example there are clear opportunities for commercial properties).
 - Rainwater harvesting of commercial settings;
 - Installation of water reduction fittings in Council-owned buildings.

These measures need to be implemented until such time as a more sustainable water supply has been secured.

It will also need to be ensured that measures are not already proposed (for example in Southern Water's Management Plan) to avoid double-counting.

Any mitigation must be suitably certain in order to comply with the Habitats Regulations and Caselaw.


If the application cannot demonstrate, through an appropriate assessment, the required water neutrality, we advise that it is either revised to achieve this in line with the above or awaits completion of the strategic approach.

The securing of water neutrality is a matter which needs to be resolved at a strategic level and Natural England is working with the relevant authorities and the water company to achieve this. In light of this, Natural England will not be engaging with individual planning applications whilst the strategy is evolving.

***This this is the reasonably achievable figure with the above measures based on the early data from the strategic solution and may be subject to change as the strategic solution evolves.**

Appendix D

Sussex North Water Supply Zone (SNWSZ)

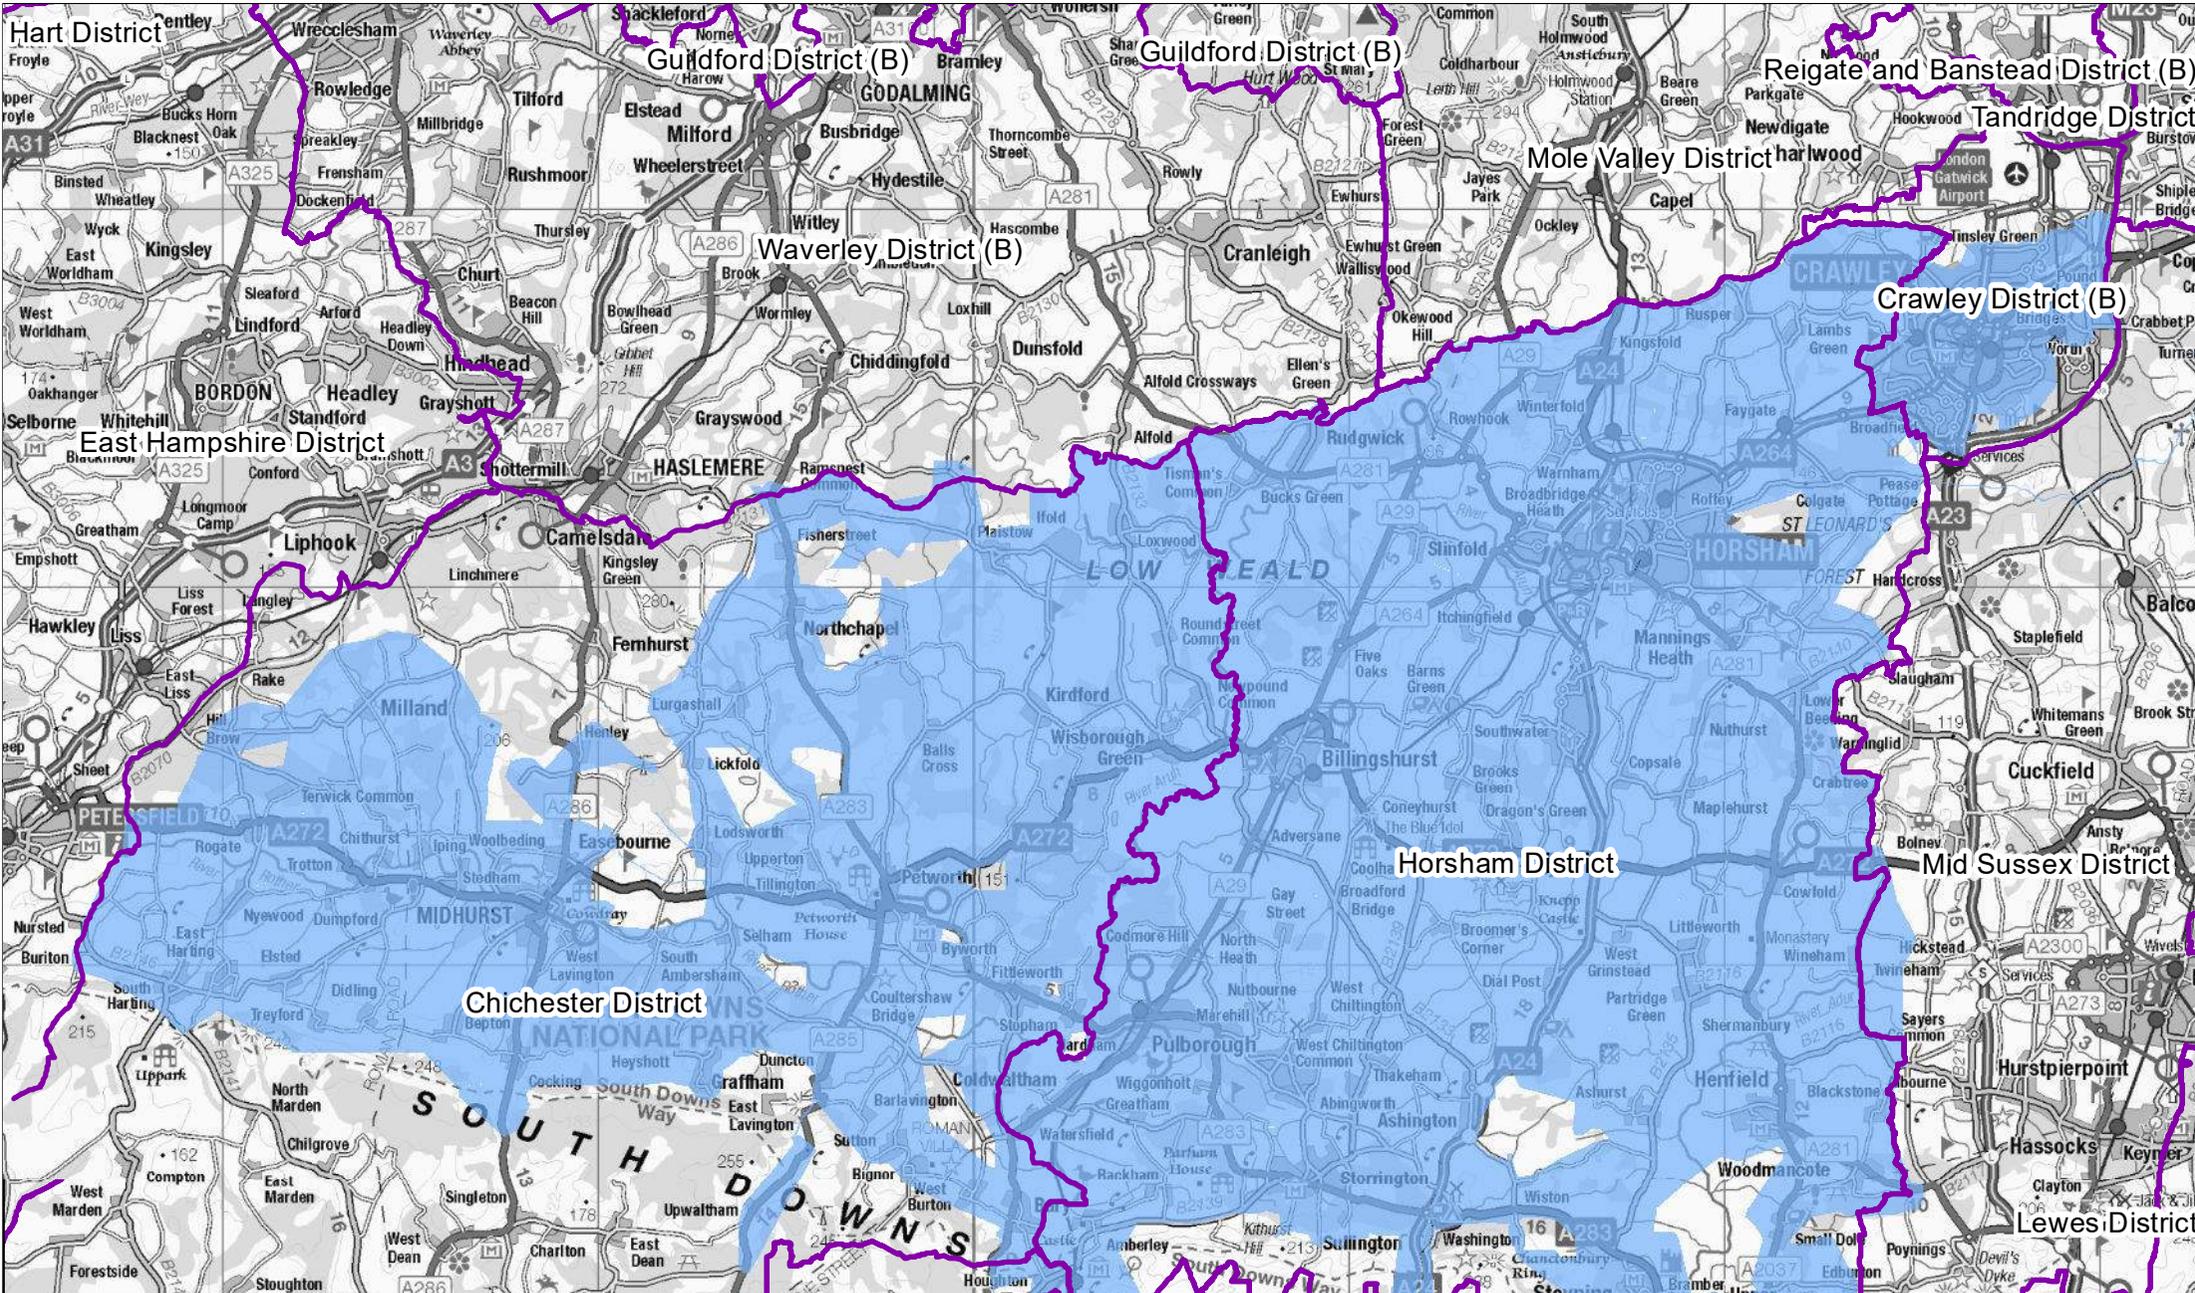

LPA Boundary
 Sussex North WRZ

0 2.5 5 10 km

Contains Ordnance Survey data © Crown copyright and database right 2020.
 Contains public sector information licenced under the Open Government Licence v3.0

Appendix E

Rainwater harvesting Calculation

Rainwater Harvesting System (BS EN 16941-1:2018 - Intermediate Approach)

AAR	833.69	Average Annual Rainfall
e	0.9	Yield Coefficient
h	0.9	Hydraulic Filter Efficiency
P _d	27.99	Daily Requirement per Person

Unit	Type	No. Beds	No. Units	Census	Population	Roof Area (m ²)	9.6% Annual Rainwater Yield (litres)	9.6% Annual Water Demand (litres)	Minimum Tank Size (litres)
Plot 2	House	4	1	2.86	2.86	71	4,602.77	2,804.93	3,400
Plot 3	House	2	1	1.88	1.88	57	3,695.18	1,843.80	2,600
Plot 4	House	2	1	1.88	1.88	57	3,695.18	1,843.80	2,600
Plot 4	House	4	1	2.86	2.86	87	5,640.01	2,804.93	3,400

Appendix F

North Heath Met Office Station Rainfall Data

Average tables

Average graphs

Location comparison

Average maps

Climate period:

Station: North Heath


1991-2020

Month	Maximum temperature (°C)	Minimum temperature (°C)	Days of air frost (days)	Sunshine (hours)	Rainfall (mm)	Days of rainfall ≥1 mm (days)	Monthly mean wind speed at 10 m (knots)
January	8.55	2.52	–	55.25	92.33	–	–
February	9.02	2.24	–	83.04	63.49	–	–
March	11.74	3.44	–	117.86	52.58	–	–
April	14.83	4.64	–	170.19	52.57	–	–
May	17.61	6.99	–	205.07	46.86	–	–
June	20.65	9.68	–	199.60	55.92	–	–
July	23.31	11.77	–	215.93	63.28	–	–
August	22.99	11.58	–	196.60	63.61	–	–
September	19.93	9.46	–	148.17	63.38	–	–
October	15.89	7.06	–	109.26	103.33	–	–
November	11.89	4.40	–	66.22	103.13	–	–
December	9.20	2.62	–	54.06	98.22	–	–
Annual	15.50	6.39	–	1621.25	858.70	–	–


Appendix G

SDS Rainwater Harvesting Tank Details


SDS 1,800 Litre Rainwater Harvesting Tank

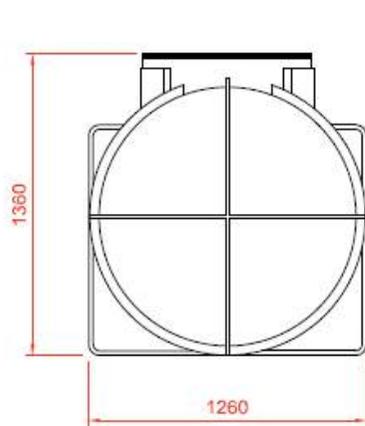

END ELEVATION

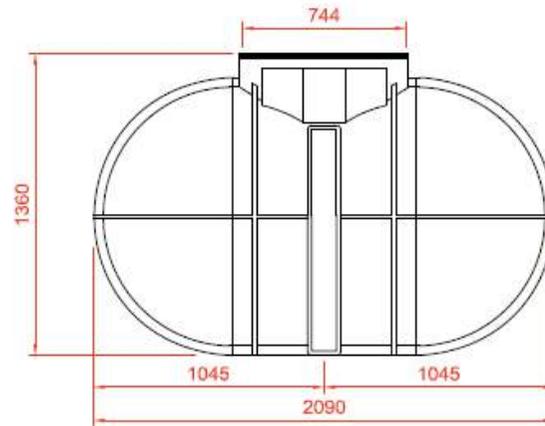

SIDE ELEVATION

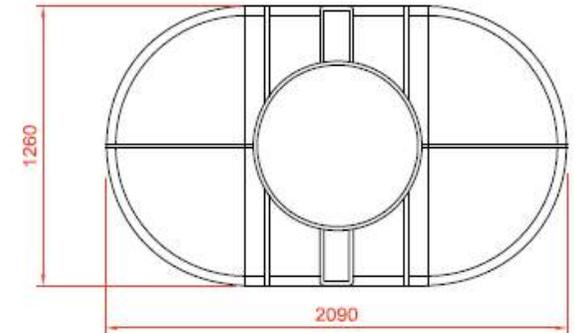

PLAN

Client	SDS	Details
Project Name	1,800 Litre Tank	
Type	Standard Detail	
Date	-	
Drawing no.	-	
Revision	A	


Notes:

This Drawing is to be read in conjunction with all relevant Architect, Engineers and Specialists drawings and specifications.


Do not scale from the drawing in either paper or digital form. Use written dimensions only.




SDS 2,600 Litre Rainwater Harvesting Tank

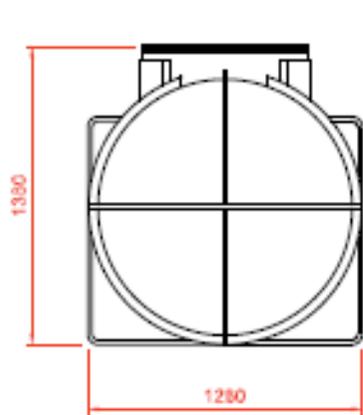

END ELEVATION

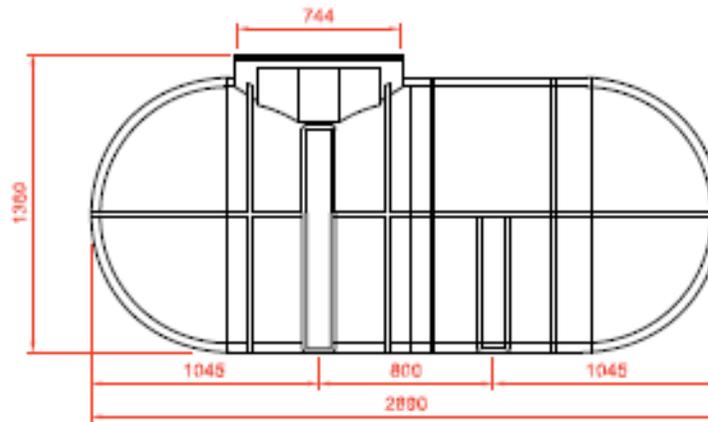

SIDE ELEVATION

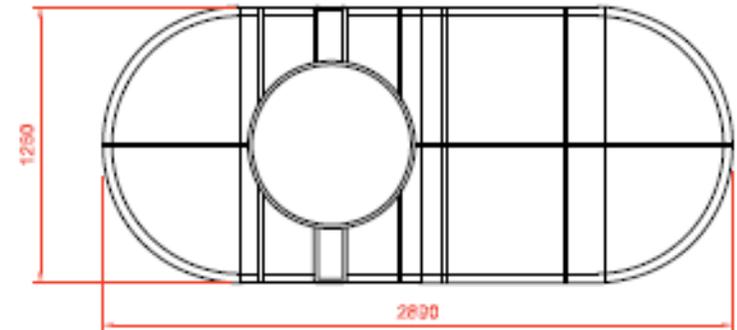

PLAN

Client	SDS	Details
Project Name	2,600 Litre Tank	
Type	Standard Detail	
Date	-	
Drawing no.	-	
Revision	A	

Notes:

This Drawing is to be read in conjunction with all relevant Architect, Engineers and Specialists drawings and specifications.


Do not scale from the drawing in either paper or digital form. Use written dimensions only.



Appendix H

Typical Layout and Specification of a Rainwater Harvesting System

HARVESTING RAINWATER DIRECT-PRESSURE OPERATING PRINCIPLES

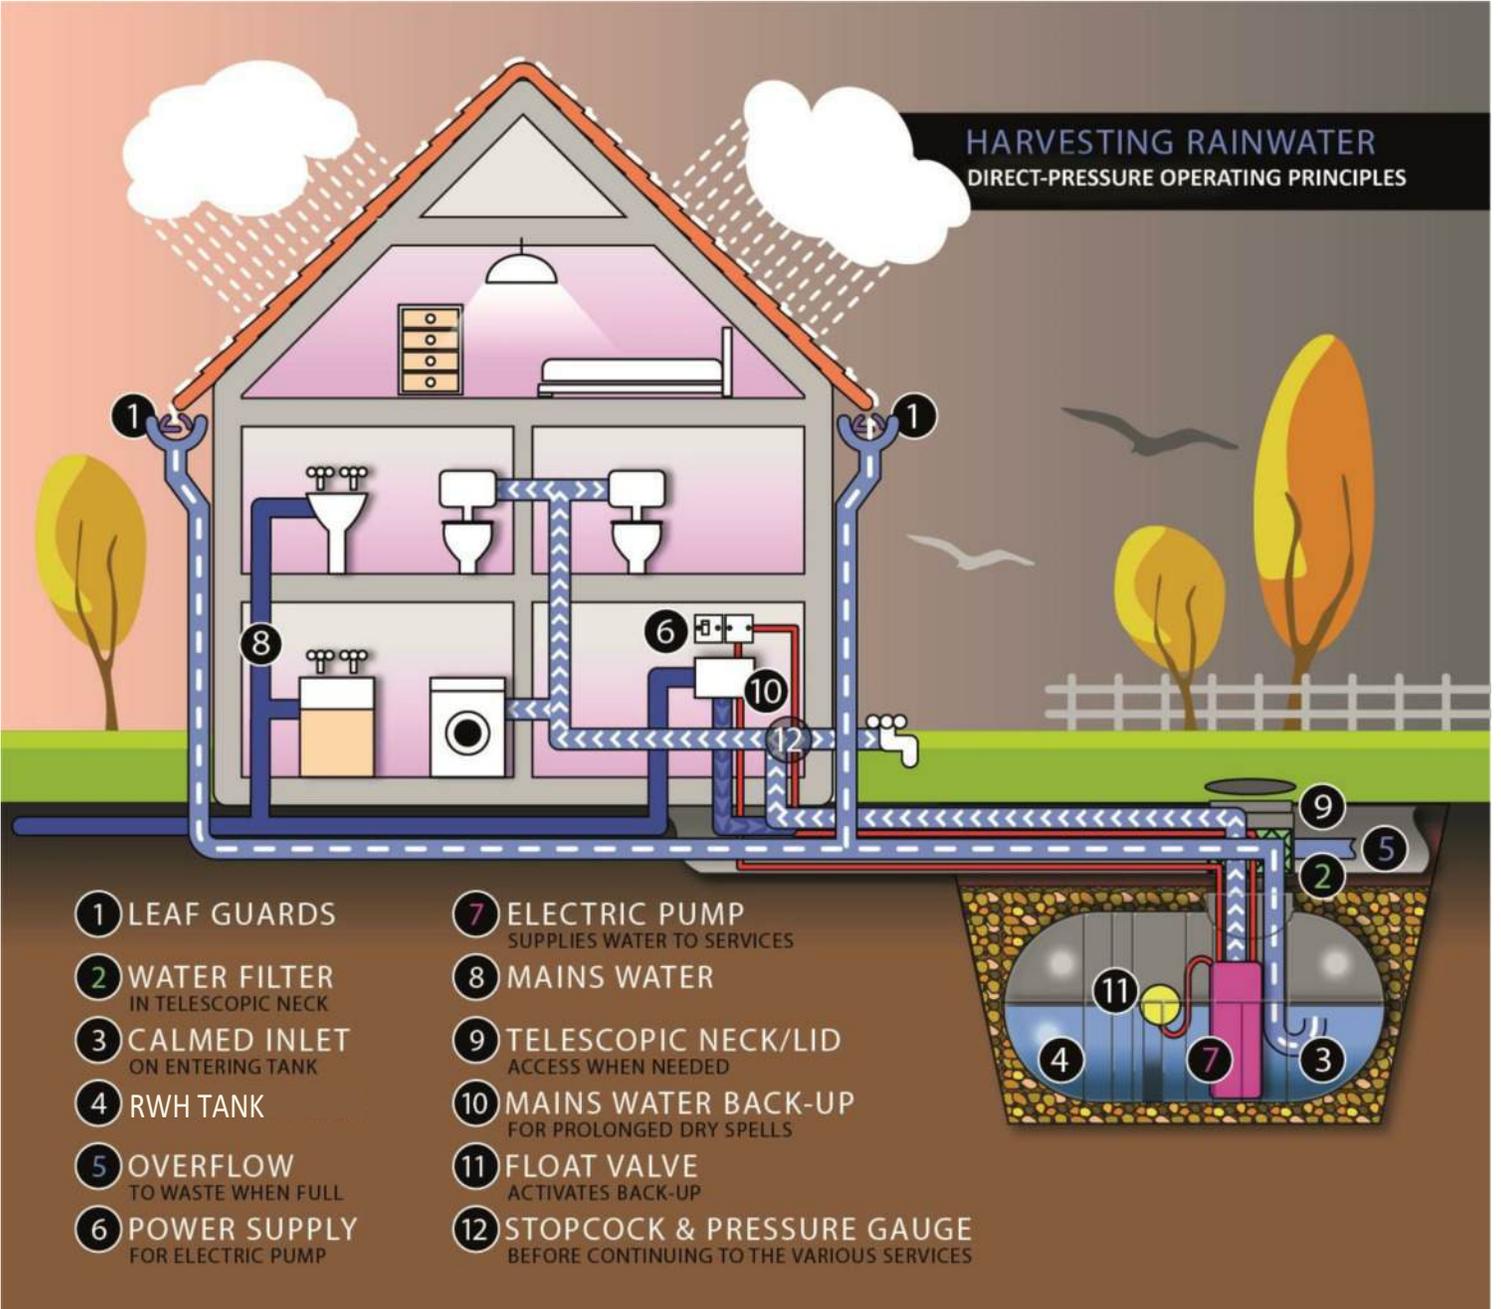

1 LEAF GUARDS

2 WATER FILTER
IN TELESCOPIC NECK

3 CALMED INLET
ON ENTERING TANK

4 RWH TANK

5 OVERFLOW
TO WASTE WHEN FULL

6 POWER SUPPLY
FOR ELECTRIC PUMP

7 ELECTRIC PUMP
SUPPLIES WATER TO SERVICES

8 MAINS WATER

9 TELESCOPIC NECK/LID
ACCESS WHEN NEEDED

10 MAINS WATER BACK-UP
FOR PROLONGED DRY SPELLS

11 FLOAT VALVE
ACTIVATES BACK-UP

12 STOPCOCK & PRESSURE GAUGE
BEFORE CONTINUING TO THE VARIOUS SERVICES

DIRECT PRESSURE SYSTEM HOME & GARDEN



Inside the Household

Top Up Controller

Automatic mains water top-up Controller kit for rainwater tanks with pump isolation and alarm. The system detects when the tank contents level is running low and initiates a mains top up procedure to ensure the tank never runs out of water supply.

SYSTEM:

A Direct Pressure System is the most popular, cost effective and risk-free option for rainwater harvesting. It can be used for both garden and household applications, for example, it can be used in buildings with a small block of toilets, and for garden irrigation and machine washdowns. The system sends pressurised water straight from the external tank directly to the application. If the water level in the tank gets too low, the top up controller will activate a mains top up so the tank doesn't empty.

COMPONENTS

P Series pumps are stainless steel pumps with plastic coverings and are suitable for domestic water systems, rainwater harvesting, tanks, surface irrigation and tank transfer.

The rodent guard protects the internal water from rodents and large debris which could contaminate the water entering via the overflow.

The PF filter is designed with a level drop, this along with its very smooth surface structure allows excess dirt to be rinsed straight through to the overflow. The filter cartridge mesh is stainless steel within plastic housing and is self-cleaning, though regular inspection is recommended.

The calmed inlet removes the kinetic energy from the water as it enters the tank. This means that as the water enters it doesn't stir up the contents of the tank.

The turret set provides the connection between the pump and the pipework leading to the various external applications. They are made from a flexible plastic so can easily deal with the pressurised water coming from the pump.

The pump lifting chain aids in servicing the pump as it allows the pump to be easily pulled up towards the top of the tank.

A floating intake ensures that no water from either the bottom or the surface of the tank is taken in. Meaning only clean water passes through the system and is pumped into the household.

ADDITIONAL SPECIFICATIONS

- Service duct
- Delivery hose (Options available)
- Top up controller
- Tanks sold separately
- Extra overflow on tanks 5600 – 10000

POPULAR USE:

- Garden irrigation
- Cleaning the car
- Washing windows
- Power washing drive/patio
- Outside tap and hosepipe
- Flushing toilets
- Drinking water (if tank is potable)
- Washing machine



Appendix I

Rainwater Harvesting Management and Maintenance Plan



Land Adjacent to Pucks Croft Cottage
Horsham Road, Rusper, West Sussex

**Rainwater Harvesting Management and
Maintenance Plan**

For

BPH Plant Hire Ltd

Document Control Sheet

Land Adjacent to Pucks Croft Cottage
Horsham Road, Rusper, West Sussex
BPH Plant Hire Ltd

This document has been issued and amended as follows:

Date	Issue	Prepared by	Approved by
17/06/2025	FINAL	Laura Jagiela	Phil Allen MCIWEM C.WEM



Motion
84 North Street
Guildford
GU1 4AU
T 01483 531300
F 01483 531333
E info@motion.co.uk
W www.motion.co.uk

Contents

1.0	Introduction	1
2.0	Treatment.....	2
3.0	Water Quality Control	4
4.0	Continuity of Supply	5
5.0	Maintenance Categories	6
6.0	The Rainwater Harvesting System.....	7
7.0	General Maintenance Principles.....	8
8.0	Inspection and Maintenance Frequency of Components.....	9

1.0 Introduction

- 1.1 The report sets out the principles for the long-term management and maintenance of the rainwater harvesting systems at the proposed development.
- 1.2 The purpose of this report is to ensure that the client has a robust inspection and maintenance plan for the lifetime of the development. This will ensure the optimum operation of the rainwater harvesting systems and that they will be continually maintained. This will ensure that the proposed development will remain water neutral.
- 1.3 All those responsible for maintenance shall follow relevant health and safety legislation for all activities listed within this report (including lone working, if relevant). Method statements and risk assessments shall always be undertaken and made available, if requested.
- 1.4 Under Private Water Regulations 2016 the site is classed as a regulation 10 supply, as the water supply is <math><10\text{m}^3</math> per day to a single dwelling.
- 1.5 This report has been produced by Motion to describe the typical management and maintenance tasks that are known at the design stage (such as maintenance frequencies and typical tasks). These have been drawn from industry guidance such as BS EN 16941-1:2018, The SuDS Manual (CIRIA 753) and the manufacturer's own guidance.
- 1.6 Maintenance is considered as a construction activity under the CDM Regulations 2015. Under the CDM Regulations, it is a requirement that a competent person be appointed to carry out a required role. CDM defines a competent person as an individual with sufficient knowledge of the specific tasks to be undertaken, as well as sufficient experience and ability to carry out their duties in relation to the task in a way that secures health and safety on site.
- 1.7 In recognition of the requirements of the CDM Regulations 2015, this rainwater harvesting management and maintenance plan expects that the maintenance work will be carried out by a competent person who must have prior knowledge of the rainwater harvesting systems onsite.

2.0 Treatment

- 2.1 The rainwater harvesting system shall incorporate suitable treatment in accordance with BS EN 16941-1:2018, to ensure that the water quality is suitable for its intended end use.
- 2.2 The potential contaminants are listed below:
- ▶ pH
 - ▶ TOC
 - ▶ Colour
 - ▶ Turbidity
 - ▶ Suspended solids
 - ▶ Conductivity
 - ▶ Cl, No₃, SO₄
 - ▶ Na, Ca, Mg, Al
 - ▶ Ni, Cr, Cu, Pb
 - ▶ Total & Dissolved Fe
 - ▶ Mn
 - ▶ Ammonium/Ammonia
 - ▶ TVC, E.Coli, Coliforms, Pseudomonas aeruginosa, Enterococci, Clostridium Perfringens
- 2.3 The treatment, of the potential contaminants listed above, will cover the following:
- ▶ Removal of coarse particles, upstream of the storage;
 - ▶ Retention of fine particles by sedimentation and flotation in the storage tank; and
 - ▶ Filtration following the storage device, depending on the intended use.
- 2.4 Preliminary treatment will be provided in the form of filters and separators prior to the storage tank. This will include leaf guards on gutters and a leaf filter. A first flush diverter will be included to divert particles contained in rainwater away from the tank and to a suitable drain. These measures will prevent coarse solids and organic matter from entering the storage tank.
- 2.5 Any fine particles will then be separated either by sedimentation by settling out to the bottom of the tank, or flotation to the water surface.
- 2.6 A calmed inlet will be incorporated in the tank to prevent turbation of the sediment at the bottom of the tank by the inflow of water. Removal of the sediment will be carried out in accordance with Table 5.1 below.
- 2.7 Removal of floating particles will occur when the tank overflows, or when it is cleaned out in accordance with Table 5.1 below.
- 2.8 Water will be extracted from the tank via a floating pump, which will extract water from level that is above any sediment collected at the bottom of the tank and below any floating particles. This will help maintain the quality of harvested rainwater that is to be used in the property.

- 2.9 Where the water is being used for laundry, it is understood that the Council require an additional level of treatment. Therefore, it is proposed that a UV filter will be incorporated in advance of the washing machine and this will kill any microorganisms, prior to it being used in the washing machine.
- 2.10 A schematic showing the layout of the equipment used in a rainwater harvesting system is shown in Figure B.2 of BS EN 16941-1:2018.
- 2.11 All component used in the rainwater harvesting system shall be WRAS approved.

3.0 Water Quality Control

- 3.1 It is understood that the system will be considered as a private water supply and, therefore, will be governed by the Private Water Supply Regulations 2016. These are regulated by the local council's Environmental Health Officer or Pollution Control Officer.
- 3.2 The regulations in England and Wales do not require monitoring to be undertaken where the water supply is to a single domestic dwelling, unless the local authority is requested to do so by the owner or occupier of the dwelling, or if they are concerned that the supply presents a potential danger to human health.
- 3.3 NA.1 in BS EN 16941-1:2018 states that frequent testing will not normally be required for rainwater harvesting systems of a single domestic dwelling to ensure the water quality. It states that observations for water quality will be made during maintenance visits and testing will be carried out where the system is not operating satisfactorily. When sampling is required a sample will be taken and carried out in accordance with the guidance set out in NA.1 and Table NA.1 sets out the guideline values for bacteriological monitoring and Table NA.2 for non-bacteriological monitoring.
- 3.4 The Drinking Water Inspectorates (DWI's) guidance and regulations on Private Water Supplies recommends that for all water supplies of <math><10\text{m}^3</math> per day that supplies water to more than one domestic dwelling must be monitored for five specific parameters once every five years. These parameters include: conductivity; Enterococci; E. coli; pH; and turbidity. The local authority can increase the frequency of sampling, and monitor other parameters, if they deem it to be necessary.
- 3.5 The guidance states that the sampling must be undertaken by an accredited sampler. These samplers must be certified by companies that are accredited to ISO 17024. Analysis must be carried out at a laboratory that is accredited to the ISO 17025 Drinking Water Testing Specification.
- 3.6 The water quality will need to be maintained at a suitable level commensurate with the end use and the treated water quality will have to meet those set out in the Private Water Supply Regulations.
- 3.7 The British Standard and DWI guidance, does not require water quality testing for systems serving one domestic unit. However, HDC has requested that testing is carried out in accordance with the standards set in paragraphs 3.4 and 3.5 above.

4.0 Continuity of Supply

- 4.1 To ensure that sufficient water is available for re-use, the storage tank will be sized so that it can provide 35 days of storage, which will provide sufficient supply during periods of drought.
- 4.2 Where drought periods extend beyond 35 days, the rainwater harvesting system will include an automatic mains backup. This will ensure that water is available at all times, even during extended periods of drought.

5.0 Maintenance Categories

5.1 There are three categories of maintenance activities referred to in this report. These are:

Inspection and Monitoring

- ▶ Inspection and monitoring tasks shall be carried out frequently, nominally once a month, and will include a visual inspection of all components including all inlets and outlets.

Regular Maintenance (Monthly)

- ▶ Regular maintenance consists of basic tasks done on a frequent and predictable schedule.

Seasonal Maintenance (Quarterly)

- ▶ Seasonal maintenance comprises tasks that are likely to be required periodically, but on a much less frequent and predictable basis than the routine tasks.

Remedial Maintenance

- ▶ Remedial maintenance comprises of intermittent tasks that may be required to rectify faults associated with the system that have been identified through visual inspections. The likelihood of faults can be minimised by correct installation, regular inspection and timely maintenance.

6.0 The Rainwater Harvesting System

- 6.1 The proposed rainwater harvesting system will receive rainwater passing through and over several structures and will store rainwater within several items of infrastructure. These include:
- ▶ Roofs
 - ▶ Gutters
 - ▶ Filters;
 - ▶ Pumps;
 - ▶ Overflows; and
 - ▶ Storage tanks.
- 6.2 All components shall be installed in accordance with the manufacturer's instructions and to the levels/arrangements as defined on the designer's drawings.
- 6.3 This report shall be read in conjunction with the rainwater harvesting design, so that the location and type of each item of infrastructure can be recognised and understood.
- 6.4 Manufacturer's instructions are to be added to this document once specific products have been selected and installed as part of the detailed design. This document will subsequently form the basis for a maintenance regime for the rainwater harvesting system.

7.0 General Maintenance Principles

- 7.1 All rainwater harvesting systems require regular maintenance to keep them working at optimum efficiency and capacity. The maintenance of the rainwater harvesting systems shall be carried out alongside other regular maintenance tasks within the property.
- 7.2 Timely and adequate maintenance will increase the lifespan of the rainwater harvesting system. Inadequate maintenance will do the reverse.
- 7.3 The property owners are responsible for the monitoring and maintenance of the rainwater harvesting system for the lifetime of the development.

8.0 Inspection and Maintenance Frequency of Components

- 8.1 Table 8.1 below lists each of the components used within the development’s rainwater harvesting systems. It suggests an indicative maintenance frequency for each component and ascribes typical maintenance tasks to them.
- 8.2 In accordance with the DWI’s Private Water Supply regulations, it is the responsibility of the homeowner to ensure that all necessary maintenance activities are carried out in a timely manner and that the design performance of each drainage component is preserved. The homeowner may appoint a competent contractor to assist with the maintenance of their rainwater harvesting system. Additionally, the Council has a role to ensure the regulations are upheld by the homeowner.
- 8.3 If there is any uncertainty regarding the correct and safe methods of cleaning, or what equipment will be used, the manufacturer should be consulted.

Maintenance Schedule	Required Action	Frequency
Regular Maintenance	Inspection of the tank for debris and sediment build-up	Annually
	Inspection of inlets/outlets and withdrawal devices	Annually
	Inspection of filters	Annually
	Inspection of Pumps	Annually
	Inspection of overflow areas	Annually
	Inspection of gutters	Annually
	Cleaning of tank	Annually
	Cleaning of inlets and outlets and withdrawal devices	Annually
	Cleaning of gutters and roof drain filters	Annually
	Check pump operation	Annually
Occasional Maintenance	Cleaning and/or replacement of any filters	Quarterly
	Sampling of water supply	Every five years
Remedial Actions	Repair of overflow erosion damage or damage to tank	As required
	Pump repairs	As required

Table 8.1 – Maintenance tasks and frequencies

- 8.4 Upon completion of maintenance activities, a record will be kept of the work carried out. This will be retained and an annual maintenance report will be compiled, which shall include the following:
- ▶ Observations resulting from inspections;
 - ▶ Maintenance and operation activities undertaken during the year; and

- ▶ Recommendations for inspections and maintenance programmes for the following year.

8.5 On the next page is a table with suggested information that will be recorded and included with the maintenance plan. As mentioned in the introduction to this document, this shall be a living document and regularly updated, as required and will be kept for the lifetime of the development.

Date	Component requiring maintenance	Issues prompting maintenance	Scheduled maintenance (Y/N)	Maintenance carried out	Additional works required (Y/N). If yes, please detail	Next scheduled date of inspection and maintenance

Appendix J

Rainwater Harvesting UV Filter Specification



Quotation for the supply of Rainwater Harvesting Equipment

Client :

Neil Jaques

Prepared by:

Ian Woodcock

ianw@rainwaterharvesting.co.uk

01733 405104 / 07736 45 46 45

Our reference : IMW223452

Date of proposal : 04/04/2025



Your Proposal

Thank you for your time on the telephone just now and as requested please find the following information regarding our proposed system.

SHALLOW DIG F-LINE TANK

	3000
Weight Kg	170
Length	2400
Width	2400
Overall Height	1015 - 1415
Ground to Invert VS60 (Pedestrian 635mm Shaft)	320 - 720
Invert to Outlet	162

EXCAVATION

Length	2800
Width	2800
Overall height VS60	1115 - 1515

Overall height allows for 100mm compacted aggregate

The overall height difference above is because up to 400 mm can be cut off of the 635 mm shaft on site so as to achieve your exact invert level.

The system below has been upgraded with a UV filter

Rainwater Harvesting Limited is a private family owned company, our strong service ethos has been built on many years of experience and this is reflected in our ability to offer both simple to install rainwater harvesting systems and mix and match components to provide bespoke solutions reflecting clients needs. At our 100,000sq ft warehouse in Peterborough we hold over 3000 stock items, we are the largest stockholder of the Shallow Dig Rewatec tanks in the UK and we regularly despatch to site complete rainwater harvesting systems within 5-7days of order.

Generally a rainwater harvesting system is simple in concept however the differences in design and performance vary greatly from supplier to supplier, the fact that we manufacture as well as supply enables us to help you specify the right system for your project at an aggressive price, we also provide full technical support on all our products.


We would welcome the opportunity of supplying your rainwater harvesting system and I can easily be contacted either by phone or email as shown on the previous page



Components and Prices – Supply Only

Product Code : **RWH-3099FL-DUK2.**

3000 Litre Shallow Dig Direct Feed System

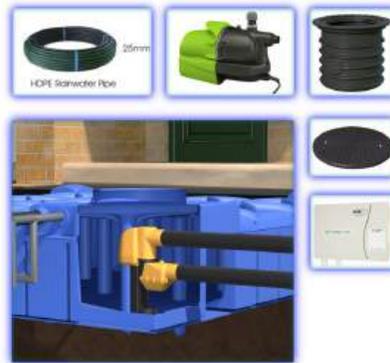

Components

Product Code	Description	Qty
RWFT3000	F-LINE 3000L TANK	1
RWDS0062	F-LINE TANK 635mm EXTENSION SHAFT - VS60	1
RWDS0066	F-LINE TANK WALK ON LID	1
RWH-RV01	RAINVANTAGE FILTER KIT INC SIPHON & OVERFLOW	1
RWH-HYD04	HYDROFORCE SERIES 4 PUMP / INC STRAINER	1
RWH-HDPE25/25	25mm HDPE RAINWATER PIPE - 25m ROLL	1
RWH-BUB03	RAIN BACKUP IN A BOX / SD	1
RWH-PKFLINE-STD	FLINE INSTALLATION PACK STANDARD / INC LABELS & 90° ELBOW	1
UV-DS55	UV FILTER - 36 LTR/MIN 1 X 55W LAMP c/w PRE FILTER	1

Price : £2,695.00 (£3,234.00 Inc. VAT)

UK delivery is included in the price (Highlands and islands extra)



Mains backup and rainwater management






Direct feed with simple, 12v automatic float switch & solenoid valve for mains water backup

Most often used on a direct feed system, the automatic electrically-actuated solenoid valve (or tap) admits some mains water into the rainwater storage tank as a simple means of maintaining water flow to toilets and washing machine fed by a rainwater harvesting system. This method is sometimes referred to as a trickle-feed mains backup.

- a) Filtered rainwater flows as normal to the tank
- b) The home is plumbed with a separate pipe network for toilets and washing machine.
- c) When there is rainwater in the tank the pump supplies rain water to the toilets and washing machine. The principle is the same whether the pump is indoors or submerged in the tank.
- d) The pump is a pressure sensitive type or fitted with a pressure-sensitive switch which turns off when water is not being used in the house.
- e) When the tank is nearly empty a float switch turns ON a mains-powered solenoid valve which allows some mains water to flow into the rainwater tank.
- f) The provision of a “Air Gap” is a regulation requirement. This i) provides a visible warning of water flow if the valve sticks open and ii) prevents any possibility of rain water flowing into the mains (drinking) water. After a few moments the floating switch turns the solenoid valve OFF.
- g) Although this simple mains backup can be criticised by some for admitting mains water back into the rainwater tank, it should be pointed out that the tank remains largely empty and can receive new rain water from a downpour at any time.
- h) This is sometimes referred to as “trickle feed” because the tank does not get filled up with water; the level is simply lifted to the level (about 10 cms) where the inlet of the pump can draw water when next called upon.
- i) There is no risk of rainwater being drawn into the mains water supply so there is no risk of breaching building regulations in this respect.
- j) To ease the installation of a variety of components and rather complex wiring, RainWaterHarvesting.co.uk introduced in early 2009 the Rain Backup in a Box® which replaced the higgly piggle of components with a single wall mounted unit, one 12v electric plug to a wall socket, mains water input and a pipe to the underground storage tank. This is supplied as a default with “standard” DUK-2 kits.



3000L F-Line

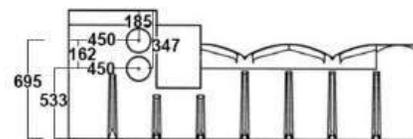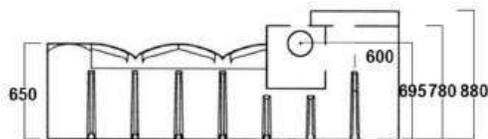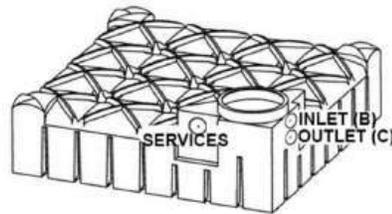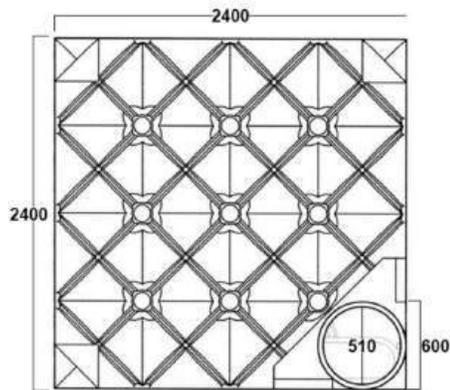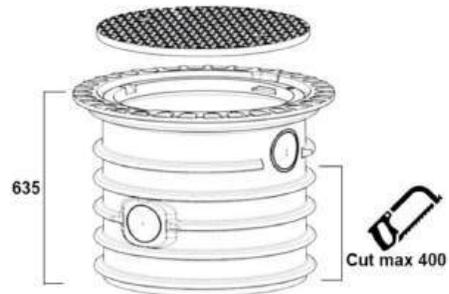



The **Series 4** water pump
from HydroForce Pumps Ltd.




The Series 4 pump has been engineered by HydroForce Pumps Ltd in Peterborough to respond to the demand for the highest quality pump for use underwater in rainwater harvesting tanks. Using the most rugged components it has been exhaustively tested for trouble-free running. The pump features a self-controlling pressure switch and dry run protection. It is suitable for total immersion in rainwater or it can be externally connected to the tank above ground. The Series 4 will

deliver up to 3.5 bar (household pressure is around 2.5-4.0 bar). If connected to a hose or tap, the pump will automatically start to pump water when the tap or hose is turned on. The pump delivers over 2500 litres per hour using a 1" connector and runs at 230v AC delivered by a 5 metre cable.

Specifications

- Submersible: for underwater use in a rainwater tank, or can be used above ground
- Extended two year guarantee
- Nominal pump pressure at outlet 3.5 bar
- Max head 35 metres
- Pressure-sensitive (demand) pump: turns itself off until there is demand for water
- Dry-run Protection: when no water is detected for 8 seconds, the pump is turned off in order to protect the motor and pump from burning out. Automatic reset after a period of 30 minutes.
- Radial flow centrifugal roto-dynamic pump with no reciprocating parts
- **New:** Alloy bulkhead, pressure release gap and twin chamber design prevents ingress of water to motor, electrical components and to bearing oil.
- **New:** Double bearing seal prevents egress of bearing oil.
- **New:** Alloy bulkhead dissipates motor heat to water in the second chamber.
- **New:** Logic processors in Series 4 printed circuit board prevent other pump anomalies and permit factory programming of reset timings.
- **New:** Each pump is tested before leaving our factory. Factory measurements are on record for each individual pump. No user-serviceable parts
- Electricity consumption 800 watts at 230 Volts AC 50 Hz (requires 10 or 13 amp fuse and RCD mains socket). Connection cable 10m H07RN-F.
- Dimensions L 565 W 185 H 260 mm, weight 12 kg
- Max suction 8 metres deep, preferable operating regime 4 metres deep
- Inlet port to the non-removable cartridge filter 1 inch (25mm) female BSP
- Outlet port 1 inch (25mm) female BSP provided with push-fit connector for 1 inch (25mm) MDPE pipe.
- Supplied with an inline filter, 1" intake strainer and 1" outlet connection.

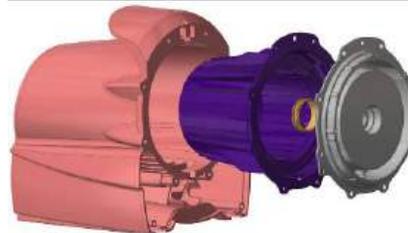

Italian styling
British engineering
British manufacture



Recommended Rainwater Pipe

Rainwater Pipe in HDPE (High Density Polyethylene) for rainwater use as recommended by Water Authorities is available as an option for all tanks and systems. Black with 4 green stripes and available in both 25mm and 32mm diameter. High quality HDPE.

RainWater Harvesting Limited has worked with the UK Rainwater Harvesting Association and listened to WRAS and several of the water companies, to bring to the market the pipe marked with four green stripes. The identification helps maintenance staff and the end user, after installation, to know which pipes on site carry rainwater (which is non-potable in the UK Building Regs). We stock the following two sizes preferred by contractors fitting rainwater systems.



25mm diameter,
flexible, in 25 or 50m coils
Product ID: RWH-HDPE25/25

Ship weight of one 25m coil: 4.3 kg



32mm diameter,
flexible, in 25 or 50m coils
Product ID: RWH-HDPE32/25

Ship weight of one 25m coil: 5.5 kg

Other sizes available upon request





Upgrade your system for
£179.00 ex VAT

Backup in a Box with built in wireless level sensor



The Rain Backup in a Box *PLUS* works in the same way as the standard Backup in a Box but comes with the following added benefits :

- Wireless sensor so there are no cables to run from the control unit back to the underground tank
- Built in level sensor so you can see your current water level either on the control unit or via a web browser.
- You can set your own level for when you want the mains water to enter the tank without having to go into the tank.

The Rain Acculevel will accurately measure the water level in your rainwater tank giving readings that you can view on a PC, smart device or the control unit. Using the latest wireless technology, it works on tanks below or above ground and over long distances.

Once placed in your water tank the Rain Acculevel sends signals to a the control unit. The control unit sends the data via your home hub to your own on-line account at tanklevels.co.uk The Acculevel is powered by a long life battery (up to five years)..

The Acculevel will work anywhere as long as the control unit is within signal distance of your a home hub (or router).





F-Line Flat Tank shallow dig underground tank



Why buy this tank?

- The F-Line is a high quality, rotationally moulded, one piece rainwater tank that can be installed without the need for concrete, thereby minimising installation costs and supported by our long term 25 year tank guarantee.
- Minimal installation depth
- Easy and quick to install
- Small excavation pit and little earth excavation preserves your garden
- Ideal for installation in new or existing properties
- Can be installed in ground water up to tank shoulder
- Easy to install

The F-line flat tank can be installed into much higher water tables than a standard round tank. If you don't know what your water table will be like in the winter, you're safer to install a flat tank. The F-Line tanks are flat and the installation depth is up to 60% less than other rainwater tanks. The excavation can be up to 70% less, meaning little earth excavation, easy handling and less cost for you! The small excavation pit is easily filled in and your garden will look just like it did before.



model shown
UV-DS55 with 3/4" BSP offset ports



Flow rate	36 lpm
Unit wattage	55 w
Lamps	1 x 55 w
Quartz sleeve	1
Inlet/outlet port size	3/4" BSP
Length	36" (92cm)
Unit Width	3 1/2" (9cm)
Height	5" (13cm)
Chamber diameter	3 1/2" (9cm)
Shipping weight	8 kg
Casing stainless steel	316
Voltage	220/240 v
Max operating pressure	100 psi

- available with offset or parallel ports
- spray baked electrical control box
- available on polypropylene backboard

Silverline UK Limited
Whitemoor
Iddesleigh, Winkleigh
Devon EX19 8BN

Tel: +44 (0)1805 804202
enquiries@silverlineuk.co.uk
www.silverlineuk.co.uk

Dimensions are approximate. Specifications may be subject to modification without notice.

Appendix K

South Lodge Hotel Offsetting Report

**WATER OFFSETTING SCHEME AT THE SOUTH LODGE HOTEL
FOR THE LAND ON THE KNOWN AS PUCKS CROFT COTTAGE, HORSHAM ROAD,
RUSPER RH12 4PR (BPH CONSTRUCTION LTD)**

This statement has been prepared by Nicholls Countryside Construction Ltd who are providing a water offsetting scheme at The South Lodge Hotel, Brighton Road, Lower Beeding, Horsham RH13 6PS (“The Site”). The statement forms part of the Developer’s Water Neutrality Statement and sets out the offsetting measures proposed in that statement. It provides the following details.

1. List of scheme participants at date of publication.
2. Description of the Site, actual meter readings and an assessment of existing consumption
3. Proposed offsetting scheme at the Site.
4. Hydrologist’s assessment of the hydrogeology, impact on the protected areas, borehole design, yield, sustainability and water quality.
5. Implementation specifications, maintenance regime and water quality assurance.

This report replaces all previously issued reports.

DEVELOPER WATER CREDIT ALLOCATION

BPH Construction Equipment Ltd (“The Developer”) is participating in the scheme alongside other developers and has been allocated 586 credits in the scheme based on their offsetting requirement for this application and or others. The water offsetting requirement for each application is set out in the relevant Water Neutrality Statement. One credit is equivalent to offsetting 1 litre of water per day. The table below lists the developers currently participating in this scheme and their allocation together with any planning reference to which the credits have been applied.

Developer	Planning Reference if Available	Credits
Croudace Homes Ltd	HDC - DC/21/0749	14,086
Garrison Properties (Southern) Ltd	HDC - DC/24/1413	216
Cygnature Homes Ltd	HDC - TBA	159
Michael Casey	HDC - DC/24/1409	315
David & Elizabeth King	HDC - TBA	254
Plaxtol Investments Ltd	HDC - DC/23/1685	328
Mr A & Mrs K Walls and Scorpio Property Ltd (Plot 1B)	HDC - DC/22/1594	246
Mr A & Mrs K Walls and Scorpio Property Ltd (Plot 5B)	HDC - DC/22/1711	228
Mr Chris Hayhoe	HDC - DC/24/0104	107
Cullum Capital Investments LLP	HDC - DC/24/0535	706
Philip and Eleanor Morris	HDC - DC/24/0489	186
William and Anita Eastwood	HDC - DC/23/1485	215
Adam Heslop and Susan Heslop	HDC - DC/24/0218	82
BPH Construction Equipment Ltd	HDC - TBA	586
	TOTAL CREDITS IN SCHEME	19,999
	TOTAL CURRENTLY ALLOCATED	17,714
	REMAINING CREDITS (CURRENT SURPLUS)	2,285

OVERVIEW OF OFFSETTING PROPOSAL

The Site has an average daily water consumption in excess of 52m³/day and potentially over 70m³/day. The latter amount is still being assessed as discussed later in the document. Two boreholes have been drilled and yield tested and the supply aquifer is not connected to Hardham.

An EA licence is currently being applied for which, once approved, will allow the whole Site to be removed from the mains supply. The EA application process will take some time and in the meantime one of the boreholes will be used to supply an unlicensed supply (licence not required) of just under 20 m³/day to the Site and remove 19.999 m³/day from the mains supply making it available to offset demand for future housing development. This is Stage 1 of the offsetting scheme.

Stage 1 will provide all of the infrastructure for it and Stage 2 (the full offsetting scheme). Stage 1 will only turn on the supply to the Main Hotel Area, however all the necessary pipework will be laid to turn on the other Areas as soon as Stage 2 can be brought online.

This offsetting scheme described in this report has been **assessed by Natural England and approved under application DC/21/0749** (See Appendix J). Sufficient water credits have been sold to cover the cost of both stages.

OFFSETTING SITE DESCRIPTION

Existing Supply & Consumption

The Site is a luxury hotel and spa with water currently supplied from three existing mains supplies. There are two further metered supplies which are no longer in use. The hotel is located within the Sussex North Water Resource Zone (see location map in Appendix A) and all three supplies are metered mains supplies. Details of each supply points are provided in the table below.

Meter Number	Area Supplied	Usage litres/day
11M50090	Main Hotel Area	46.3
17MS000318	Spa Area	7.4
11AC001166	Gatehouse Area	2
TOTAL		52,674

Actual meter readings were taken over a 12 month period within the last 3 years and these are detailed below with evidence of the meter readings provided in Appendix B.

Existing Water Consumption – Main Hotel Area		m ³
Meter Number 11M50090		
	Actual Reading 22/08/2022	163,810
	Actual Reading 16/08/2023	179,340
	Number of days between readings	359
	Consumption in Period	15,530
	Average daily consumption	43.259

Existing Water Consumption – The Spa Area

m3

Meter Number 17MS000318

Actual Reading 22/08/2022	5,920
Actual Reading 16/08/2023	8,572
Number of days between readings	359
Consumption in Period	2,652
Average daily consumption	7.387

Existing Water Consumption – Gatehouse Area

m3

Meter Number 11AC001166

Actual Reading 13/06/2022	9,184
Actual Reading 16/08/2023	10,054
Number of days between readings	429
Consumption in Period	870
Average daily consumption	2.028

TOTAL Average Daily Consumption (all three supplies)

52.674

52.674 m3 per day equals 52,674 litres/day and converts to 52,674 water credits of which 19,999 are being made available through Stage 1.

The date range used above has been selected as prior to it the hotel was still recovering from Covid. Indeed water consumption for the Spa Area only appears to have begun to return to normal levels in the last two months of the period used. The table below shows readings for a more extended period from 13/09/2021 to 16/08/2023.

MAIN HOTTEL AREA				SPA AREA				GATEHOUSE AREA			
Date	Reading	Days	L/d	Date	Reading	Days	L/d	Date	Reading	Days	L/d
13/09/2021	149008	-	-	13/09/2021	5835	-	-	13/09/2021	8717	-	-
06/12/2021	153264	84	50.67	06/12/2021	5840	84	0.06	06/12/2021	8830	84	1.35
27/01/2022	155326	52	39.65	27/01/2022	5857	52	0.33	27/01/2022	8893	52	1.21
23/02/2022	156404	27	39.93	23/02/2022	5870	27	0.48	23/02/2022	8927	27	1.26
27/05/2022	160068	93	39.40	27/05/2022	5903	93	0.35	28/04/2022	9015	64	1.38
13/06/2022	160771	17	41.35	13/06/2022	5908	17	0.29	13/06/2022	9184	46	3.67
28/07/2022	162653	45	41.82	22/08/2022	5920	70	0.17	26/07/2022	9314	43	3.02
22/08/2022	163810	25	46.28	29/11/2022	5951	99	0.31	22/08/2022	9457	27	5.30
21/09/2022	165540	30	57.67	17/02/2023	5977	80	0.33	21/09/2022	9507	30	1.67
10/10/2022	166870	19	70.00	07/06/2023	6326	110	3.17	10/10/2022	9538	19	1.63
17/02/2023	171686	130	37.05	25/07/2023	7884	48	32.46	29/11/2022	9617	50	1.58
07/06/2023	176323	110	42.15	16/08/2023	8572	22	31.27	17/02/2023	9739	80	1.53
25/07/2023	178378	48	42.81					07/06/2023	9930	110	1.74
16/08/2023	179340	22	43.73					25/07/2023	10020	48	1.88
								16/08/2023	10054	22	1.55
Average daily in period for Area			43.21	Average daily in period for Area			3.90	Average daily in period for Area			1.90
AVERAGE DAILY TOTAL IN PERIOD											49.01

The average daily total for this extended period is consistent with the 12 month period selected to provide the current estimate of 52.674m3. The uptick in the Spa's usage during July and August 2023 will be monitored until a full 12 months of normal post Covid usage has been observed. The latest 3 month bills available for February to April show an average daily consumption across all Areas of over 70 m3/day which indicates that the increase has continued.

At this stage the offsetting requirement is for 19.999 m3/day which is well within the extended and latest usage data. The figure of 52.674 m3/day would appear very conservative based on the latest usage data. Actual meter readings are provided in Appendix B for the period in which the 52.674

m³/day was measured as well as the actual readings from 13/09/2021 the beginning of the extended period. Further meter readings are available on request.

When Stage 2 is brought online and once the EA licence has been approved the, it's anticipated that 52.674 m³/day will be increased and appropriate supporting evidence provided at that time. This is not required for this application which is based on offsetting just 19.999 m³/day.

It is important that the maximum level of consumption is understood so that the maximum amount of water can be removed from the mains supply and therefore decrease demand at Hardham. Should water use drop at the Site in the future then this still represents the same reduction in the mains supply, it just means that the private water supply is providing less water to the Site at that time.

Breakdown of Water Use by Area

The Main Hotel Area supply provides water for the following main consumers:

- Staff and guest toilet and washing facilities
- Cleaning and laundry
- Kitchens and bars
- Garden irrigation

The Spa Area supply provides water for the following main consumers:

- Staff and guest toilet and washing facilities
- Cleaning
- Pools and spas
- Kitchen
- Garden irrigation

The Gatehouse Area supply provides water for the following main consumers:

- Staff toilet and washing facilities
- Cleaning and laundry
- Kitchens
- Garden irrigation

Description of Boreholes

Two boreholes (BH) were drilled at the Site between the 11th and 22nd April 2024, both to 62 m depth and into the Upper Tunbridge Wells Sand Formation. The BH's locations are shown in Figure 1 and their respective drill logs are provided in Appendix C. they are labelled BH1 and BH2 for the purposes of this report and to be consistent with the hydrologist's report in Appendix E.

An initial test pump of BH1 was undertaken on 18th April 2024 (see Appendix D) and a maximum flow rate of 71 l/minute was achieved with a starting depth of 22.09m and a finishing depth of 25.95m. The flow rate is equivalent to 102 m³/day.

Assessment of Impact on Protected Areas

A senior hydrologist (Stephen Buss) examined whether the BH's could have an adverse effect on the integrity of Arun Valley Special Protection Area (SPA), Special Area of Conservation (SAC) and Ramsar site is provided in Appendix E. The impact statement in his report clearly shows there would be no adverse impact, stating:

"The site is in the catchment of the Cowfold Stream, which flows southwards to join the River Adur (Figure 2). The site is therefore not in the catchment of the River Arun, which at its closest is about 1.7 km north of the boreholes. The net impact of the proposed abstraction on the

water balance of the River Arun catchment is therefore zero, and the potential impact on the Arun Valley SAC, SPA and Ramsar site is also therefore zero.

Bedrock geology is the Upper Tunbridge Wells Sand, and so the abstraction does not have continuity with the Lower Greensand aquifer of the Arun Valley.”

Water Quality

Water quality is deemed treatable for the purposes of potable water and is discussed in detail in the Water Quality later in this report.

Borehole Yield and Sustainability Assessment

To assess sustainable yield BH1 was tested between 7 May 2024 and 9 May 2024 at an average rate of 20.8 m³/day. An EA licence has been applied for but at this stage BH1 has only been tested for an unlicensed supply which is why it was tested at this rate which is slightly above the maximum abstraction rate for an unlicensed supply (<20m³). Details and analysis of this test are documented in the senior hydrologist’s report which is provided in Appendix E. The report provides the following conclusion.

“This note reviews the results of a pumping test at the borehole BH1 at South Lodge Hotel. The borehole was pumped over two days. The aquifer response is that of a confined aquifer. Seasonal variation has been considered and the likely drawdown after 60 years of operation has been estimated.

Given conservative assumptions about aquifer properties, there is no indication that the borehole does not offer a sustainable and safe source of at least 20 m³/day groundwater in perpetuity.”

At this stage BH2 has not been yield tested as it is not required for Stage 1. Testing of this BH will take place during the EA abstraction licence application process. It is not needed to provide the 19.999 m³/day for the Stage 1 of the offsetting scheme.

Existing Supply Network

Figure 1 below shows the existing supply network. The mains supplies are connected to the local supplier’s distribution network in Brighton Road. A existing header tanks for the Main Hotel Area and Spa Area together with distribution pumps ensure a consistent supply to these areas. The Gatehouse is a direct feed from the mains network.

Proposed Offsetting Scheme

BH1 and BH2 are not currently connected to the distribution network within the Site and are not currently filtered or treated. BH1 has a proven supply on an unlicensed basis of 20 m³/day without any effect on the protected sites.

The existing mains supplies provide an average of at least 52.674 m³/day. Stage 1 of the offsetting scheme will provide 19.999 m³/day for potable use within the main Hotel Area. This will reduce demand in the SNWRZ by 19.999 m³/day and allow that amount to be used to offset the future demands of new development. This will be facilitated through the Nicholls water credit scheme.

An EA abstraction licence application is currently in process and at the point that that is awarded Stage 2 of the offsetting scheme will be realised and the remaining demand of at least 32.675 m³/day will be provided by BH1 and BH2 working alternatively. At this stage all three areas of the hotel removed from the mains supply for up to that amount of daily water use. The plant and filtration equipment required to implement the initial 19.999 m³/day scheme will be suitable to provide the full Stage 2 system.

Stage 1 of the offsetting scheme will connect BH1 to a new treatment plant designed to provide a potable supply. This will be connected to the main Hotel Area supply via a new potable water storage tank. Figure 2 shows how the scheme will be laid out. The work will include:

1. Removing the existing storage tank and redundant structures.
2. Installation of appropriate potable water aeration & storage tanks, pumps, filtration, and treatment systems in a self-contained ISO container (see specification at Appendix F)
3. Water treatment design and quality testing to WHO standards and/or the standards set by the local authority's Environmental Health Officer (EHO)
4. Environmental Health Officer (EHO) sign-off and approval
5. Connection of the treated water supply from the new storage tank to the main Hotel Area supply using the existing distribution pipe (see Figure 2)
6. A telematics system will be installed to remotely monitor the borehole and record the amount of water supplied 24/7.

A batch meter will ensure that BH1 is not abstracting more than the limit for an unlicensed supply (<20 m³/day). The mains supply will continue to provide water to the main Hotel area for demand above 19.999 m³/day. This will be facilitated via an air separated feed (to comply with water regulations and ensure no water is fed back into the mains supply network) into the new storage tank. The mains supply will only switch on when the tank level drops below a certain level which will occur when the daily 19.999 m³ BH1 supply has been provided and switched off by the batch meter.

Ongoing Maintenance

Once the works are completed an annual maintenance programme will be set in place to ensure the offsetting measures are kept fully operational and the quality of the potable water supply continues to meet WHO standards and/or the standards set by the local authority's Environmental Health Officer (EHO). This will include periodic testing as specified by the EHO. The maintenance programme is set out in the section below and will be undertaken by Nicholls Boreholes Servicing Team under annual contract to the Site.



Produced on May 24, 2024.
© Crown copyright and database right 2024 (licence number 100059532)





Figure 1 – Existing Supply Network (pipe runs are indicative)

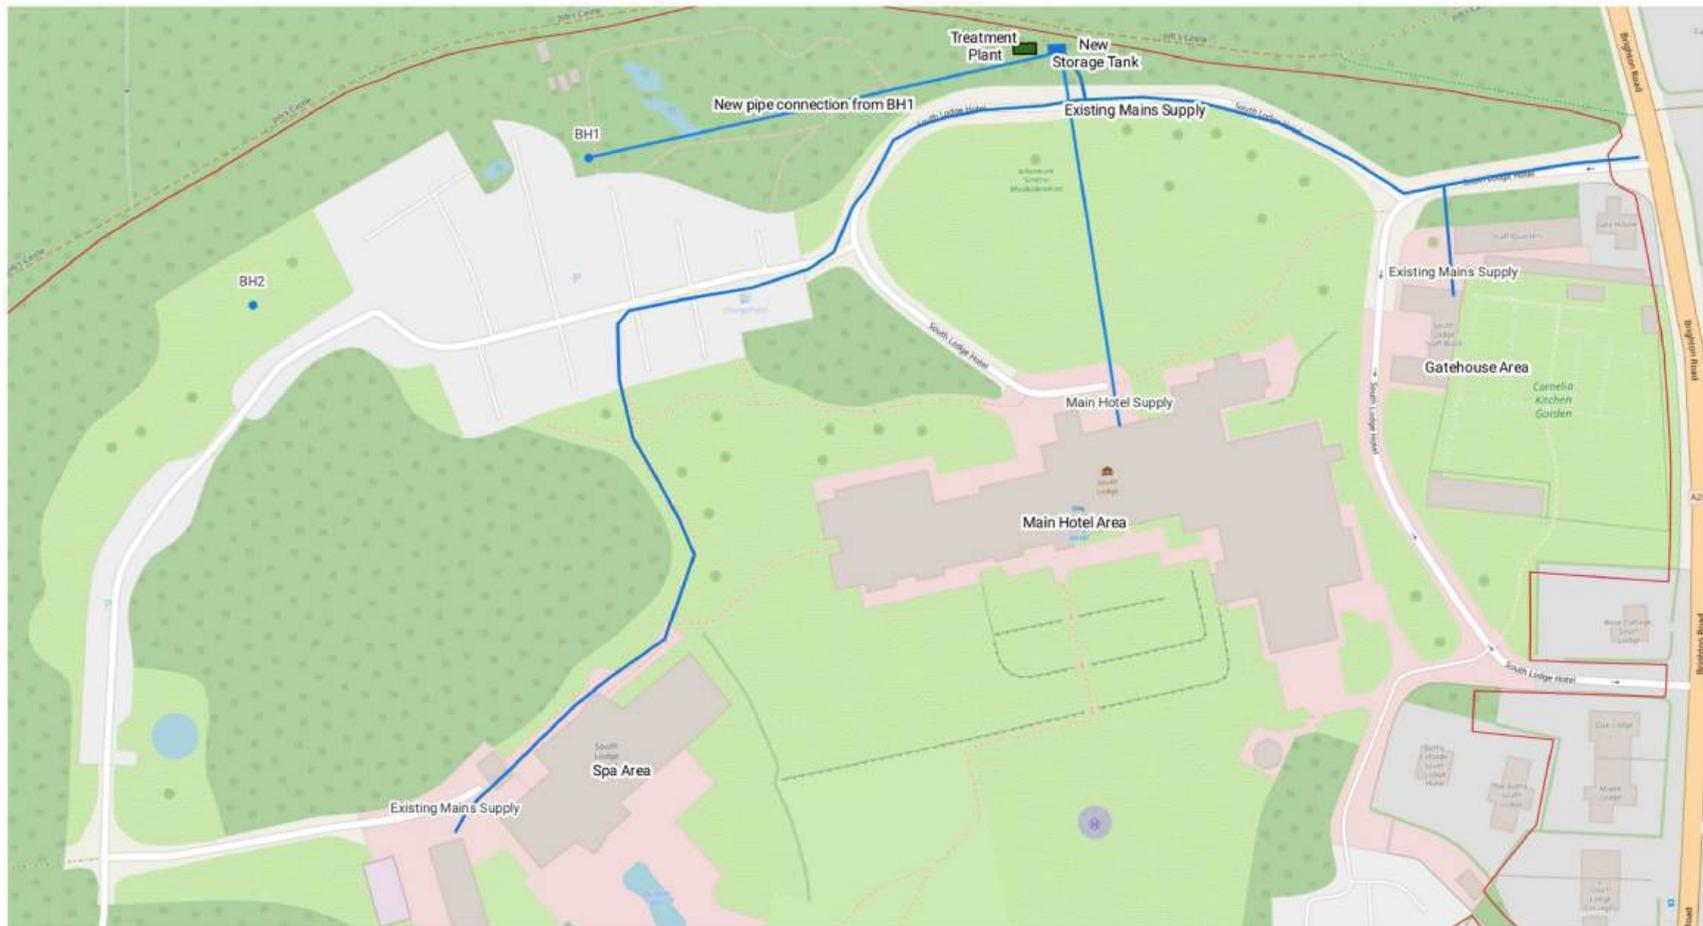

Produced on May 24, 2024.
© Crown copyright and database right 2024 (licence number 100059532)




Figure 2 – Proposed Supply Network (pipe runs are indicative)

Water Quality

Appendix I - Groundwater Investigation Report provides a detailed assessment of the groundwater quality and proposed treatment. In addition to that report the physical features to be installed to protect the borehole from contamination are set out below.

The borehole will include the following protection measures.

- 2 external locks – to prevent unauthorised access.
- Twin skin GRP enclosure – to prevent changes in temperature and seal the area directly around the borehole to prevent ingress from the surface.
- Raised Plinth – to prevent external contaminants or surface flows entering the borehole.
- Bolt Down Well Head – to prevent unauthorised access and secure the borehole from the ingress of external contaminants.
- Grouting – to prevent ingress of surface flows or contaminants from the surface and any made up ground.
- Linings – to prevent ingress from geologies not targeted by design.

Ongoing Maintenance

A telemetric system will be installed which will allow the system to be remotely monitored by the Nicholl's servicing team 24/7 using an active alert system. Ongoing maintenance and water quality assurance routines are set out in Appendices G and I. Water quality will be sampled at a minimum on a biannual basis and should the EHO require a more frequent testing regime this will be implemented.

Further details regarding the water quality assurance and testing regime are set out in Appendix I - Groundwater Investigation Report.

Implementation of Measures, Planning Consents & Section 106 Agreements

The measures will be implemented and maintained at the borehole location under The South Lodge Hotel title (WSX331265) and appropriate s106 obligations should be tied to this land. A red edge plan will be provided on request. Separate planning obligations agreements will be entered into with each developer. Suggested s106 obligations on the Site owner and developer are provided in Appendix H.

Sufficient credits have been sold at time of publication with signed contracts in place to provide for the cost of implementing the measures and securing the ongoing maintenance.

The plant treatment room will be housed in a purpose-built ISO container as set out above. This does not require planning permission as it is a temporary structure. Notwithstanding that, it is being installed on an existing concrete hardstanding replacing existing structures.


Summary

The proposed offsetting scheme is based at a site in the Sussex North Water Supply Zone with a proven average consumption of at least 52.674 m³/day per day derived from the mains supplies. Stage 1 of the offsetting scheme will remove 19.999 m³/day from the mains demand with the remainder being removed when Stage 2 is brought online.


The scheme utilises an existing borehole with a proven yield that is in excess of 20 m³ per day and this has been assessed as having no effect on the protected areas.

The proposed offsetting scheme has been approved by Natural England under HDC application number DC/21/0749 (see Appendix J).

SITE LOCATION

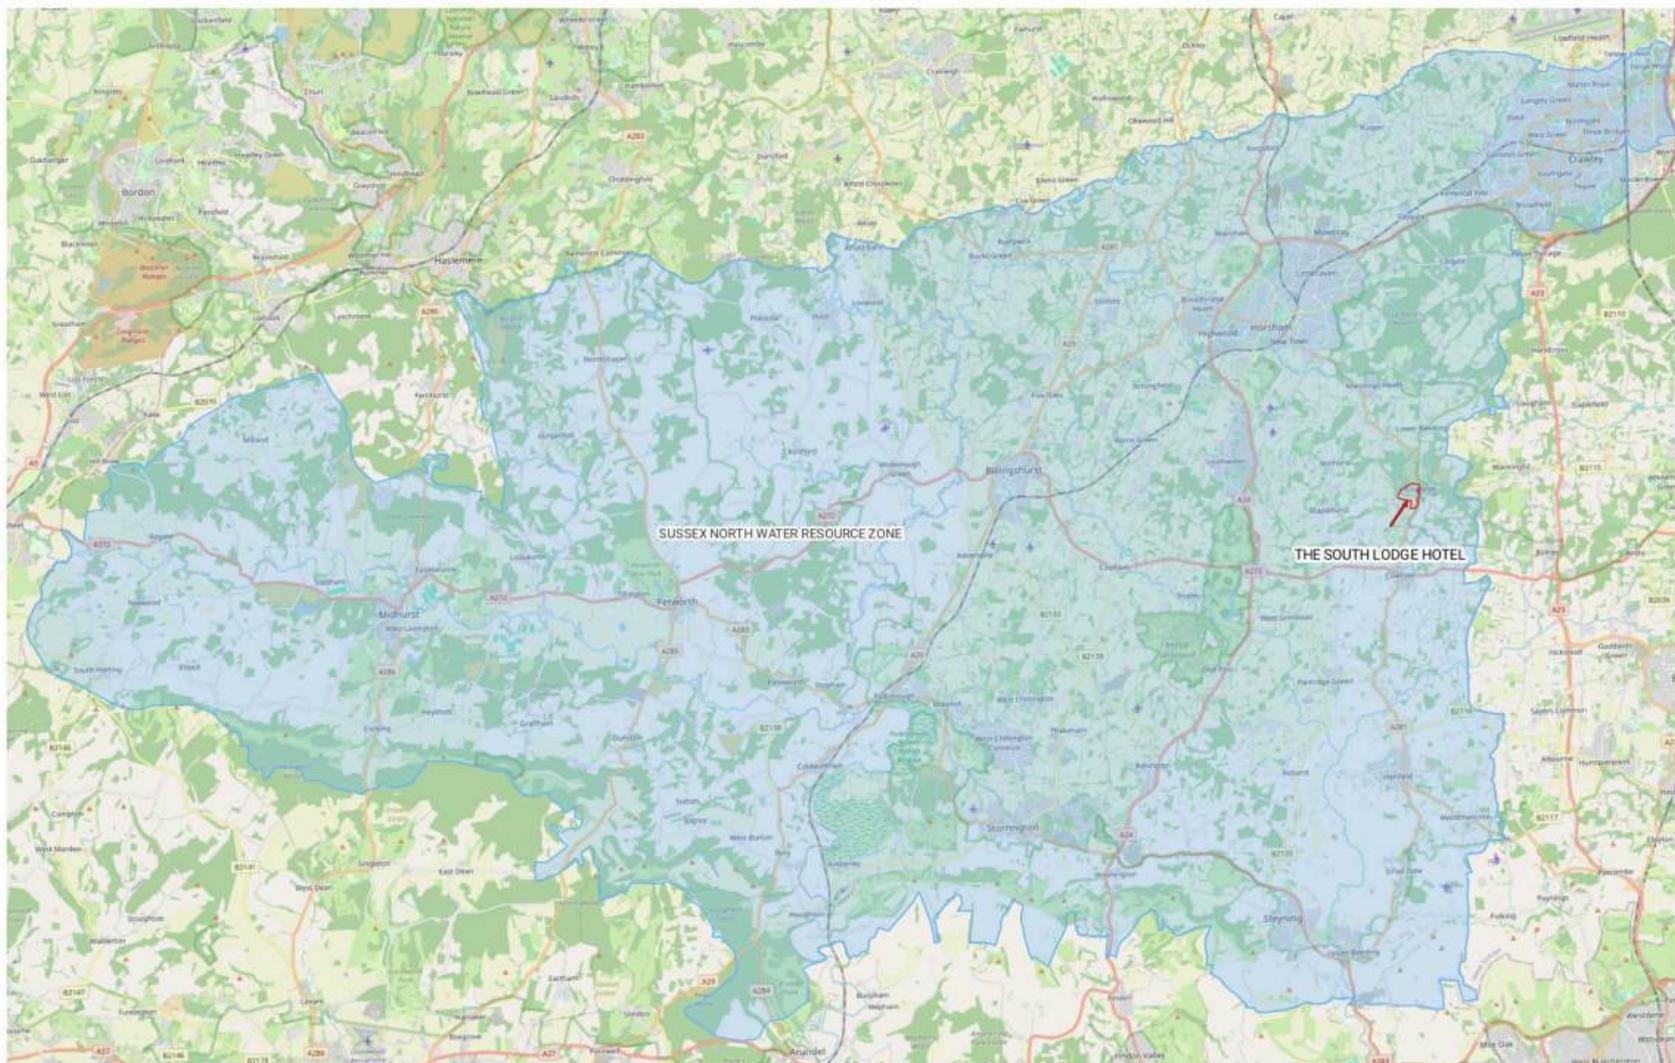

Produced on May 24, 2024.
© Crown copyright and database right 2024 (licence number 100059532)



APPENDIX B – EVIDENCE OF EXISTING CONSUMPTION

WATER 2 BUSINESS BILL FOR METERS 11M50090 AND 17MS000318 SHOWING ACTUAL READINGS ON 22/08/2022



Customer Number	w2b001684
Please quote when contacting us	
Bill Number	900585032
Date (tax point)	31/08/2022

Details of Premises Supplied

	South Lodge				
Site Name	South Lodge				
Site Reference	South Lodge				
Water Supply Point ID (SPID)	3019500494W11	3019633230W16	3019633230W16	3019633230W16	301945753XW1X
Sewerage Supply Point (SPID)					
Meter Serial Number	3019500494	11M50090	17MS000318	9M085135	11AC001166
Last Actual Read Date		22/08/2022	22/08/2022	22/08/2022	22/08/2022
Last Actual Read		163810	5920	9177	9457

Meter Readings and Water Consumptions

	31/07/2022	31/07/2022	31/07/2022	31/07/2022	31/07/2022
Bill Start Date	31/07/2022	31/07/2022	31/07/2022	31/07/2022	31/07/2022
Bill End Date	31/08/2022	31/08/2022	31/08/2022	31/08/2022	31/08/2022
Current Read Estimated	Estimated	Estimated	Estimated	Estimated	Estimated
Total Bill Days	31	31	31	31	31
Bill Start Reading	0	162869	5923	9315	9323
Bill End Reading	0	164198	5922	9177	9476
Gross Consumption (m3)	0	1329	-1	-138	153
Previous YTD Consumption	0	3171	39	138	359
Total YTD Consumption (m3)	0	4500	38	0	512

Charge Details - Water

Tariff Code	NHH_UW_VAR	NHH_LB1	NHH_LB1	NHH_LB1	NHH_MWVOL
1st Volumetric Rate	£0 9430	£1 3930	£1 3930	£1 3930	£1 4270
Volumetric Charge	£12 17	£1851 30	-£1 39	-£192 23	£218 33
2nd Volumetric Rate					
Volumetric Charge					
3rd Volumetric Rate					
Volumetric Charge					
Annual Standing Charge	31 days at £10	0 00	31 days at £580	0 00	31 days at £23
Standing Charge	£0 85	£0 00	£49 26	£0 00	£1 95
Total Water Charges	£13.02	£1,851.30	£47.87	-£192.23	£220.28

Charge Details - Sewerage

Tariff Code					
RTS %					
1st Volumetric Rate					
Volumetric Charge					
2nd Volumetric Rate					
Volumetric Charge					
3rd Volumetric Rate					
Volumetric Charge					
Highway & Surface Vol Rate					
Volumetric Charge					
Annual Standing Charge	0 00	0 00	0 00	0 00	0 00
Standing Charge	£0 00	£0 00	£0 00	£0 00	£0 00
Highway Drainage Charge					
Tariff Code					
Annual Standing Charge					
Standing Charge					
Surface Water Charge					
Tariff Code					
Annual Standing Charge					
Standing Charge					
Total Sewerage Charges					

WATER 2 BUSINESS BILL FOR METER 11AC001166 SHOWING ACTUAL READINGS ON 13/06/2022



Customer Number w2b001684
Please quote when contacting us

Bill Number 900576878
Date (tax point) 30/06/2022

Details of Premises Supplied

	South Lodge				
Site Name	South Lodge				
Site Reference	South Lodge				
Water Supply Point ID (SPID)	3019500494W11	3019633230W16	3019633230W16	3019633230W16	301945753XW1X
Sewerage Supply Point (SPID)					
Meter Serial Number	3019500494	11M50090	17MS000318	9M085135	11AC001166
Last Actual Read Date		13/06/2022	13/06/2022	13/06/2022	13/06/2022
Last Actual Read		160771	5908	9177	9184

Meter Readings and Water Consumptions

	31/05/2022	31/05/2022	31/05/2022	31/05/2022	31/05/2022
Bill Start Date	31/05/2022	31/05/2022	31/05/2022	31/05/2022	31/05/2022
Bill End Date	30/06/2022	30/06/2022	30/06/2022	30/06/2022	30/06/2022
Current Read Estimated	Y	Y	Y	Y	Y
Total Bill Days	30	30	30	30	30
Bill Start Reading	0	160399	5905	9177	9027
Bill End Reading	0	162156	5916	9177	9205
Gross Consumption (m3)	0	1757	11	0	178
Previous YTD Consumption	0	701	21	0	63
Total YTD Consumption (m3)	0	2458	32	0	241

Charge Details - Water

	NHH_UW_VAR	NHH_LB1	NHH_LB1	NHH_LB1	NHH_MWVOL
Tariff Code	NHH_UW_VAR	NHH_LB1	NHH_LB1	NHH_LB1	NHH_MWVOL
1st Volumetric Rate	£0 9430	£1 3930	£1 3930	£1 3930	£1 4270
Volumetric Charge	£11 78	£2447 50	£15 32	£0 00	£254 01
2nd Volumetric Rate					
Volumetric Charge					
3rd Volumetric Rate					
Volumetric Charge					
Annual Standing Charge	30 days at £10	0 00	30 days at £580	0 00	30 days at £23
Standing Charge	£0 82	£0 00	£47 67	£0 00	£1 89
Total Water Charges	£12.60	£2,447.50	£62.99	£0.00	£255.90

Charge Details - Sewerage

Tariff Code					
RTS %					
1st Volumetric Rate					
Volumetric Charge					
2nd Volumetric Rate					
Volumetric Charge					
3rd Volumetric Rate					
Volumetric Charge					
Highway & Surface Vol Rate					
Volumetric Charge					
Annual Standing Charge	0 00	0 00	0 00	0 00	0 00
Standing Charge	£0 00	£0 00	£0 00	£0 00	£0 00
Highway Drainage Charge					
Tariff Code					
Annual Standing Charge					
Standing Charge					
Surface Water Charge					
Tariff Code					
Annual Standing Charge					
Standing Charge					
Total Sewerage Charges					

WATER 2 BUSINESS BILL FOR METERS 11M50090, 17MS000318 AND 11AC001166 SHOWING ACTUAL READINGS ON 16/08/2023



Customer Number	w2b001684
Please quote when contacting us	
Bill Number	900638247
Date (tax point)	31/08/2023

Premises Supplied	South Lodge				
Site Name	South Lodge				
Site Reference	South Lodge				
Water Supply Point ID (SPID)	3019500494W11	3019633230W16	3019633230W16	3019633230W16	301945753XW1X
Sewerage Supply Point (SPID)					
Meter Serial Number	Unmetered -	11M50090	17MS000318	9M085135	11AC001166
Last Actual Read Date		16/08/2023	16/08/2023	16/08/2023	16/08/2023
Last Actual Read		179340	8572	9177	10054

Meter Readings and Water Consumptions	31/07/2023	31/07/2023	31/07/2023	31/07/2023	31/07/2023
Bill Start Date	31/07/2023	31/07/2023	31/07/2023	31/07/2023	31/07/2023
Bill End Date	31/08/2023	31/08/2023	31/08/2023	31/08/2023	31/08/2023
Current Read Estimated	Estimated	Estimated	Estimated	Estimated	Estimated
Total Bill Days	31	31	31	31	31
Bill Start Reading	0	178650	7921	9177	10032
Bill End Reading	0	180021	8688	9177	10080
Gross Consumption (m3)	0	1371	767	0	48
Previous YTD Consumption	0	3871	364	0	145
Total YTD Consumption (m3)	0	5242	1131	0	193

Charge Details - Water	NHH_UW_VAR	NHH_LB1	NHH_LB1	NHH_LB1	NHH_MWVOL
Tariff Code					
1st Volumetric Rate	£1 0440	£1 5800	£1 5800	£1 5800	£1 5820
Volumetric Charge	£13 48	£2166 18	£1211 86	£0 00	£76 42
2nd Volumetric Rate					
Volumetric Charge					
3rd Volumetric Rate					
Volumetric Charge					
Annual Standing Charge	31 days at £10 81	0 00	31 days at £639 09	0 00	31 days at £25 42
Standing Charge	£0 92	£0 00	£54 28	£0 00	£2 16
Total Water Charges	£14.40	£2,166.18	£1,266.14	£0.00	£78.58

Charge Details - Sewerage					
Tariff Code					
RTS %					
1st Volumetric Rate					
Volumetric Charge					
2nd Volumetric Rate					
Volumetric Charge					
3rd Volumetric Rate					
Volumetric Charge					
Highway & Surface Vol Rate					
Volumetric Charge					
Annual Standing Charge	0 00	0 00	0 00	0 00	0 00
Standing Charge	£0 00	£0 00	£0 00	£0 00	£0 00
Highway Drainage Charge					
Tariff Code					
Annual Standing Charge					
Standing Charge					
Surface Water Charge					
Tariff Code					
Annual Standing Charge					
Standing Charge					
Total Sewerage Charges					

WATER 2 BUSINESS BILL FOR METERS 11M50090, 17MS000318 AND 11AC001166 SHOWING ACTUAL READINGS ON 13/09/2021



Customer Number w2b001684
Please quote when contacting us

Bill Number 900544491
Date (tax point) 30/09/2021

Details of Premises Supplied

Site Name	South Lodge				
Site Reference	South Lodge				
Water Supply Point ID (SPID)	3019500494W11	3019633230W16	3019633230W16	3019633230W16	301945753XW1X
Sewerage Supply Point (SPID)					
Meter Serial Number	3019500494	9M085135	11M50090	17MS000318	11AC001166
Last Actual Read Date		13/09/2021	13/09/2021	13/09/2021	13/09/2021
Last Actual Read		9177	149008	5835	8717

Meter Readings and Water Consumptions

	31/08/2021	31/08/2021	31/08/2021	31/08/2021	31/08/2021
Previous Reading Date	31/08/2021	31/08/2021	31/08/2021	31/08/2021	31/08/2021
Current Reading Date	30/09/2021	30/09/2021	30/09/2021	30/09/2021	30/09/2021
Current Read Estimated (Y/N)	Y	Y	y	Y	y
Total Days	30	30	30	30	30
Previous Reading	0	9178	152699	5851	8612
Current Reading	0	9178	150677	5845	8730
Gross Consumption (m3)	0	0	-2022	-6	118
Previous YTD Consumption		0	10865	52	96
Total YTD Consumption (m3)		0	8843	46	214

Charge Details - Water

Tariff Code	NHH_UW_VAR	NHH_LB1	NHH_LB1	NHH_LB1	NHH_MWVOL
1st Volumetric Rate	£0 9020	£1 3380	£1 3380	£1 3380	£1 3650
Volumetric Charge	£11 27	£0 00	-£2705 44	-£8 03	£161 07
2nd Volumetric Rate					
Volumetric Charge					
3rd Volumetric Rate					
Volumetric Charge					
Annual Standing Charge	30 days at £10	0 00	0 00	30 days at £540	30 days at £23
Standing Charge	£0 82	£0 00	£0 00	£44 38	£1 89
Total Water Charges	£12.09	£0.00	-£2,705.44	£36.35	£162.96

Charge Details - Sewerage

Tariff Code
RTS %

APPENDIX C – BH1520 DRILL LOGS



BH1

Borehole record form



British Geological Survey
NATURAL ENVIRONMENT RESEARCH COUNCIL



Environment Agency

Water Resources Act 1991 (as amended by the Water Act 2003)

A Site details

Borehole drilled for

Location

NGR (ten digits) Please attach site plan

Ground level (if known) metres Above Ordnance Datum

Drilling company

Date drilling commenced (DD/MM/YYYY) Completed (DD/MM/YYYY)

B Construction details

Borehole datum (if not ground level) metres (m). Please tick if this is above or below ground level. (point from which all measurements of depth are taken, for example, flange, edge of chamber)

Borehole drilled diameter mm from to m/depth
 mm from to m/depth
 mm from to m/depth
 mm from to m/depth

Casing material diameter mm from to m/depth and type (for example, if plain steel, plastic slotted). Please record permanent casing details, not temporary casing.

Casing material diameter mm from to m/depth

Casing material diameter mm from to m/depth

Casing material diameter mm from to m/depth

Grouting details

Water struck at 1. m (depth below datum – mbd) 2. m (mbd)
 3. m (mbd) 4. m (mbd)

C Test pumping summary (Please supply full details on form WR39)

Test pumping datum m. Please tick if this is above or below ground level. (if different from borehole datum)

Pump suction depth mbd

Water level (start of test) mbd

Water level (end of test) mbd

Type of test (for example, bailer, step, constant rate)

Pumping rate m³/hour or litres/second . Please tick as appropriate.
 for days, hours, mins

Recovery to mbd in days, hours, mins
 (from end of pumping)

Date(s) of measurements Pump started (DD/MM/YYYY)

Pump stopped (DD/MM/YYYY)

Please supply chemical analysis if available. If you have included this please tick this box

Project South Lodge Hotel				BOREHOLE No 1a	
Job No AL162 / BH1520	Date 11-04-24 15-04-24	Ground Level (m)	Co-Ordinates ()		
Contractor Nicholls				Sheet 1 of 1	

SAMPLES & TESTS			STRATA				Geology	Instrument/ Backfill
Depth	Type No	Test Result	Reduced Level	Legend	Depth (Thickness)	DESCRIPTION		
					0.50	TOP SOIL: Medium soft very moist light brown organic silty CLAY.		
					2.00	Frequent roots and rootlets.		
					(5.00)	Medium firm brown very clayey silty MUDSTONE.		
					7.00	Medium firm dark yellow brown very clayey MUDSTONE.		
					(11.00)	Firm light blue silty CLAY and reddish brown MUDSTONE.		
					18.00			
					(16.00)	Firm dark brown red silty MUDSTONE.		
					34.00			
					36.00	Firm light blue silty CLAY with mudstone.		
					(25.00)	Firm light blue grey silty CLAY with mudstone.		
					61.00			
					62.00	Firm pale grey silty CLAY (Grinstead clay)		

Boring Progress and Water Observations					Chiselling			Water Added		GENERAL REMARKS
Date	Time	Depth	Casing Depth	Water Dpt	From	To	Hours	From	To	
										Service avoidance procedure followed. Rotary open hole No visual or olfactory sings of contamination.

All dimensions in metres Scale 1:393.75	Client South Lodge Hotel	Method/ Plant Used Massenza	Logged By SP
--	-----------------------------	-----------------------------------	-----------------

BH2

Borehole record form



British Geological Survey
NATURAL ENVIRONMENT RESEARCH COUNCIL



Environment Agency

Water Resources Act 1991 (as amended by the Water Act 2003)

A Site details

Borehole drilled for

Location

NGR (ten digits) Please attach site plan

Ground level (if known) metres Above Ordnance Datum

Drilling company

Date drilling commenced (DD/MM/YYYY) Completed (DD/MM/YYYY)

B Construction details

Borehole datum (if not ground level) metres (m). Please tick if this is above or below ground level. (point from which all measurements of depth are taken, for example, flange, edge of chamber)

Borehole drilled diameter

<input type="text" value="300"/>	mm from	<input type="text" value="0"/>	to	<input type="text" value="30"/>	m/depth
<input type="text" value="200"/>	mm from	<input type="text" value="30"/>	to	<input type="text" value="62"/>	m/depth
<input type="text"/>	mm from	<input type="text"/>	to	<input type="text"/>	m/depth
<input type="text"/>	mm from	<input type="text"/>	to	<input type="text"/>	m/depth

Casing material diameter mm from to m/depth and type (for example, if plain steel, plastic slotted). Please record permanent casing details, not temporary casing.

Casing material diameter mm from to m/depth

Casing material diameter mm from to m/depth

Casing material diameter mm from to m/depth

Grouting details

Water struck at

1. <input type="text"/>	m (depth below datum – mbd)	2. <input type="text"/>	m (mbd)
3. <input type="text"/>	m (mbd)	4. <input type="text"/>	m (mbd)

C Test pumping summary (Please supply full details on form WR39)

Test pumping datum m. Please tick if this is above or below ground level. (if different from borehole datum)

Pump suction depth mbd

Water level (start of test) mbd

Water level (end of test) mbd

Type of test (for example, bailer, step, constant rate)

Pumping rate m³/hour or litres/second . Please tick as appropriate.
for days, hours, mins

Recovery to mbd in days, hours, mins (from end of pumping)

Date(s) of measurements Pump started (DD/MM/YYYY)

Pump stopped (DD/MM/YYYY)

Please supply chemical analysis if available. If you have included this please tick this box

Project South Lodge Hotel				BOREHOLE No 2	
Job No AL162 / BH1520	Date 16-04-24 18-04-24	Ground Level (m) TQ 21666 25470	Co-Ordinates ()		
Contractor Nicholls				Sheet 1 of 2	

SAMPLES & TESTS			STRATA					Geology	Instrument Backfill
Depth	Type No	Test Result	Reduced Level	Legend	Depth (Thickness)	DESCRIPTION			
					0.50	TOP SOIL: Medium soft very moist light brown orange organic friable silty CLAY. Frequent roots and rootlets.			
					(6.00)	Medium firm dark yellow very clayey MUDSTONE.			
					6.50				
					(11.00)	Medium firm light blue grey silty CLAY and reddish brown MUDSTONE.			
					17.50				
					(12.50)	Firm dark brown reddish silty MUDSTONE with interstitial ferrous staining.			
					30.00				
					(20.00)	Medium firm grey silty MUDSTONE.			
					50.00				
					(12.00)	Firm light blue silty CLAY and MUDSTONE.			
					61.00				
					62.00	Firm pale grey silty CLAY (Grinstead clay)			

Boring Progress and Water Observations						Chiselling			Water Added		GENERAL REMARKS
Date	Time	Depth	Casing Depth	Casing Dia. mm	Water Dpt	From	To	Hours	From	To	
											Service avoidance procedure followed. Rotary open hole No visual or olfactory signs of contamination.

All dimensions in metres Scale 1:393.75	Client South Lodge Hotel	Method/ Plant Used Massenza	Logged By MC
--	-----------------------------	-----------------------------------	-----------------

APPENDIX D – BH1 INITIAL TEST PUMPING RECORD



Test Pumping Record

Client Name	DAH WAIT		Operator Name	M.V. P.S		
Address	SOUTH LODGE HOTEL RH136PS					
Project Number	BH1520		Date	18.04.24		
Installation Method (please circle)	Terex One	Terex Two	Yellow Tow Behind Reeler	Narrow Black Reeler	Wide Black Reeler	By Hand
Left on site? (please circle)	<input checked="" type="radio"/> Yes			<input type="radio"/> No		
Pump Used	VS 9/14					
Motor Used	1.1 kW 400V					
Timer Fitted	<input checked="" type="radio"/> Yes / <input type="radio"/> No	Type	On for	Off for		
Well Depth (m) (From dip-meter reading)	61					
Pump Depth (m) (from Team Up and/or PM)	50					
Rest Water Level at Start (m) (from dip-meter reading)	21.90					
Start stop watch before turning pump on						
Draw Down (please circle)	Static level achieved for at least 1h			To pump		
	Time ran for (min)	30		Time taken (min)		
	Depth (m)	25.95		Depth (m)		
	Max flow rate (L/m)	71		Max flow rate (L/m)		
Pump Restricted	Yes/No	Pump restricted to (L/m)				
Draw Down Test Pumping Regime						
Time taken to draw down (min)	First run					
	10 min rest					
	10 min rest					
	20 min rest					
Recovery rate (m/min)						
Samples Taken (please circle)	<input checked="" type="radio"/> Yes / <input type="radio"/> No	Lab sample	Office sample			
Rest water level at end (m)	22.09					

WEA361

APPENDIX E –HYDROLOGIST’S ASSESSMENT OF IMPACT ON PROTECTED SITES, SUSTABLE YIELD,
WATER QUALITY AND TEST PUMP LOGS

MEMORANDUM:

Review of Pumping Test Data, South Lodge Hotel

Document reference: 2024-095-025-001

Dated: 28/05/2024

Scope and Introduction

The site is South Lodge Hotel, Brighton Road, Lower Beeding, Horsham RH13 6PT (Figure 1). It has been proposed that abstraction at the site can provide a water offsetting solution to sites within the Sussex North water supply zone. To date all water supply has been obtained from mains water supply, sourced from the Sussex North WSZ. This is to be replaced by a borehole supply from local water resource. The reduction of up to 20 m³/day from the Sussex North WSZ is to be credited against developments within the WSZ which are unable to otherwise demonstrate water neutrality.


Natural England (2022) believes that groundwater abstraction in the Sussex North water supply zone (WSZ) has a detrimental impact on the Arun Valley SAC, SPA and Ramsar site. To try to prevent further deterioration of the SAC, SPA and Ramsar site, Natural England insists that:

“For every new development, total water use in the Sussex North Water Supply Zone after the development must be equal to or less than the total water-use in the region before the new development.”

Hence each new development will need to demonstrate how that development will achieve no net increase in water consumption, by water efficiency measures, offsetting or not being reliant on groundwater resources that are used for public water supply in the WSZ.

By removing the reliance on mains water from the WSZ at these sites, and drawing water from a source that is not hydrologically connected to the WSZ, it is proposed that the amount of water saved can be used to offset at development sites within the WSZ that do not have the ability to use groundwater.

This report has been written by Dr Stephen Buss MA MSc CGeol, based on the field work and preparatory work of Nicholls Licensing and Consulting. Dr Buss is a UK-based independent hydrogeologist with more than 25 years' consulting experience. Dr Buss's CV and publications list is available at www.hydro-geology.co.uk.

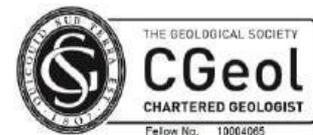

Water Neutrality Impact Statement

The site is in the catchment of the Cowfold Stream, which flows southwards to join the River Adur (Figure 2). The site is therefore not in the catchment of the River Arun, which at its closest is about 1.7 km north of the boreholes. The net impact of the proposed abstraction on the water balance of the River Arun catchment is therefore zero, and the potential impact on the Arun Valley SAC, SPA and Ramsar site is also therefore zero.

Bedrock geology is the Upper Tunbridge Wells Sand, and so the abstraction does not have continuity with the Lower Greensand aquifer of the Arun Valley.

The Boreholes

The boreholes were drilled between the 11th and 22nd April 2024, both to 62 m into the Upper Tunbridge Wells Sand Formation. The drillers' logs record yellow sand/clay with sandstones to 6.5 m or 7.0 m depth then grey clays and mudstones, with interbedded sandstones and limestones to 61 m depth. The boreholes terminated in greenish grey clay of the Grinstead Clay Formation (Appendix A). Figure 1 shows a schematic diagram of the boreholes.

Pumping Test Analysis

Borehole 1 was tested between 7 May 2024 and 9 May 2024 at an average rate of 20.8 m³/day, resulting in a drawdown of 0.47 m (Figure 1). There was no response to very heavy rainfall on the 6th May (34 mm fell in total).

Two methods of estimating flow were used: a totalising flow meter, which records the total amount of flow passing through for the duration of the test; and an instantaneous flow gauge, which records the flow at a given time. For estimating average rate the totalising flow meter is the most reliable source, hence the representative average rate in the following calculations is taken as 20.8 m³/day.

Drawdown for each borehole is plotted on Figure 2. Drawdown, on a semi-log scale, is plotted for Cooper-Jacob analysis of the data in Figure 4, and recovery data, plotted for Theis analysis, is shown on Figure 5. Aquifer parameters are as follows:

	BH1 data	BH2 data
Cooper-Jacob: transmissivity (m ² /day)	31.1	30.5
Cooper-Jacob: storage coefficient (-)	-	4x10 ⁻⁶
Theis recovery: transmissivity (m ² /day)	76.1	76.1

Interpretation

The Tunbridge Well Sand Formation is one of the key aquifers of the Wealden District, and supports many minor groundwater abstractions. The BGS memoir for sheet 302 (Horsham) indicates that:

“Groundwater flow within the Tunbridge Wells Sand is both intergranular and through joints, and well yields tend to be variable... a shaft at Crawley yielded 650 m³/day from the Upper Tunbridge Wells Sand. Because of variable yields and siltation with usage borehole supplies are... variable with yields varying from 20 to more than 2000 m³/day. The mean yield for a 300 mm diameter borehole penetrating 30 metres of saturated Tunbridge Wells Sand in the Wealden district has been calculated to be 750 m³/day for a 10 metre drawdown. The same analysis suggests that there would be a 20% probability that the yield would be less than 300 m³/day for the same drawdown.”

This memo only deals with the potential for the abstraction of 20 m³/day which is much less than the pessimistic value of 300 m³/day cited above.

The pumping test results plot close to a straight line on a log-time chart (Figure 5), which is expected for a confined aquifer. The water-bearing formation in these boreholes is the mudstone with interbedded sandstones and limestones: most flow probably comes via fractures in the sandstone and limestone units.

The borehole maintained a constant pumping rate of 20.8 m³/day for two days, with very limited drawdown at the pumping borehole. Transmissivity values are similar from each borehole. Most of the recovery from the pumping tests was quick after each test. Water levels recovered to levels slightly higher than the starting level, but this was probably due to background groundwater level fluctuation.

The test was undertaken in spring, when groundwater levels were likely high, after a very wet winter. A groundwater level hydrograph from the Environment Agency's Kingstanding observation borehole, near Crowborough, shows that the typical seasonal range of groundwater levels is about 6 m in the Ashdown Sands Formation (which is a similar aquifer to the Tunbridge Wells Sand). Hence a typical summer water level in BH1 might be closer to 28 m depth.

Long-term estimates of drawdown can be made by assuming the range aquifer properties determined above. Using the Theis equation for confined aquifers, these suggest that the drawdown after 60 years would be as shown in Figure 6, for different abstraction rates up to 20 m³/day. The maximum likely drawdown is 2.3 m. Allowing for a further 6.0 m seasonal drop in levels from the April 2024 peak of 22.1 m, the long-term lowest water level can be estimated at 30.4 m. Clearly, therefore, groundwater will be available from the borehole all year round, and as the open section of the borehole is below 30 m depth there should be no seasonal change in borehole performance.

Water Quality and Potential for Contamination

Water quality from the borehole was tested in May 2024 (Appendix B). The water is soft, with low mineralisation. It is anoxic (elevated ammonium, iron and manganese; low nitrate). There was slightly elevated turbidity and detectable concentrations of coliforms. All of these issues can be dealt with via water treatment.

Since it is anoxic the water is demonstrably old and the upper layers of the subsurface comprise layers of mudstones and clays. Heavy rainfall on 6 May 2024 did not reach the water table during the week following the rain. Water quality in the aquifer will be stable.

There are no potentially polluting land uses in the area around Crabtree. Given this, and since the intake to the borehole source is so deep, and there are many mudstone layers in the upper 30 m of the formation, there is no risk of gross contamination reaching the borehole.

Conclusions

This note reviews the results of a pumping test at the borehole BH1 at South Lodge Hotel. The borehole was pumped over two days. The aquifer response is that of a confined aquifer. Seasonal variation has been considered and the likely drawdown after 60 years of operation has been estimated.

Given conservative assumptions about aquifer properties, there is no indication that the borehole does not offer a sustainable and safe source of at least 20 m³/day groundwater in perpetuity.


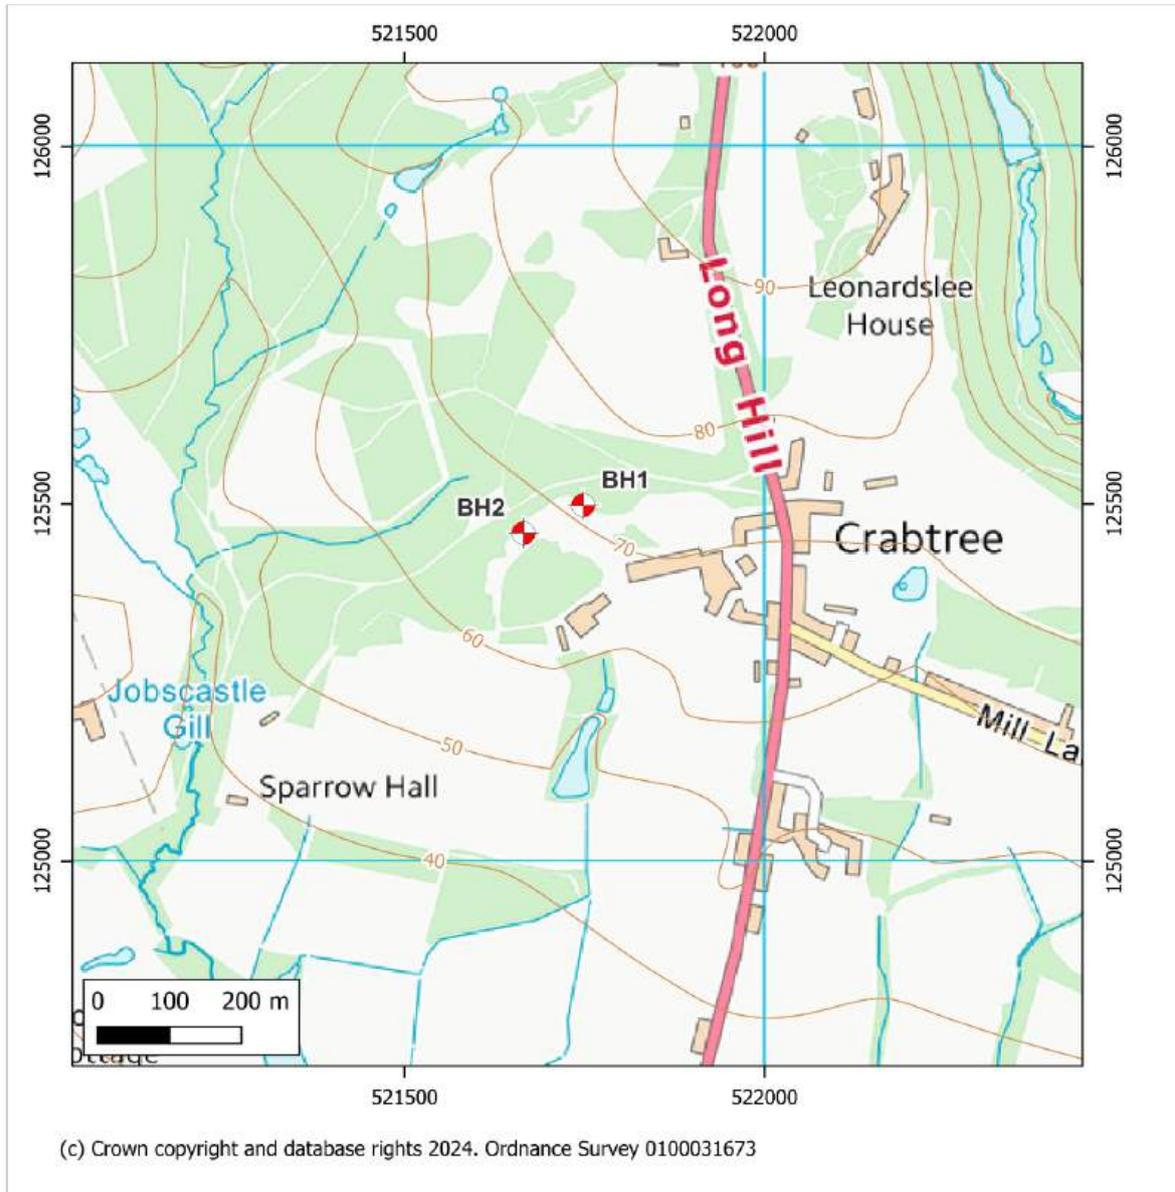


Figure 1: Borehole locations

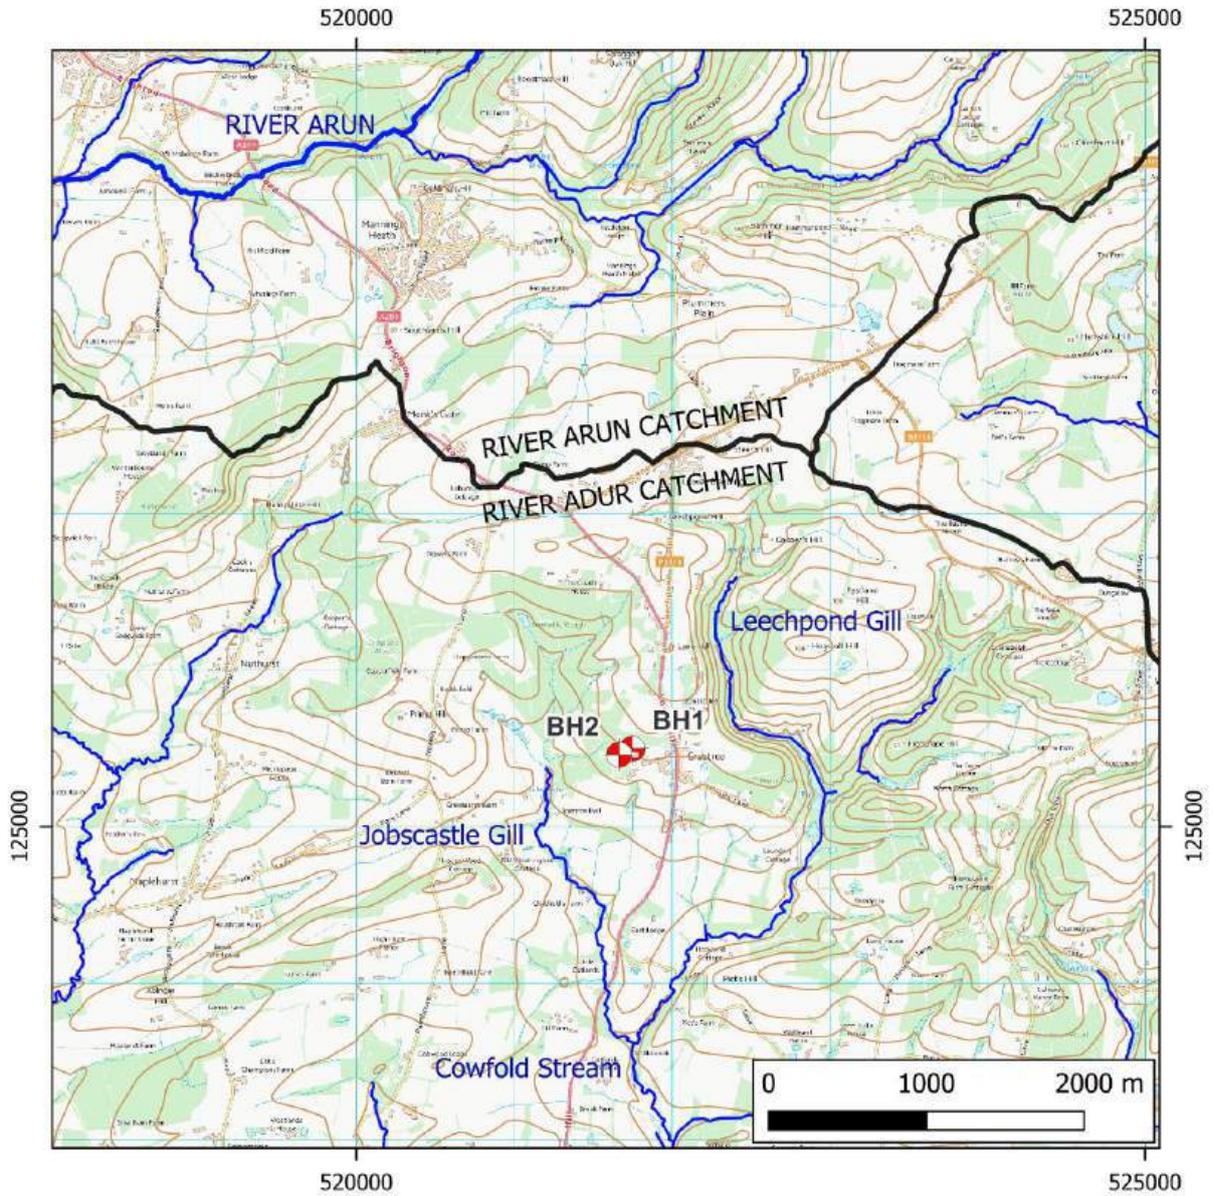

Contains Ordnance Survey Data (c) Crown Copyright and database right 2024

Figure 2: Watercourses and catchment boundaries

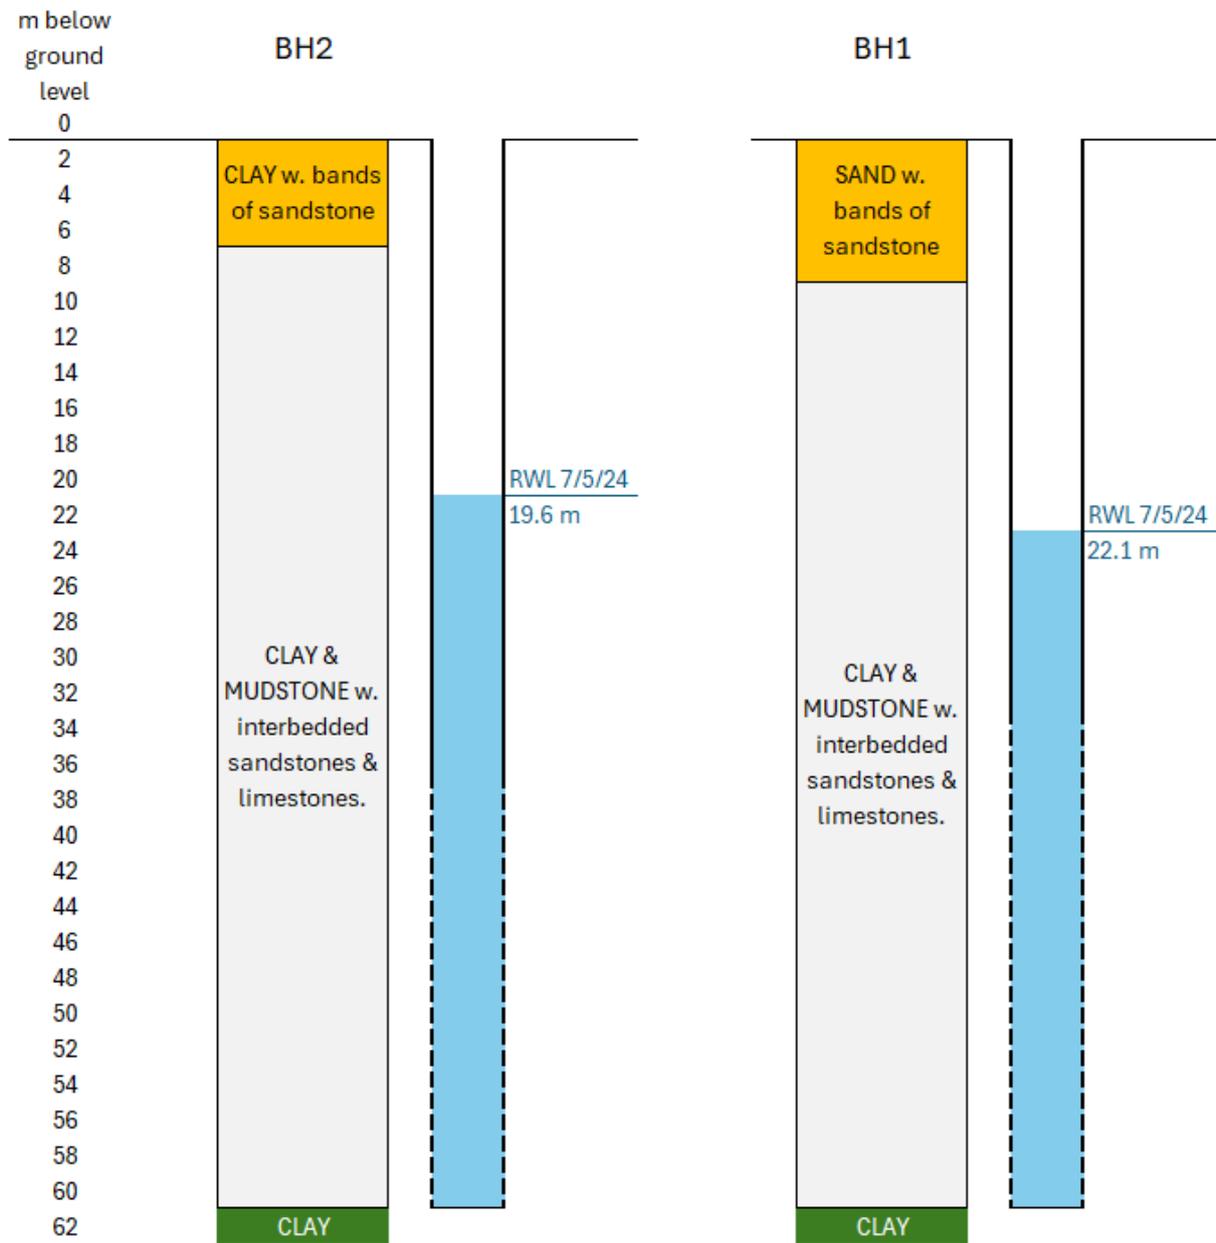


Figure 3: Schematic west-east section through boreholes

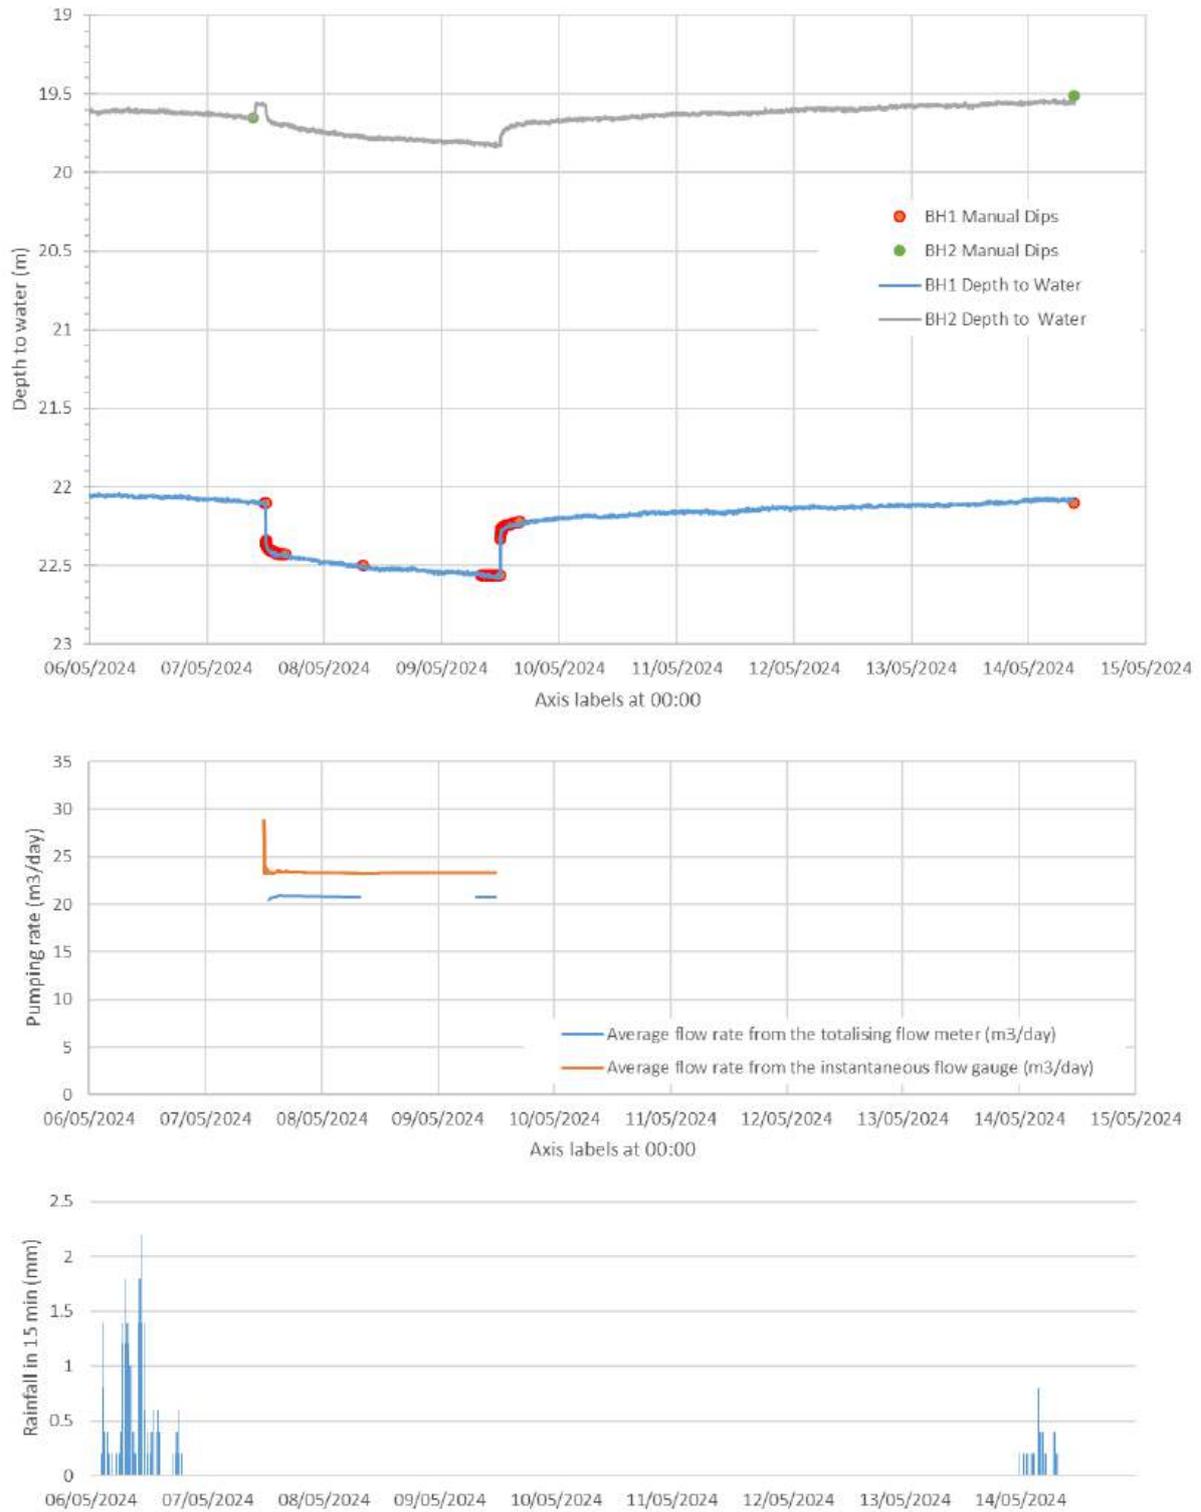


Figure 4: Groundwater levels, pumping rates and rainfall at EA Cowfold gauge

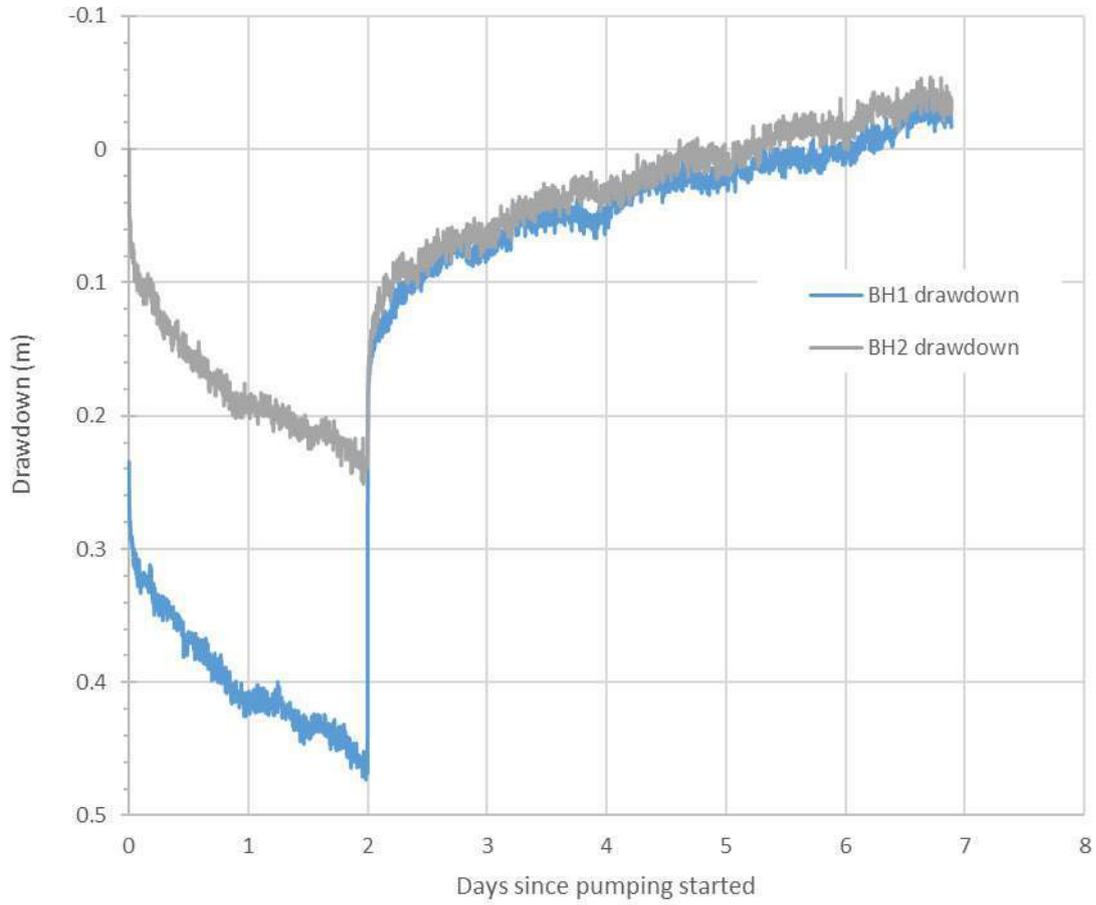


Figure 5: Drawdown

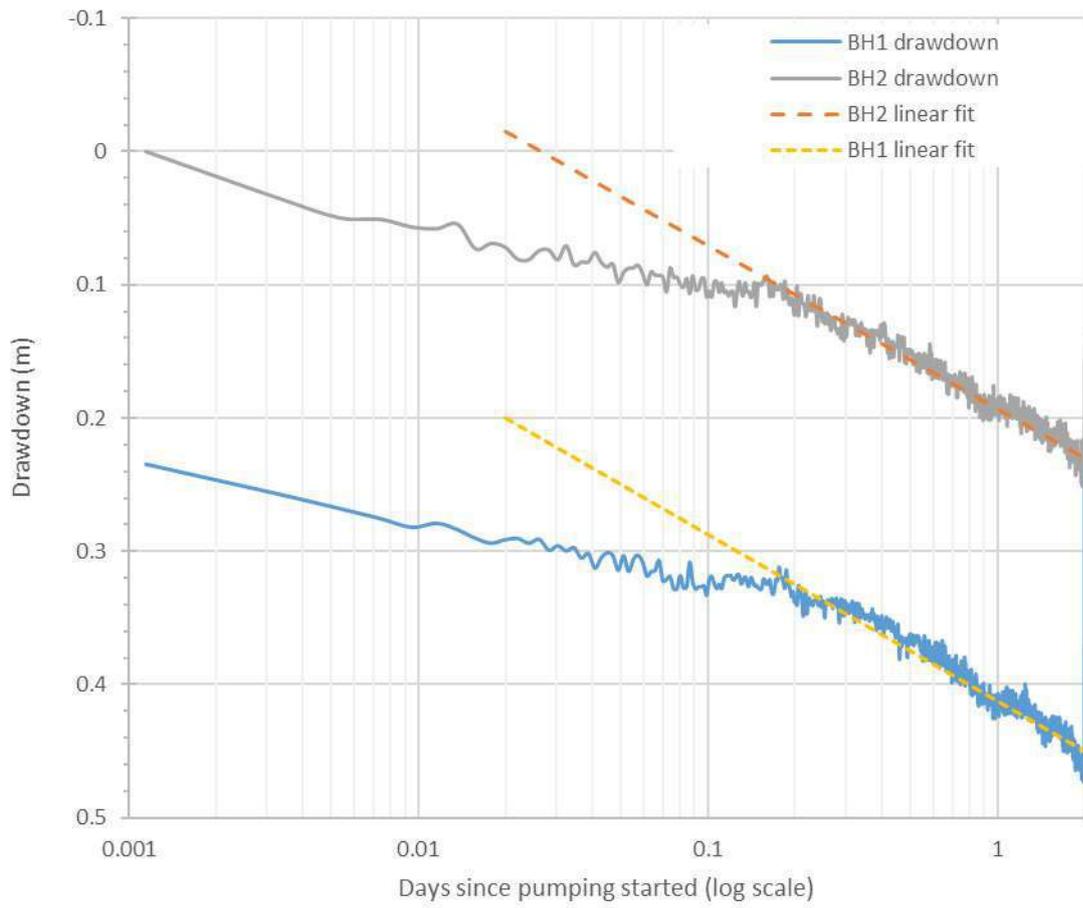


Figure 6: Drawdown on a log-time scale, and linear fit lines

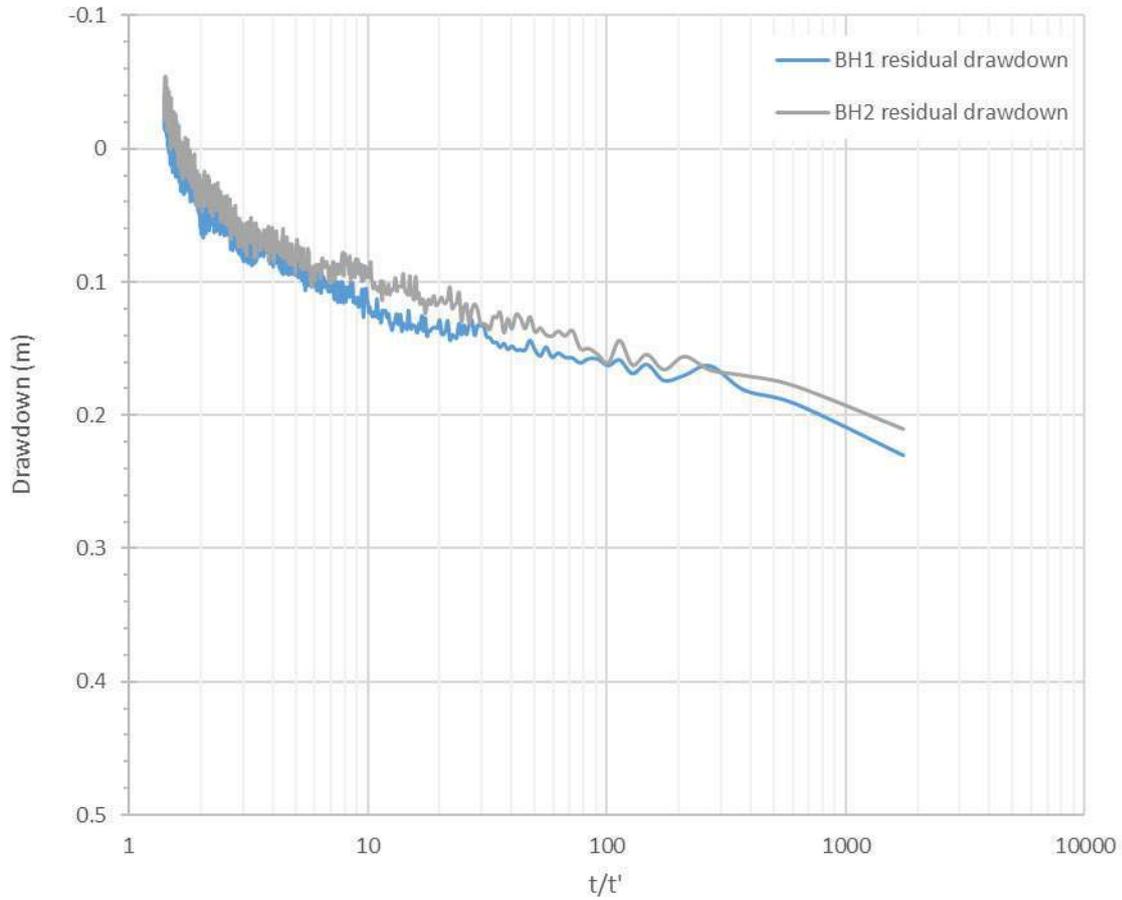


Figure 7: Residual drawdown during recovery on a log- t/t' scale

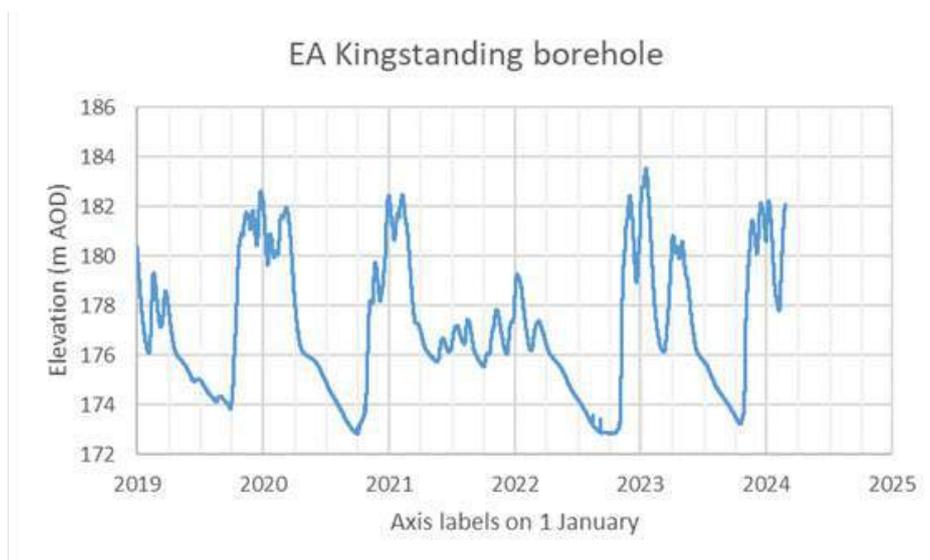


Figure 8: Groundwater levels in the Ashdown Sands Formation

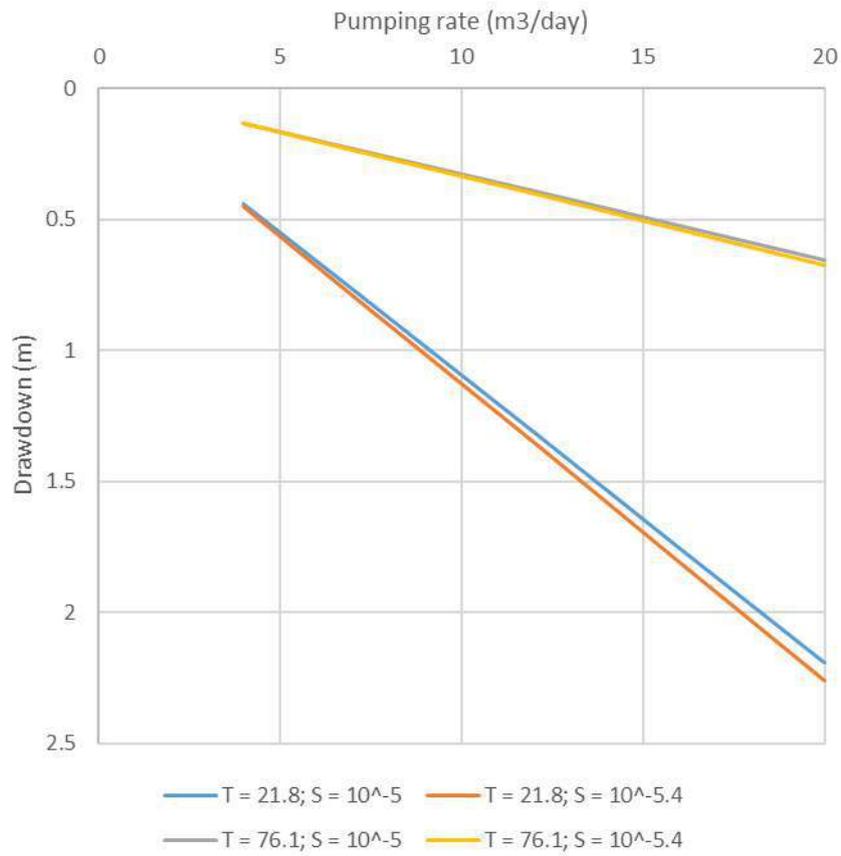


Figure 9: Potential drawdown at 60 years, given different pumping rates and aquifer properties

APPENDIX F – TREATMENT SYSTEM AND PLANT ROOM SPECIFICATION AND WATER QUALITY TEST CERTIFICATE

Purpose

To provide a filtration, storage & delivery system from the borehole at the offsetting site via an underground pipe network to multiple outlets.

High Level Description of the Treatment and Filtration System.

A borehole fed filtration system that comprises contact & resin-based filters with auto backwash, feeding a central reverse osmosis (RO) unit with multiple membranes & concentrate re-treatment for high efficiency.

Post RO water is re-mineralised before passing through a UV/sediment filter & chlorine dosing & monitoring unit into an insulated break tank.

A duty stand by booster pump set will draw from the tank and deliver water at a constant flow and pressure to all users; the control for which is demand based. The entire system is monitored by a multi-point telemetry system which picks up fault outputs from all key components, displays critical system performance indicators, delivers alarm alerts & records flow rates/volumes & overall performance back to a remote monitoring station/person.

Key spare parts will be stored within the plant room & central stores to facilitate swift system support & repair. WSP & service/maintenance manuals all to be available within the plant room.


The system will be designed in close collaboration with the incumbent local authority. Following completion of the works the system would be risk assessed & signed off by the local authority's Environmental Health Department.

A suitable bespoke service & maintenance regime (see maintenance section below) would be implemented following commissioning, this service offering would adapt the system for the long term & include interval sampling to monitor system performance.

Primary System Components

- Borehole pump to provide system flow via pressure control.
- 2x Water meters for record keeping and service measurement.
- 1x Particulate & iron contact filter with auto backwash.
- 1x ion exchange unit with auto backwash.
- 1x Reverse osmosis unit.
- 1x re-mineraliser unit.
- 1x pre tank UV & sediment filter.
- 16m³ insulated storage tank.
- 1x chlorine dosing unit with constant PPM level monitoring & adjustment.
- Duty stand-by booster pumps to provide flow & pressure to the network.
- Overarching telemetry system to provide remote monitoring & alarms.

A Filtration System Schematic is shown overleaf and further details of the Water Quality Analysis are provided in Appendix I - Groundwater Investigation Report.

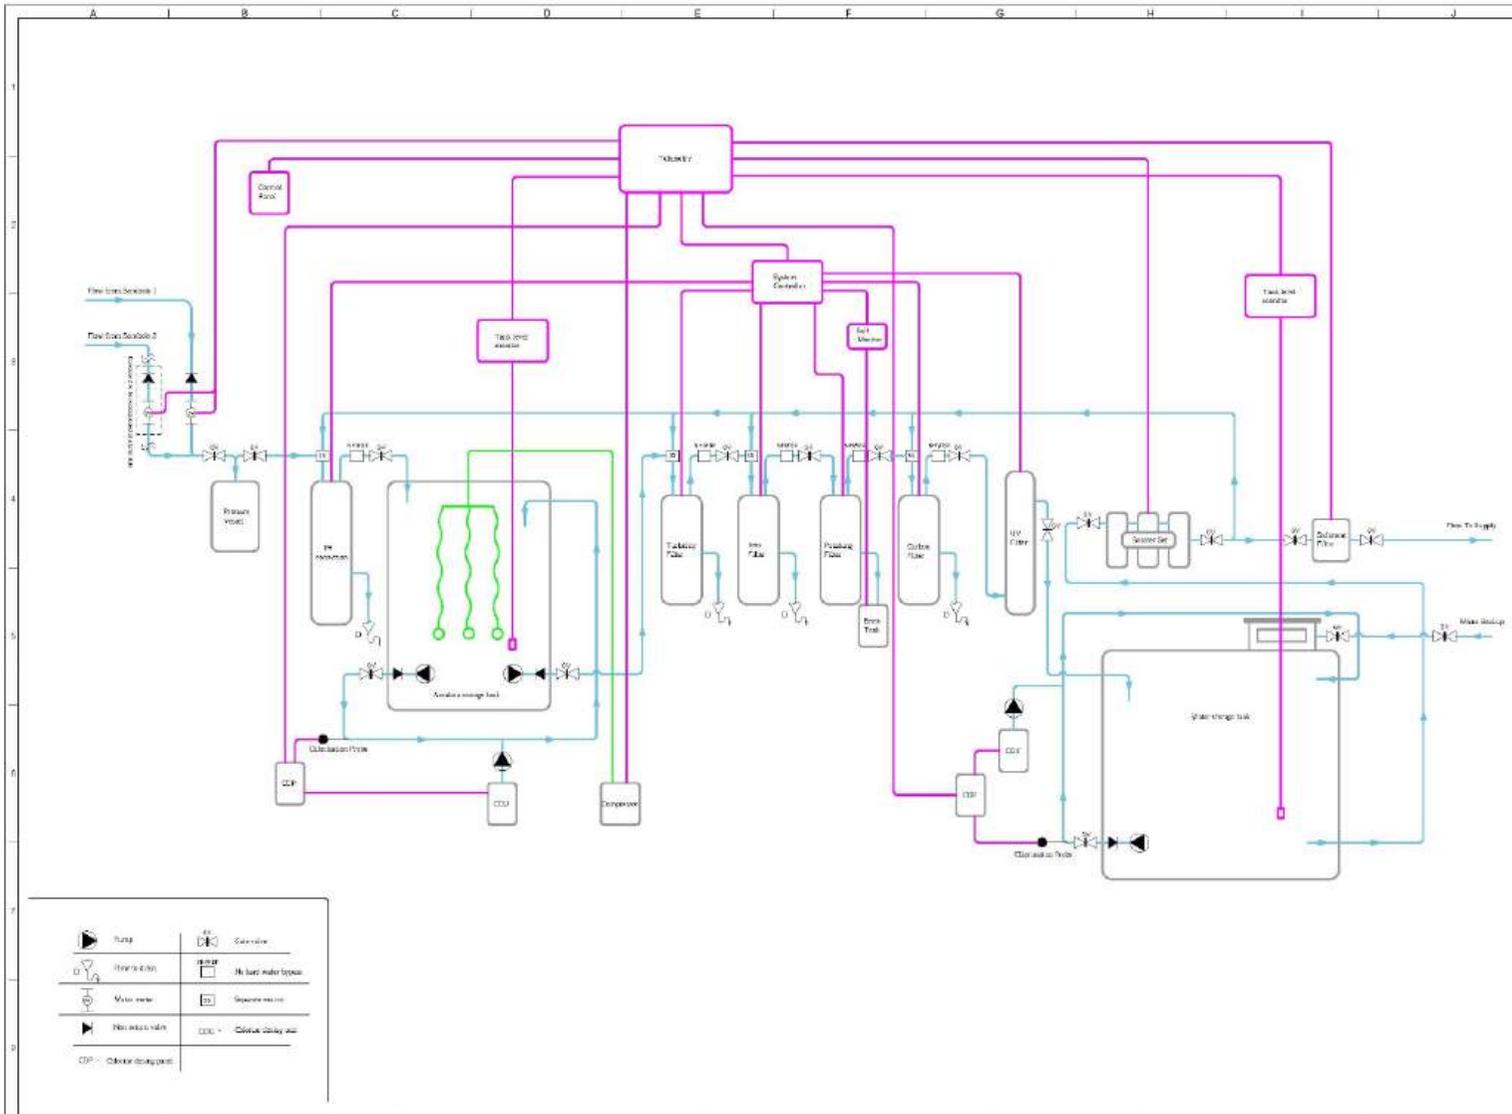

General Notes

Labour Division
Unless otherwise specified in Schedule Bill of Quantities, all ground work, brick / block work and back filling of holes and trenches are to be priced and completed by others.

All pipe work and tanks are to be back filled with clean shingle to prevent damage to pipes.

Mains Power
Unless otherwise stated, mains power is to be provided to a IP56 Rated junction box with isolation switch at or near the plant room/borehole. All electrical connections to the mains supply as well as outlets are to be priced and completed by a qualified electrician. By others.

Water
Untreated borehole water is a category 0 supply and may harbour pathogens. A break gap of 30mm with header tank is required between the incoming mains and incoming borehole supplies. See <http://www.eras.co.uk/> for more information.

Surface Water
Unless otherwise stated and agreed all well covers will be raised to prevent surface contamination. In some circumstances recessed covers would be acceptable but clients will need to be made aware of the risks involved.

Contractors Responsibility
It is the contractors/clients responsibility to protect from damage any and all bespoke components installed on site by Nicholls.

Clients Responsibility
It is the clients responsibility to monitor usage and any filter equipment. This is to ensure there has been no damage by others during the surrounding works by others. Nicholls cannot be held liable for any cost incurred from damage caused by others.

Notes	Title: BH1420 High Level Design		Drawn: Mr Adem Hardiman	
	Client: South Lodge Hotel		Checked: Mr George Parker	
	Date: 16/05/2024		Indicative layout for design purposes only. Final position to be confirmed on site. Drawing is not to be scaled.	
	Revision: Rev:000	Sheet: 1 of 1		



Water Quality Test Certificate BH1

ANALYTICAL REPORT

Page 1 of 3

NICHOLLS BOREHOLES

Brownings Barn
Glasshouse Lane
Kirdford
West Sussex
RH14 0LW

Collected From: BRIGHTON ROAD, LOWER BEEDING, HARSHAM RH13 6PS

Date Received: 09/05/2024

Certificate Number: 1248571-3 Final
 Supercedes report 1248571-2

Order Number: BH1520

Date Reported: 30/05/2024

Lab Ref.	Sample Details	Method	Test	Result	Units	Limit	Flag
4761624	Desc: RAW BOREHOLE WATER BH1520BH1	255	Ammonium (Ammonia and Ammonium Ions)	0.651	mg/l	<0.500	F
	Collect From: BRIGHTON ROAD, LOWER BEEDING, HARSHAM RH13 6PS	215	Chloride	24.78	mg/l	<250.00	
		245	Nitrate	<0.9	mg/l	<50.0	
	Order No: BH1520	225	Nitrite	<0.004	mg/l	<0.500	
	Received Date: 09/05/2024	calc	Nitrite/Nitrate	0.000	mg/l	<1.000	*
	Tested Date: 09/05/2024	305	Sulphate	67.6	mg/l	<250.0	
	Sampling Date: 09/05/2024 11:00	205	Total Hardness	28.1	mg/l		
	Sample Type: GW : Ground Water	230	Odour - Qualitative	None			*
	Product: SS-DWREGS	230	Odour - Quantitative	0			
		430	Colony Count 3 Days at 22°C	>300	cfu/ml		
		400	E coli	0	mpn/100ml	0	
		400	Total Coliforms	1	mpn/100ml	0	F
		660	Colour	<2	mg/l Pt/Co	<20	
		660	Conductivity	414	uS/cm		
		660	Hydrogen Ion (pH)	6.8	pH_unit	6.5 to 9.5	
		660	Turbidity	47.000	NTU	<4.000	F
	ext		Epichlorohydrin	<0.1	µg / l	<0.10	*
		3401	Bromate	<0.8	µg / l	<10.0	
		390	Enterococci	1	cfu/100ml	0	F
		5413	Total Cyanide	<4.1	µg / l	<50.0	
		765	Mercury	<0.04	µg / l	<1.00	
		745	Antimony	0.3	µg / l	<5.0	
		745	Arsenic	1.7	µg / l	<10.0	
		745	Selenium	<0.8	µg / l	<10.0	
		740	Boron	0.219	mg/l	<1.000	
		740	Sodium	60.1	mg/l	<200.0	
		3371	Fluoride	0.182	mg/l	<1.500	
		3545	2,4,5-T	<0.007	µg / l	<0.100	
		3545	2,4-D	<0.007	µg / l	<0.100	
		3545	Bentazone	<0.007	µg / l	<0.100	
		3545	Bromoxynil	<0.007	µg / l	<0.100	

Disclaimers:

Unless otherwise stated, all results apply to the sample as received. Information provided by the customer (includes Date, Time, Sample Matrix & Sample Description) can affect the validity of the result.

Opinions and interpretations expressed in this report are outside the scope of UKAS accreditation.

Details of Uncertainty of Measurement and Analytical Quality Control are available on request.

Where a statement of conformity to a Regulatory Standard or customer limit is provided, the uncertainty of measurement is not taken into account unless shown on the certificate.

* - denotes non UKAS accredited test

A result of 0 cfu denotes none found in volume analysed

F - Result Exceeds The Maximum Pcv As Defined In The Water Supply (Water Quality) (Amendment) Regulations 2018

ext - Analysis subcontracted to an external laboratory



1579

This analytical report may not be reproduced, except in full, without the written approval of South East Water Scientific Services.

South East Water Ltd. Registered in England, No.2679874. Registered Office: Rocford Road, Snodland, Kent ME5 5AH.

Certificate Number: 1248571-3 Final
Supercedes report
1248571-2
Order Number: BH1520

Lab Ref.	Sample Details	Method	Test	Result	Units	Limit	Flag
4761624	Continued from Page 1	3545	Dicamba	<0.020	µg / l	<0.100	
		3545	Dichlorprop	<0.003	µg / l	<0.100	
		3545	Fluroxypyr	<0.008	µg / l	<0.100	
		3545	MCPA	<0.008	µg / l	<0.100	
		3545	MCPB	<0.008	µg / l	<0.100	
		3545	Mecoprop (MCP)	<0.005	µg / l	<0.100	
		3545	Triclopyr	<0.015	µg / l	<0.100	
		2587	Atrazine	<0.002	µg / l	<0.100	
		2587	Carbendazim	<0.001	µg / l	<0.100	
		2587	Carbetamide	<0.002	µg / l	<0.100	
		2587	Chlortoluron	<0.003	µg / l	<0.100	
		2587	Diuron	<0.004	µg / l	<0.100	
		2587	Epoxiconazole	<0.003	µg / l	<0.100	
		2587	Flutriafol	<0.003	µg / l	<0.100	
		2587	Isoproturon	<0.003	µg / l	<0.100	
		2587	Linuron	<0.003	µg / l	<0.100	
		2587	Oxadixyl	<0.003	µg / l	<0.100	
		2587	Pendimethalin	<0.007	µg / l	<0.100	
		2587	Prometryn	<0.002	µg / l	<0.100	
		2587	Propazine	<0.002	µg / l	<0.100	
		2587	Simazine	<0.003	µg / l	<0.100	
		2587	Terbutryn	<0.002	µg / l	<0.100	
		2587	Trietazine	<0.004	µg / l	<0.100	
		480	Benzo (a) pyrene	<0.003	µg / l	<0.010	
		480	Benzo(1,12)perylene	<0.003	µg / l		
		480	Benzo(11,12)fluoranthene	<0.003	µg / l		
		480	Benzo(3,4)fluoranthene	<0.003	µg / l		
		480	Indeno(1,2,3-cd)pyrene	<0.003	µg / l		
		calc	PAH Total	0.000	ug/l	<0.100	*
		775	1,1,1 Trichloroethane	<0.60	µg / l		
		775	1,2-Dichloroethane	<0.12	µg / l	<3.00	
		775	Benzene	<0.02	µg / l	<1.00	
		775	Dibromochloromethane	<0.50	µg / l		
		775	Dichlorobromomethane	<0.43	µg / l		
		775	Tetrachloroethene	<0.15	µg / l	<10.00	
		calc	Tetrachloroethene/Trichloroethene- Sum	0.00	µg / l		*
		775	Tetrachloromethane	<0.11	µg / l	<3.00	
		calc	Total Trihalomethanes	0.00	µg / l	<100.00	*
		775	Tribromomethane	<0.60	µg / l		
		775	Trichloroethene	<0.10	µg / l	<10.00	
		775	Trichloromethane	<0.50	µg / l		
		730	Aluminium	121.5	µg / l	<200.0	
		730	Iron	5244.7	µg / l	<200.0	F
		730	Manganese	610.5	µg / l	<50.0	F
		735	Cadmium	<0.12	µg / l	<5.00	

Disclaimers:

Unless otherwise stated, all results apply to the sample as received. Information provided by the customer (includes Date, Time, Sample Matrix & Sample Description) can affect the validity of the result.

Opinions and interpretations expressed in this report are outside the scope of UKAS accreditation.

Details of Uncertainty of Measurement and Analytical Quality Control are available on request.

Where a statement of conformity to a Regulatory Standard or customer limit is provided, the uncertainty of measurement is not taken into account unless shown on the certificate.

* - denotes non UKAS accredited test

A result of 0 cfu denotes none found in volume analysed

F - Result Exceeds The Maximum Pcv As Defined In The Water Supply (Water Quality) (Amendment) Regulations 2018

ext - Analysis subcontracted to an external laboratory



1579

This analytical report may not be reproduced, except in full, without the written approval of South East Water Scientific Services.

South East Water Ltd. Registered in England, No.2679674. Registered Office: Rocfort Road, Snodland, Kent ME6 5AH.

Certificate Number: 1248571-3 Final
Supercedes report
1248571-2
Order Number: BH1520

Lab Ref.	Sample Details	Method	Test	Result	Units	Limit	Flag
4761624	Continued from Page 2	735	Chromium	<0.5	µg / l	<50.0	
		730	First Draw Copper	<0.009	mg/l	<2.000	
		730	First Draw Lead	<0.9	µg / l	<10.0	
		730	First Draw Nickel	<0.9	µg / l	<20.0	
		360	Clostridium perfringens (including spore	0	cfu/100ml	0	
		calc	Pesticides - Total Substances	0.000	ug/l		*
		4170	Aldrin	<0.007	µg / l	<0.030	
		4170	Dichlobenil	<0.006	µg / l	<0.100	
		4170	Dieldrin	<0.007	µg / l	<0.030	
		4170	Gamma-HCH (Lindane)	<0.005	µg / l	<0.100	
		4170	Heptachlor	<0.008	µg / l	<0.030	
		4170	Heptachlor Epoxide	<0.005	µg / l	<0.030	
		4170	Propyzamide	<0.005	µg / l	<0.100	
		4170	Tri-allylate	<0.005	µg / l	<0.100	
		295	Gross Alpha	<0.02	Bq/l	<0.10	
		295	Gross Beta	<0.28	Bq/l	<1.00	
		5374	Tritium	<8.5	Bq/l	<100.0	
		740	Magnesium	7.6	mg/l		
		730	Iron (Free)	<7.3	µg / l		
		ext	Vinyl Chloride	<0.113	µg / l	<0.500	
		ext	Acrylamide	<0.008	µg / l	<0.100	

Job number changed as requested



Richard Brown
Laboratory Manager

Disclaimers:

Unless otherwise stated, all results apply to the sample as received. Information provided by the customer (includes Date, Time, Sample Matrix & Sample Description) can affect the validity of the result.
Opinions and interpretations expressed in this report are outside the scope of UKAS accreditation.
Details of Uncertainty of Measurement and Analytical Quality Control are available on request.
Where a statement of conformity to a Regulatory Standard or customer limit is provided, the uncertainty of measurement is not taken into account unless shown on the certificate.
* - denotes non UKAS accredited test
A result of 0 cfu denotes none found in volume analysed
F - Result Exceeds The Maximum Pcv As Defined In The Water Supply (Water Quality) (Amendment) Regulations 2018
ext - Analysis subcontracted to an external laboratory



1579

This analytical report may not be reproduced, except in full, without the written approval of South East Water Scientific Services.

South East Water Ltd. Registered in England, No.2679874. Registered Office: Roxford Road, Snodland, Kent ME6 5AH.

BH1520 Bespoke Waterwell Annual Service Programme



Service Programme MAIN SERVICE

Full day service @ 2 x engineers

- Resistance & insulation testing of borehole pump motor & cable
- Check well heads
- Inspection of controls & adjustment where necessary
- Check flowrate & pressure and adjust as necessary

Control panel

- Check operation

System controller

- Check operation

Pressure vessel

- Check pressure vessel settings
- Adjust pressure as necessary

pH correction unit

- Replace separate source valve service kit
- Replace No Hard Water Bypass service kit
- Replace clack head service kit
- Change memory back up battery
- Confirm all settings and times on the head are correct
- Run forced re-gen to confirm correct operation of head and valves
- Top up juraperle / corosex as needed
- Check and record pH levels

Aeration storage tank

- Fill aeration tank and flush
- Clean bubblers in tank

Compressor

- Change compressor service kit
- Change compressor filter

Turbidex Unit

- Replace separate source valve service kit
- Replace No Hard Water Bypass service kit
- Replace clack head service kit
- Change memory back up battery
- Confirm all settings and times on the head are correct
- Run forced re-gen to confirm correct operation of head and valves

Filox iron filter unit

- Replace separate source valve service kit
- Replace No Hard Water Bypass service kit
- Change clack head service kit
- Change memory back up battery
- Confirm all settings and times on the head are correct
- Run forced re-gen to confirm correct operation of head and valves
- Sodium hypochlorite flush
- Check filox media levels and replace as necessary
- Filox media will need full replacement every 5-7 years

CR200 Filter

- Replace No Hard Water Bypass service kit
- Change clack head service kit
- Change memory back up battery
- Confirm all settings and times on the head are correct
- Check crystal right media, top up as necessary
- Full media replacement required every 7-10 years

Brine tank

- Check salt levels
- Top up as necessary

Carbon filter

- Replace separate source valve service kit
- Replace No Hard Water Bypass service kit
- Replace clack head service kit
- Change memory back up battery
- Confirm all settings and times on the head are correct
- Check levels of activated carbon, top up as necessary
- Change carbon filter

Ultraviolet System

- Replace UV Lamp
- Replace UV Quartz
- Replace UV Seal Kit
- Reset hour counter

Service Programme MAIN SERVICE

DAB Ezybox Booster Set
 Check and clear stored error messages

Sediment filter
 Replace filters

Chlorine Dosing Unit x 2
 Check chlorine levels
 Replace chlorine dosing service kits
 Check operation
 Refill reservoirs

Water storage tank
 Check and clean as necessary

Mains Emergency Supply
 Check operation of purge system
 Check operation of MAV and clean diaphragm

General
 Check plant room to ensure it is vermin proof
 Dust / wipe down all plant units and equipment
 Check water meters
 Check all gate valves are back in correct position
 Remove all rubbish and redundant parts
 Confirm the presence of the WSP and EP
 Remote checking of the Telemetry system
 Ensure the service and maintenance records are up to date on completion of works

During the service, if any system components are found to be functioning incorrectly, we will make you aware of this, and discuss whether a repair can be undertaken, or a replacement unit is necessary. If any additional materials required are available at time of service, the Engineer will replace as necessary, and you will be invoiced separately.

Service Programme TANK CLEAN

TANK CLEAN
1 x full day @ 3 x engineers

During the tank clean, if any system components are found to be functioning incorrectly, we will make you aware of this, and discuss whether a repair can be undertaken, or a replacement unit is necessary. If any additional materials required are available at time of service, the Engineer will replace as necessary, and you will be invoiced separately.

APPENDIX H – SUGGESTED S106 OFFSETTING SITE OWNER OBLIGATIONS

The obligations below are based on current agreements being negotiated with HDC. These are to be negotiated between:

- the LPA
- the Site Owner (i.e. the owner of the land on which the Water Off-Setting Works are to be carried out (“the Water Neutrality Land”)); and
- the Developer/Applicant, the owner of the Development Site the subject of the Application

Part 1

Schedule XX - The Site Owner’s Covenants Restrictions and Obligations to the Council

The Site Owner covenants with the Council so as to bind its interest in the Water Neutrality Land to ensure that the following obligations in relation to the Water Neutrality Land are delivered for the lifetime of the Development as follows:

1. Subject to paragraph 2 below:
 - 1.1 to implement the Water Offsetting Solution on the Water Neutrality Land and provide written and/or photographic evidence to the Council demonstrating that the Water Offsetting Solution has been implemented and is operational prior to the Occupation of any Dwellings on the Development Site. The Council will acknowledge receipt of this evidence and, providing it is satisfactory, confirm in writing to the submitting party that this obligation has been met and is thereby discharged within 30 days of receipt. The Council’s discharge of this obligation does not release the Site Owners from the other obligations set out in this schedule; The evidence will be deemed satisfactory providing it includes:
 - (a) Photographs of the installed borehole, plant room, storage tank and pipework connecting the storage tank to the Site’s distribution network.
 - (b) Photographs of the borehole supply meter at the start and end of a five day period showing an average daily consumption equal to the amount specified in the Water Offsetting Solution.
 - (c) Evidence of the Environmental Health Officer’s approval that the borehole supply meets the required quality standard for potable water
 - 1.2 to manage and maintain and keep in good repair at all times the Water Offsetting Solution (subject to any minor amendments as may be agreed between the Site Owner and the Council in writing from time to time) for the lifetime of the implementation of the Planning Approval on the Development; and
 - 1.3 afford the Council (and its agent) access between the hours of 0900 and 1700 on a working day provided that the Council (or its agent) shall give the Site Owner not less than 72 hours’ notice to the Site to inspect and assess whether or not the Water Offsetting Solution has been implemented on the Site and is being maintained in accordance with the Water Offsetting Solution provided always that:
 - (a) the Council and its agent shall comply fully with the Site Owner’s reasonable site rules and regulations applicable as at the time of access throughout the duration of such inspection and with health and safety legislation, policy and best practice; and
 - (b) the Council and its agents shall at all times be accompanied by the Site Owner or its agent.
2. In the event that the Council approves in writing that the Water Offsetting Solution is no longer required to be delivered on the Site to achieve Water Neutrality then the obligations in relevant Schedule XX shall determine and cease to have legal effect and the Site shall no longer be bound by the terms of this deed.

Part 2

Schedule YY - The Developer's Obligations

1. The Developer covenants with the Council so as to bind its interest in the Development Site not to permit occupation of an individual dwelling until the on-site water neutrality measures as set out in the Water Neutrality Statement have been implemented in relation to that dwelling, i.e. the subject of the relevant occupation.
2. The Developer covenants with the Council so as to bind its interest in the Development Site not to permit occupation of an individual dwelling until the off-site water neutrality measures as set out in the Water Neutrality Statement have been implemented.

Groundwater Investigation Report – Offsetting Scheme

Site: South Lodge, Hotel and Spa, Brighton Road, Lower Beeding, Horsham RH13 6PS

SOUTH LODGE



Client: South Lodge Hotel and Spa

Report reference: BH1520 GWI Version: 1

Date: 19th August 2024

Co-author: George Parker – Project Manager Nicholls Boreholes



Co-author: Dr Stephen Buss MA MSc FGS CGeol – Consulting Hydrogeologist



Contents

1.0	Introduction	3
2.0	Water Neutrality and Conservation	3
3.0	Site Description.....	3
3.0	Exploratory Work and Water Quality Testing	4
3.1	Rotary Boreholes	4
4.0	Ground Conditions	5
	Topsoil.....	5
	Upper Tunbridge Wells Formation	5
	Grinstead Clay Formation	5
4.1	Groundwater	6
4.2	Pumping Tests	6
5.0	Raw Borehole Water Quality Testing	6
6.0	Source Protection.....	7
7.0	Concept Design.....	7
8.0	Regulatory Compliance	9
8.1	Sampling and Testing Regime.....	9
8.2	Maintenance and Servicing	9
8.3	Record Keeping.....	9

Appendices

Appendix A	Site location and borehole location plans
Appendix B	Borehole logs
Appendix C	Water quality analysis results
Appendix D	Treatment plant concept design

1.0 Introduction

As part of the water offsetting scheme at South Lodge Hotel and Spa, Brighton Road, Lower Beeding, Horsham RH13 6PS (Appendix A.1) two boreholes are required to provide a duty standby regime for provision of the water supply to the spa. Nicholls Boreholes constructed and tested two abstraction water wells in April 2024 in accordance with EA consent number S/2024/340. Included within the GIC document, a monitoring borehole was required to be drilled in order monitor the influence on groundwater when pumping of the 2 abstraction wells at 2 water sources of interest, c. 250m South-East of the abstraction wells.

Prior to the EA abstraction and the water usage can switch wholly away from mains.

This report describes the site works and includes the results of water quality testing. A factual report was requested by the local authority, Horsham Borough Council, to support the planning application.

2.0 Water Neutrality and Conservation

Lower Beeding is in the catchment of the River Adur, on the southern slope of a broad hill that is formed out of the Tunbridge Wells Sand Formation outcrop. The northern part of the hill, which is in the catchment of the River Arun, is at least 1.9 km distant from the abstraction boreholes. This location is not in the Hardham Basin (Folkestone Beds) or the Chichester and Worthing Chalk.

Being 1.9 km distant from the River Arun catchment means that there is no feasible hydrogeological linkage between the abstraction and the River Arun. Therefore, abstraction will not also take water from the Arun Valley habitat sites, or any river catchment that serves the Arun Valley basin.

The closest conservations sites are 3.7 km to the north of the boreholes: St. Leonard's Forest SSSI. This is so far from the site that it is not feasible that there would be an impact on the conservation site.

3.0 Site Description

A summary description of the site and its general setting is as follows. The site address is South Lodge, Hotel and Spa, Horsham RH13 6PS. The immediate environs of the boreholes are the hotel's car park, with woodland to the north. The ground around each borehole is fairly flat and level, but overall slopes southwards.

The current site features are shown on the site plan included in Appendix A.1.

3.0 Exploratory Work and Water Quality Testing

All of the Nicholls Boreholes lead drillers are NVQ Level 2 Land Drilling accredited, which is a nationally recognised qualification promoted and run by the British Drilling Association. Nicholls is also a member of the Water Reg UK advisory body.

3.1 Rotary Boreholes

Two abstraction boreholes and one monitoring borehole were constructed in accordance with the instructions on Environment Agency consent number S/2024/340 using rotary flush technique.

Abstraction Borehole 1

Location:	TQ 21748 25498
Ground level:	71.7 m AOD (from Environment Agency LIDAR data)
Drilling date:	04-04-2024 to 11-04-2024
Construction details:	Rotary technique with recirculating mud flush. Drilled at 300mm diameter to a depth of 36m, with 200mm solid steel casing lined to 36m. Drilled at 200mm diameter to a depth of 62m. Slotted 125mm UPVC liner was installed from 61m to 35.25m and solid 125mm UPVC liner was installed from 35.25m to ground level.

Abstraction Borehole 2

Location:	TQ 21665 25459
Ground level:	68.6 m AOD (from Environment Agency LIDAR data)
Drilling date:	16-04-2024 to 18-04-2024
Construction details:	Rotary technique with recirculating mud flush. Drilled at 300mm diameter to a depth of 30m, with 200mm solid steel casing lined to 30m. Drilled at 200mm diameter to a depth of 62m. Slotted 125mm UPVC liner was installed from 61m to 32.5m and solid 125mm UPVC liner was installed from 32.5m to ground level.

Monitoring Borehole

Location:	TQ 21799 25264
Ground level:	55.5 m AOD (from Environment Agency LIDAR data)
Drilling date:	30-04-2024
Construction details:	Rotary technique with recirculating mud flush. Drilled at 100mm diameter to a depth of 15m. Borehole lined with 75mm slotted liner from 15m to 1m. Solid 75mm UPVC liner was installed from 1m to ground level.

4.0 Ground Conditions

Published BGS information (1:50 000 scale maps) indicates that the site is underlain by the Upper Tunbridge Wells formation consisting primarily of sandstone and mudstones. Underlying this is the Grinstead Clay formation. This was confirmed when drilling, although the sandstones were not identified as a discrete layer. The strata encountered are summarised below.

Topsoil

At both boreholes 1 and 2 topsoil comprised c. 0.5 m of medium soft, moist light brown organic silty clay and frequent roots and rootlets. At the monitoring borehole topsoil comprised c. 1.5 m of medium soft, yellow brown clay with interstitial mudstone.

Upper Tunbridge Wells Formation

This stratum was encountered through from 0.5m to 61m in both of the abstraction boreholes, and to 15 m in the observation borehole.

In general, the Tunbridge Wells Formation was found to comprise dominantly clay layers, and mudstone layers, with various degrees of silt as part of the rock matrix and as interbeds.

Grinstead Clay Formation

At 62m in boreholes 1 and 2 Grinstead Clay was encountered as a firm pale grey silty clay. Drilling was stopped at this geology change and the boreholes were backfilled 1 m with bentonite pellets.

4.1 Groundwater

Groundwater observations were not made during drilling as the use of mud flush obscures water strikes. Subsequent groundwater level observations, around the time of pumping tests are tabulated below.

	BH1	BH2	Monitoring BH
Borehole datum elevation	71.7 m AOD	68.6 m AOD	55.5 m AOD
April 2024	21.9 m // 49.80 m AOD	19.7 m // 48.90 m AOD	<i>no data, not completed in this time</i>
May 2024	22.12 m // 49.58 m AOD	19.65m // 48.95 m AOD	6.5 m // 49.0 m AOD
August 2024	22.64 m // 49.06 m AOD	20.31 m // 48.29 m AOD	6.5 m // 49.0 m AOD

4.2 Pumping Tests

Stephen Buss Environmental Consulting (2024) reviewed pumping test data from borehole BH1, which was tested between 7 and 9 May 2024. The borehole was shown to be easily capable of maintaining an abstraction rate of 20 m³/day. The conclusion of the assessment was that the borehole would be capable of maintaining that rate in the long term, even when considering seasonal fluctuation.

5.0 Raw Borehole Water Quality Testing

A Group A+B water sample was taken from BH1 on 9th May 2024, BH 2 will be sampled during the EA summer testing window.

BH1 Water samples were collected from the base of the well at pump depth on the 9th May 2024 after a period of over 3 hours of continuous running to ensure a representative sample. These were collected and stored in a refrigerated container and shipped straight to the SE Water Scientific Services lab in Farnborough. The report was produced on the 30th May 2025.

Water samples were taken by a Nicholls engineer certified by CATG to sample boreholes according to the DWI certification of persons scheme. This means that: samples are representative of the water at the sampling point at the time of sampling (the boreholes were purged a minimum three hours before sampling), that samples are not contaminated in the course of being taken; and that samples are kept at such a temperature and in such

condition as will secure that there is no material change in what is to be measured, and analysed without delay.

Water samples were analysed by South East Water Scientific Services, which is a UKAS accredited lab (as shown on the lab certificates in Appendix C). When results shown in Appendix C are compared with the standards in Schedule 1 of the Private Water Supplies (England) Regulations (2016), elevated concentrations of iron, manganese, ammonium, turbidity and coliforms (including enterococci) were apparent.

NB - The bacterium level, is likely to come from the development pump installation process rather than within the well itself because it is seen at such a low concentration. Whilst all our equipment is sanitised prior to each installation, we cannot guarantee low levels of bacteria influencing the results.

6.0 Source Protection

Development of a water supply borehole leads to the creation of a default 50 m radius source protection zone (SPZ). Appendix D shows the 50 m radii over Google Earth imagery from March 2022, with land ownership boundaries from August 2024.

This image shows that the area is mostly woodland around BH2, and to the north of BH1, with parking to the south of BH1 and east of BH2. The parking area is gravel over clayey bedrock and slopes southwards: ground level falls 3 m over the parking area.

Most (87%) of the land within the SPZ is owned by the hotel owner, currently Exclusive Hotels Group. The strip of land to the north of the hotel is a gravel driveway to a private dwelling which also holds a public right of way.

Activities that are prohibited within a SPZ1 are potentially very polluting such as landfilling, construction of filling stations or chemical works etc. none of which are anticipated in this environment. Normal domestic activities are not prohibited within a SPZ1. The construction of SUDS soakaways, for instance, is not prohibited; though unless they are for rainwater only a risk assessment should be submitted to the Environment Agency.

Full details of the activities that are and are not permitted are contained within the Environment Agency's groundwater protection position statements (www.gov.uk/government/publications/groundwater-protection-position-statements) and are frequently updated. These restrictions will be included in the O&M manual for the treatment works. When the abstraction is licensed the Environment Agency will be able to regulate development within the SPZ.

7.0 Concept Design

The filtration system as designed below, will use 20 m³ per day supplied from the borehole before switching to the mains supply to meet the remainder of the hotel's daily requirements.

This switch of supply has been designed to be compliant with Category 5 regulations. Furthermore, the system is designed to accommodate the higher volume 83 m³ daily demand once the EA license has been granted. Using the design in appendix D you can follow the flow of water through the system with the text below.

- The pH correction unit will raise the pH of the water, to more effectively treat the parameters above the UK drinking limit.
- The water then fills a contact tank, where both compressed air and chlorine are added. This process will drop the Manganese out of solution in order for it to be filtered more easily later in the system. The chlorination of the water will also convert the Ammonium into chloramines, which will be filtered out later in the process.
- The water is then passed through a turbidity filter to remove particulate, including FEIII iron.
- The water will then pass through an Iron filter unit to reduce the iron content of the water below the UK drinking limit.
- The water then passes through a polishing unit in order to reduce the manganese levels below the UK drinking limit, having pre-treated the manganese in the second stage.
- The water will then pass through a carbon filter, which will remove excess chlorine and the chloramines formed as the by product in the aeration tank.
- The water will be passed through a UV filter in order to kill bacteria including cryptosporidium, before it is passed into a tank.
- The water will then enter the storage tank. A chlorine dosing unit will cycle water through a separate line monitoring chlorine concentration in the water. This dosing unit will maintain a set chlorine level in order to kill the bacteria in the tank and ensure free chlorine levels are kept to the required volume.
- The multistage booster set shown is an existing pump set in the plant room of the hotel, and therefore is sized appropriately. The new filtration system will be plumbed into this existing network.
- Post booster, the water passes through a high flow sediment filter, which will ensure that any sediment that remains in the water after the filtration process or picked up from the tank, is reduced below the UK limit. The water is then distributed through the network.
- Telemetry – throughout the system telemetry links to all the filtration and treatment stages. The telemetry system will input a level of automatic control on the system. Additionally, the telemetry will be monitored remotely, allowing easy diagnostics and system amendments as well as warnings which could help pre-empt potential maintenance requirements.
- The water storage tank will have a CAT 5 complaint turret which will provide an emergency mains backup supply, should there be a system outage or failure within the filtration, ensuring the hotel maintains an adequate supply of water.

8.0 Regulatory Compliance

8.1 Sampling and Testing Regime

In accordance with the Private Water Supplies (England) Regulations 2016 Regulation 9, for which the hotel falls under, monitoring of the parameters will be as listed in Part 1 of schedule 1, analysed twice per year, and monitoring of parameters in part 2 of schedule 1, analysed twice per year. Sampling over the requirements of Part 1 and 2 of Schedule 1 will additionally be carried out as outlined in the local authority risk assessment at the specified intervals. The contaminants that have already been analysed in excess of the standards (as laid out in Schedule C.1) are included within Part 1 of schedule and as such will be sampled twice per year.

In the case of a failure to any of the parameters the Hotel will be supplied with mains water through the compliant mains water backup built into the filtration system. This will ensure that the hotel will maintain a wholesome supply. Once the mains supply has been implicated, the hotel will engage with a competent organization to carry out a full investigation into the cause of the failure and rectify the cause. The outcome of the investigation will ultimately dictate the additional required monitoring and potential maintenance that will be implemented on to area of the system deemed to have failed. Full details of the investigation procedure will be provided within the Water Safety Plan.

8.2 Maintenance and Servicing

Servicing will be required at quarterly intervals throughout the year to ensure the system is maintained to continue to deliver a wholesome supply at all times. In addition to the maintenance, regular visual inspections will be carried out in accordance with the stipulations from the local authority. Servicing arrangements will also include any additional requirements as identified as by the local authority.

Full details of the servicing will be provided within the Water Safety Plan.

In the event of equipment failure, a stock of replacement parts will be kept within the plant room to ensure that the supply can be re-initiated as soon as possible. In the event that the supply from the boreholes is interrupted, the mains backup will be implemented to ensure a wholesome supply to the hotel. Full details of the equipment failure procedure will be provided within the Water Safety Plan.

8.3 Record Keeping

Servicing and sampling records will be completed after each service and a hard copy of these will be kept in the plant room within the Water Safety Plan, with a digital copy being provided to the hotel and retained by the service provider. Full details of the required record keeping will be provided in the Water Safety Plan.

APPENDIX A.1



Borehole record form



British Geological Survey
NATURAL ENVIRONMENT RESEARCH COUNCIL



Environment Agency

Water Resources Act 1991 (as amended by the Water Act 2003)

A Site details

Borehole drilled for

Location

NGR (ten digits) Please attach site plan

Ground level (if known) metres Above Ordnance Datum

Drilling company

Date drilling commenced (DD/MM/YYYY) Completed (DD/MM/YYYY)

B Construction details

Borehole datum (if not ground level) metres (m). Please tick if this is above or below ground level. (point from which all measurements of depth are taken, for example, flange, edge of chamber)

Borehole drilled diameter mm from to m/depth
 mm from to m/depth
 mm from to m/depth
 mm from to m/depth

Casing material diameter mm from to m/depth and type (for example, if plain steel, plastic slotted). Please record permanent casing details, not temporary casing.

Casing material diameter mm from to m/depth

Casing material diameter mm from to m/depth

Casing material diameter mm from to m/depth

Grouting details

Water struck at 1. m (depth below datum – mbd) 2. m (mbd)
 3. m (mbd) 4. m (mbd)

C Test pumping summary (Please supply full details on form WR39)

Test pumping datum m. Please tick if this is above or below ground level. (if different from borehole datum)

Pump suction depth mbd

Water level (start of test) mbd

Water level (end of test) mbd

Type of test (for example, bailer, step, constant rate)

Pumping rate m³/hour or litres/second . Please tick as appropriate.
 for days, hours, mins

Recovery to mbd in days, hours, mins (from end of pumping)

Date(s) of measurements Pump started (DD/MM/YYYY)
 Pump stopped (DD/MM/YYYY)

Please supply chemical analysis if available. If you have included this please tick this box

APPENDIX B.1 cont'd

Project South Lodge Hotel				BOREHOLE No 1a	
Job No AL162 / BH1520	Date 11-04-24 15-04-24	Ground Level (m)	Co-Ordinates ()		
Contractor Nicholls				Sheet 1 of 1	

SAMPLES & TESTS			Water	STRATA				Geology	Instrument/ Backfill
Depth	Type No	Test Result		Reduced Level	Legend	Depth (Thickness)	DESCRIPTION		
						0.50	TOP SOIL: Medium soft very moist light brown organic silty CLAY. Frequent roots and rootlets.		
						2.00	Medium firm brown very clayey silty MUDSTONE.		
						(5.00)	Medium firm dark yellow brown very clayey MUDSTONE.		
						7.00	Firm light blue silty CLAY and reddish brown MUDSTONE.		
						(11.00)			
						18.00	Firm dark brown red silty MUDSTONE.		
						(16.00)			
						34.00	Firm light blue silty CLAY with mudstone.		
						36.00	Firm light blue grey silty CLAY with mudstone.		
						(25.00)			
						61.00	Firm pale grey silty CLAY (Grinstead clay)		
						62.00			

Boring Progress and Water Observations						Chiselling			Water Added		GENERAL REMARKS
Date	Time	Depth	Casing Depth	Casing Dia. mm	Water Dpt	From	To	Hours	From	To	
											Service avoidance procedure followed. Rotary open hole No visual or olfactory signs of contamination.

All dimensions in metres Scale 1:393.75	Client South Lodge Hotel	Method/ Plant Used Massenza	Logged By SP
--	-----------------------------	-----------------------------------	-----------------

Borehole record form



Water Resources Act 1991 (as amended by the Water Act 2003)

A Site details

Borehole drilled for

Location

NGR (ten digits) Please attach site plan

Ground level (if known) metres Above Ordnance Datum

Drilling company

Date drilling commenced (DD/MM/YYYY) Completed (DD/MM/YYYY)

B Construction details

Borehole datum (if not ground level) metres (m). Please tick if this is above or below ground level. (point from which all measurements of depth are taken, for example, flange, edge of chamber)

Borehole drilled diameter

<input type="text" value="300"/>	mm from	<input type="text" value="0"/>	to	<input type="text" value="30"/>	m/depth
<input type="text" value="200"/>	mm from	<input type="text" value="30"/>	to	<input type="text" value="82"/>	m/depth
<input type="text"/>	mm from	<input type="text"/>	to	<input type="text"/>	m/depth
<input type="text"/>	mm from	<input type="text"/>	to	<input type="text"/>	m/depth

Casing material diameter mm from to m/depth and type (for example, if plain steel, plastic slotted). Please record permanent casing details, not temporary casing.

Casing material diameter mm from to m/depth

Casing material diameter mm from to m/depth

Casing material diameter mm from to m/depth

Grouting details

Water struck at

1. <input type="text"/>	m (depth below datum – mbd)	2. <input type="text"/>	m (mbd)
3. <input type="text"/>	m (mbd)	4. <input type="text"/>	m (mbd)

C Test pumping summary (Please supply full details on form WR39)

Test pumping datum m. Please tick if this is above or below ground level. (if different from borehole datum)

Pump suction depth mbd

Water level (start of test) mbd

Water level (end of test) mbd

Type of test (for example, bailer, step, constant rate)

Pumping rate m³/hour or litres/second . Please tick as appropriate.
for days, hours, mins

Recovery to mbd in days, hours, mins (from end of pumping)

Date(s) of measurements Pump started (DD/MM/YYYY)
Pump stopped (DD/MM/YYYY)

Please supply chemical analysis if available. If you have included this please tick this box

APPENDIX B.2 cont'd

Project South Lodge Hotel				BOREHOLE No 2	
Job No AL162 / BH1520	Date 16-04-24 18-04-24	Ground Level (m) TQ 21666 25470	Co-Ordinates ()		
Contractor Nicholls				Sheet 1 of 2	

SAMPLES & TESTS			STRATA					Geology	Instrument Backfill
Depth	Type No	Test Result	Water	Reduced Level	Legend	Depth (Thickness)	DESCRIPTION		
			↓			0.50 (6.00) 6.50	TOP SOIL: Medium soft very moist light brown orange organic friable silty CLAY. Frequent roots and rootlets. Medium firm dark yellow very clayey MUDSTONE.		
							(11.00) 17.50		Medium firm light blue grey silty CLAY and reddish brown MUDSTONE.
							(12.50) 30.00		Firm dark brown reddish silty MUDSTONE with interstitial ferrous staining.
							(20.00) 50.00		Medium firm grey silty MUDSTONE.
							(12.00) 61.00		Firm light blue silty CLAY and MUDSTONE.
							62.00		Firm pale grey silty CLAY (Grinstead clay)

Boring Progress and Water Observations					Chiselling			Water Added		GENERAL REMARKS
Date	Time	Depth	Casing Depth	Water Dpt	From	To	Hours	From	To	
										Service avoidance procedure followed. Rotary open hole No visual or olfactory signs of contamination.

All dimensions in metres Scale 1:393.75	Client South Lodge Hotel	Method/ Plant Used Massenza	Logged By MC
--	-----------------------------	-----------------------------------	-----------------

Borehole record form



British Geological Survey
NATURAL ENVIRONMENT RESEARCH COUNCIL



Environment Agency

Water Resources Act 1991 (as amended by the Water Act 2003)

A Site details

Borehole drilled for

Location

NGR (ten digits) Please attach site plan

Ground level (if known) metres Above Ordnance Datum

Drilling company

Date drilling commenced (DD/MM/YYYY) Completed (DD/MM/YYYY)

B Construction details

Borehole datum (if not ground level) metres (m). Please tick if this is above or below ground level. (point from which all measurements of depth are taken, for example, flange, edge of chamber)

Borehole drilled diameter mm from to m/depth

mm from to m/depth

mm from to m/depth

mm from to m/depth

Casing material diameter mm from to m/depth and type (for example, if plain steel, plastic slotted). Please record permanent casing details, not temporary casing.

Casing material diameter mm from to m/depth

Casing material diameter mm from to m/depth

Casing material diameter mm from to m/depth

Grouting details

Water struck at 1. m (depth below datum – mbd) 2. m (mbd)

3. m (mbd) 4. m (mbd)

C Test pumping summary (Please supply full details on form WR39)

Test pumping datum m. Please tick if this is above or below ground level. (if different from borehole datum)

Pump suction depth mbd

Water level (start of test) mbd

Water level (end of test) mbd

Type of test (for example, bailer, step, constant rate)

Pumping rate m³/hour or litres/second . Please tick as appropriate. for days, hours, mins

Recovery to mbd in days, hours, mins (from end of pumping)

Date(s) of measurements Pump started (DD/MM/YYYY)

Pump stopped (DD/MM/YYYY)

Please supply chemical analysis if available. If you have included this please tick this box

WR38: Borehole record form

D Strata log

Geological classification (BGS only)	Description of strata	Thickness m	Depth (to base of strata) m
	<p>yellow / brown clay with interstitial mudstone</p> <p>light grey, soft, very fine sand / siltstone with brown mudstone</p> <p>medium grey siltstone with brown mudstone</p> <p>grey brown silty mudstone</p> <p>(continue on separate page if necessary)</p>	<p>1.5</p> <p>6.5</p> <p>2</p> <p>5</p>	<p>1.5</p> <p>8</p> <p>10</p> <p>15</p>
	<p>Other comments (for example, gas encountered, saline water intercepted)</p>		

APPENDIX C.1

South East Water Scientific Services
 3 Columbus Drive, Farnborough
 Hampshire, GU14 0NZ
 E-Mail: sales@southeastwater.co.uk
 Website: www.southeastwater.co.uk



ANALYTICAL REPORT

Page 1 of 3

NICHOLLS BOREHOLES

**Brownings Barn
 Glasshouse Lane
 Kirdford
 West Sussex
 RH14 0LW**

Collected From: BRIGHTON ROAD, LOWER BEEDING, HARSHAM RH13 6PS

Date Received: 09/05/2024

Certificate Number:

1248571-3 Final
 Supercedes report 1248571-2

Order Number:

BH1520

Date Reported:

30/05/2024

Lab Ref.	Sample Details	Method	Test	Result	Units	Limit	Flag
4761624	Desc: RAW BOREHOLE WATER BH1520BH1	255	Ammonium (Ammonia and Ammonium Ions)	0.651	mg/l	<0.500	F
	Collect From: BRIGHTON ROAD, LOWER BEEDING, HARSHAM RH13 6PS	215	Chloride	24.78	mg/l	<250.00	
		245	Nitrate	<0.9	mg/l	<50.0	
	Order No: BH1520	225	Nitrite	<0.004	mg/l	<0.500	
	Received Date: 09/05/2024	calc	Nitrite/Nitrate	0.000	mg/l	<1.000	*
	Tested Date: 09/05/2024	305	Sulphate	67.6	mg/l	<250.0	
	Sampling Date: 09/05/2024 11:00	205	Total Hardness	28.1	mg/l		
	Sample Type: GW : Ground Water	230	Odour - Qualitative	None			*
	Product: SS-DWREGS	230	Odour - Quantitative	0			
		430	Colony Count 3 Days at 22°C	>300	cfu/ml		
		400	E coli	0	mpn/100ml	0	
		400	Total Coliforms	1	mpn/100ml	0	F
		660	Colour	<2	mg/l Pt/Co	<20	
		660	Conductivity	414	uS/cm		
		660	Hydrogen Ion (pH)	6.8	pH_unit	6.5 to 9.5	
		660	Turbidity	47.000	NTU	<4.000	F
		ext	Epichlorhydrin	<0.1	µg / l	<0.10	*
		3401	Bromate	<0.8	µg / l	<10.0	
		390	Enterococci	1	cfu/100ml	0	F
		5413	Total Cyanide	<4.1	µg / l	<50.0	
		765	Mercury	<0.04	µg / l	<1.00	
		745	Antimony	0.3	µg / l	<5.0	
		745	Arsenic	1.7	µg / l	<10.0	
		745	Selenium	<0.8	µg / l	<10.0	
		740	Boron	0.219	mg/l	<1.000	
		740	Sodium	60.1	mg/l	<200.0	
		3371	Fluoride	0.182	mg/l	<1.500	
		3545	2,4,5-T	<0.007	µg / l	<0.100	
		3545	2,4-D	<0.007	µg / l	<0.100	
		3545	Bentazone	<0.007	µg / l	<0.100	
		3545	Bromoxynil	<0.007	µg / l	<0.100	

Disclaimers:

Unless otherwise stated, all results apply to the sample as received. Information provided by the customer (includes Date, Time, Sample Matrix & Sample Description) can affect the validity of the result.

Opinions and interpretations expressed in this report are outside the scope of UKAS accreditation.

Details of Uncertainty of Measurement and Analytical Quality Control are available on request.

Where a statement of conformity to a Regulatory Standard or customer limit is provided, the uncertainty of measurement is not taken into account unless shown on the certificate.

* - denotes non UKAS accredited test

A result of 0 cfu denotes none found in volume analysed

F - Result Exceeds The Maximum Pcv As Defined In The Water Supply (Water Quality) (Amendment) Regulations 2018

ext - Analysis subcontracted to an external laboratory



1579

Certificate Number: 1248571-3 Final
 Supercedes report
 1248571-2
Order Number: BH1520

Lab Ref.	Sample Details	Method	Test	Result	Units	Limit	Flag
4761624	Continued from Page 1	3545	Dicamba	<0.020	µg / l	<0.100	
		3545	Dichlorprop	<0.003	µg / l	<0.100	
		3545	Fluroxypyr	<0.008	µg / l	<0.100	
		3545	MCPA	<0.008	µg / l	<0.100	
		3545	MCPB	<0.008	µg / l	<0.100	
		3545	Mecoprop (MCP)	<0.005	µg / l	<0.100	
		3545	Tridopyr	<0.015	µg / l	<0.100	
		2587	Atrazine	<0.002	µg / l	<0.100	
		2587	Carbendazim	<0.001	µg / l	<0.100	
		2587	Carbetamide	<0.002	µg / l	<0.100	
		2587	Chlortoluron	<0.003	µg / l	<0.100	
		2587	Diuron	<0.004	µg / l	<0.100	
		2587	Epoxiconazole	<0.003	µg / l	<0.100	
		2587	Flutriafol	<0.003	µg / l	<0.100	
		2587	Isoproturon	<0.003	µg / l	<0.100	
		2587	Linuron	<0.003	µg / l	<0.100	
		2587	Oxadixyl	<0.003	µg / l	<0.100	
		2587	Pendimethalin	<0.007	µg / l	<0.100	
		2587	Prometryn	<0.002	µg / l	<0.100	
		2587	Propazine	<0.002	µg / l	<0.100	
		2587	Simazine	<0.003	µg / l	<0.100	
		2587	Terbutryn	<0.002	µg / l	<0.100	
		2587	Trietazine	<0.004	µg / l	<0.100	
		480	Benzo (a) pyrene	<0.003	µg / l	<0.010	
		480	Benzo(1,12)perylene	<0.003	µg / l		
		480	Benzo(1,1,2)fluoranthene	<0.003	µg / l		
		480	Benzo(3,4)fluoranthene	<0.003	µg / l		
		480	Indeno(1,2,3-cd)pyrene	<0.003	µg / l		
		calc	PAH Total	0.000	ug/l	<0.100	*
		775	1,1,1 Trichloroethane	<0.60	µg / l		
		775	1,2-Dichloroethane	<0.12	µg / l	<3.00	
		775	Benzene	<0.02	µg / l	<1.00	
		775	Dibromochloromethane	<0.50	µg / l		
		775	Dichlorobromomethane	<0.43	µg / l		
		775	Tetrachloroethene	<0.15	µg / l	<10.00	
		calc	Tetrachloroethene/Trichloroethene- Sum	0.00	µg / l		*
		775	Tetrachloromethane	<0.11	µg / l	<3.00	
		calc	Total Trihalomethanes	0.00	µg / l	<100.00	*
		775	Tribromomethane	<0.60	µg / l		
		775	Trichloroethene	<0.10	µg / l	<10.00	
		775	Trichloromethane	<0.50	µg / l		
		730	Aluminium	121.5	µg / l	<200.0	
		730	Iron	5244.7	µg / l	<200.0	F
		730	Manganese	610.5	µg / l	<50.0	F
		735	Cadmium	<0.12	µg / l	<5.00	

Disclaimers:

Unless otherwise stated, all results apply to the sample as received. Information provided by the customer (includes Date, Time, Sample Matrix & Sample Description) can affect the validity of the result.
 Opinions and interpretations expressed in this report are outside the scope of UKAS accreditation.
 Details of Uncertainty of Measurement and Analytical Quality Control are available on request.
 Where a statement of conformity to a Regulatory Standard or customer limit is provided, the uncertainty of measurement is not taken into account unless shown on the certificate.
 * - denotes non UKAS accredited test
 A result of 0 cfu denotes none found in volume analysed
F - Result Exceeds The Maximum Pcv As Defined In The Water Supply (Water Quality) (Amendment) Regulations 2018
 ext - Analysis subcontracted to an external laboratory



1579

Certificate Number: 1248571-3 Final
 Supercedes report:
 1248571-2
Order Number: BH1520

Lab Ref.	Sample Details	Method	Test	Result	Units	Limit	Flag
4761624	Continued from Page 2	735	Chromium	<0.5	µg / l	<50.0	
		730	First Draw Copper	<0.009	mg/l	<2.000	
		730	First Draw Lead	<0.9	µg / l	<10.0	
		730	First Draw Nickel	<0.9	µg / l	<20.0	
		360	Clostridium perfringens (including spore)	0	cfu/100ml	0	
		calc	Pesticides - Total Substances	0.000	ug/l		*
		4170	Aldrin	<0.007	µg / l	<0.030	
		4170	Dichlobenil	<0.006	µg / l	<0.100	
		4170	Dieldrin	<0.007	µg / l	<0.030	
		4170	Gamma-HCH (Lindane)	<0.005	µg / l	<0.100	
		4170	Heptachlor	<0.008	µg / l	<0.030	
		4170	Heptachlor Epoxide	<0.005	µg / l	<0.030	
		4170	Propyzamide	<0.005	µg / l	<0.100	
		4170	Tri-allate	<0.005	µg / l	<0.100	
		295	Gross Alpha	<0.02	Bq/l	<0.10	
		295	Gross Beta	<0.28	Bq/l	<1.00	
		5374	Tritium	<8.5	Bq/l	<100.0	
		740	Magnesium	7.6	mg/l		
		730	Iron (Free)	<7.3	µg / l		
		ext	Vinyl Chloride	<0.113	µg / l	<0.500	
		ext	Acrylamide	<0.008	µg / l	<0.100	

Job number changed as requested



Richard Brown
 Laboratory Manager

Disclaimers:

Unless otherwise stated, all results apply to the sample as received. Information provided by the customer (includes Date, Time, Sample Matrix & Sample Description) can affect the validity of the result.

Opinions and interpretations expressed in this report are outside the scope of UKAS accreditation.

Details of Uncertainty of Measurement and Analytical Quality Control are available on request.

Where a statement of conformity to a Regulatory Standard or customer limit is provided, the uncertainty of measurement is not taken into account unless shown on the certificate.

* - denotes non UKAS accredited test

A result of 0 cfu denotes none found in volume analysed

F - Result Exceeds The Maximum Pcv As Defined In The Water Supply (Water Quality) (Amendment) Regulations 2018

ext - Analysis subcontracted to an external laboratory





1579

APPENDIX D



Source protection zone 1 boundaries in red. Land ownership boundaries in white.

APPENDIX E.1

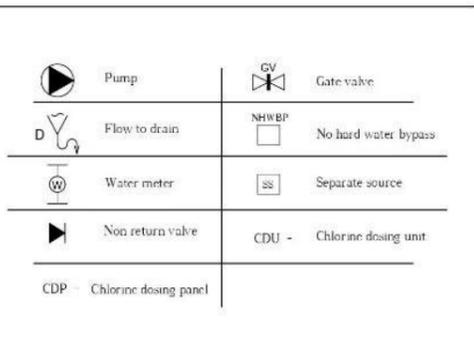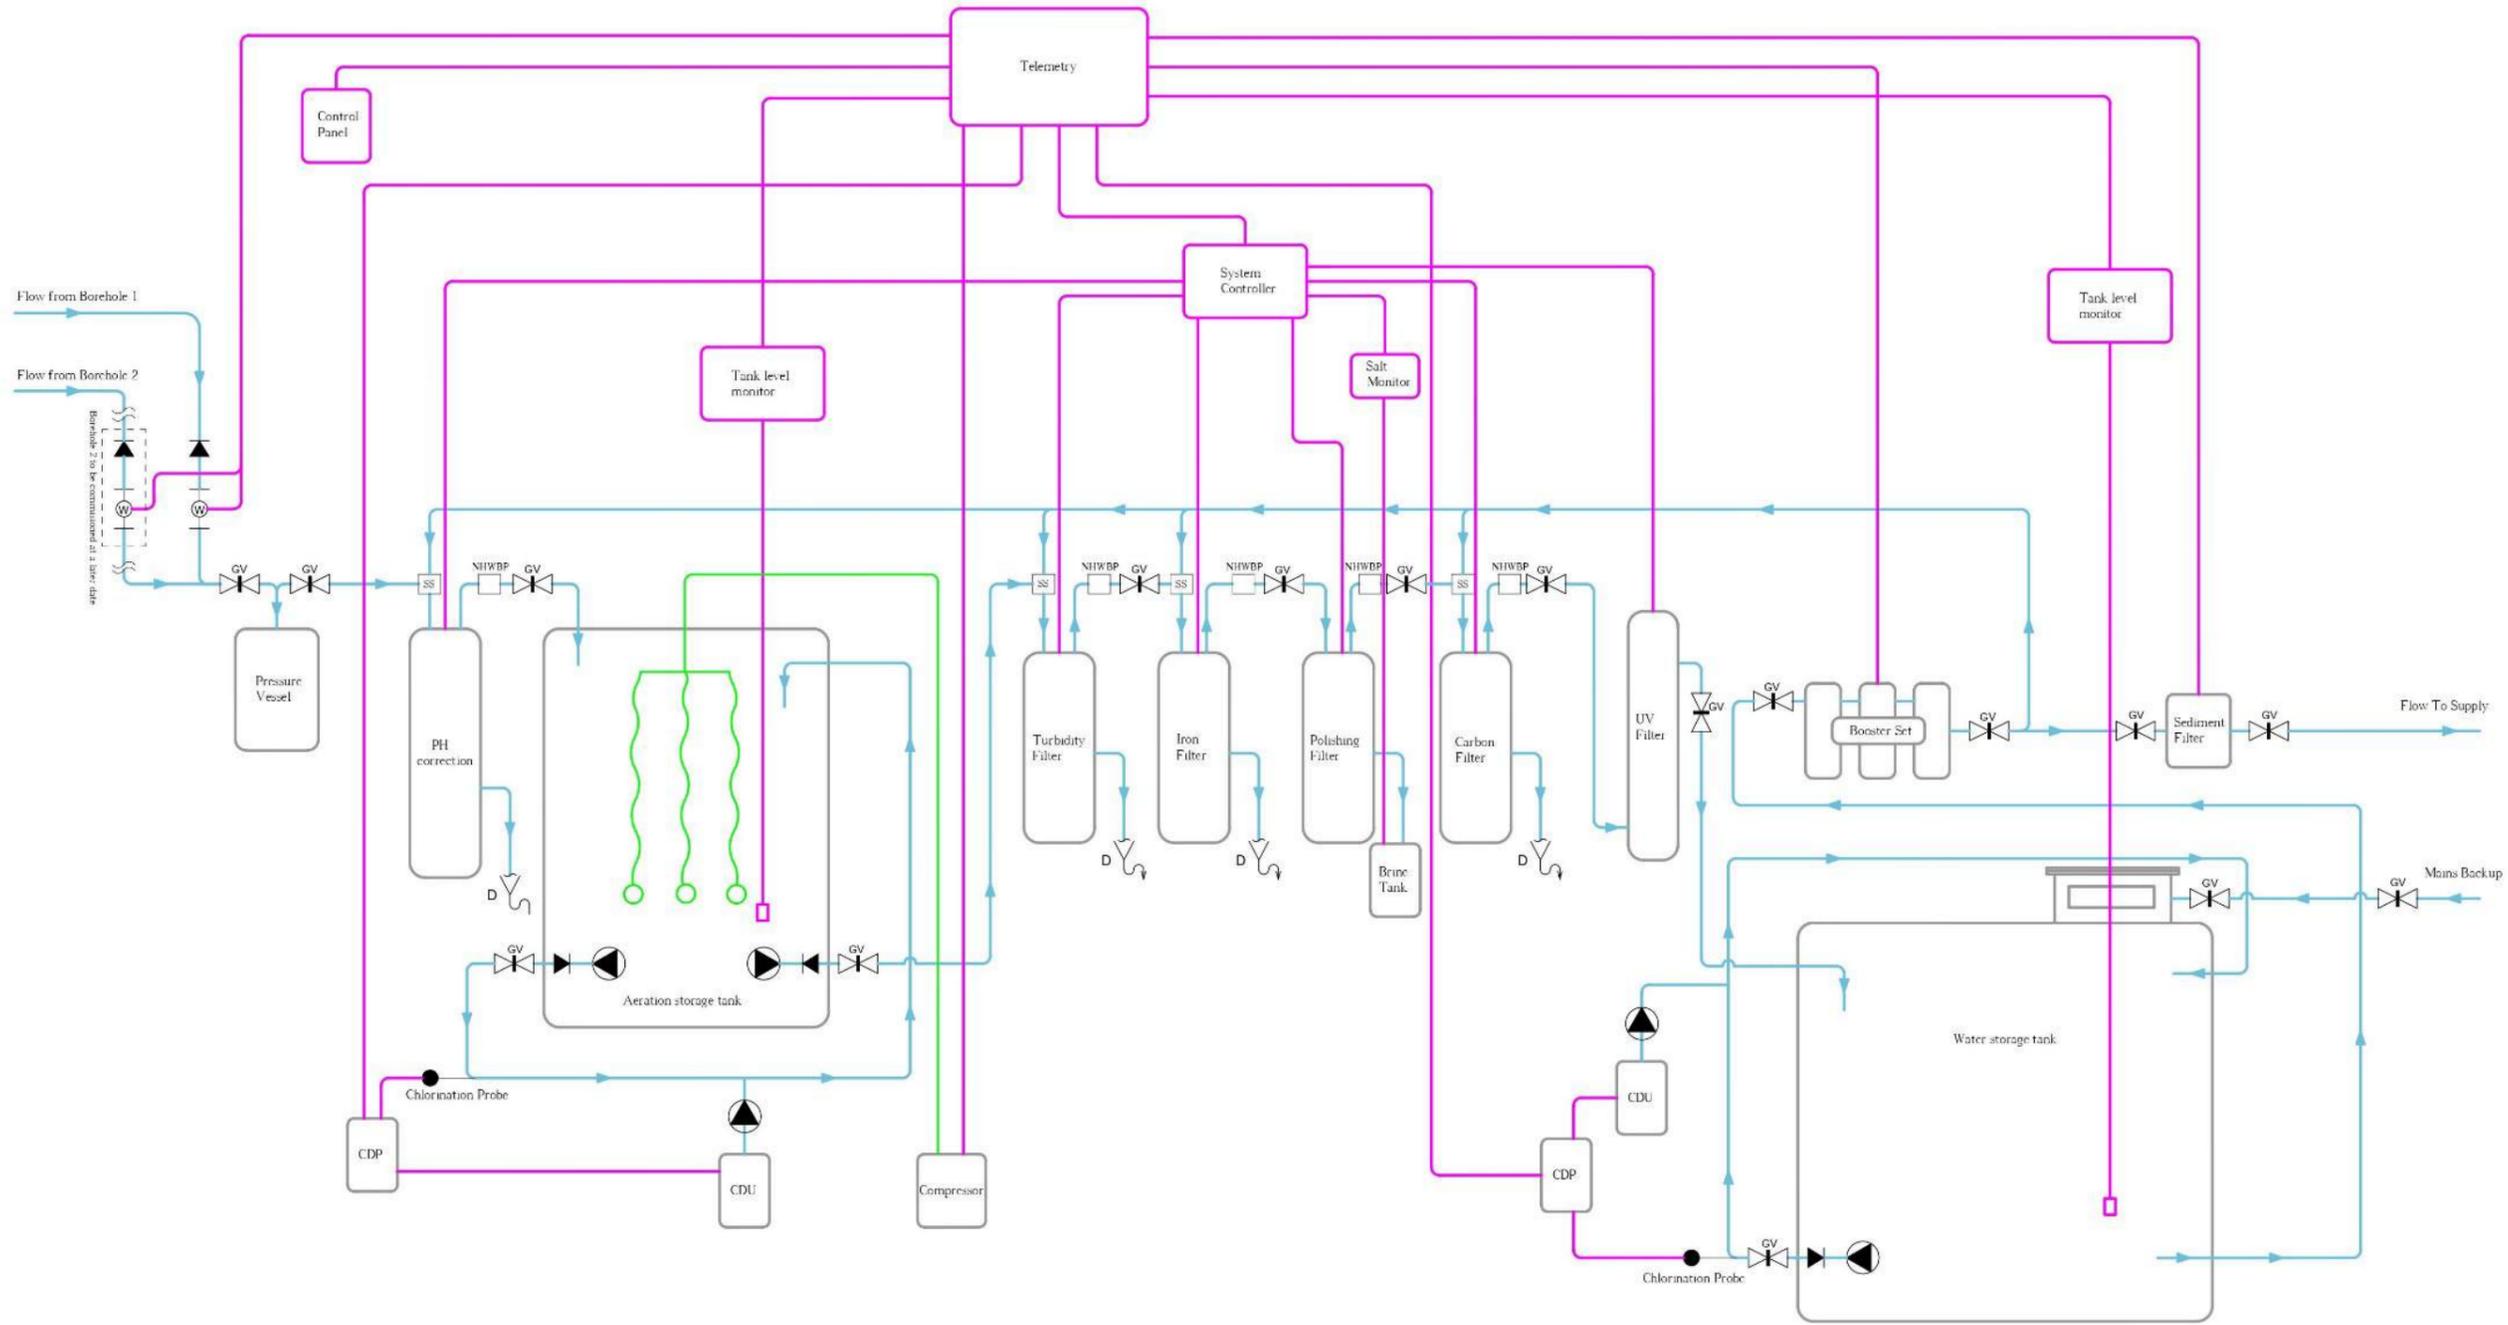

General Notes

Labour Division

Unless otherwise specified in Nicholls Bill of Quantities, all ground work, brick / block work and back filling of holes and trenches are to be priced and completed by others.

All pipe work and tanks are to be back filled with clean shingle to prevent damage to pipes.

Mains Power

Unless otherwise stated, mains power is to be provided to a IP56 Rated junction box with isolation switch at or near the plant room/borehole. All electrical connections to the mains supply as well as outlets are to be priced and completed by a qualified electrician. By others.

Water

Untreated borehole water is a category 5 supply and may harbour pathogens. A break gap of 30mm with header tank is required between the incoming mains and incoming borehole supplies.

See <http://www.wras.co.uk/> for more information.

Surface Water

Unless otherwise stated and agreed all well covers will be raised to prevent surface contamination. In some circumstances recessed covers would be acceptable but clients will need to be made aware of the risks involved.

Contractors Responsibility

It is the contractors/Clients responsibility to protect from damage any and all bespoke components installed on site by Nicholls.

Clients Responsibility

It is the clients responsibility to monitor usage and any filter equipment. This is to ensure there has been no damage by others during the surrounding works by others. Nicholls cannot be held liable for any cost incurred from damage caused by others.

Title:	BH1420 High Level Design
Client:	South Lodge Hotel
Date:	16/05/2024
Revision:	Rev000
Sheet:	1 of 1

Drawn:	Mr Adam Hardiman
Checked:	Mr George Parker
Indicative layout for design purposes only. Final position to be confirmed on site. Drawing is not to be scaled.	



Notes:

Date: 31 July 2024
Our ref: 482409
Your ref: DC/23/0290



Horsham District Council
Parkside
Chart Way
Horsham
West Sussex
RH12 1RL

Customer Services
Hornbeam House
Crewe Business Park
Electra Way
Crewe
Cheshire
CW1 6GJ

T 0300 060 3900

BY EMAIL ONLY

Dear Mr Holbrook,

Planning consultation: Reserved matters application for the erection of up to 62 residential units and the creation of a new vehicle access following approval of outline application DC/19/2015 relating to appearance, landscaping, layout, scale and associated works.

Location: Land Parcel North of Downsview Avenue, Storrington, West Sussex.

Thank you for your consultation on the above dated 15 July 2024 which was received by Natural England on the same date.

Natural England is a non-departmental public body. Our statutory purpose is to ensure that the natural environment is conserved, enhanced, and managed for the benefit of present and future generations, thereby contributing to sustainable development.

SUMMARY OF NATURAL ENGLAND'S ADVICE

NO OBJECTION - SUBJECT TO APPROPRIATE MITIGATION BEING SECURED

We consider that without appropriate mitigation the application would:

- have an adverse effect on the integrity of Arun Valley Special Area of Conservation (SAC), Special Protection Area (SPA) and Ramsar site
<https://designatedsites.naturalengland.org.uk/>.
- damage or destroy the interest features for which Chichester Harbour Site of Special Scientific Interest has been notified.

In order to mitigate these adverse effects and make the development acceptable, the following mitigation options should be secured:

- The delivery of mitigation measures outlined in the submitted Appropriate Assessment to achieve water neutrality.

We advise that an appropriate planning condition or obligation is attached to any planning permission to secure these measures.

Natural England's further advice on designated sites and advice on other natural environment issues is set out below.

Annex A –Natural England general advice

Protected Landscapes

Paragraph 182 of the [National Planning Policy Framework](#) (NPPF) requires great weight to be given to conserving and enhancing landscape and scenic beauty within Areas of Outstanding Natural Beauty (known as National Landscapes), National Parks, and the Broads and states that the scale and extent of development within all these areas should be limited. Paragraph 183 requires exceptional circumstances to be demonstrated to justify major development within a designated landscape and sets out criteria which should be applied in considering relevant development proposals. [Section 245](#) of the Levelling Up and Regeneration Act 2023 places a duty on relevant authorities (including local planning authorities) to seek to further the statutory purposes of a National Park, the Broads or an Area of Outstanding Natural Beauty in England in exercising their functions. This duty also applies to proposals outside the designated area but impacting on its natural beauty.

The local planning authority should carefully consider any impacts on the statutory purposes of protected landscapes and their settings in line with the NPPF, relevant development plan policies and the Section 245 duty. The relevant National Landscape Partnership or Conservation Board may be able to offer advice on the impacts of the proposal on the natural beauty of the area and the aims and objectives of the statutory management plan, as well as environmental enhancement opportunities. Where available, a local Landscape Character Assessment can also be a helpful guide to the landscape's sensitivity to development and its capacity to accommodate proposed development.

Wider landscapes

Paragraph 180 of the NPPF highlights the need to protect and enhance valued landscapes through the planning system. This application may present opportunities to protect and enhance locally valued landscapes, including any local landscape designations. You may want to consider whether any local landscape features or characteristics (such as ponds, woodland, or dry-stone walls) could be incorporated into the development to respond to and enhance local landscape character and distinctiveness, in line with any local landscape character assessments. Where the impacts of development are likely to be significant, a Landscape and Visual Impact Assessment should be provided with the proposal to inform decision making. We refer you to the [Landscape Institute](#) Guidelines for Landscape and Visual Impact Assessment for further guidance.

Biodiversity duty

The local planning authority has a [duty](#) to conserve and enhance biodiversity as part of its decision making. Further information is available [here](#).

Designated nature conservation sites

Paragraphs 186-188 of the NPPF set out the principles for determining applications impacting on Sites of Special Scientific Interest (SSSI) and habitats sites. Both the direct and indirect impacts of the development should be considered. A Habitats Regulations Assessment is needed where there is a likely significant effect on a habitats site and Natural England must be consulted on '[appropriate assessments](#)'. Natural England must also be consulted where development is in or likely to affect a SSSI and provides advice on potential impacts on SSSIs either via [Impact Risk Zones](#) or as standard or bespoke consultation responses.

Protected Species

Natural England has produced [standing advice](#) to help planning authorities understand the impact of particular developments on protected species. Natural England will only provide bespoke advice on protected species where they form part of a Site of Special Scientific Interest or in exceptional circumstances. A protected species [licence](#) may be required in certain cases.

Local sites and priority habitats and species

The local planning authority should consider the impacts of the proposed development on any local wildlife or geodiversity site, in line with paragraphs 180, 181 and 185 of the NPPF and any relevant development plan policy. There may also be opportunities to enhance local sites and improve their connectivity to help nature's recovery. Natural England does not hold locally specific information on local sites and recommends further information is obtained from appropriate bodies such as the local records centre,

Annex A –Natural England general advice

wildlife trust, geoconservation groups or recording societies. Emerging [Local Nature Recovery Strategies](#) may also provide further useful information.

Priority habitats and species are of particular importance for nature conservation and are included in the England Biodiversity List published under section 41 of the Natural Environment and Rural Communities Act 2006. Most priority habitats will be mapped either as Sites of Special Scientific Interest on the Magic website or as Local Wildlife Sites. A list of priority habitats and species can be found on [Gov.uk](#).

Natural England does not routinely hold species data. Such data should be collected when impacts on priority habitats or species are considered likely. Consideration should also be given to the potential environmental value of brownfield sites, often found in urban areas and former industrial land, further information including links to the open mosaic habitats inventory can be found [here](#).

Biodiversity and wider environmental gains

Development should provide net gains for biodiversity in line with the NPPF paragraphs 180(d), 185 and 186. Major development (defined in the [NPPF glossary](#)) is required by law to deliver a biodiversity gain of at least 10% from 12 February 2024 and this requirement is expected to be extended to smaller scale development in spring 2024. For nationally significant infrastructure projects (NSIPs), it is anticipated that the requirement for biodiversity net gain will be implemented from 2025.

Further information on the timetable for mandatory biodiversity net gain can be found [here](#). Further information on biodiversity net gain, including [draft Planning Practice Guidance](#), can be found [here](#).

The statutory [Biodiversity Metric](#) should be used to calculate biodiversity losses and gains for terrestrial and intertidal habitats and can be used to inform any development project. For small development sites, the [Small Sites Metric](#) may be used. This is a simplified version of the [Biodiversity Metric](#) and is designed for use where certain criteria are met.

The mitigation hierarchy as set out in paragraph 186 of the NPPF should be followed to firstly consider what existing habitats within the site can be retained or enhanced. Where on-site measures are not possible, provision off-site will need to be considered.

Development also provides opportunities to secure wider biodiversity enhancements and environmental gains, as outlined in the NPPF (paragraphs 8, 74, 108, 124, 180, 181 and 186). Opportunities for enhancement might include incorporating features to support specific species within the design of new buildings such as swift or bat boxes or designing lighting to encourage wildlife.

Natural England's [Environmental Benefits from Nature tool](#) may be used to identify opportunities to enhance wider benefits from nature and to avoid and minimise any negative impacts. It is designed to work alongside the [Biodiversity Metric](#) and is available as a beta test version.

Further information on biodiversity net gain, the mitigation hierarchy and wider environmental net gain can be found in government [Planning Practice Guidance for the natural environment](#).

Ancient woodland, ancient and veteran trees

The local planning authority should consider any impacts on ancient woodland and ancient and veteran trees in line with paragraph 186 of the NPPF. Natural England maintains the Ancient Woodland [Inventory](#) which can help identify ancient woodland. Natural England and the Forestry Commission have produced [standing advice](#) for planning authorities in relation to ancient woodland and ancient and veteran trees. It should be taken into account when determining relevant planning applications. Natural England will only provide bespoke advice on ancient woodland, ancient and veteran trees where they form part of a Site of Special Scientific Interest or in exceptional circumstances.

Best and most versatile agricultural land and soils

Local planning authorities are responsible for ensuring that they have sufficient detailed agricultural land classification (ALC) information to apply NPPF policies (Paragraphs 180 and 181). This is the case regardless of whether the proposed development is sufficiently large to consult Natural England. Further

Annex A –Natural England general advice

information is contained in [GOV.UK guidance](#) Agricultural Land Classification information is available on the [Magic](#) website and the [Data.Gov.uk](#) website

Guidance on soil protection is available in the Defra [Construction Code of Practice for the Sustainable Use of Soils on Construction Sites](#), and we recommend its use in the design and construction of development, including any planning conditions. For mineral working and landfilling, separate guidance on soil protection for site restoration and aftercare is available on [Gov.uk](#) website. Detailed guidance on soil handling for mineral sites is contained in the Institute of Quarrying [Good Practice Guide for Handling Soils in Mineral Workings](#).

Should the development proceed, we advise that the developer uses an appropriately experienced soil specialist to advise on, and supervise soil handling, including identifying when soils are dry enough to be handled and how to make the best use of soils on site.

Green Infrastructure

Natural England's [Green Infrastructure Framework](#) provides evidence-based advice and tools on how to design, deliver and manage green and blue infrastructure (GI). GI should create and maintain green liveable places that enable people to experience and connect with nature, and that offer everyone, wherever they live, access to good quality parks, greenspaces, recreational, walking and cycling routes that are inclusive, safe, welcoming, well-managed and accessible for all. GI provision should enhance ecological networks, support ecosystems services and connect as a living network at local, regional and national scales.

Development should be designed to meet the [15 Green Infrastructure Principles](#). The GI Standards can be used to inform the quality, quantity and type of GI to be provided. Major development should have a GI plan including a long-term delivery and management plan. Relevant aspects of local authority GI strategies should be delivered where appropriate.

GI mapping resources are available [here](#) and [here](#). These can be used to help assess deficiencies in greenspace provision and identify priority locations for new GI provision.

Access and Recreation

Natural England encourages any proposal to incorporate measures to help improve people's access to the natural environment. Measures such as reinstating existing footpaths, together with the creation of new footpaths and bridleways should be considered. Links to urban fringe areas should also be explored to strengthen access networks, reduce fragmentation, and promote wider green infrastructure.

Rights of Way, Access land, Coastal access and National Trails

Paragraphs 104 and 180 of the NPPF highlight the important of public rights of way and access. Development should consider potential impacts on access land, common land, rights of way and coastal access routes in the vicinity of the development. Consideration should also be given to the potential impacts on the any nearby National Trails. The National Trails website www.nationaltrail.co.uk provides information including contact details for the National Trail Officer. Appropriate mitigation measures should be incorporated for any adverse impacts.

Further information is set out in Planning Practice Guidance on the [natural environment](#)