



Horsham District Council
Parkside
Chart Way
Horsham
West Sussex
RH12 1RL

Your ref
DC/25/1120

Our ref
DSA000046349

Date
25th September 2025

Contact
Tel 0330 303 0119

Dear Sir/Madam,

Proposal: Erection of 4no. dwellings, extension to existing cottage, alterations to access and provision of landscaping.

Site: Land Adjacent to Pucks Croft Cottage Horsham Road Rusper West Sussex.

Thank you for your correspondence, please see our comments below regarding the above application.

Development Site is not within Southern Water's Supply Area

The development site is not located within Southern Water's statutory area for wastewater drainage services. Please contact Thames Water who are the relevant statutory undertaker.

Proposed SUDS features

If it is the intention of the developer for Southern Water to adopt the proposed SuDS, the system shall be designed and constructed in line with the Design and Construction Guidance www.water.org.uk/sewerage-sector-guidance-approved-documents/

No Soakaways should be connected to the public surface water sewer.

The supporting documents make reference to drainage using Sustainable Drainage Systems (SuDS). Where SuDS form part of a continuous sewer system, and are not an isolated end of pipe SuDS component, adoption of SuDS will be considered if requested by the developer if they comply with: Design and Construction Guidance (Appendix C), CIRIA guidance and Southern Water SuDS Guidance available here:

<https://www.water.org.uk/sewerage-sector-guidance-approved-documents/>

<https://www.ciria.org/ItemDetail?iProductCode=C753F&Category=FREEPUBS>

<https://www.southernwater.co.uk/media/l4ndl3db/suds-final-080824.pdf>

Where SuDS rely upon facilities which are not adoptable by sewerage undertakers the applicant will need to ensure that arrangements exist for the long-term maintenance of the SuDS facilities. It is critical that the effectiveness of these systems is maintained in perpetuity. Good management will avoid flooding from the proposed surface water system, which may result in the inundation of the foul sewerage system.

Thus, where a SuDS scheme is to be implemented, the drainage details submitted to the Local Planning Authority should:

- Specify the responsibilities of each party for the implementation of the SuDS scheme.
- Specify a timetable for implementation.
- Provide a management and maintenance plan for the lifetime of the development.

This should include the arrangements for adoption by any public authority or statutory undertaker and any other arrangements to secure the operation of the scheme throughout its lifetime. This initial assessment does not prejudice any future assessment or commit to any adoption agreements under Section 104 of the Water Industry Act 1991.

Proposed soakaways

The Council's Building Control officers or technical staff should be asked to comment on the adequacy of soakaways to dispose of surface water from the proposed development. No new soakaways should be located within 5 metres of a public or adoptable gravity sewer, rising main or water main.

No Soakaways should be connected to the public surface water sewer.

Hierarchy of Building Regulations H3 for disposal of surface water - not yet provided documentation proving compliance

If the applicant has not already provided documentation demonstrating compliance with the surface water hierarchy reflected in part H3 of the Building Regulations, as shown below, we will require this to be provided where surface water is being considered for discharge to our network. Whilst reuse does not strictly form part of this hierarchy, Southern Water would encourage the consideration of reuse for new developments.

- Reuse
- Infiltration
- Watercourse
- Storm Sewer
- Combined Sewer

Guidance on Building Regulations is here: <https://www.gov.uk/government/publications/drainage-and-waste-disposal-approved-document-h>



We would like to engage with you on the design for disposal of surface water for this development at the earliest opportunity and we recommend that civil engineers and landscape architects work together and with Southern Water. In many cases this may negate or reduce the need for network reinforcement and allow earlier completion of the development.

Where a surface water connection to the foul or combined sewer is being considered, this should be agreed by the Lead Local Flood Authority, in consultation with Southern Water.

Condition

We request that should this application receive planning approval, the following condition is attached to the consent: Construction of the development shall not commence until details of the proposed means of surface water run off disposal in accordance with Part H3 of Building Regulations hierarchy as well as acceptable discharge points, rates and volumes have been agreed by the Lead Local Flood Authority, in consultation with Southern Water.

Tree planting

We have restrictions on the proposed tree planting adjacent to Southern Water sewers, rising mains or water mains. Reference should be made to Southern Water's publication "A Guide to Tree Planting near water Mains and Sewers" (https://www.southernwater.co.uk/media/pddob0vn/ds-tree-planting-guide-1_nwm.pdf) and the Sewerage Sector Guidance (<https://www.water.org.uk/sewerage-sector-guidance-approved-documents/>) with regards to any landscaping proposals and our restrictions and maintenance of tree planting adjacent to sewers, rising mains and water mains.

Condition

In order to protect public apparatus, Southern Water requests that if consent is granted, the following pre commencement condition is attached to the planning permission; The developer must advise the local authority (in consultation with Southern Water) of the landscaping proposals in proximity of public apparatus in order to protect it in accordance with Southern Water's guidance, prior to the commencement of the development.


For further advice, please contact Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX (Tel: 0330 303 0119)

Website: [southernwater.co.uk](https://www.southernwater.co.uk) or by email at: SouthernWaterPlanning@southernwater.co.uk

Yours faithfully,

Future Growth Planning Team

[southernwater.co.uk/developing-building/planning-your-development](https://www.southernwater.co.uk/developing-building/planning-your-development)

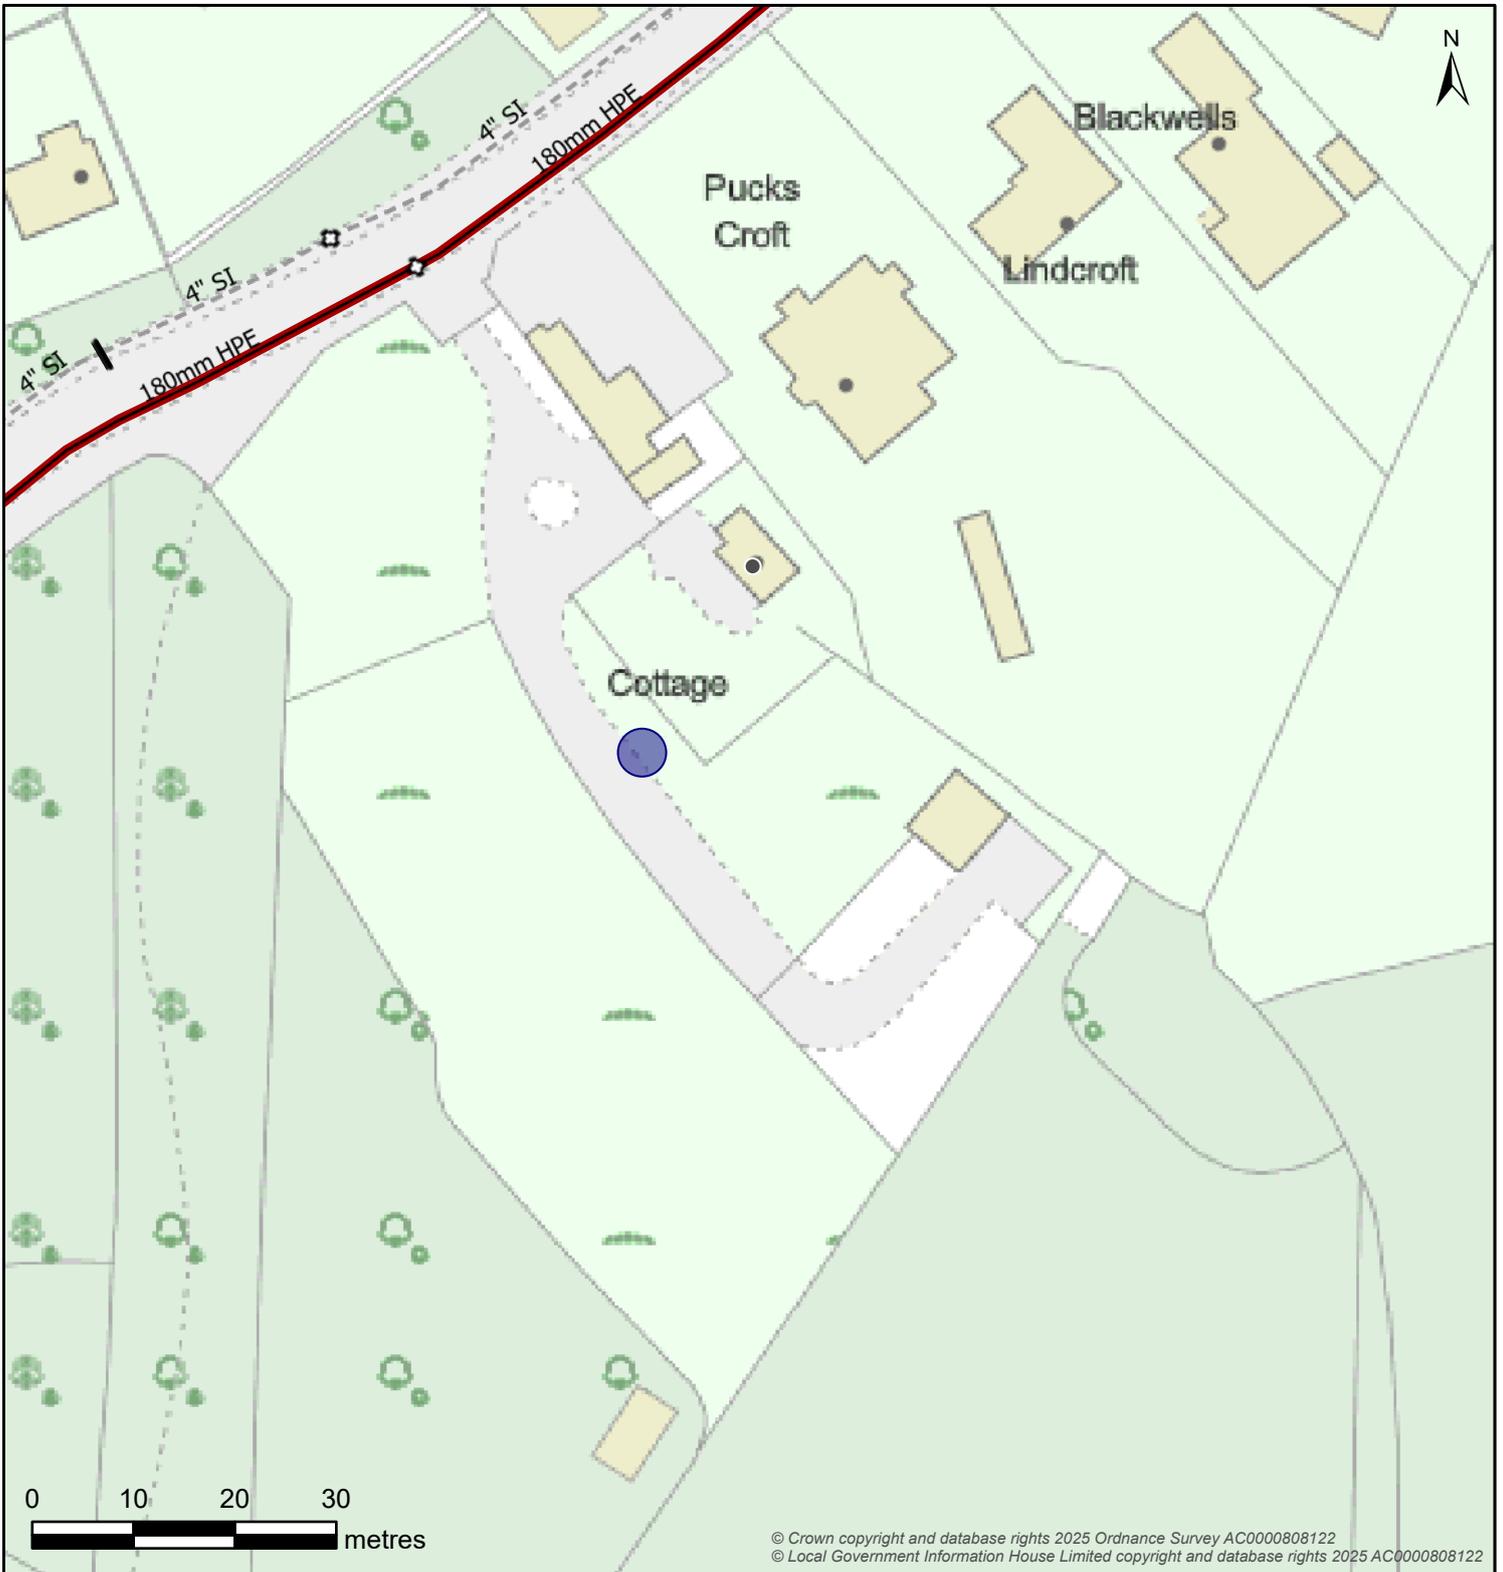

© Crown copyright and database rights 2025 Ordnance Survey AC0000808122
 © Local Government Information House Limited copyright and database rights 2025 AC0000808122

Boundary Box □ Boundary Box	Break Pressure Tank BPT Break Pressure Tank	Capped End □ Capped End	Hydrant		
			▲ Emptying Plug	⊕ Fire Hydrant	⊙ Washout Hydrant
Pressure Monitoring ● Logger	Service Reservoir ⊙ Covered ⊙ Tower	Meter ⊙ Meter	Valve - Controllable		
			Open Valve	⊕ Closed Valve	✕ Stop Tap
Site		Valve - Flow			
◇ Abstraction Point	⊙ Supply Works	⊙ Air Valve	⊙ Non-Return Valve	⊙ Washout Empty Valve	
⊙ Booster Station	⊙ Transfer Station	Valve - Pressure			
⊙ Surface Reservoir	⊙ Underground Source	⊙ Pressure Reducing Valve	⊙ Pressure Sustaining Valve	Pipe Bridge	
				= = Pipe Bridge	
Water Pipe			Water Area		
— Communication	— Trunk	— Decommissioned	■ Water Supply Zone	⊙ District Meter Area	
— Distribution	— Raw	— Discolouration			
— Non-Potable	— Private				

Map Title: SW Print

Printed By: Kelly.Donaldson
 Date Printed: 07/08/2025
 Map Scale: 750

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.

