



Horsham District Council
Parkside
Chart Way
Horsham
West Sussex
RH12 1RL

Your ref
DC/25/0403

Our ref
DSA000046578

Date
14th of August 2025

Contact
Tel 0330 303 0119

Dear Sir/Madam,

Proposal: Application to form a comprehensive masterplan including: 1. Rationalisation and enhancement of existing commercial facilities (Use Classes E(g) B2 and B8 at Stonehouse Business Park including demolition of two buildings and their replacement with new Class E(g), B2 and B8 facilities. Extension of existing building to form a new office and wardens' accommodation. Existing mobile home removed. 2. Decommissioning of the Anaerobic Digester and re-use of the existing 2no buildings for storage and office uses (Class E (g) and B8) and the diversion of a public footpath. 3. Residential redevelopment of the Jacksons Farm site including the demolition of existing barns to provide 3no. dwellings with access, parking, and landscaping.

Site: Stonehouse Farm Handcross Road Plummers Plain West Sussex.

Thank you for your correspondence, please see our comments below regarding the above application.

Private Treatment Plant

Septic tank: (If applicable) The Environment Agency should be consulted directly by the applicant regarding the use of a septic tank drainage which disposes of effluent to sub-soil irrigation.

Cess pit: (If Applicable) Under the first time sewerage guidance the EA expect people to connect to a public sewer if the dwelling is within 30m of our network, this guidance can be found here: General binding rules for small sewage discharges (SSDs) with effect from January 2015 - GOV.UK (www.gov.uk)

Proposed works involve demolition

In order to protect and safeguard the existing water supply apparatus, Southern Water requests formal notification of any proposed demolition works prior to such works being undertaken.

Proposed SUDS features

If it is the intention of the developer for Southern Water to adopt the proposed SuDS, the system shall be designed and constructed in line with the Design and Construction Guidance www.water.org.uk/sewerage-sector-guidance-approved-documents/

No Soakaways should be connected to the public surface water sewer.

The supporting documents make reference to drainage using Sustainable Drainage Systems (SuDS). Where SuDS form part of a continuous sewer system, and are not an isolated end of pipe SuDS component, adoption of SuDS will be considered if requested by the developer if they comply with: Design and Construction Guidance (Appendix C), CIRIA guidance and Southern Water SuDS Guidance available here:

<https://www.water.org.uk/sewerage-sector-guidance-approved-documents/>

<https://www.ciria.org/ItemDetail?iProductCode=C753F&Category=FREEPUBS>

<https://www.southernwater.co.uk/media/l4ndl3db/suds-final-080824.pdf>

Where SuDS rely upon facilities which are not adoptable by sewerage undertakers the applicant will need to ensure that arrangements exist for the long-term maintenance of the SuDS facilities. It is critical that the effectiveness of these systems is maintained in perpetuity. Good management will avoid flooding from the proposed surface water system, which may result in the inundation of the foul sewerage system.

Thus, where a SuDS scheme is to be implemented, the drainage details submitted to the Local Planning Authority should:

- Specify the responsibilities of each party for the implementation of the SuDS scheme.
- Specify a timetable for implementation.
- Provide a management and maintenance plan for the lifetime of the development.

This should include the arrangements for adoption by any public authority or statutory undertaker and any other arrangements to secure the operation of the scheme throughout its lifetime. This initial assessment does not prejudice any future assessment or commit to any adoption agreements under Section 104 of the Water Industry Act 1991.

Tree planting

We have restrictions on the proposed tree planting adjacent to Southern Water sewers, rising mains or water mains. Reference should be made to Southern Water's publication "A Guide to Tree Planting near water Mains and Sewers" (https://www.southernwater.co.uk/media/pddob0vn/ds-tree-planting-guide-1_nwm.pdf) and the Sewerage Sector Guidance (<https://www.water.org.uk/sewerage-sector-guidance-approved-documents/>) with regards to any landscaping proposals and our restrictions and maintenance of tree planting adjacent to sewers, rising mains and water mains.

Condition: In order to protect public apparatus, Southern Water requests that if consent is granted, the following pre commencement condition is attached to the planning permission.



The developer must advise the local authority (in consultation with Southern Water) of the landscaping proposals in proximity of public apparatus in order to protect it in accordance with Southern Water's guidance, prior to the commencement of the development.


For further advice, please contact Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX (Tel: 0330 303 0119)

Website: southernwater.co.uk or by email at: SouthernWaterPlanning@southernwater.co.uk

Yours faithfully,

Future Growth Planning Team

southernwater.co.uk/developing-building/planning-your-development

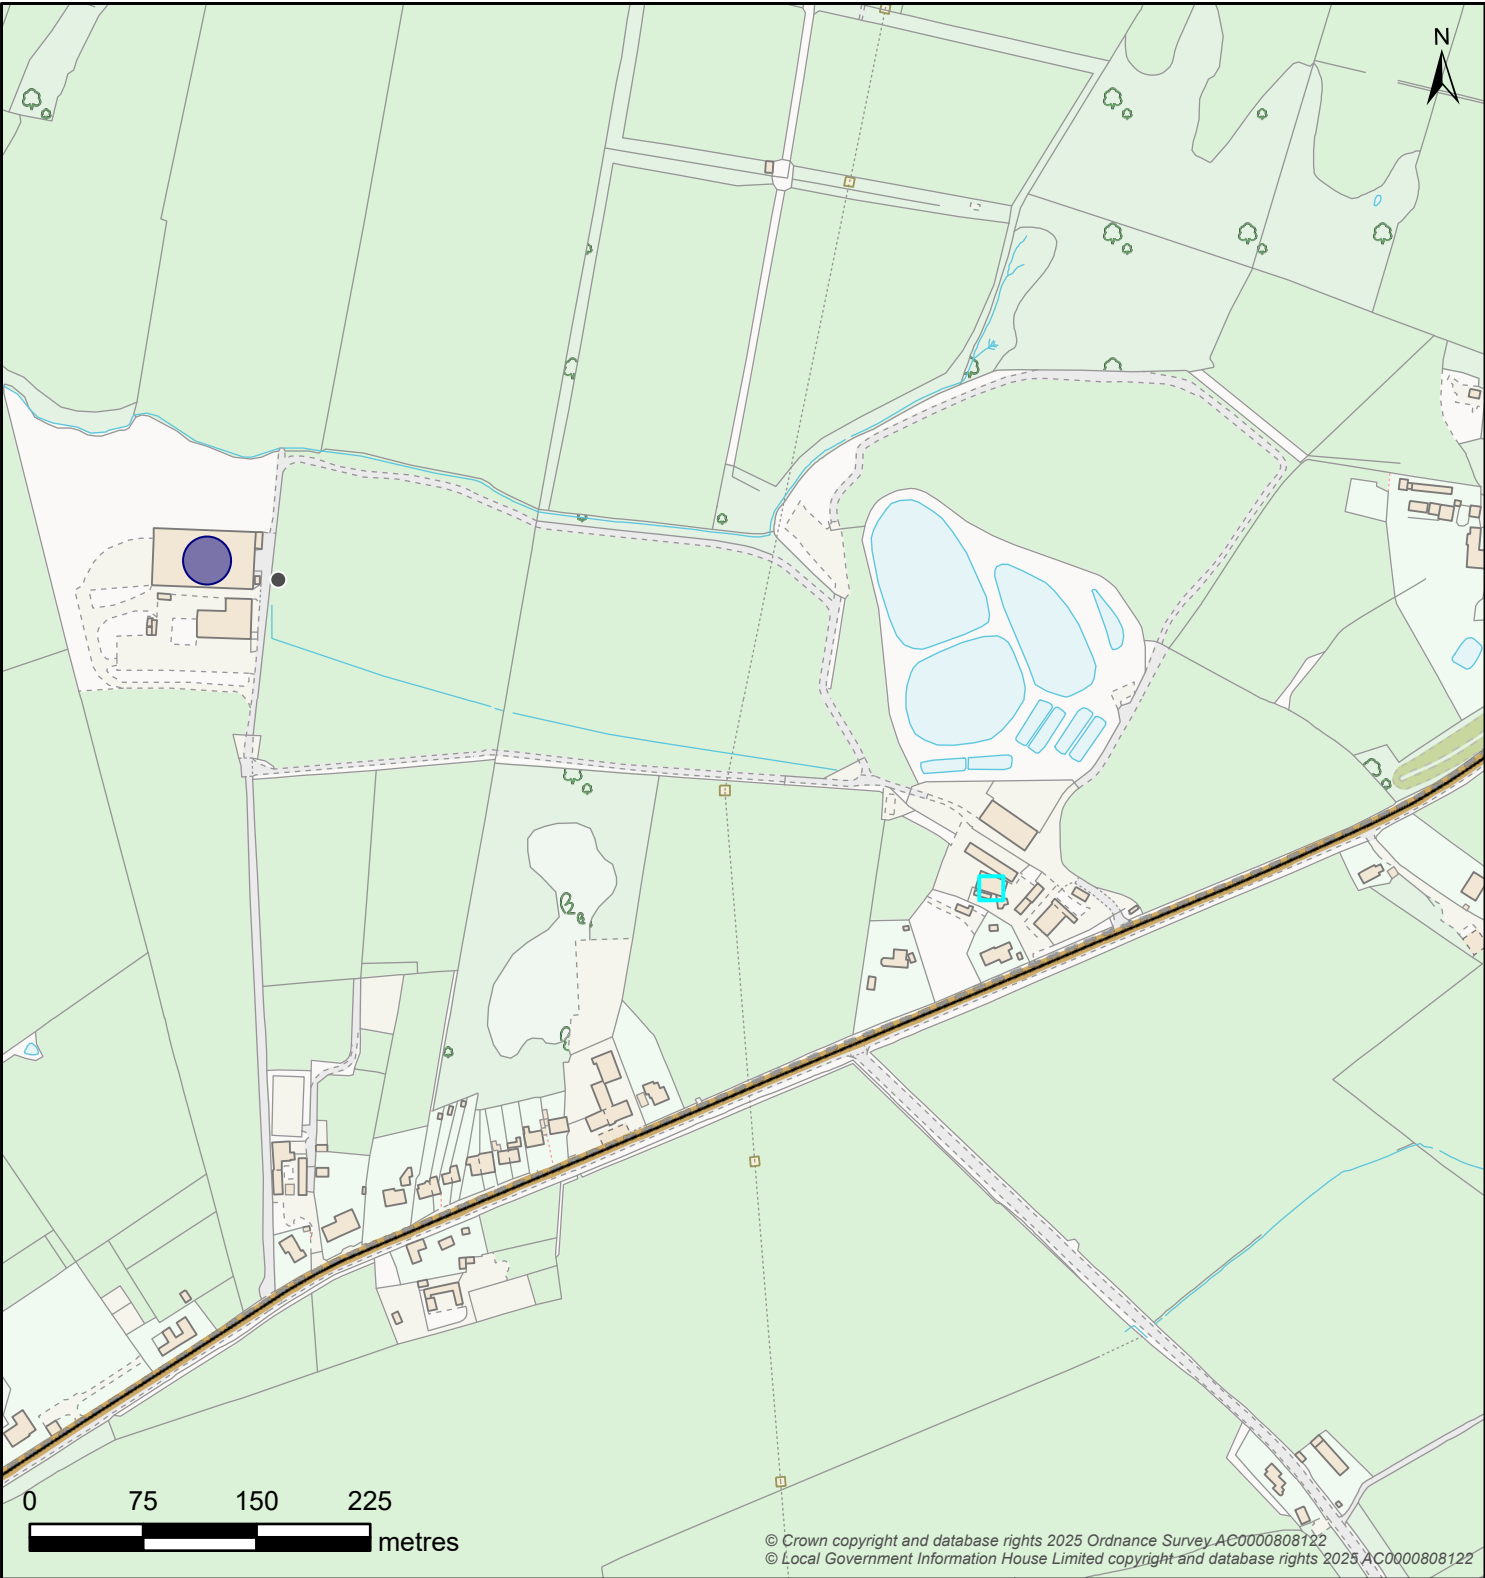

© Crown copyright and database rights 2025 Ordnance Survey AC0000808122
© Local Government Information House Limited copyright and database rights 2025 AC0000808122

Boundary Box	Break Pressure Tank	Capped End	Hydrant		
Boundary Box	Break Pressure Tank	Capped End	Emptying Plug	Fire Hydrant	Washout Hydrant
Pressure Monitoring	Service Reservoir	Meter	Valve - Controllable		
Logger	Covered	Tower	Meter	Open Valve	Closed Valve
Stop Tap					
Site		Valve - Flow			
Abstraction Point	Supply Works	Air Valve	Non-Return Valve	Washout Empty Valve	
Booster Station	Transfer Station				
Surface Reservoir	Underground Source				
		Valve - Pressure		Pipe Bridge	
		Pressure Reducing Valve	Pressure Sustaining Valve	Pipe Bridge	
Water Pipe		Water Area			
Communication	Trunk	Decommissioned	Water Supply Zone	District Meter Area	
Distribution	Raw	Discolouration			
Non-Potable	Private				

Map Title: SW Print

Printed By: Kelly.Donaldson
Date Printed: 14/08/2025
Map Scale: 5000

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.

