



Horsham District Council
Parkside
Chart Way
Horsham
West Sussex
RH12 1RL

Your ref
DC/25/1193

Our ref
DSA000046573

Date
14th of August 2025

Contact
Tel 0330 303 0119

Dear Sir/Madam,

Proposal: Demolition of 1no. agricultural building and the erection of 2no. dwellinghouses. (Alternative to prior approval reference DC/14/2697).

Site: Oaklands Barn Coltstaple Lane Horsham West Sussex, RH13 9BB.

Thank you for your correspondence, please see our comments below regarding the above application.

Package treatment plant

Cess pit proposed (if applicable)

Under the first time sewerage guidance the EA expect people to connect to a public sewer if the dwelling is within 30m of our network, this guidance can be found here: General binding rules for small sewage discharges (SSDs) with effect from January 2015 - GOV.UK (www.gov.uk)


Septic tank proposed (if applicable)

The Environment Agency should be consulted directly by the applicant regarding the use of a septic tank drainage which disposes of effluent to sub-soil irrigation.

Proposed soakaways

The Council's Building Control officers or technical staff should be asked to comment on the adequacy of soakaways to dispose of surface water from the proposed development. No new soakaways should be located within 5 metres of a public or adoptable gravity sewer, rising main or water main.

No Soakaways should be connected to the public surface water sewer.

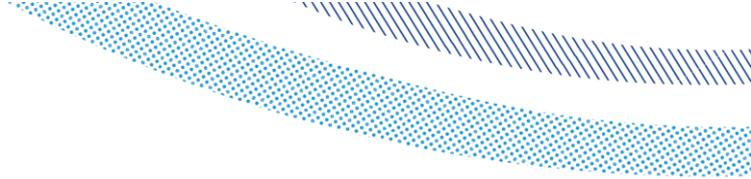

Proposed works involve demolition.

In order to protect and safeguard the existing water supply apparatus, Southern Water requests formal notification of any proposed demolition works prior to such works being undertaken.


For further advice, please contact Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX (Tel: 0330 303 0119)

Website: southernwater.co.uk or by email at: SouthernWaterPlanning@southernwater.co.uk

Yours faithfully,

Future Growth Planning Team

southernwater.co.uk/developing-building/planning-your-development

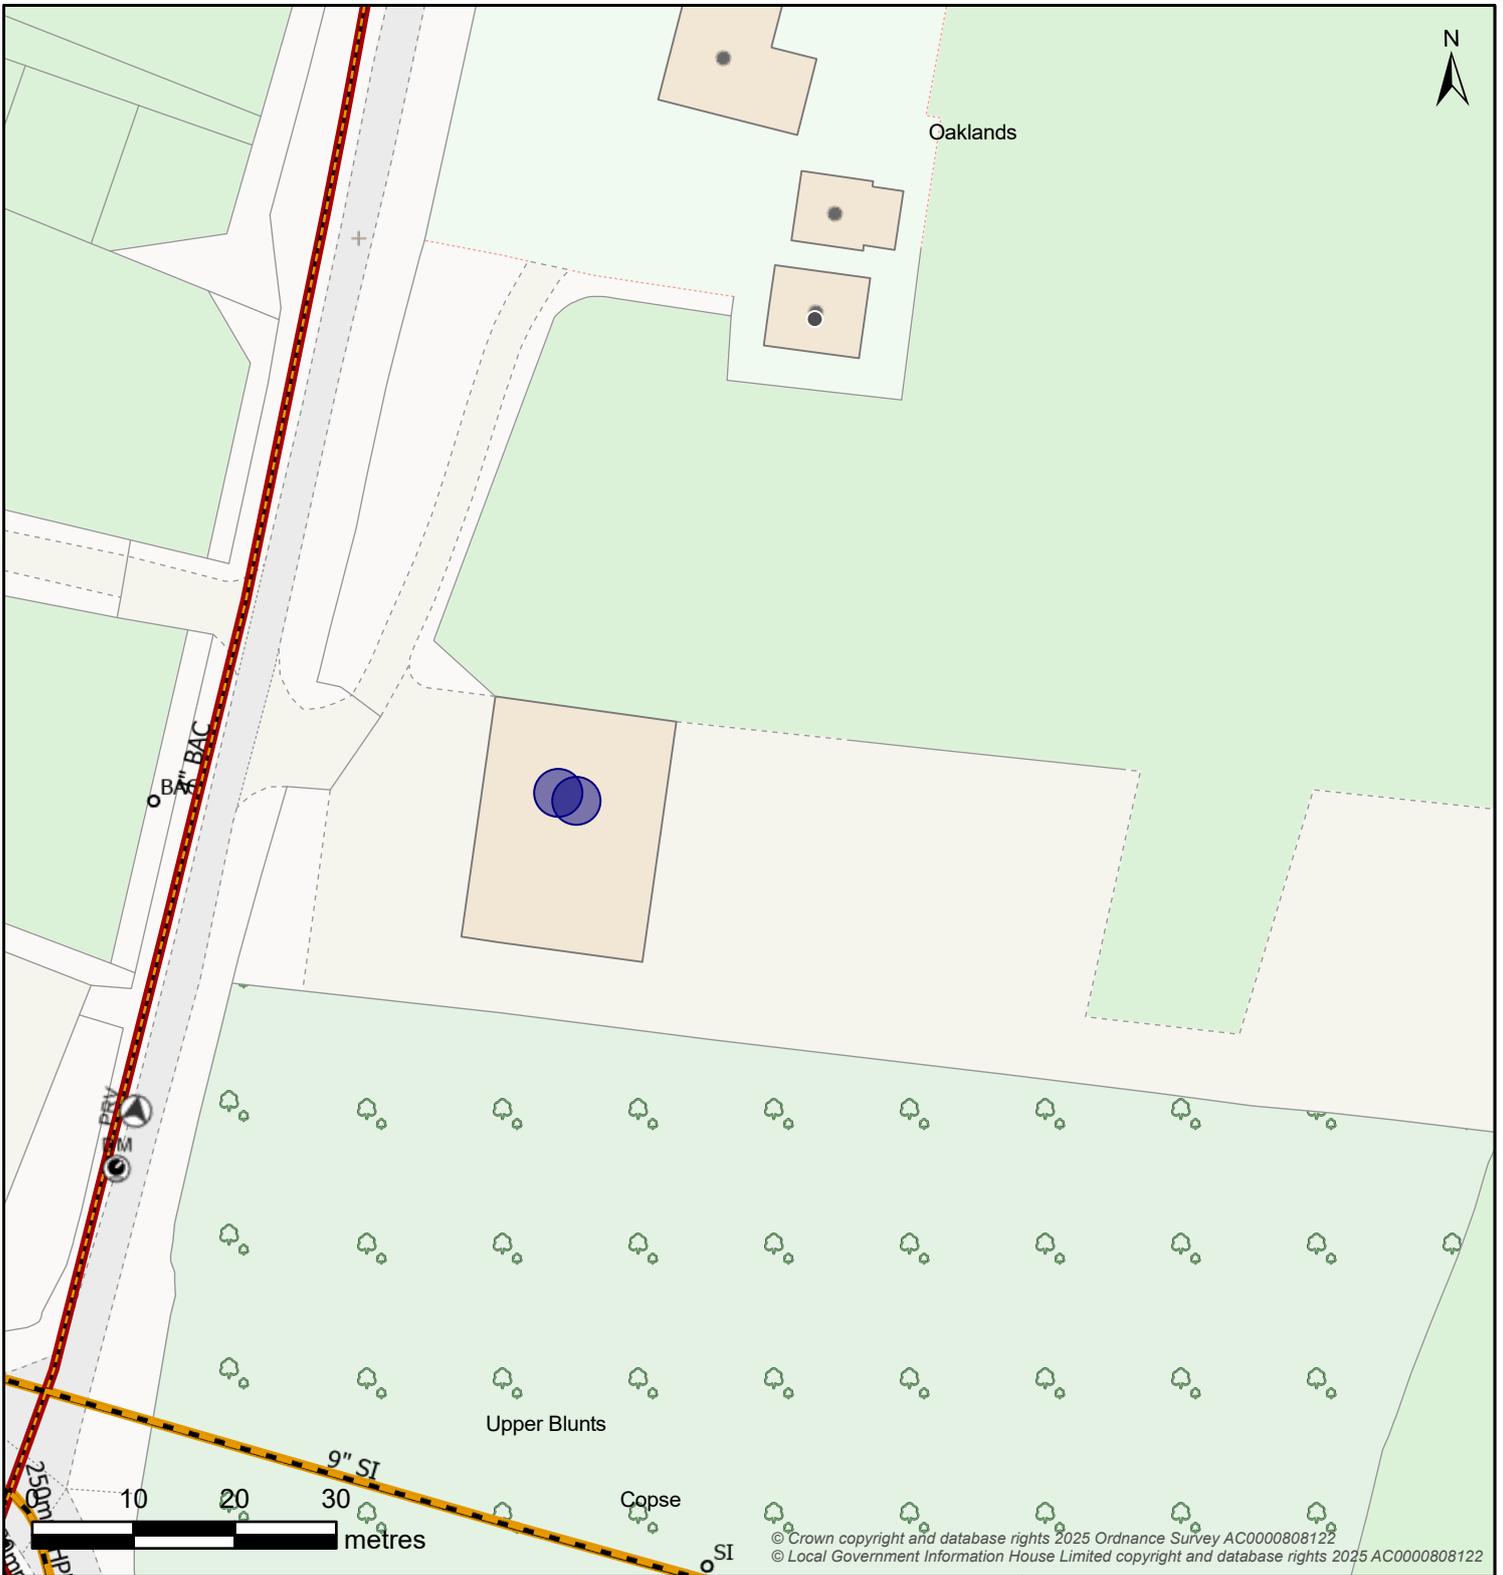

© Crown copyright and database rights 2025 Ordnance Survey AC0000808122
 © Local Government Information House Limited copyright and database rights 2025 AC0000808122

Boundary Box □ Boundary Box	Break Pressure Tank BPT Break Pressure Tank	Capped End □ Capped End	Hydrant		
			▲ Emptying Plug	⊕ Fire Hydrant	⊙ Washout Hydrant
Pressure Monitoring ● Logger	Service Reservoir ⊙ Covered ⊙ Tower	Meter ⊙ Meter	Valve - Controllable		
			Open Valve	⊕ Closed Valve	✕ Stop Tap
Site		Valve - Flow			
◇ Abstraction Point	⊙ Supply Works	⊙ AV Air Valve	⊙ NRV Non-Return Valve	⊙ WO Washout Empty Valve	
⊙ Booster Station	⊙ Transfer Station	Valve - Pressure			
⊙ Surface Reservoir	⊙ Underground Source	⊙ PRV Pressure Reducing Valve	⊙ PSV Pressure Sustaining Valve	Pipe Bridge	
				= = Pipe Bridge	
Water Pipe			Water Area		
— Communication	— Trunk	— Decommissioned	■ Water Supply Zone	⊙ District Meter Area	
— Distribution	— Raw	— Discolouration			
— Non-Potable	— Private				

Map Title: SW Print

Printed By: Anne.McFarlane2
 Date Printed: 14/08/2025
 Map Scale: 750

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.

