



from
Southern Water 

Horsham District Council
Parkside
Chart Way
Horsham
West Sussex
RH12 1RL

Your ref
DC/26/0028

Our ref
DSA000050625

Date
23rd January 2026

Contact
Tel 0330 303 0119

Dear Sir/Madam,

Proposal: Demolition of existing bungalow. Erection of a replacement dwelling, double garage with associated landscaping and creation of a driveway.

Site: 1 Byne Close, Storrington, West Sussex, RH20 4BS.

Thank you for your correspondence. Please see our comments below regarding the above planning consultation application.

Tree planting

We have restrictions on the proposed tree planting adjacent to Southern Water sewers, rising mains or water mains. Reference should be made to Southern Water's publication "A Guide to Tree Planting near water Mains and Sewers"

(https://www.southernwater.co.uk/media/pddob0vn/ds-tree-planting-guide-1_nwm.pdf) and the Sewerage Sector Guidance (<https://www.water.org.uk/sewerage-sector-guidance-approved-documents/>) with regards to any landscaping proposals and our restrictions and maintenance of tree planting adjacent to sewers, rising mains and water mains.

Condition

In order to protect public apparatus, Southern Water requests that if consent is granted, the following pre commencement condition is attached to the planning permission; The developer must advise the local authority (in consultation with Southern Water) of the landscaping proposals in proximity of public apparatus in order to protect it in accordance with Southern Water's guidance, prior to the commencement of the development.

Proposed Soakaways

The Council's Building Control officers or technical staff should be asked to comment on the adequacy of Soakaways to dispose of surface water from the proposed development. No new

Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX
southernwater.co.uk

Southern Water Services Ltd, Registered Office: Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX Registered in England No. 2366670

Soakaways should be located within 5 metres of a public or adoptable gravity sewer, rising main or water main.

No Soakaways should be connected to the public surface water sewer.

Hierarchy of Building Regulations H3 for disposal of surface water - not yet provided documentation proving compliance

If the applicant has not already provided documentation demonstrating compliance with the surface water hierarchy reflected in part H3 of the Building Regulations, as shown below, we will require this to be provided where surface water is being considered for discharge to our network. Whilst reuse does not strictly form part of this hierarchy, Southern Water would encourage the consideration of reuse for new developments.

- Reuse
- Infiltration
- Watercourse
- Storm Sewer
- Combined Sewer

Guidance on Building Regulations is here: <https://www.gov.uk/government/publications/drainage-and-waste-disposal-approved-document-h>

We would like to engage with you on the design for disposal of surface water for this development at the earliest opportunity and we recommend that civil engineers and landscape architects work together and with Southern Water. In many cases this may negate or reduce the need for network reinforcement and allow earlier completion of the development.

Where a surface water connection to the foul or combined sewer is being considered, this should be agreed by the Lead Local Flood Authority, in consultation with Southern Water.

Condition

We request that should this application receive planning approval, the following condition is attached to the consent: Construction of the development shall not commence until details of the proposed means of surface water run off disposal in accordance with Part H3 of Building Regulations hierarchy as well as acceptable discharge points, rates and volumes have been agreed by the Lead Local Flood Authority, in consultation with Southern Water.

Proposed works involve demolition

In order to protect and safeguard the existing water supply apparatus, Southern Water requests formal notification of any proposed demolition works prior to such works being undertaken.

S106 Connection application

Any new connections to the public sewerage system will require a Section 106 connection application to be submitted and approved by Southern Water Services.

To make an application visit Southern Water's Get Connected service:

<https://developerservices.southernwater.co.uk> and please read our New Connections Charging Arrangements documents which are available on our website via the following link:

<https://www.southernwater.co.uk/developing-building/connection-charging-arrangements>

Please note that, where there are separate systems available, Southern Water will not allow surface water to connect into the public foul sewer. If this is not possible, please provide evidence that all other options have been explored.


We request that should this planning application receive planning approval, the following informative is attached to the consent:

Construction of the development shall not commence until details of the proposed means of foul sewerage and surface water disposal have been submitted to and approved in writing by the Local Planning Authority in consultation with Southern Water.

For further advice, please contact Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX (Tel: 0330 303 0119).

Website: southernwater.co.uk or by email at: SouthernWaterPlanning@southernwater.co.uk

Yours faithfully,
Future Growth Planning Team
southernwater.co.uk/developing-building/planning-your-development

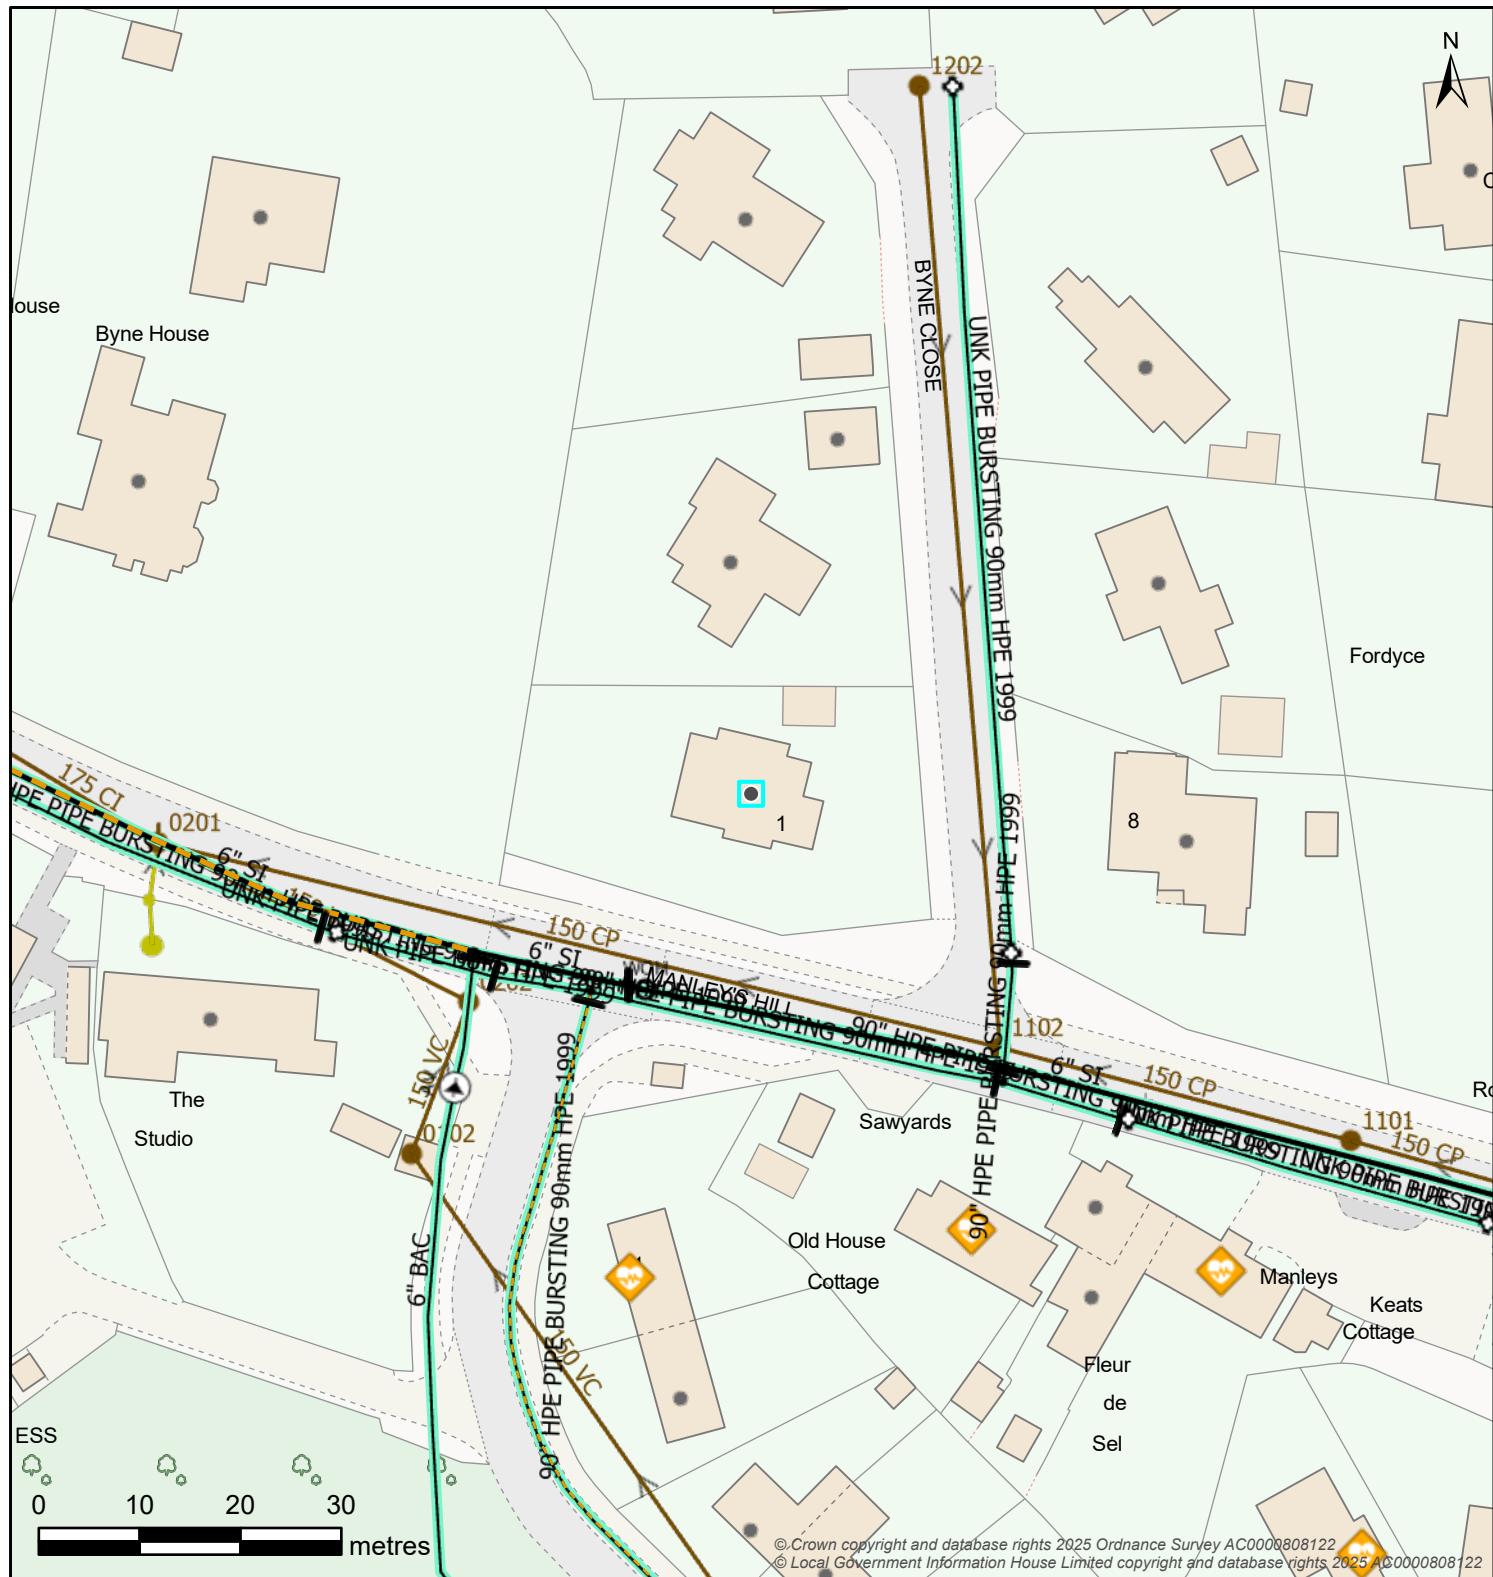

Controllable Valve		Flow Control		Inlet-Outfall	
Damboards	Penstock	Valve	Anti Flood Device	Pumped Anti Flood Device	Reflux Valve
BIF	Cascade	CP	Catchpit	Head Of Public Sewer	Interceptor
Outfall Headworks	Overflow Chamber	Pipe Bridge	Pumping Station		
Outfall Headworks	CSO Combined Sewer Overflow	EMO Emergency Overflow	Pipe Bridge	Micro Pumping Station	Pumping Station
Sewer Level Monitor		Storage		Treatment Works	
Sewer Level Monitor	Storm Tank	Tidal Storage Tank	Treatment Works	Weir	Wastewater Site
Wastewater Pipe			Wastewater Use		
Culverted Water Course	Syphon	Foul	Build Over Agreement	Section 104	
Drain	Tank Sewer	Combined			
Outfall	Trunk Sewer	Sludge			
Overflow	Vacuum Main	Treated Effluent			
Rising Main	Decommissioned Pipe	Surface Water			
Sewer		Private			

Map Title: SW Print

Printed By: Anne.McFarlane2

Date Printed: 23/01/2026

Map Scale: 750

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.



from
Southern Water