



from
Southern Water 

Horsham District Council
Parkside
Chart Way
Horsham
West Sussex
RH12 1RL

Your ref
DC/25/0629

Our ref
DSA000044056

Date
21st of May 2025

Contact
Tel 0330 303 0119

Dear Sir/Madam,

Proposal: Residential development comprising approximately 206 dwellings.
Site: Former Novartis Site Parsonage Road Horsham West Sussex RH12 5AA.

Thank you for your letter.

Your consultation request needs to be progressed by our modelling team due to the development. will send you our full response within 21 calendar days.


EXPECTED RESPONSE DATE: 11th of June 2025.

For further advice, please contact Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX (Tel: 0330 303 0119).

Website: southernwater.co.uk or by email at: SouthernWaterPlanning@southernwater.co.uk

Yours faithfully,

Future Growth Planning Team
Developer Services
southernwater.co.uk/developing-building/planning-your-development

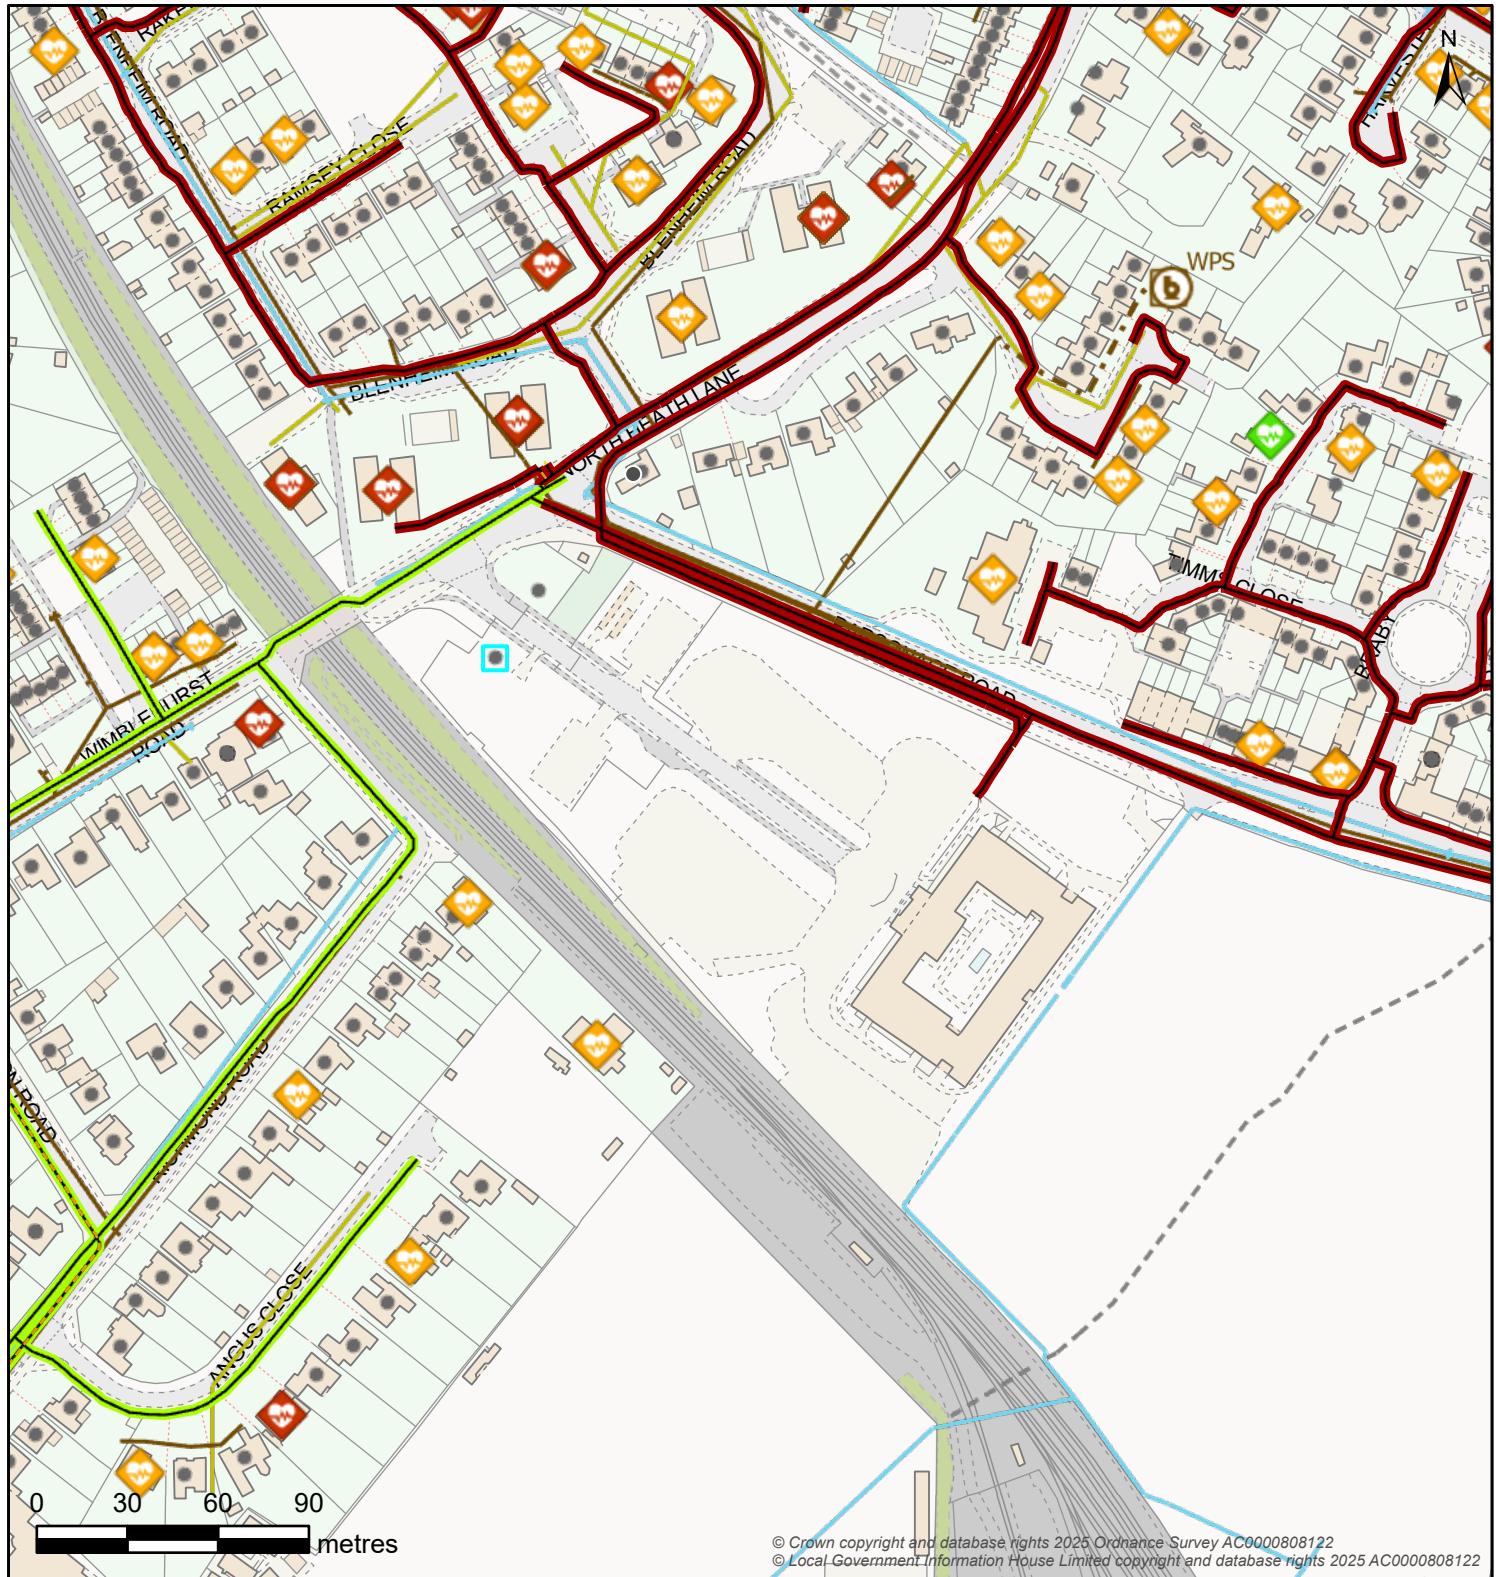

Boundary Box	Break Pressure Tank	Capped End	Hydrant
<input type="checkbox"/> Boundary Box	<input type="checkbox"/> BPT Break Pressure Tank	<input type="checkbox"/> Capped End	<input type="checkbox"/> Emptying Plug
			<input type="checkbox"/> Fire Hydrant
			<input type="checkbox"/> WOH Washout Hydrant
Pressure Monitoring	Service Reservoir	Meter	Valve - Controllable
<input type="checkbox"/> Logger	<input type="checkbox"/> Covered	<input type="checkbox"/> Tower	<input type="checkbox"/> Meter
			<input type="checkbox"/> Open Valve
			<input type="checkbox"/> Closed Valve
			<input type="checkbox"/> Stop Tap
Site	Valve - Flow		
<input type="checkbox"/> Abstraction Point	<input type="checkbox"/> Supply Works	<input type="checkbox"/> AV Air Valve	<input type="checkbox"/> NRV Non-Return Valve
<input type="checkbox"/> Booster Station	<input type="checkbox"/> Transfer Station	<input type="checkbox"/> PRV Pressure Reducing Valve	<input type="checkbox"/> PSV Pressure Sustaining Valve
<input type="checkbox"/> Surface Reservoir	<input type="checkbox"/> Underground Source		<input type="checkbox"/> WO Washout Empty Valve
Valve - Pressure		Pipe Bridge	
		<input type="checkbox"/> Pipe Bridge	<input type="checkbox"/> Pipe Bridge
Water Pipe	Water Area		
<input type="checkbox"/> Communication	<input type="checkbox"/> Trunk	<input type="checkbox"/> Decommissioned	<input type="checkbox"/> Water Supply Zone
<input type="checkbox"/> Distribution	<input type="checkbox"/> Raw	<input type="checkbox"/> Discolouration	<input type="checkbox"/> District Meter Area
<input type="checkbox"/> Non-Potable	<input type="checkbox"/> Private		

Map Title: SW Print

Printed By: Kelly.Donaldson

Date Printed: 21/05/2025

Map Scale: 2500

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.

