



File Location: Z:\P-LDE\PROJECTS\80815-NEW PLACE FARM\_PULBOROUGH\INFRASTRUCTURE\DRAWINGS-S- PLANNING\80815-RSK-ZZ-XX-DR-C-8013 TO 8022 LONG SECTIONS.DWG

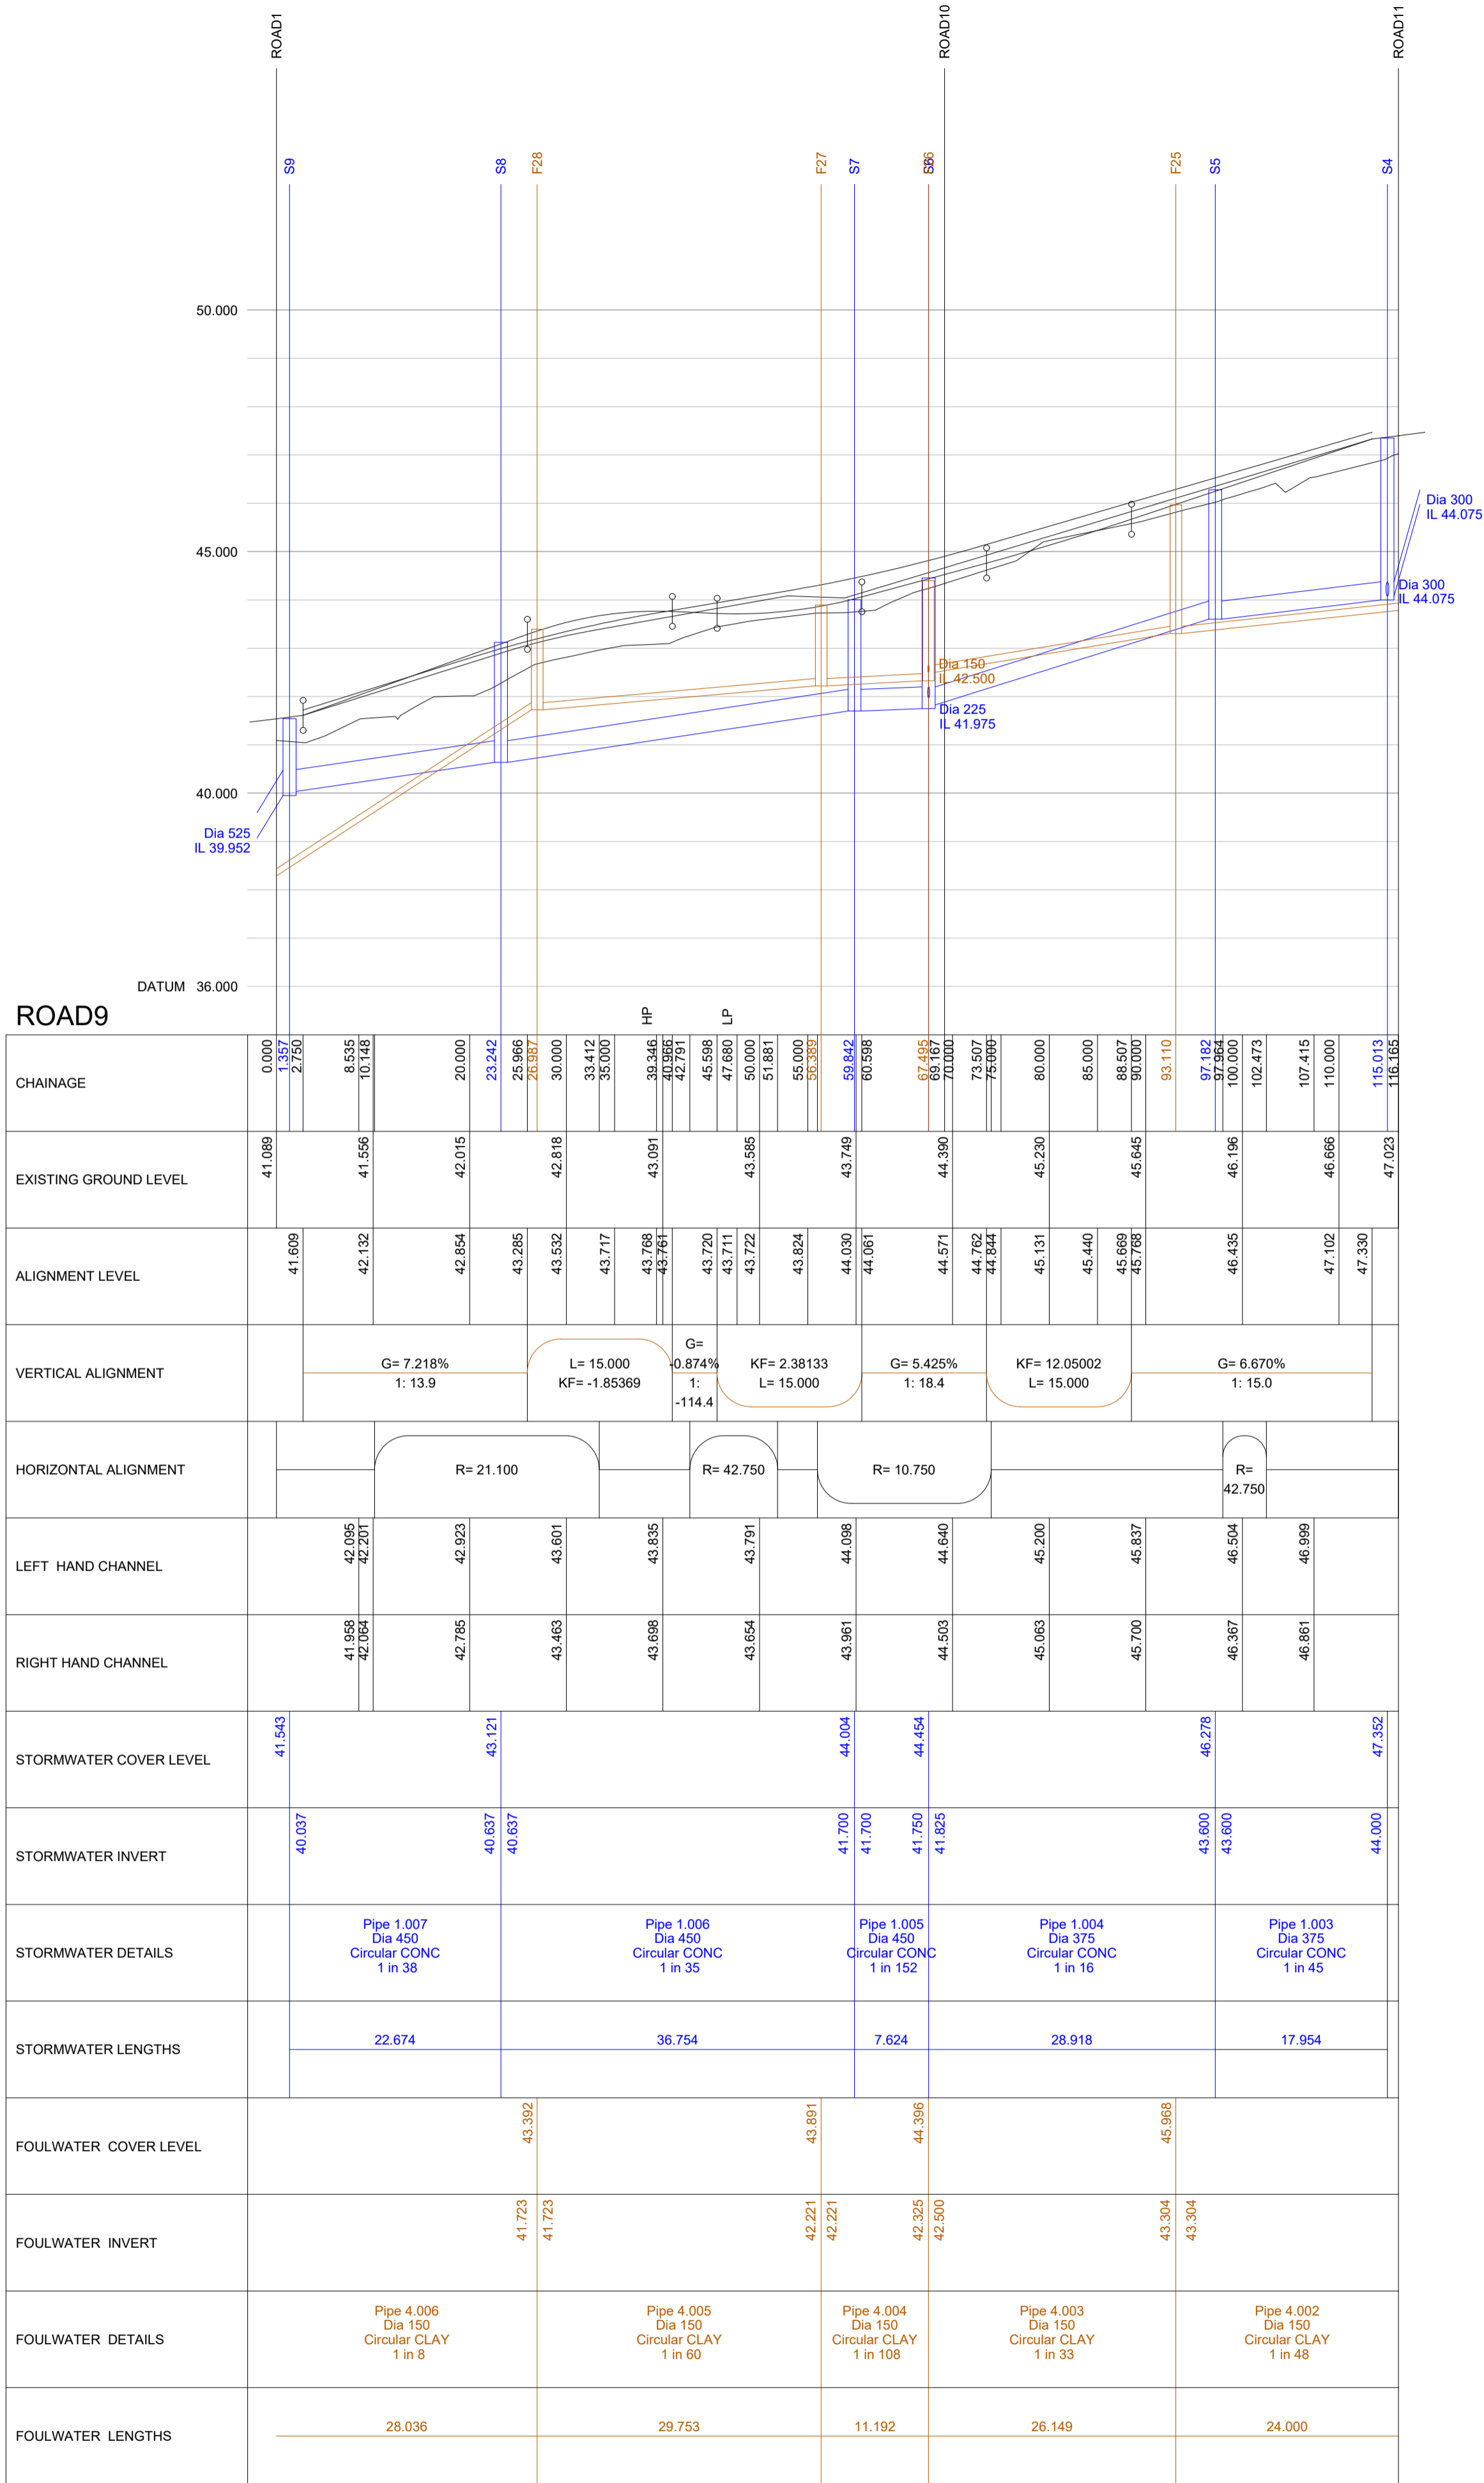

#### ROAD10

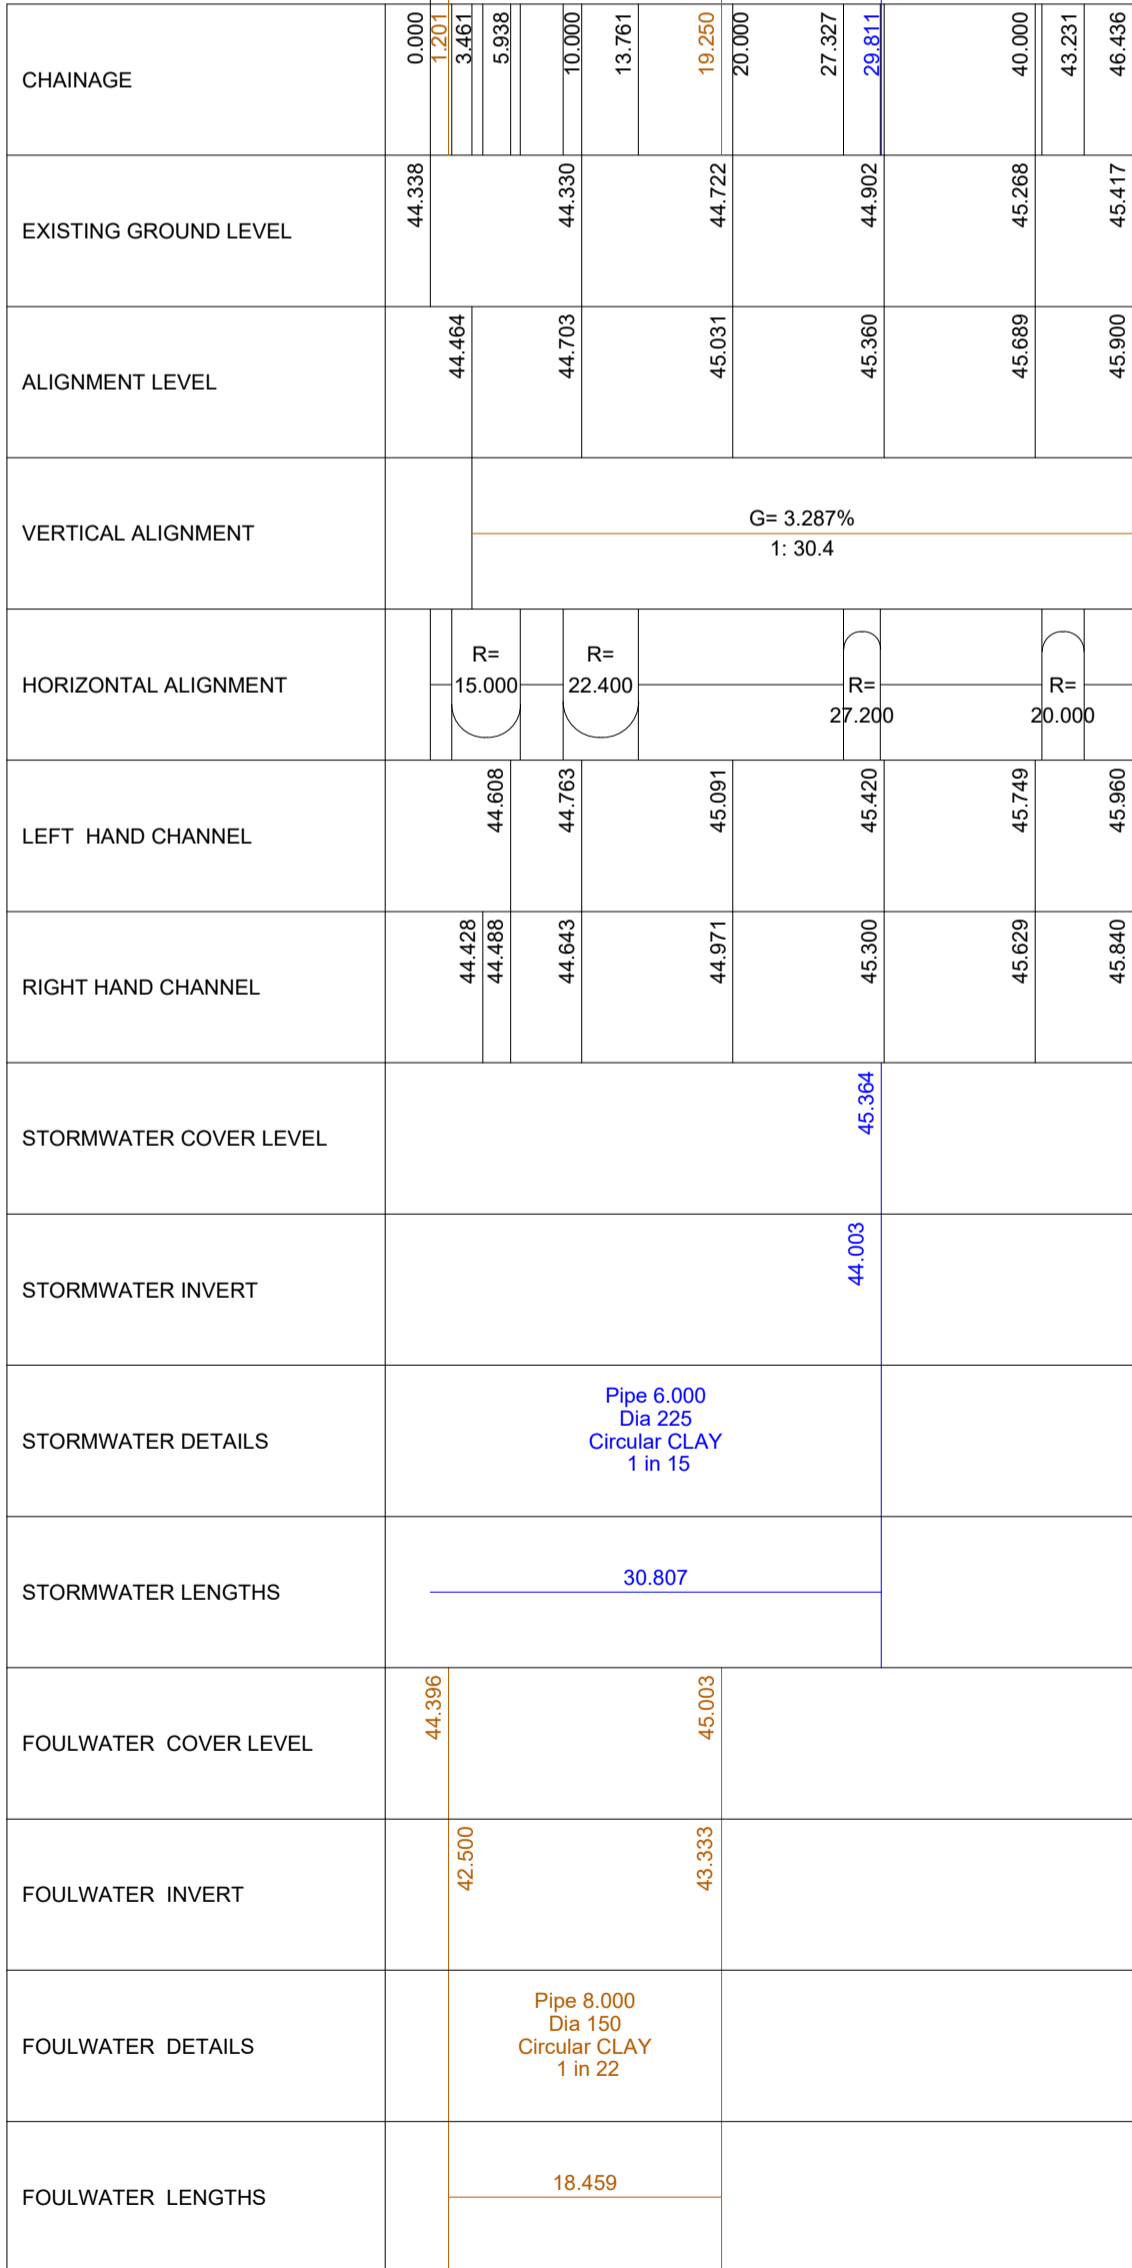

#### CIVIL / STRUCTURAL DESIGN RISK MANAGEMENT

Abnormal or unusual residual risks associated with the design outcomes shown on this drawing are:-

RSK LDE LTD has followed its Design Risk Management process for Hazard Elimination and Risk reduction in developing the designs shown on this drawing.  
Abnormal or unusual residual risks may be shown above where it is considered that such risk may not normally be expected by competent persons engaged on work of this nature or type.

#### Notes:

- This drawing is to be read in conjunction with the Standard Details, the layouts, schedules and specification for this project.
- All adoptable drainage to be constructed in conjunction with Design and Construction Guidance for Drainage or as stipulated in Southern Water Addendum.
- For guidance on types and distances of proposed trees away from adoptable sewers refer Design and Construction Guidance for Drainage Restrictions On Tree Planting Adjacent To Sewers.
- A + 1% gradient represents a rise of 1m in 100m.
- Left and right hand channels are on the left and right hand side respectively, when standing at zero chainage and looking along the road.
- A level at any point 'X'm from the start of a vertical curve is given by the formula:-  
$$\text{Level @ 'X'} = \text{Level @ start of the curve} + \frac{AX}{100} + \frac{(A-B)X^2}{200L}$$
  
where A and B are the gradients at the start and end of the curve respectively and having the algebraic signs +/,-.
- LHG and RHG indicates a left and right gully respectively.
- Pipe sizes are stated in millimetres and levels are shown in metres A.O.D.
- All pipes to have flexible joints with granular bedding ( ClaS S ) unless stated otherwise. Where 150mm concrete bed and surround is specified the concrete must be broken at the joint positions by the insertion of a "flexcell" collar.
- Connections to existing sewers are to be "SOFFIT TO SOFFIT" unless noted otherwise.
- All concrete pipes to be CLAS 'M' All clay pipes shall comply with BSEN 295-1 crushing strengths and shall have a minimum crushing strength of 34KN/m. All Concrete pipes 3000 and above shall be claS 120 and have a minimum crushing strength of 36kn/m
- 'MV' is equal to the rate of change of gradient and is calculated from the formula:-  
$$MV = 100 \times \frac{(A-B)}{L}$$
  
where A and B are as in Note 4 above.
- Existing levels to be confirmed on site prior to commencement of works.

P03	13.12.2024	Issued for PLANNING RESUBMISSION	SB	GXA	RD
P02	25.10.2024	Issued for PLANNING	SH	GXA	RD
P01	20.09.2024	Preliminary Issue	LN	GXA	RD
Rev.	Date	Amendment	Drawn	Chkd.	Appd.



Abbey Park  
Humber Road  
Coventry  
CV3 4AQ  
United Kingdom

Tel: +44 (0) 24 7650 5600  
Fax: +44 (0) 24 7650 1417  
Email: info@rsk.co.uk  
Web: www.rsk.co.uk

Client  
**BARRATT DAVID WILSON  
(SOUTHERN COUNTIES)**

Project Title  
**NEW PLACE FARM  
PULBOROUGH  
WEST SUSSEX**

Status  
**PLANNING**

Drawing Title  
**LONG SECTION  
ROADS 9 AND 10**

Drawn	Date	Checked	Date	Approved	Date
LN	09.24	GXA	09.24	RD	09.24

Scale	Orig Size	Dimensions
1:500	A1	m

Project No.	Drawing File
890815	890815-RSK-ZZ-XX-DR-C-8013 to 8022 Long Sections.dwg

Drawing No.	Rev.
890815	P03

Project	Orig.	Vol./Sys.	Lev./Loc.	Type	Role	Draw. No.

Scale 1:500