



from
Southern Water 

Horsham District Council
Parkside
Chart Way
Horsham
West Sussex
RH12 1RL

Your ref
DC/25/1269

Our ref
DSA000047153

Date
8th September 2025

Contact
Tel 0330 303 0119

Dear Sir/Madam,

Proposal: Outline Planning Application for up to 90 no. residential dwellings (including 40% affordable) all matters to be reserved apart from access.

Site: Land North of Guildford Road, Bucks Green, Rudgwick, West Sussex, RH12 3JJ.

Thank you for your correspondence, please see our comments below regarding the above application.

Connection to public sewer - capacity available desktop study over 50

Southern Water has undertaken a capacity check, and our investigations indicate that Southern Water can facilitate foul sewerage /surface water run off disposal to service the proposed development. Southern Water requires a formal application for a connection to the public sewer to be made by the applicant or developer.

To make an application visit Southern Water's Get Connected service:

<https://developerservices.southernwater.co.uk> and please read our New Connections Charging Arrangements documents which are available on our website via the following link: <https://www.southernwater.co.uk/developing-building/connection-charging-arrangements>

We request that should this planning application receive planning approval, the following informative is attached to the consent: Construction of the development shall not commence until details of the proposed means of foul sewerage and surface water disposal have been submitted to and approved in writing by the Local Planning Authority in consultation with Southern Water.

Existing Southern Water Assets – General within boundary but no tree, buildings, assets within stand-off distance (approximate)

Please see the attached extract from Southern Water records showing the approximate position of our existing sewer and water main assets crossing/in the vicinity of the development site. The exact position of the public assets must be determined on site by the applicant in consultation with Southern Water before the layout of the proposed development is finalised. To get in contact to confirm the exact position of the asset please visit;

https://www.southernwater.co.uk/media/ph4fk3pe/ds-location-of-rising-mains_pb.pdf.

For information on required stand-off distances from public sewers please refer to:

<https://www.southernwater.co.uk/media/st5orjvm/stand-off-distances.pdf>

Existing Gravity Sewer - tree, buildings, assets within stand-off distance

The 150 mm diameter gravity sewer requires a clearance of 3 metres on either side of the gravity sewer to protect it from construction works and to allow for future maintenance access.

No development or tree planting should be carried out within 3 metres of the external edge of the public gravity sewer without consent from Southern Water. All existing infrastructure should be protected during the course of construction works. Please refer to:

<https://www.southernwater.co.uk/media/st5orjvm/stand-off-distances.pdf>

Condition

In order to protect public sewers, Southern Water requests that if consent is granted, the following condition is attached to the planning permission; The developer must agree with Southern Water, prior to commencement of the development, the measures to be taken to protect the public sewers.

Existing Water Main - tree, buildings, assets within stand-off distance

The 125 mm diameter water main requires a clearance of 3 metres on either side of the water main to protect it from construction works and to allow for future maintenance access.

No excavation, mounding or tree planting should be carried out within 3 metres of the external edge of the public water main without consent from Southern Water. All existing infrastructure, including protective coatings and cathodic protection, should be protected during the course of construction works. Please refer to: <https://www.southernwater.co.uk/media/st5orjvm/stand-off-distances.pdf>

Condition

In order to protect water apparatus, Southern Water requests that if consent is granted, the following condition is attached to the planning permission; The developer must agree with Southern Water, prior to commencement of the development, the measures to be undertaken to protect/divert the public water supply main.

Tree planting

We have restrictions on the proposed tree planting adjacent to Southern Water sewers, rising mains or water mains. Reference should be made to Southern Water's publication "A Guide to Tree Planting near water Mains and Sewers"

(https://www.southernwater.co.uk/media/pddob0vn/ds-tree-planting-guide-1_nwm.pdf) and the

Sewerage Sector Guidance (<https://www.water.org.uk/sewerage-sector-guidance-approved-documents/>) with regards to any landscaping proposals and our restrictions and maintenance of tree planting adjacent to sewers, rising mains and water mains.

Condition

In order to protect public apparatus, Southern Water requests that if consent is granted, the following pre commencement condition is attached to the planning permission; The developer must advise the local authority (in consultation with Southern Water) of the landscaping proposals in proximity of public apparatus in order to protect it in accordance with Southern Water's guidance, prior to the commencement of the development.

Proposed SuDS features

If it is the intention of the developer for Southern Water to adopt the proposed SuDS, the system shall be designed and constructed in line with the Design and Construction Guidance www.water.org.uk/sewerage-sector-guidance-approved-documents/.

No Soakaways should be connected to the public surface water sewer.

The supporting documents make reference to drainage using Sustainable Drainage Systems (SuDS). Where SuDS form part of a continuous sewer system, and are not an isolated end of pipe SuDS component, adoption of SuDS will be considered if requested by the developer if they comply with: Design and Construction Guidance (Appendix C), CIRIA guidance and Southern Water SuDS Guidance available here:

<https://www.water.org.uk/sewerage-sector-guidance-approved-documents/>

<https://www.ciria.org/ItemDetail?iProductCode=C753F&Category=FREEPUBS>

<https://www.southernwater.co.uk/media/l4ndl3db/suds-final-080824.pdf>

Where SuDS rely upon facilities which are not adoptable by sewerage undertakers the applicant will need to ensure that arrangements exist for the long-term maintenance of the SuDS facilities. It is critical that the effectiveness of these systems is maintained in perpetuity. Good management will avoid flooding from the proposed surface water system, which may result in the inundation of the foul sewerage system.

Thus, where a SuDS scheme is to be implemented, the drainage details submitted to the Local Planning Authority should:

- Specify the responsibilities of each party for the implementation of the SuDS scheme.
- Specify a timetable for implementation.
- Provide a management and maintenance plan for the lifetime of the development.

This should include the arrangements for adoption by any public authority or statutory undertaker and any other arrangements to secure the operation of the scheme throughout its lifetime. This initial assessment does not prejudice any future assessment or commit to any adoption agreements under Section 104 of the Water Industry Act 1991.

Proposed soakaways

The Council's Building Control officers or technical staff should be asked to comment on the adequacy of soakaways to dispose of surface water from the proposed development. No new soakaways should be located within 5 metres of a public or adoptable gravity sewer, rising main or water main.

No Soakaways should be connected to the public surface water sewer.

Hierarchy of Building Regulations H3 for disposal of surface water - not yet provided documentation proving compliance

If the applicant has not already provided documentation demonstrating compliance with the surface water hierarchy reflected in part H3 of the Building Regulations, as shown below, we will require this to be provided where surface water is being considered for discharge to our network. Whilst reuse does not strictly form part of this hierarchy, Southern Water would encourage the consideration of reuse for new developments.

- Reuse
- Infiltration
- Watercourse
- Storm Sewer
- Combined Sewer

Guidance on Building Regulations is here: <https://www.gov.uk/government/publications/drainage-and-waste-disposal-approved-document-h>

We would like to engage with you on the design for disposal of surface water for this development at the earliest opportunity and we recommend that civil engineers and landscape architects work together and with Southern Water. In many cases this may negate or reduce the need for network reinforcement and allow earlier completion of the development.

Where a surface water connection to the foul or combined sewer is being considered, this should be agreed by the Lead Local Flood Authority, in consultation with Southern Water.

Condition

We request that should this application receive planning approval, the following condition is attached to the consent: Construction of the development shall not commence until details of the proposed means of surface water run off disposal in accordance with Part H3 of Building Regulations hierarchy as well as acceptable discharge points, rates and volumes have been agreed by the Lead Local Flood Authority, in consultation with Southern Water.

For further advice, please contact Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX (Tel: 0330 303 0119)

Website: southernwater.co.uk or by email at: SouthernWaterPlanning@southernwater.co.uk

Yours faithfully,




Future Growth Planning Team

southernwater.co.uk/developing-building/planning-your-development

Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX
southernwater.co.uk

Southern Water Services Ltd, Registered Office: Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX Registered in England No. 2366670

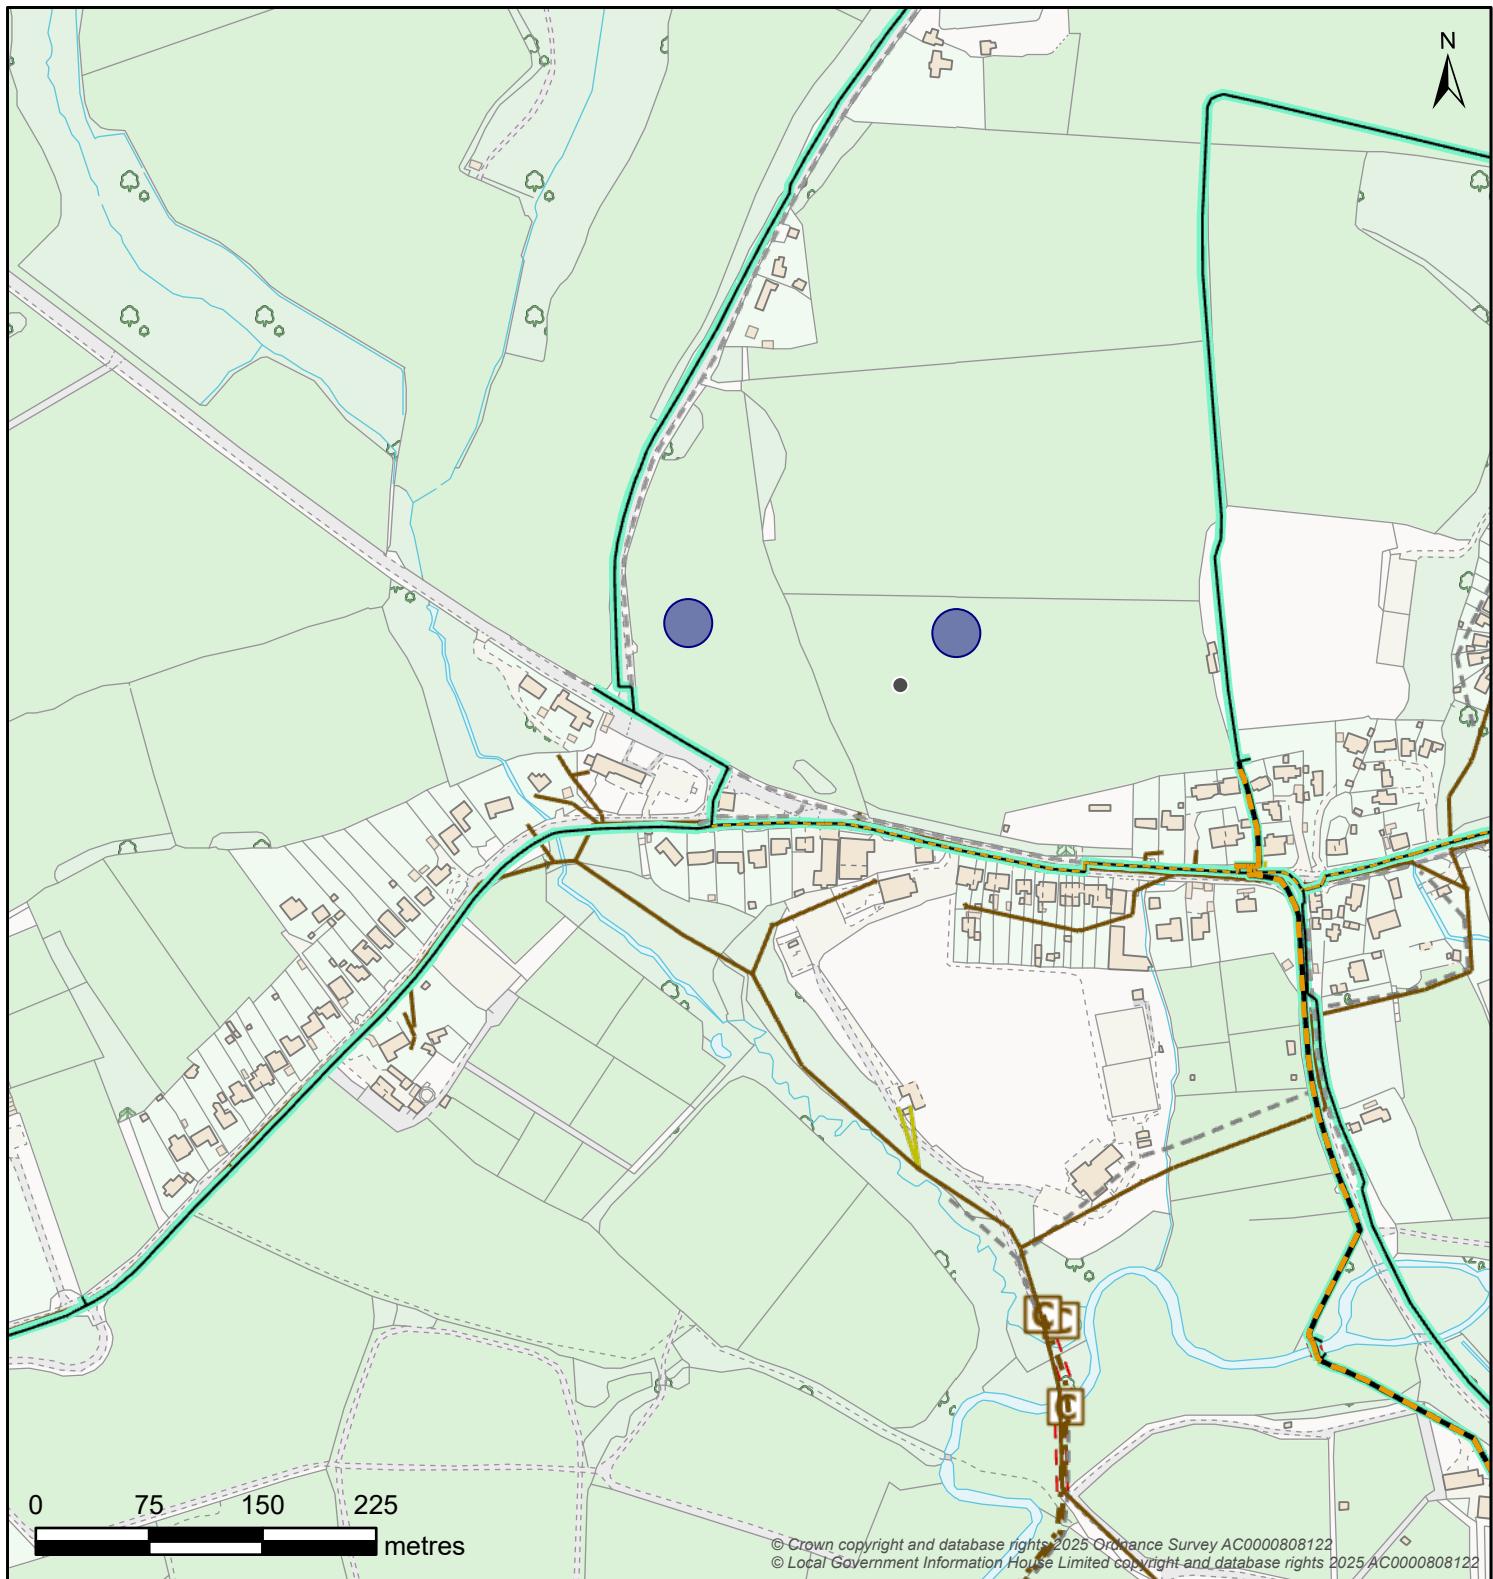

Controllable Valve	Flow Control	Inlet-Outfall
Damboards Penstock Valve	Anti Flood Device Pumped Anti Flood Device Reflux Valve	Inlet Outfall
BIF Bifurcation Cascade CP Catchpit Head Of Public Sewer IC Interceptor Chamber Manhole S Soakaway WO Washout		
Outfall Headworks	Overflow Chamber	Pipe Bridge
Outfall Headworks CSO Combined Sewer Overflow	Emergency Overflow	Pipe Bridge Micro Pumping Station Pumping Station
Sewer Level Monitor	Storage	Treatment Works
Sewer Level Monitor Storm Tank Tidal Storage Tank		Treatment Works Weir Wastewater Site
Wastewater Pipe	Wastewater Use	Developer Services
Culverted Water Course Drain Outfall Overflow Rising Main Sewer	Syphon Tank Sewer Trunk Sewer Vacuum Main Decommissioned Pipe	Foul Combined Sludge Treated Effluent Surface Water Private
		Build Over Agreement Section 104
Wastewater Area		
		Catchment Sub-Catchment

Map Title: SW Print

Printed By: Anne.McFarlane2

Date Printed: 08/09/2025

Map Scale: 5000

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.

