



Horsham District Council
Parkside
Chart Way
Horsham
West Sussex
RH12 1RL

Your ref
DC/26/0835

Our ref
DSA000055424

Date
16th July 2026

Contact
Tel 0330 303 0119

Dear Sir/Madam,

Proposal: Reserved matters approval for appearance, landscaping, layout and scale for 55 residential dwellings and associated infrastructure pursuant to outline planning permission ref DC/22/0301 for redevelopment of the site to provide up to 55 dwellings, ancillary parking and associated infrastructure with all matters reserved except access.

Site: Land North of The Rise, Partridge Green, West Sussex, RH13 8JB.

Thank you for your correspondence, please see our comments below regarding the above application.

Connection to water distribution main

Our investigations indicate that Southern Water can facilitate water supply to service the proposed development. Southern Water requires a formal application for a connection to the water supply to be made by the applicant or developer.

To make an application visit Southern Water's Get Connected service:

<https://developerservices.southernwater.co.uk> and please read our New Connections Charging Arrangements documents which are available to read on our website via the following link www.southernwater.co.uk/developing-building/connection-charging-arrangements

No capacity – Wastewater

Network Capacity refers to the available capacity in our underground assets that carry wastewater to Waste Water Treatment Works (WWTWs). This includes a range of pipe sizes and material types, Wastewater Pumping Stations (WPS) and supporting infrastructure.

Some capacity issues may be addressed with operational changes, others may require physical works on our assets. We may identify where several developments would benefit from a larger network reinforcement programme to serve them all where significant growth is taking place in close proximity.



Part of our evaluation looks at the risk of flooding incidents arising from the additional flow of material in terms of 'hydraulic overload'. This means we consider whether there is enough room in the pipes for the likely maximum flow from the connection itself. This assessment does not include random events such as ingress of water from broken pipes, changes in flow arising from blockages or unidentified additional flows from misconnections, these are dealt with through other processes outside of our asset growth planning team as they are operational incidents.

Network Capacity is independent of capacity at the WWTW and growth is planned in a different way though in some cases we may have parallel projects to both reinforce both the network and upgrade the treatment works but this is often not required.

For full details of our connection charging arrangement visit: Connection charging arrangements (southernwater.co.uk)

Southern Water has undertaken a capacity check of the impact that the additional foul sewerage flows from the proposed development will have on the existing public sewer network. This study indicates that these additional flows may lead to a minor increased risk of impact on the sewer network.

S106 Connection application

Any new connections to the public sewerage system will require a Section 106 connection application to be submitted and approved by Southern Water Services.

To make an application visit Southern Water's Get Connected service:

<https://developerservices.southernwater.co.uk> and please read our New Connections Charging Arrangements documents which are available on our website via the following link:

<https://www.southernwater.co.uk/developing-building/connection-charging-arrangements>

Please note that, where there are separate systems available, Southern Water will not allow surface water to connect into the public foul sewer. If this is not possible, please provide evidence that all other options have been explored.

It is possible that a sewer now deemed to be public could be crossing the development site. Therefore, should any sewer be found during construction work, an investigation of the sewer will be required to ascertain its ownership before any work commences on site. If this happens, please call our Customer Service Desk on 0330 303 0119

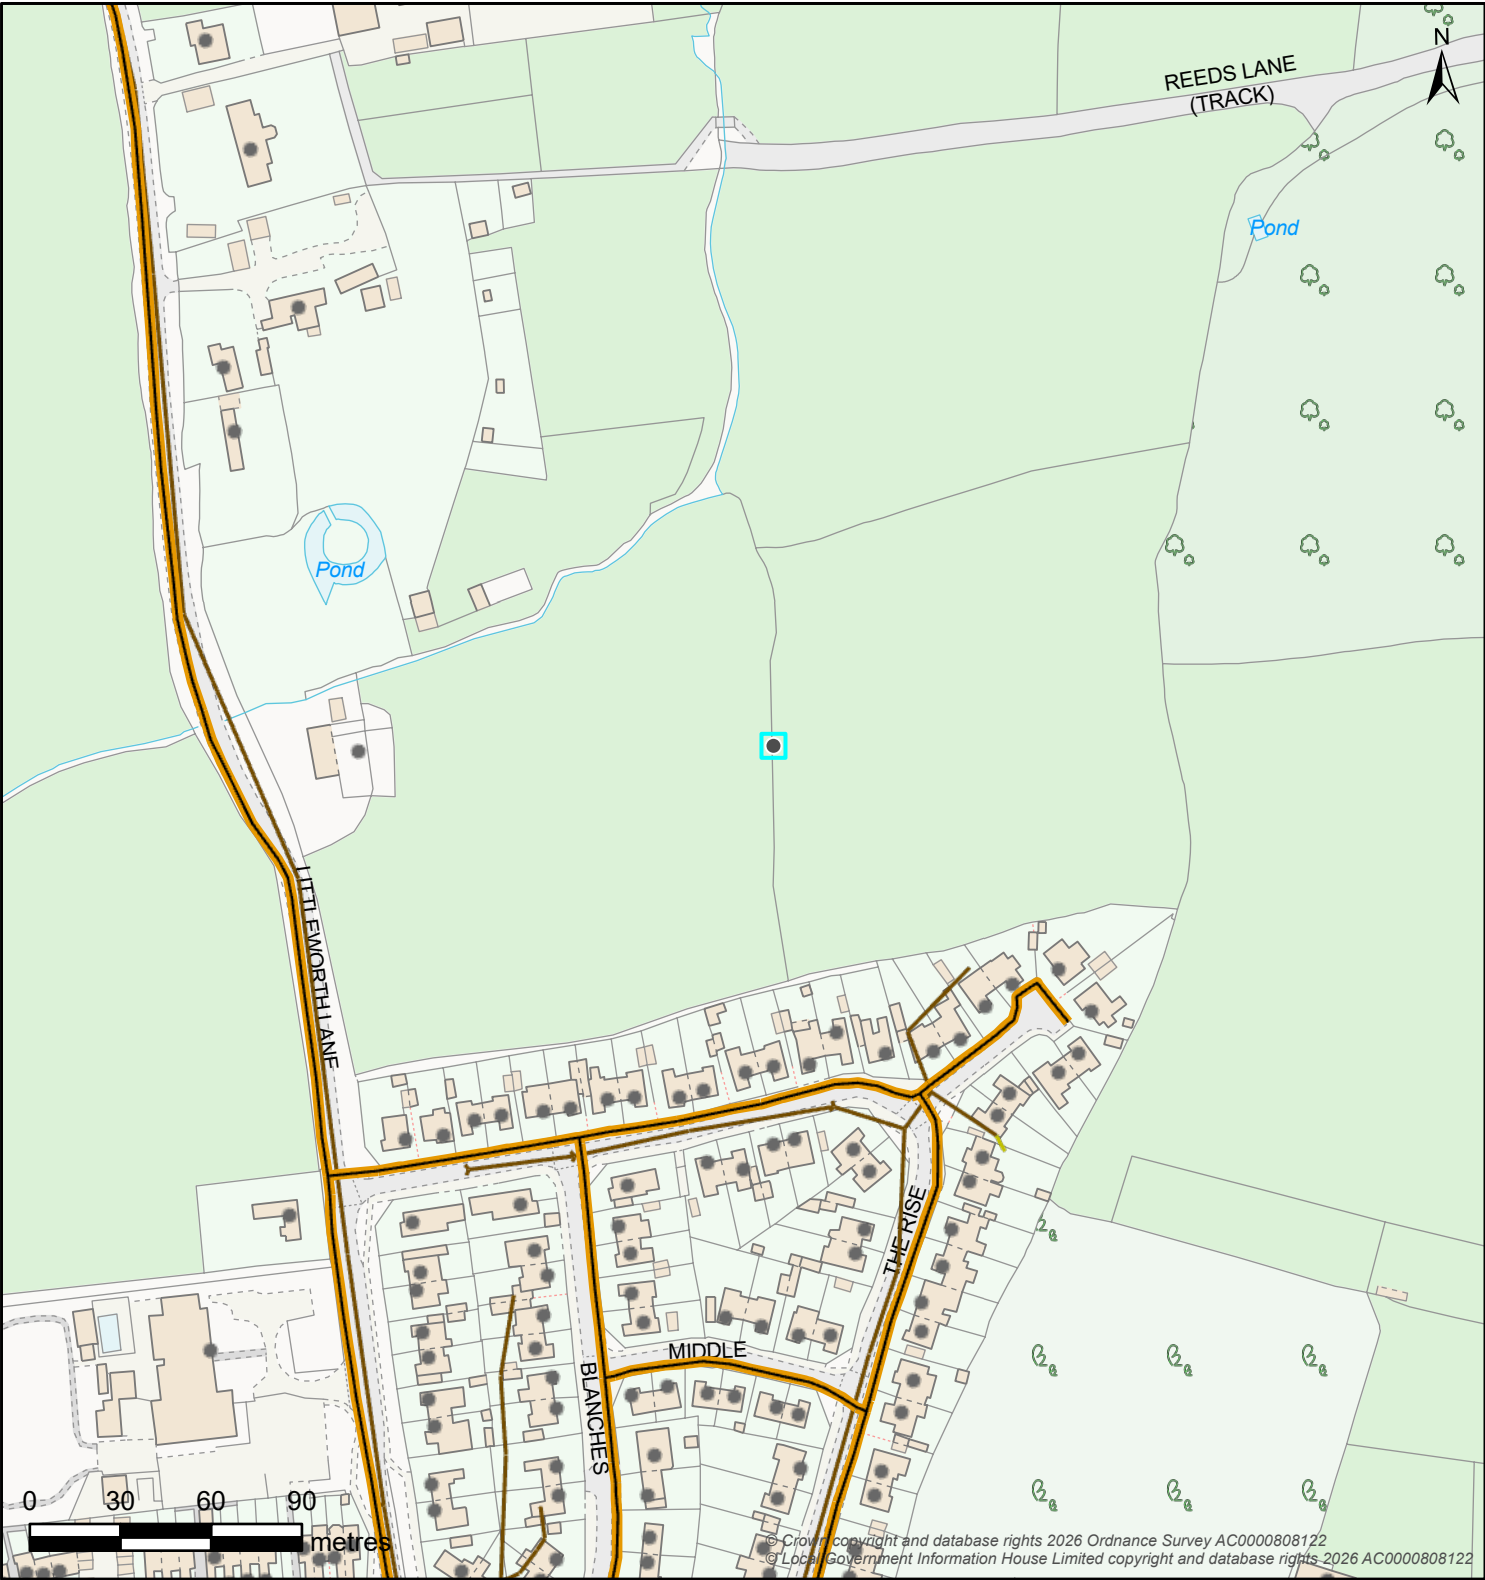
For further advice, please contact Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX (Tel: 0330 303 0119)

Website: southernwater.co.uk or by email at: SouthernWaterPlanning@southernwater.co.uk



Yours faithfully,

Future Growth Planning Team

southernwater.co.uk/developing-building/planning-your-development



© Crown copyright and database rights 2026 Ordnance Survey AC0000808122
© Local Government Information House Limited copyright and database rights 2026 AC0000808122

Boundary Box		Break Pressure Tank		Capped End		Hydrant		
 Boundary Box	 BPT Break Pressure Tank	 Capped End	 Emptying Plug	 Fire Hydrant	 Washout Hydrant			
Pressure Monitoring		Service Reservoir		Meter		Valve – Controllable		
 Logger	 Covered	 Tower	 Meter	 Open Valve	 Closed Valve	 Stop Tap		
Site				Valve – Flow				
 Abstraction Point	 Supply Works	 AV Air Valve	 NRV Non-Return Valve	 WO Washout Empty Valve				
 Booster Station	 Transfer Station	Valve – Pressure			Pipe Bridge			
 Surface Reservoir	 Underground Source	 PRV Pressure Reducing Valve	 PSV Pressure Sustaining Valve	 Pipe Bridge				
Water Pipe				Water Area				
 Communication	 Trunk	 Decommissioned		 Water Supply Zone		 District Meter Area		
 Distribution	 Raw	 Discolouration						
 Non-Potable	 Private							

Map Title: DSA000055424 GIS

Printed By: Kelly.Donaldson
Date Printed: 03/07/2026
Map Scale: 2500

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.

