from Southern Water

Directorate of Planning
Horsham District Council
Parkside
Chart Way
Horsham
West Sussex
RH12 1RL

Your ref
DC/24/0203

Our ref
DSA000031763

Date
08 March 2024

Contact
Tel 0330 303 0119

Dear Sir/Madam,

Proposal: Relocation of existing Wardens Accommodation to an alternative location on the site.
Site: DC/24/0203: - Land at Sumners Ponds, Chapel Road, Barns Green, West Sussex, RH13 0PR.

Thank you for your letter dated 19 February 2024.

Following the review of the submitted documents, we have the below comments for the Planning consultation.

Foul and Surface Water Drainage

There are no public foul and surface water sewers in the area to serve this development. The applicant is advised to examine alternative means of foul and surface water disposal.

It is possible that a sewer now deemed to be public could be crossing the development site. Therefore, should any sewer be found during construction works, an investigation of the sewer will be required to ascertain its ownership before any further works commence on site.

Southern Water has noted that the applicant has submitted a Water Neutrality report which we understand the Local Planning Authority will be working in conjunction with Natural England on reviewing the developers proposals. We would not comment on the developers proposals directly, however if the LPA have any specific questions, they can be forwarded to us for a direct response.

Southern Water Services Ltd, Registered Office: Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX Registered in England No. 2366670

For further advice, please contact Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX (Tel: 0330 303 0119).

Website: southernwater.co.uk or by email at: SouthernWaterPlanning@southernwater.co.uk

Yours faithfully,

Future Growth Planning Team
Developer Services

southernwater.co.uk/developing-building/planning-your-development

Southern Water Services Ltd, Registered Office: Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX Registered in England No. 2366670

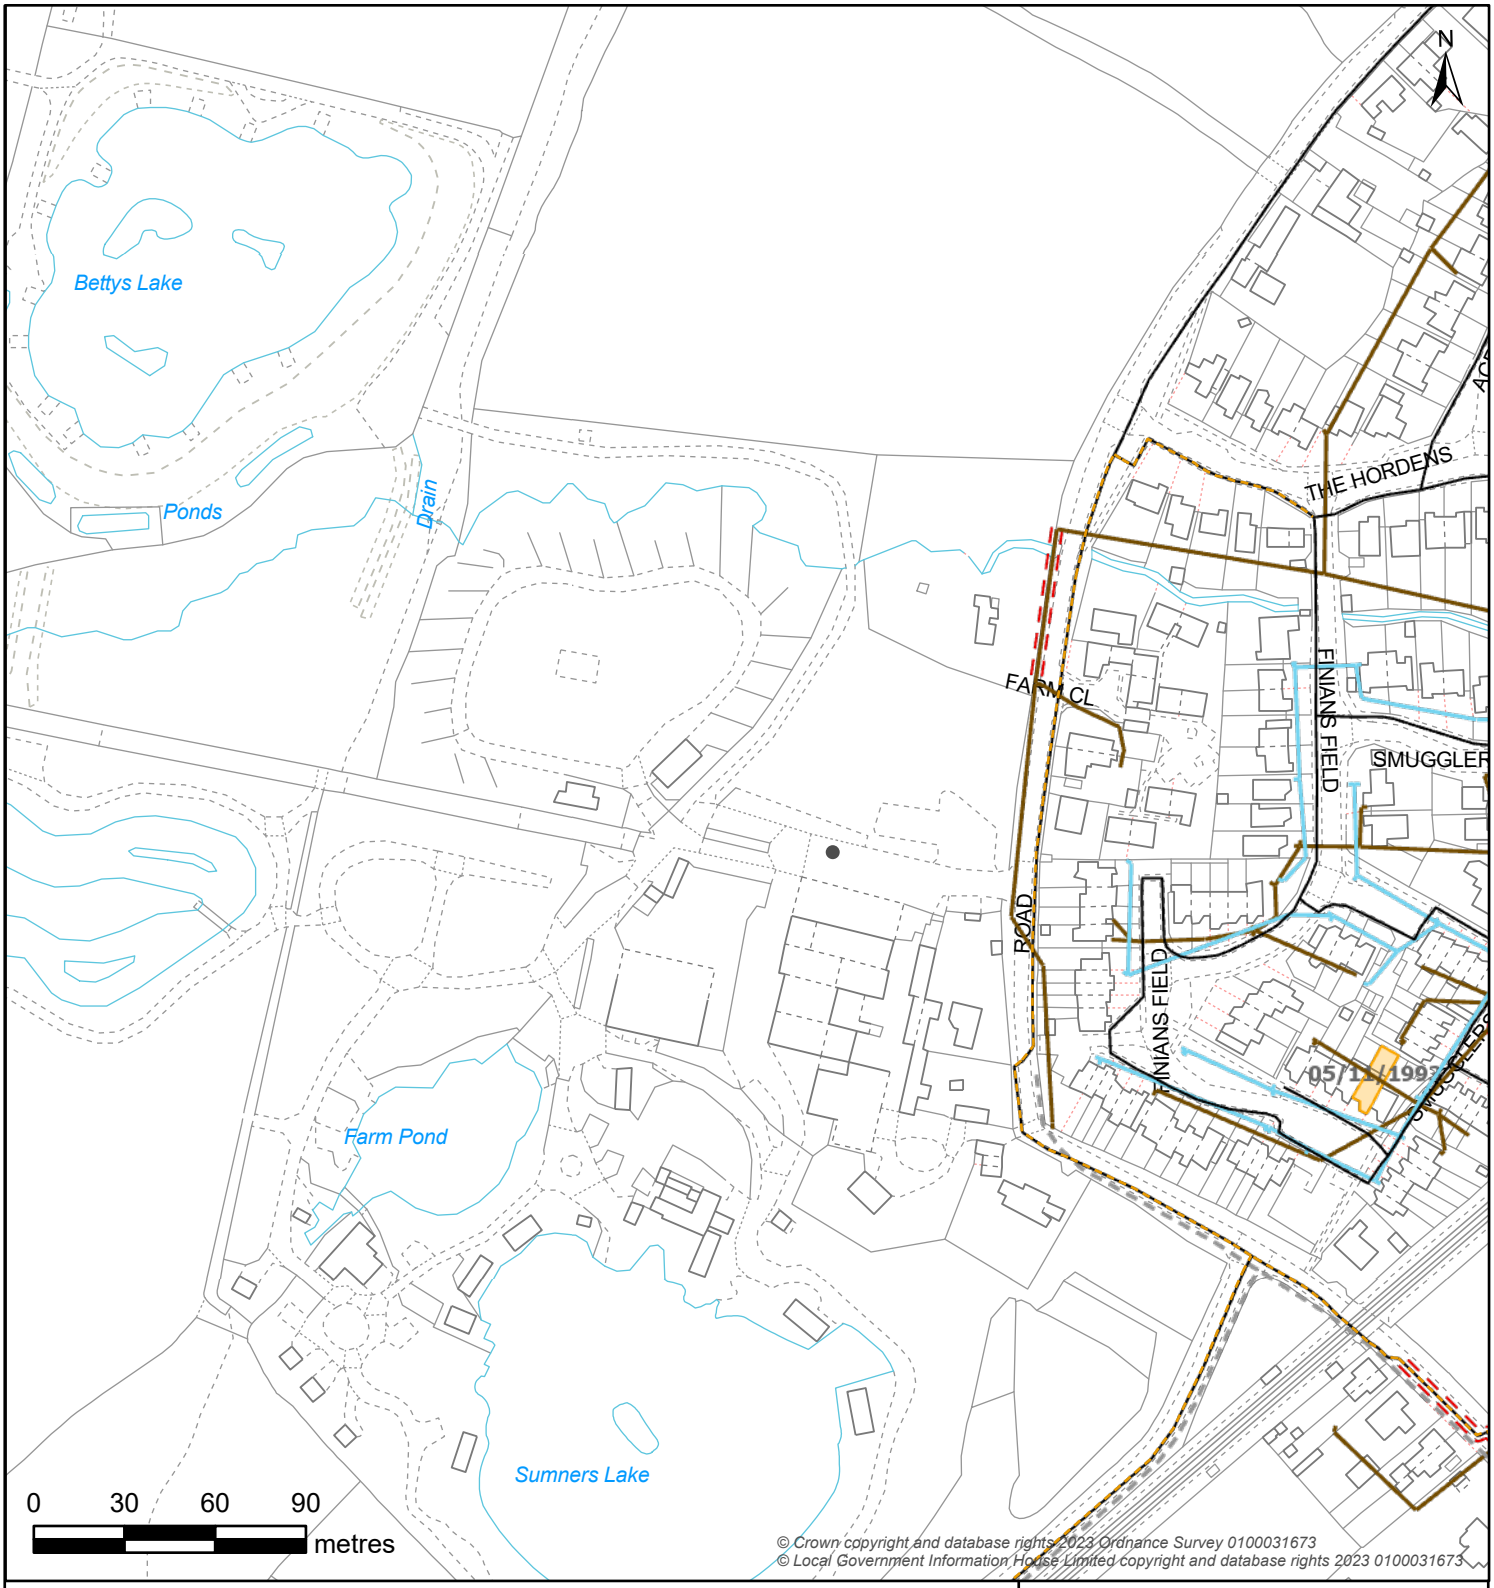

Controllable Valve			Flow Control			Inlet-Outfall	
Damboards	Penstock	Valve	Anti Flood Device	Pumped Anti Flood Device	Reflux Valve	Inlet	Outfall

Manhole											
BIF	Bifurcation	Cascade	CP	Catchpit	Head Of Public Sewer	IC	Interceptor Chamber	Manhole	S	Soakaway	WO	Washout

Outfall Headworks	Overflow Chamber		Pipe Bridge	Pumping Station	
Outfall Headworks	CSO	Combined Sewer Overflow	Pipe Bridge	Micro Pumping Station	Pumping Station
	EMO	Emergency Overflow			

Sewer Level Monitor	Storage		Treatment Works	Weir	Wastewater Site
Sewer Level Monitor	Storm Tank	Tidal Storage Tank	Treatment Works	Weir	Wastewater Site

Wastewater Pipe		Wastewater Use	Developer Services	
Culverted Water Course	Syphon	Foul	Build Over Agreement	Section 104
Drain	Tank Sewer	Combined	**Wastewater Area**	
Outfall	Trunk Sewer	Sludge	Catchment	
Overflow	Vacuum Main	Treated Effluent	Sub-Catchment	
Rising Main	Decommissioned Pipe	Surface Water		
Sewer		Private		

Map Title: SW Print

Printed By: Arjun.Yadav

Date Printed: 01/03/2024

Map Scale: 2500

The positions of pipes on this plan are believed to be correct, but Southern Water Services Ltd accept no responsibility in the event of inaccuracy. The actual positions should be determined on-site

WATER for LIFE from Southern Water