



Horsham District Council
Parkside
Chart Way
Horsham
West Sussex
RH12 1RL

Your ref
DC/25/2006

Our ref
DSA000050070

Date
26th June 2026

Contact
Tel 0330 303 0119

Dear Sir/Madam,

Proposal: Outline application with all matters to be reserved except for access and layout, for the erection of 38no. dwellings, (including 13no. on-site affordable housing units), together with access from Hayes Lane, vehicle and cycle parking, landscaping, open space and play provision, sustainable drainage, and re-alignment of Public Right of Way No.3782

Site: Land East of 1 To 25 Hayes Lane, Slinfold, West Sussex, RH13 0SQ.

Thank you for your correspondence. Please see our comments below regarding the above planning consultation application.

Following a further review please see our updated response to the application.

Inadequate capacity in the foul network

Network Capacity refers to the available capacity in our underground assets that carry wastewater to Waste Water Treatment Works (WWTWs). This includes a range of pipe sizes and material types, Wastewater Pumping Stations (WPS) and supporting infrastructure.

Some capacity issues may be addressed with operational changes, others may require physical works on our assets. We may identify where several developments would benefit from a larger network reinforcement programme to serve them all where significant growth is taking place in close proximity.

Part of our evaluation looks at the risk of flooding incidents arising from the additional flow of material in terms of 'hydraulic overload'. This means we consider whether there is enough room in the pipes for the likely maximum flow from the connection itself. This assessment does not include random events such as ingress of water from broken pipes, changes in flow arising from blockages or unidentified additional flows from misconnections, these are dealt with through other processes outside of our asset growth planning team as they are operational incidents.



Network Capacity is independent of capacity at the WWTW and growth is planned in a different way though in some cases we may have parallel projects to both reinforce both the network and upgrade the treatment works but this is often not required.

For full details of our connection charging arrangement visit: Connection charging arrangements (southernwater.co.uk)


Southern Water has undertaken a capacity check of the impact that the additional foul sewerage flows from the proposed development will have on the existing public sewer network. This study indicates that these additional flows may lead to a minor increased risk of impact on the sewer network.

It is possible that a sewer now deemed to be public could be crossing the development site. Therefore, should any sewer be found during construction work, an investigation of the sewer will be required to ascertain its ownership before any work commences on site. If this happens, please call our Customer Service Desk on 0330 303 0119

For further advice, please contact Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX (Tel: 0330 303 0119).

Website: southernwater.co.uk or by email at: SouthernWaterPlanning@southernwater.co.uk

Yours faithfully,
Future Growth Planning Team
southernwater.co.uk/developing-building/planning-your-development

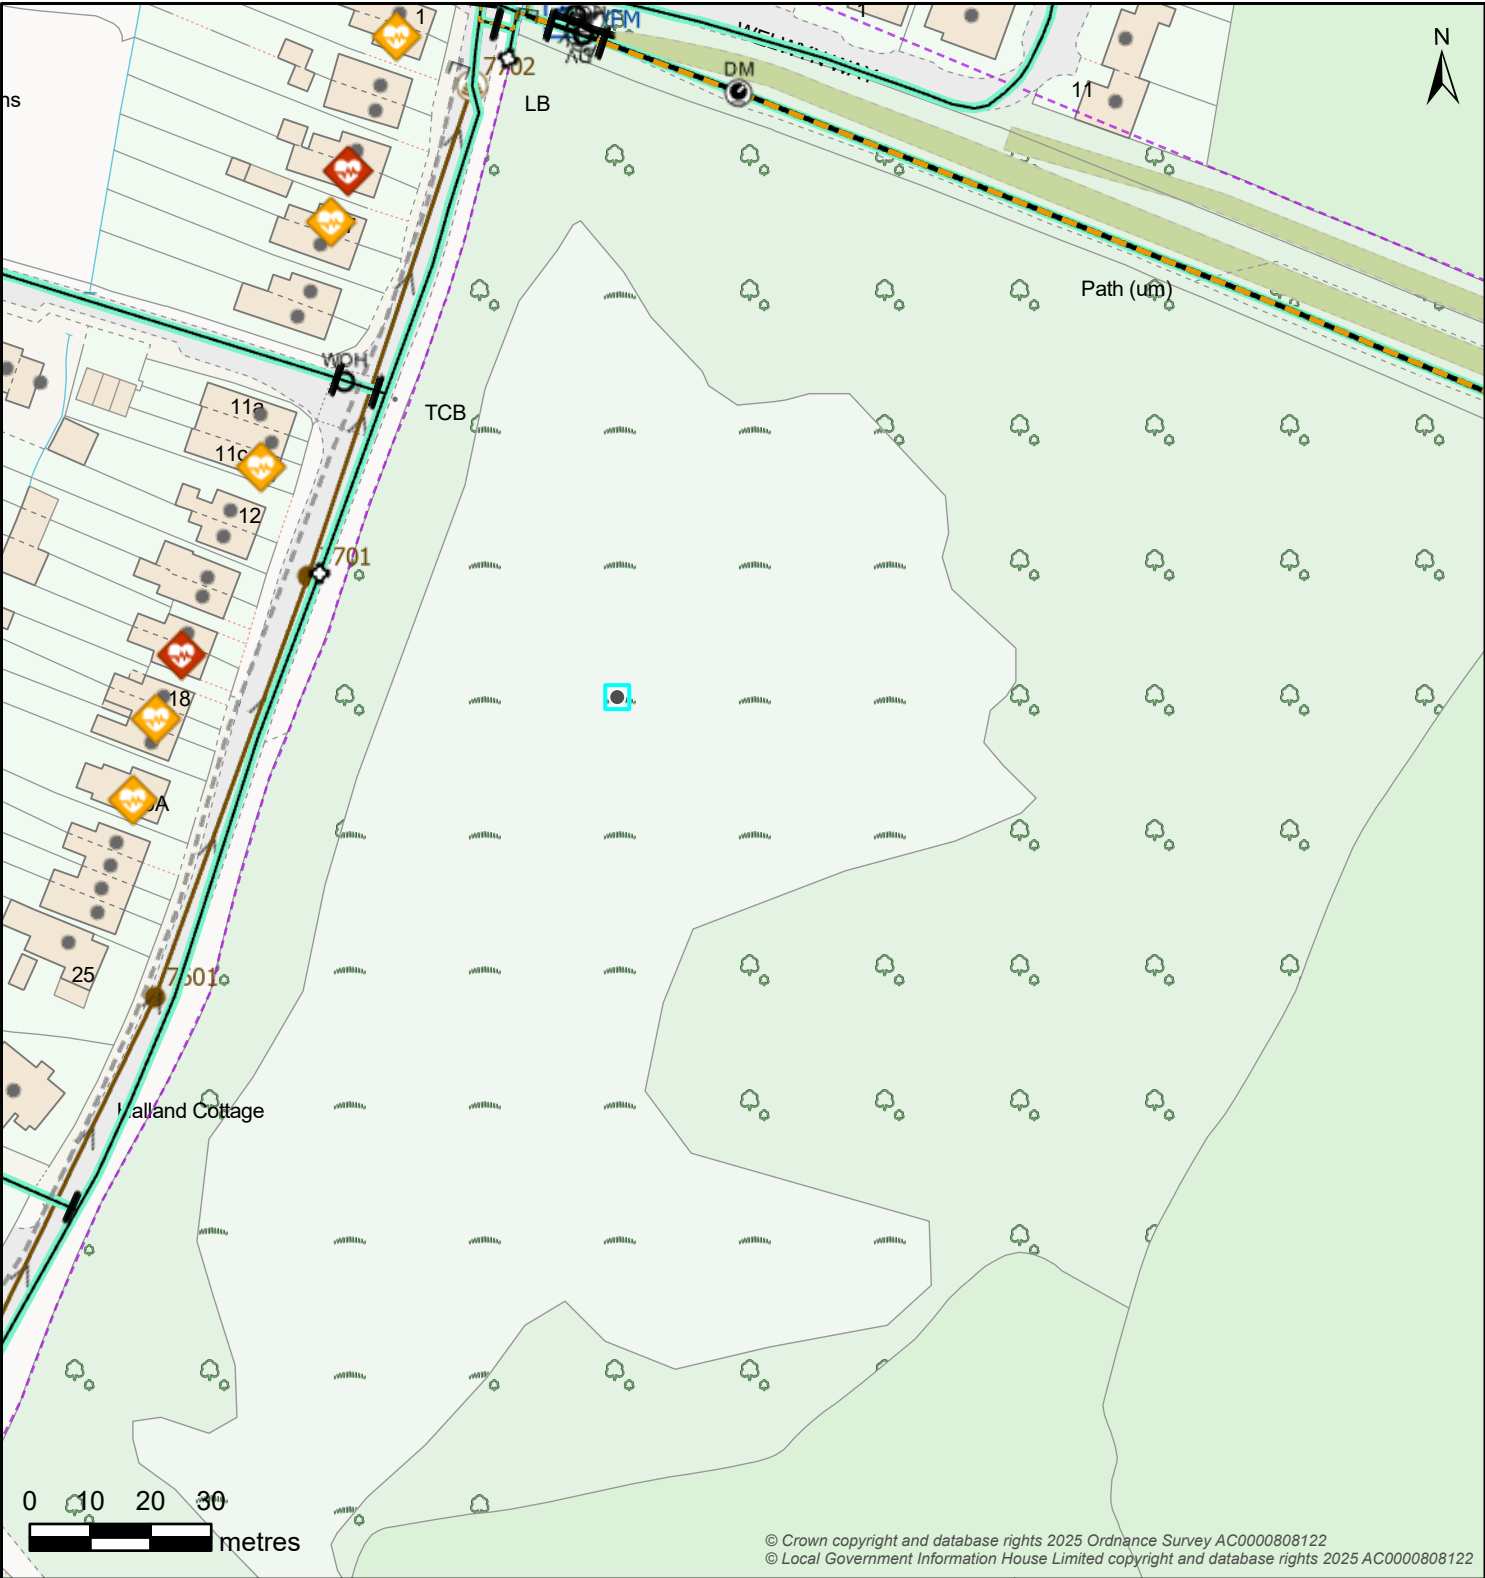

© Crown copyright and database rights 2025 Ordnance Survey AC0000808122
© Local Government Information House Limited copyright and database rights 2025 AC0000808122

Controllable Valve			Flow Control			Inlet-Outfall	
Damboards	Penstock	Valve	Anti Flood Device	Pumped Anti Flood Device	Reflux Valve	Inlet	Outfall
Manhole							
BIF Bifurcation	Cascade	CP Catchpit	Head Of Public Sewer	IC Interceptor Chamber	Manhole	S Soakaway	WO Washout
Outfall Headworks		Overflow Chamber		Pipe Bridge		Pumping Station	
Outfall Headworks	CSO Combined Sewer Overflow	Emergency Overflow	EMO Emergency Overflow	Pipe Bridge	Micro Pumping Station	Pumping Station	
Sewer Level Monitor		Storage		Treatment Works		Weir	
Sewer Level Monitor	Storm Tank	Tidal Storage Tank		Treatment Works		Weir	Wastewater Site
Wastewater Pipe				Wastewater Use		Developer Services	
Culverted Water Course	Syphon	Tank Sewer	Trunk Sewer	Foul	Combined	Build Over Agreement	Section 104
Drain	Vacuum Main	Decommissioned Pipe		Sludge	Treated Effluent	Wastewater Area	
Outfall				Surface Water	Private	Catchment	Sub-Catchment
Overflow							
Rising Main							
Sewer							

Map Title: SW Print

Printed By: Anne.McFarlane2
Date Printed: 06/01/2026
Map Scale: 1250

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.

