



Horsham District Council
Parkside
Chart Way
Horsham
West Sussex
RH12 1RL

Your ref
DC/26/1197

Our ref
DSA000056843

Date
20th August 2026

Contact
Tel 0330 303 0119

Dear Sir/Madam,

Proposal: Change of Use of the existing Class E building into 195 residential dwellings
Site: St Marks Court, Chart Way, Horsham, West Sussex, RH12 1XL.

Thank you for your correspondence, please see our comments below regarding the above application.

Insufficient Information provided

Condition

Construction of the development shall not commence until details of the proposed means of foul/surface water drainage disposal have been submitted to, and approved in writing by the Local Planning Authority in consultation with Southern Water.

Existing Southern Water Assets – General within boundary but no tree, buildings, assets within standoff distance (approximate)

Please see the attached extract from Southern Water records showing the approximate position of our existing sewer and water main assets crossing/in the vicinity of the development site. The exact position of the public assets must be determined on site by the applicant in consultation with Southern Water before the layout of the proposed development is finalised. To get in contact to confirm the exact position of the asset please visit;

https://www.southernwater.co.uk/media/ph4fk3pe/ds-location-of-rising-mains_pb.pdf.

For information on required stand-off distances from public sewers please refer to:

<https://www.southernwater.co.uk/media/st5orjvm/stand-off-distances.pdf>

Existing Gravity Sewer - tree, buildings, assets within stand-off distance

The 450 mm & 300 mm diameter gravity sewers requires a clearance of 3 metres on either side of the gravity sewers to protect it from construction works and to allow for future maintenance access. No development or tree planting should be carried out within 3 metres of the external edge of the public gravity sewer without consent from Southern Water. All existing infrastructure should be protected during the course of construction works. Please refer to:

<https://www.southernwater.co.uk/media/st5orjvm/stand-off-distances.pdf>

Condition

In order to protect public sewers, Southern Water requests that if consent is granted, the following condition is attached to the planning permission; The developer must agree with Southern Water, prior to commencement of the development, the measures to be taken to protect the public sewers

Existing Water Main - tree, buildings, assets within stand-off distance

The 300 mm diameter water main requires a clearance of 3 metres on either side of the water main to protect it from construction works and to allow for future maintenance access.

No excavation, mounding or tree planting should be carried out within 3 metres of the external edge of the public water main without consent from Southern Water. All existing infrastructure, including protective coatings and cathodic protection, should be protected during the course of construction works. Please refer to: <https://www.southernwater.co.uk/media/st5orjvm/stand-off-distances.pdf>

Condition

In order to protect water apparatus, Southern Water requests that if consent is granted, the following condition is attached to the planning permission; The developer must agree with Southern Water, prior to commencement of the development, the measures to be undertaken to protect/divert the public water supply main.

Proposed basement.

The design of the proposed basements and on-site drainage system should consider the possibility of surcharging within the public sewerage system in order to provide adequate protection to basements from the risk of flooding.

Possible Contamination on Redevelopment Site

The level of contamination on site should be investigated, as this may affect the materials used for the public water mains to service the development. Details of any contamination found on site should be declared to the statutory water undertaker, as part of a water connection application, as this will influence the materials used for construction of public water mains on the site.

Please visit [water-connection-technical-guidance_wca.pdf](#) for more information.

S106 Connection application

Any new connections to the public sewerage system will require a Section 106 connection application to be submitted and approved by Southern Water Services.

To make an application visit Southern Water's Get Connected service:



<https://developerservices.southernwater.co.uk> and please read our New Connections Charging Arrangements documents which are available on our website via the following link:
<https://www.southernwater.co.uk/developing-building/connection-charging-arrangements>

Please note that, where there are separate systems available, Southern Water will not allow surface water to connect into the public foul sewer. If this is not possible, please provide evidence that all other options have been explored.


Due to legislative changes effective from 1st October 2011 regarding the ownership of sewers, it is possible that a sewer now deemed to be public could be crossing the development site. Therefore, should any sewer be found during construction work, an investigation of the sewer will be required to ascertain its ownership before any work commences on site. If this happens, please call our Customer Service Desk on 0330 303 0119

For further advice, please contact Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX (Tel: 0330 303 0119)

Website: southernwater.co.uk or by email at: SouthernWaterPlanning@southernwater.co.uk

Yours faithfully,

Future Growth Planning Team
southernwater.co.uk/developing-building/planning-your-development

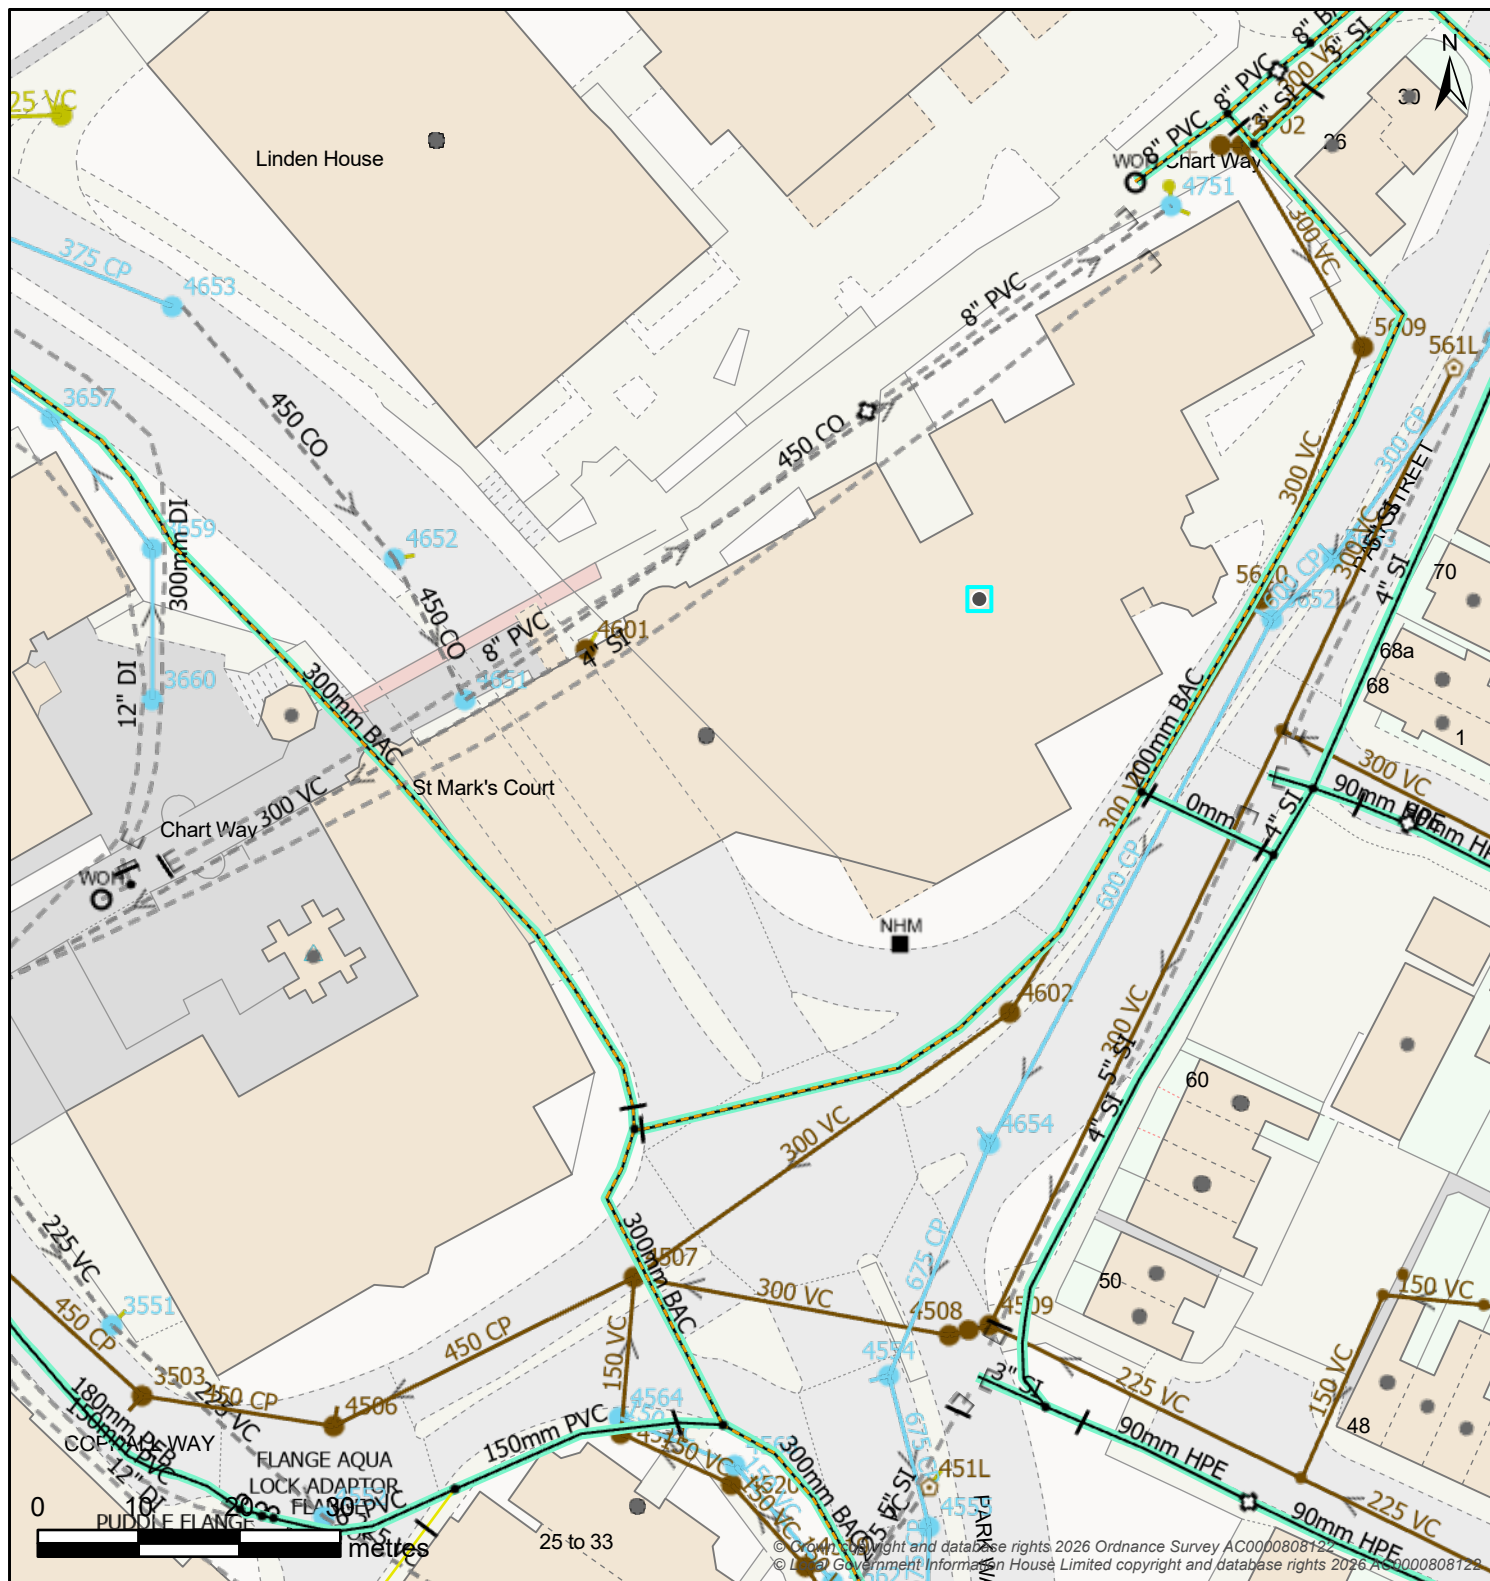

Controllable Valve			Flow Control			Inlet-Outfall	
Manhole							
BIF Bifurcation	Cascade	CP Catchpit	HOP Head Of Public Sewer	IC Interceptor Chamber	Manhole	S Soakaway	WO Washout
Outfall Headworks		Overflow Chamber		Pipe Bridge		Pumping Station	
Outfall Headworks	CSO Combined Sewer Overflow	EMO Emergency Overflow	Pipe Bridge	Micro Pumping Station	Pumping Station		
Sewer Level Monitor		Storage		Treatment Works		Weir	
Sewer Level Monitor	Storm Tank	Tidal Storage Tank	Treatment Works	Weir	Wastewater Site		
Wastewater Pipe				Wastewater Use		Developer Services	
Culverted Water Course	Syphon	Tank Sewer	Trunk Sewer	Foul	Combined	Build Over Agreement	Section 104
Drain	Vacuum Main	Decommissioned Pipe	Sewer	Sludge	Treated Effluent	Surface Water	Private
Overflow				Developer Services	Wastewater Area	Catchment	Sub-Catchment

Map Title: SW Print

Printed By: Anne.McFarlane2

Date Printed: 20/08/2026

Map Scale: 750

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.

