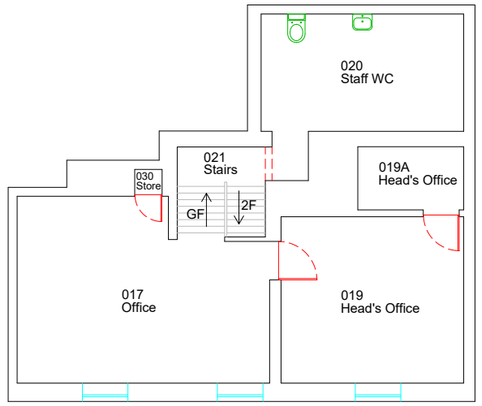

Main Building: First Floor



Main Building: Second Floor



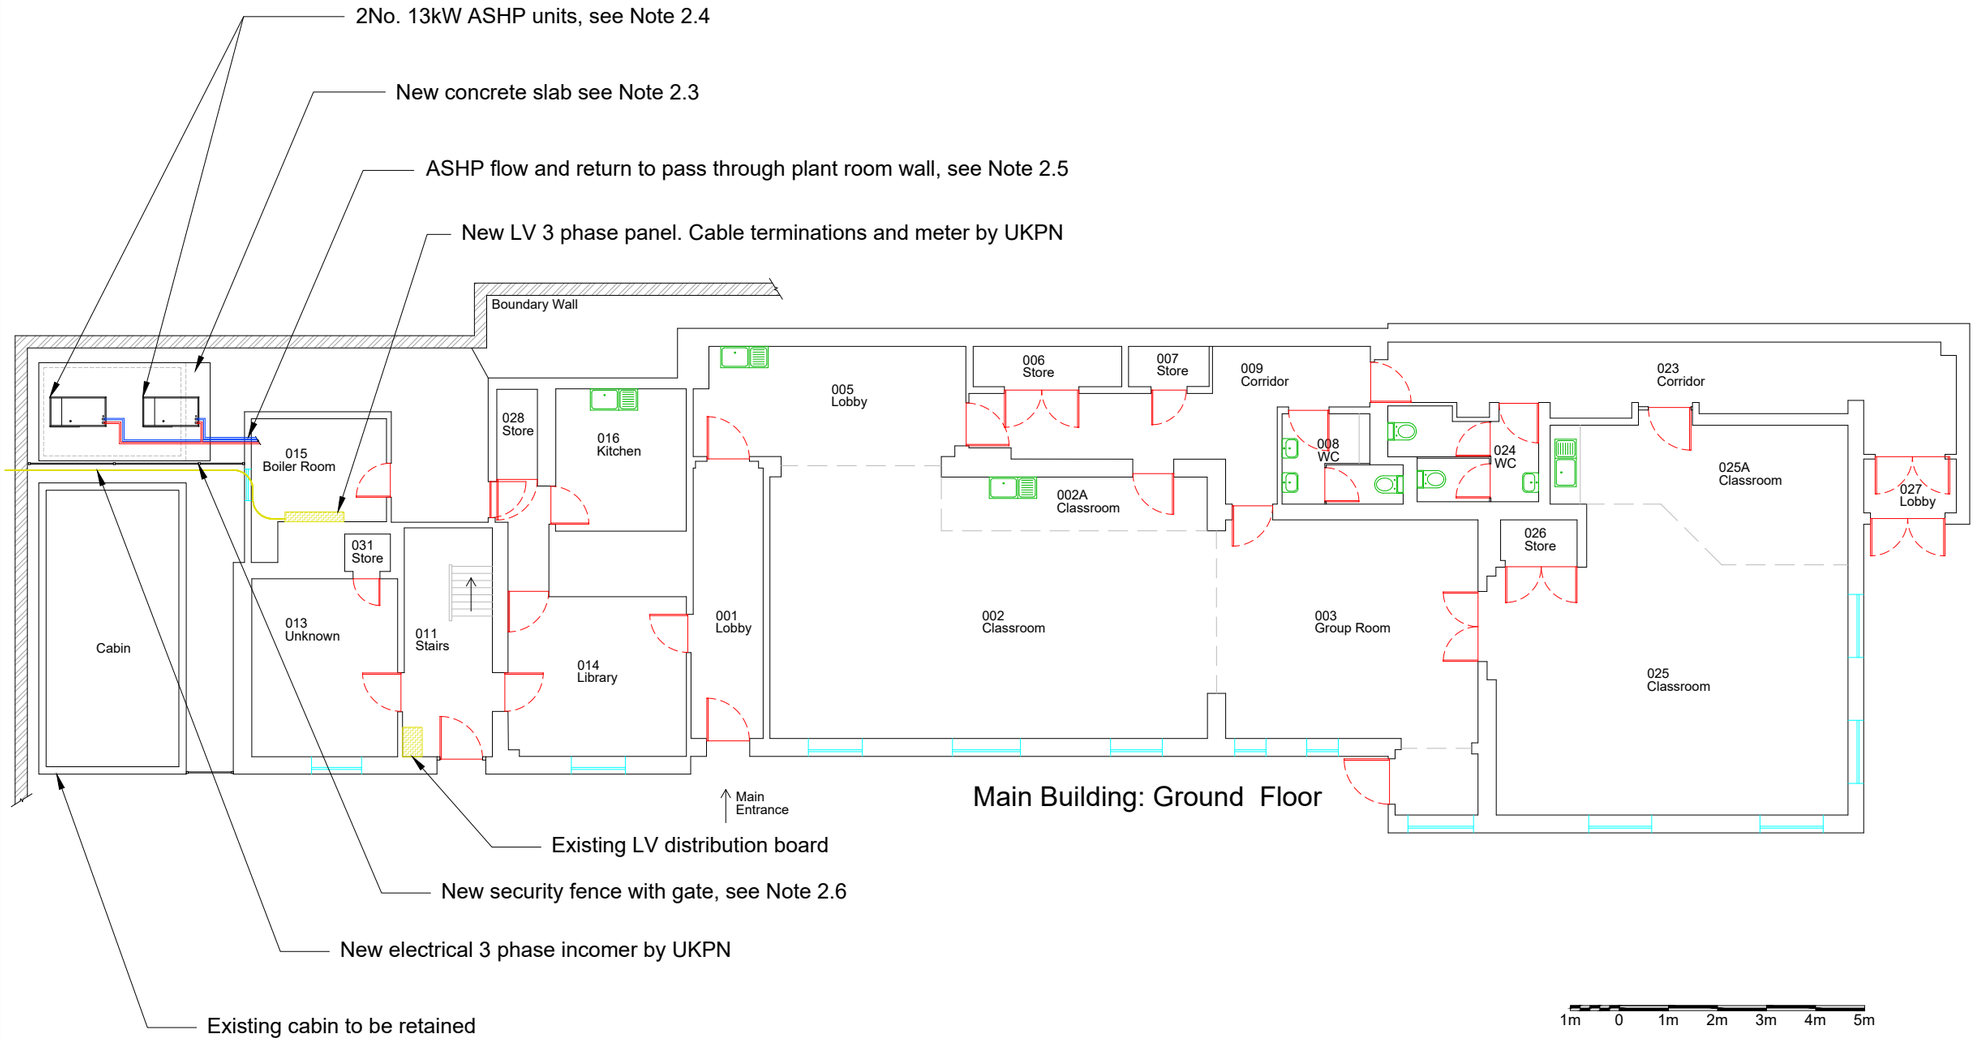

Main Building: Ground Floor

1m 0 1m 2m 3m 4m 5m

Notes:
1. There are no changes to the building included within these proposed works.
2. The proposed external works include:
   - 2.1. Removal of the existing oil tank and pipework passing into the building
   - 2.2. Removal of the existing green mesh fence surrounding the oil tank within the school boundary.
   - 2.3. Extending the existing brick bund that houses the existing oil tank and constructing a concrete base to site the air source heat pump (ASHP) external units.
   - 2.4. Placement of 2No. 13kW Viessmann Vitocal 150-A units, or similar approved, onto the concrete slab.
   - 2.5. Installing flow and return pipework at a low level from the ASHP units and into the plant room. This pipework shall enter the plant room at the position of the existing openings for the existing oil pipes.
   - 2.6. Installation of a new 1.8m high mesh security fence with access gate between the ASHP and the existing external cabin.
3. No trees shall be removed as part of these works nor any areas of natural landscaping effected.
4. New electrical incomer to be provided and installed by UKPN to existing plant room

CLIENT: DIOCESE OF CHICHESTER – TO KNOW · LOVE · FOLLOW JESUS	CONSULTANT: reenergise – ReEnergise Project Limited
PROJECT: Diocese of Chichester PSDS Project Ashurst CofE Primary School	
TITLE: Site plan - proposed	
DRAWING NUMBER: 24-1161-01/DWG-003	SCALE: 1:125 @A3
STATUS: INFORMATION	REVISION: A