



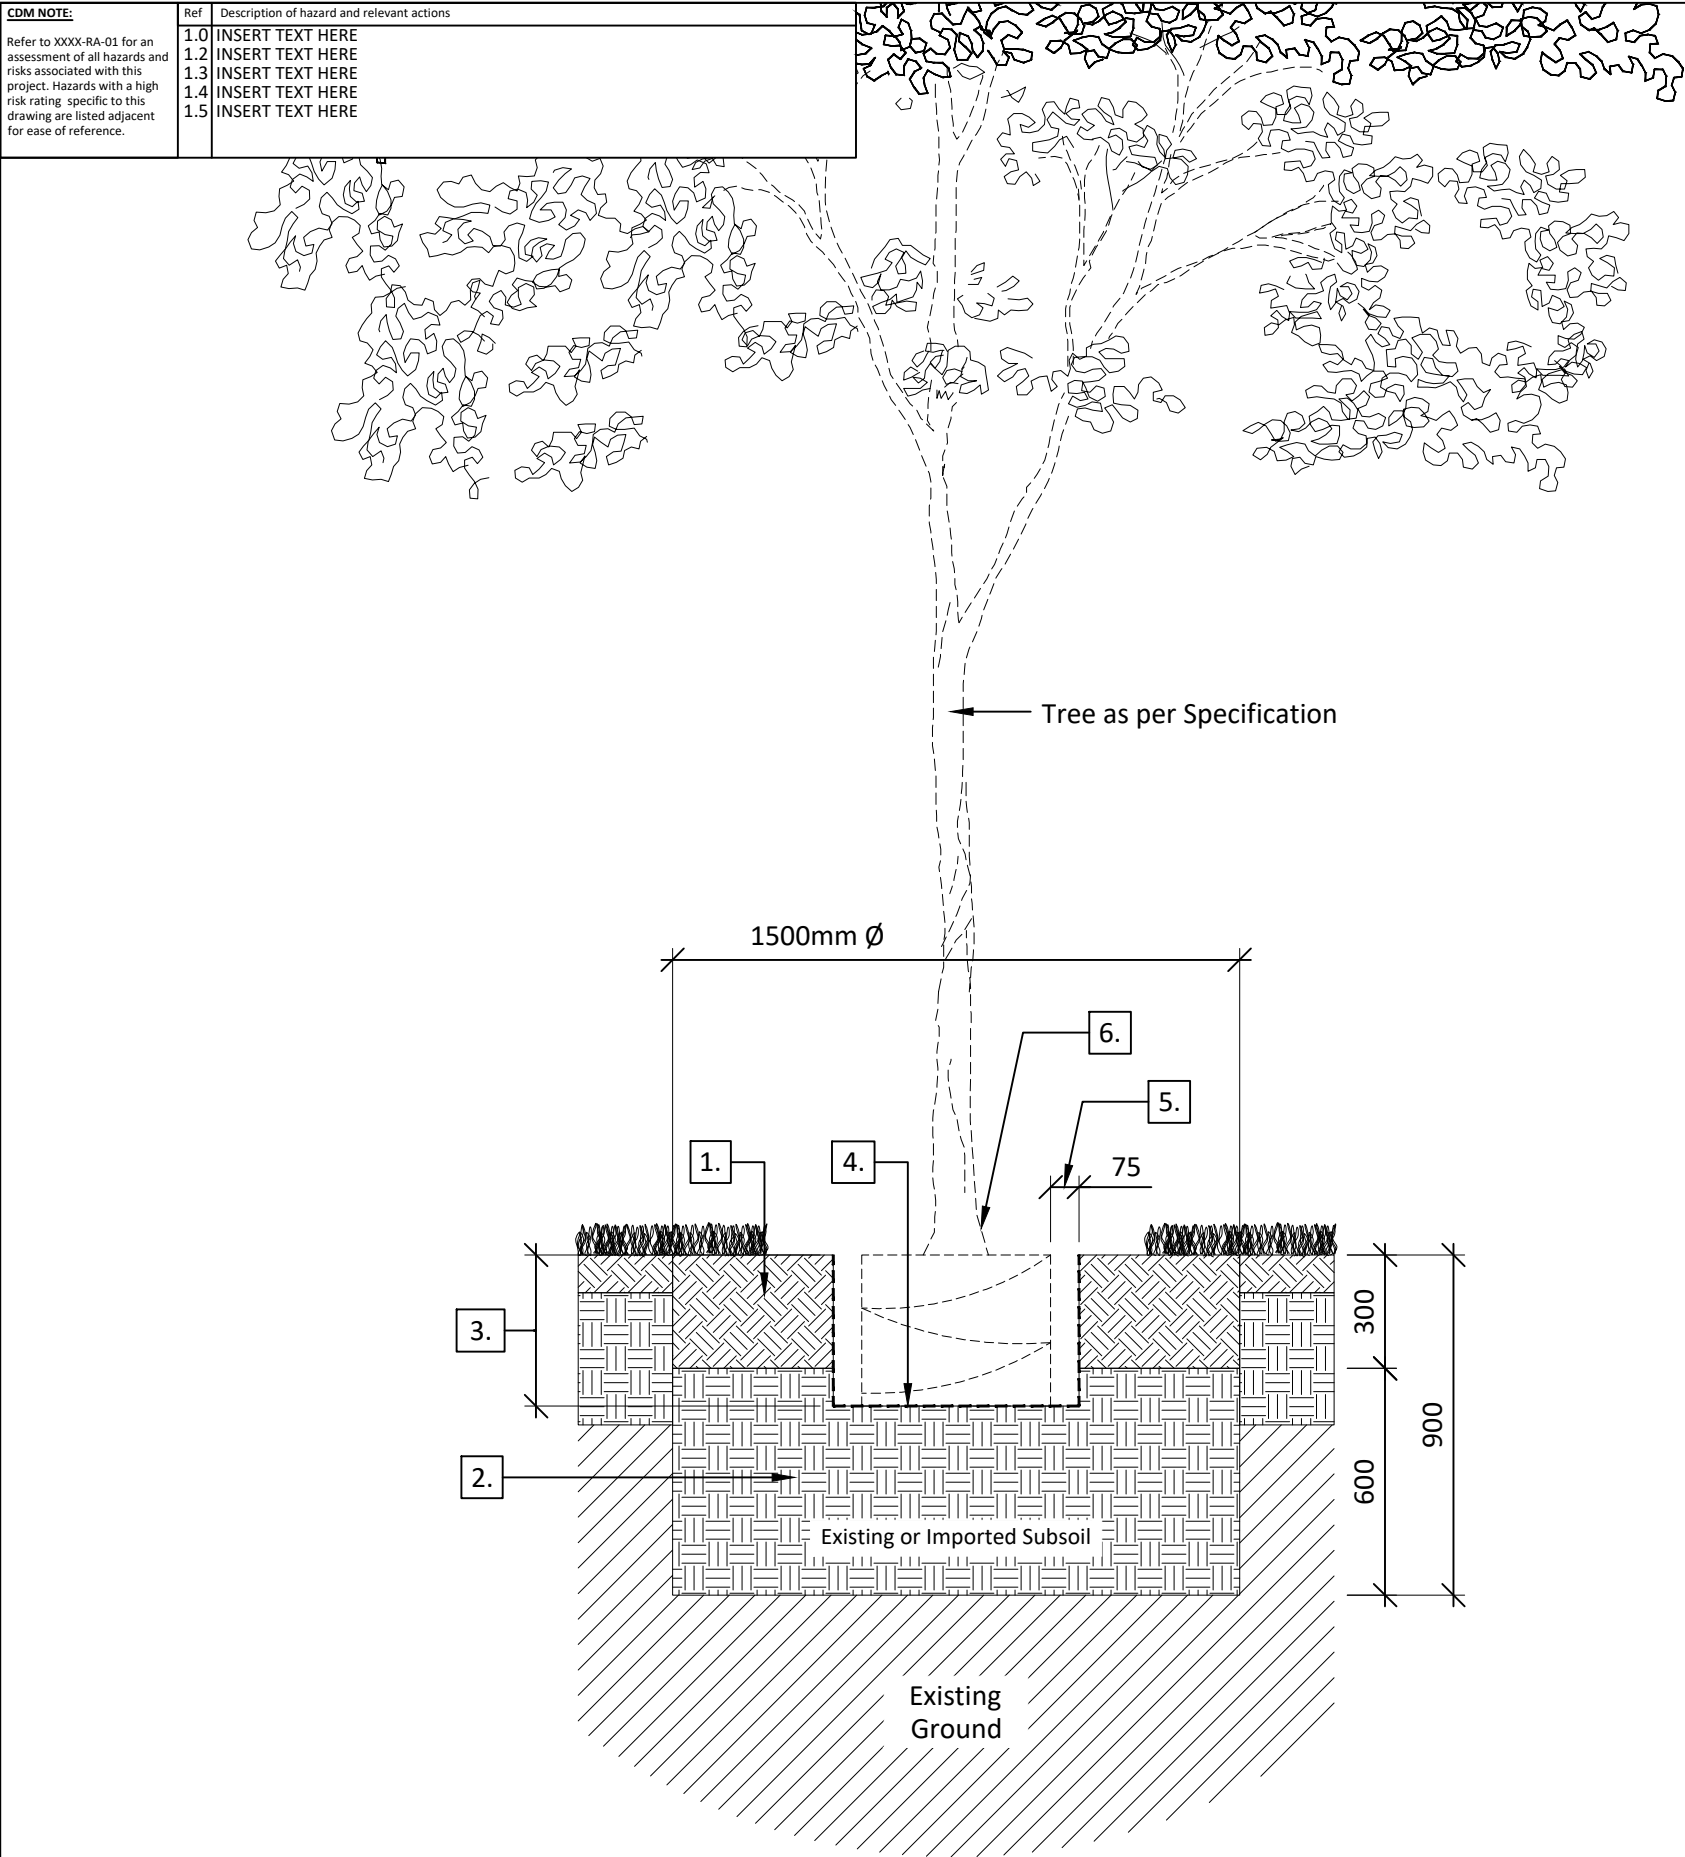

01
DT-01
GROUND PREPARATION
Scale 1:20

- 900mm Soil Profile for Proposed Trees in areas of open ground**
Detail References:
- 1500mmØ 300mm of Topsoil (Existing or Imported but compliant with BS 3882:2015)
 - 1500mmØ 600mm of Subsoil (Existing or Imported but compliant with BS 8601:2013)
 - Tree pit excavated no deeper than the height of container or rootball.
 - Base of tree pit to be left undisturbed and not broken up unless drainage problems are apparent - refer BS8545:2014 for recommendations
 - Tree pit width an additional 75-100mm min than container to allow room for placement.
 - Root Flare and top of rootball to be slightly proud of soil

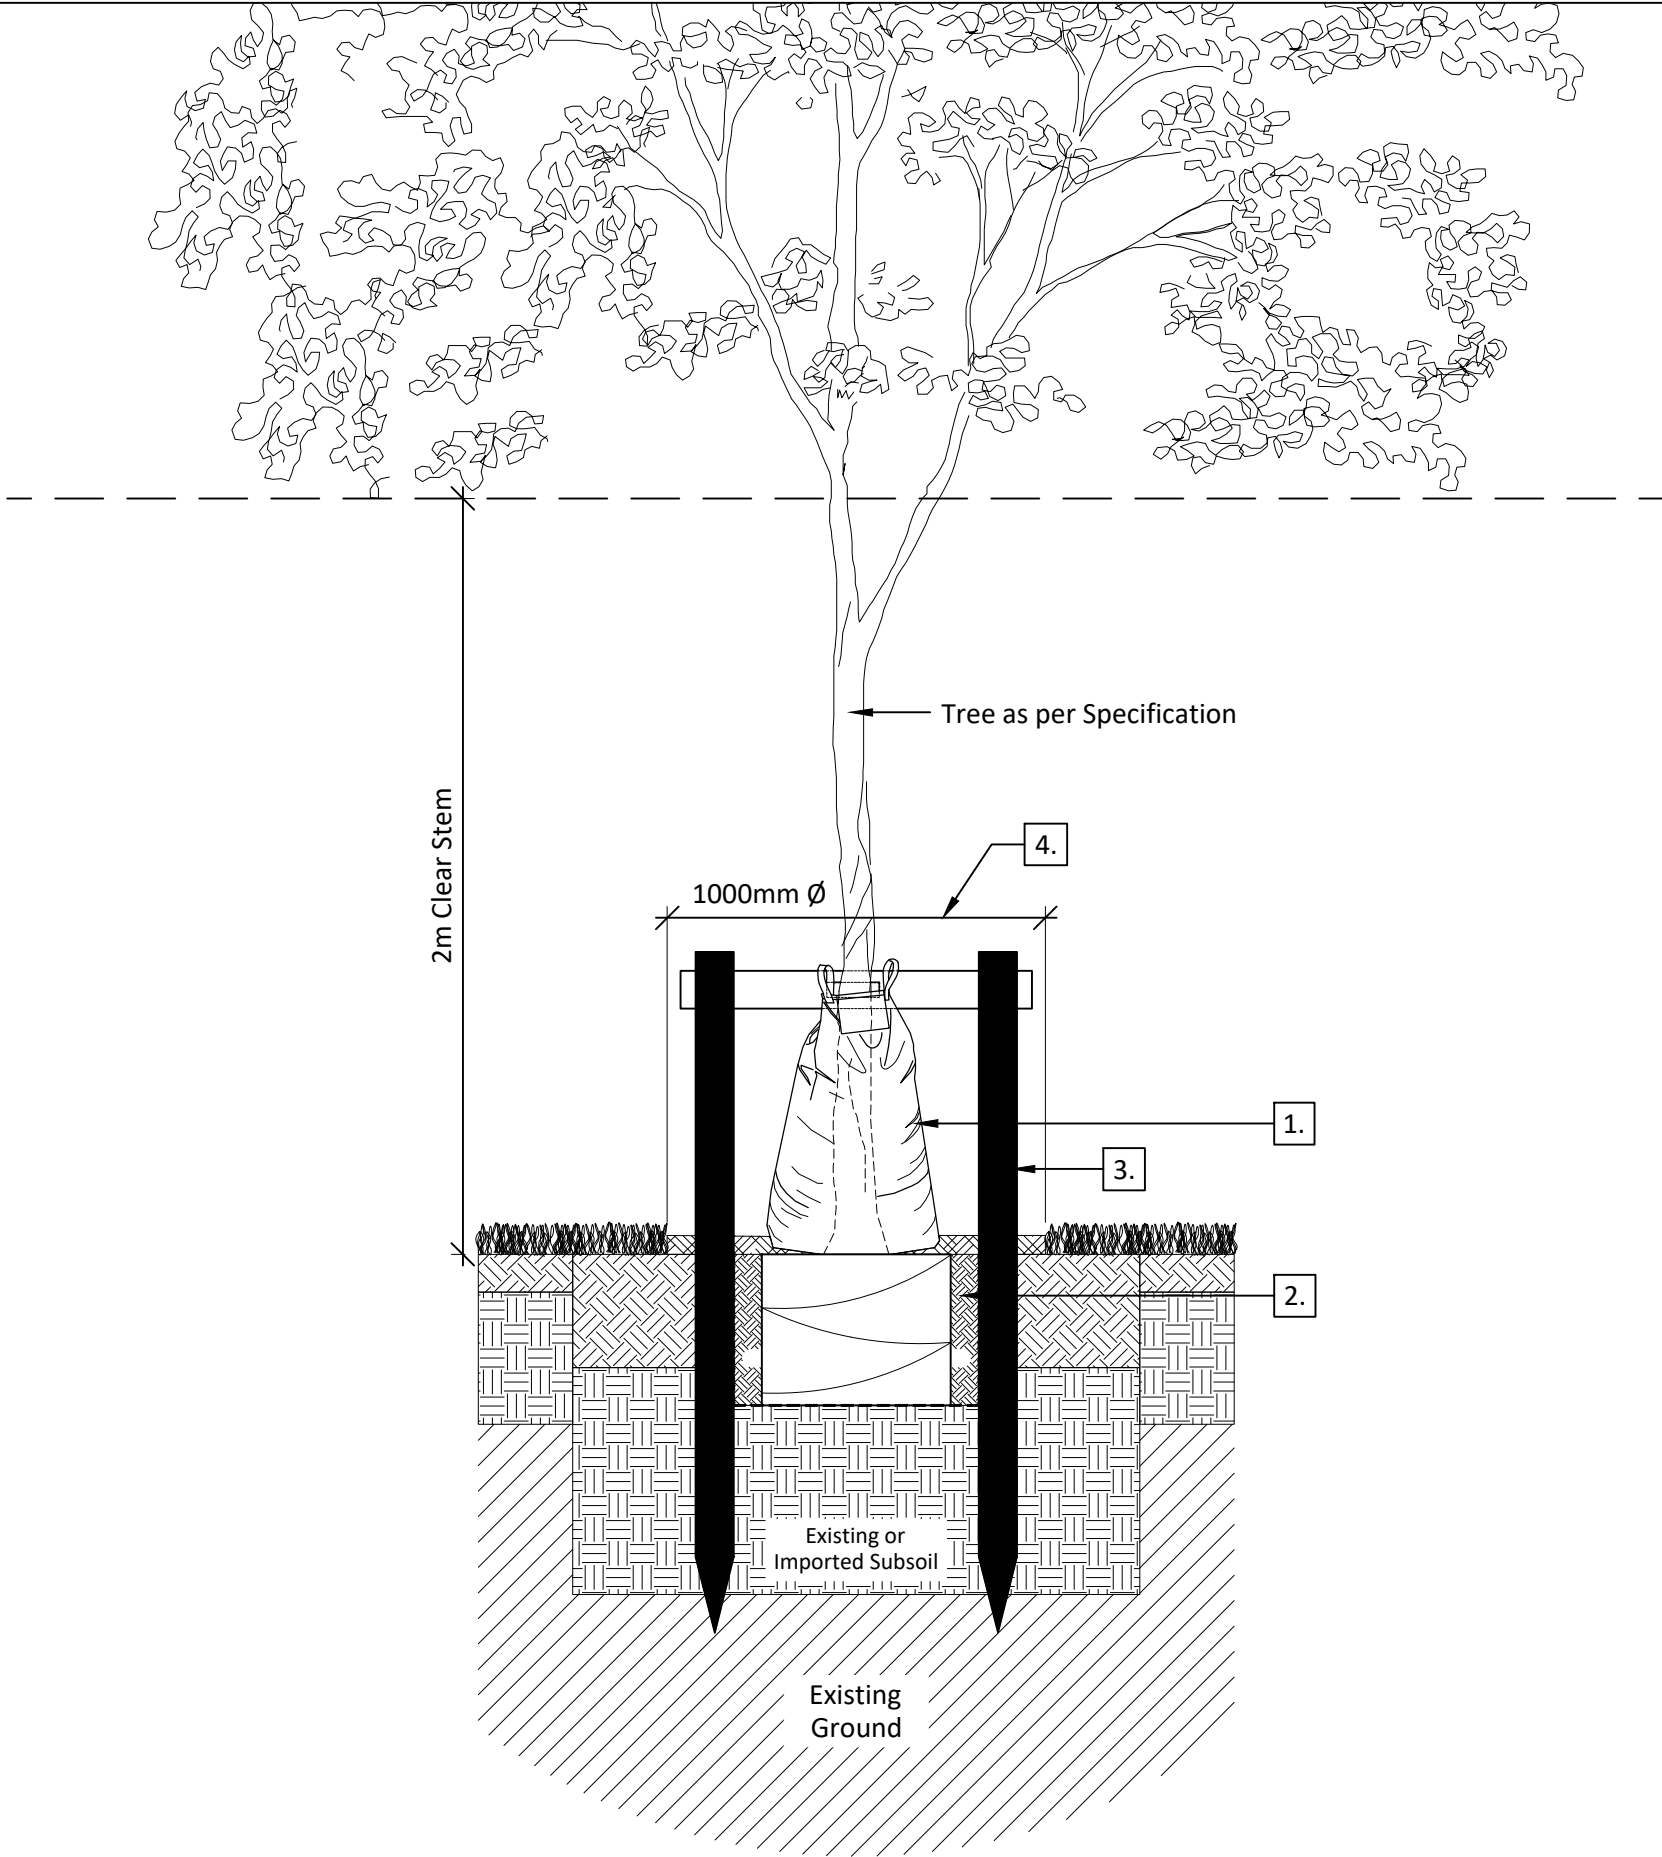

02
DT-01
TREE SUPPORT AND ACCESSORIES
DOUBLE STAKE IN OPEN SPACE
Scale 1:20

- Detail References:**
- Tree irrigation bag
 - Backfill pit with soil removed whilst digging tree pit, ensuring that existing top and sub soil horizons are kept intact i.e. back fill with loosened subsoil then finish top 300mm with top soil; providing soil has been tested and is of good quality in accordance with BS 8601:2013. Soil to be improved with slow released fertiliser 70g per tree, or as per manufacturers recommendations.
 - Double stake, 100mm diameter untreated sweet chestnut or larch, driven vertically into bottom of pit (outside of the rootball) to a min depth of 300mm below the rootball and so that a maximum of 500-750mm is above ground (to allow for irrigation bag). Secure tree using cross strut with approved biodegradable tie and flat black spacer. Stake to be removed when tree has established, (typically 3-5 years) refer specification for details
 - 1000mmØ 50-75mm well-composted bark mulch to top of tree pit. Freshly shredded green waste is not acceptable - refer specification for details.

APAL FILE REFERENCE
3360-APA-ZZ-XX-DT-L-3000.dwg

Notes


This drawing is subject to copyright.
Do not scale from this drawing.

Based on drawing by XXX
Drawing number XXX


NOTES

- All details to comply with BS 8545:2014 Trees: From Nursery to Independence in the landscape, BS 3882:2015 Specification for topsoil, BS8601:2013 Specification for Subsoil and BS5837:2012 Trees in relation to construction.
- All timber to come from FSC (Forest Stewardship Council) certified sources/suppliers.
- Root barriers to be provided where tree pit abuts service margin. Refer to specification (where provided) and engineers details.
- All materials and products to meet relevant British Standard.

APPROXIMATE CONTAINER SIZES

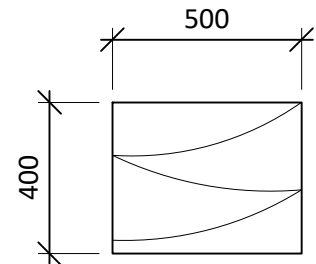

Size for 14-16cm to 18-20cm girth trees

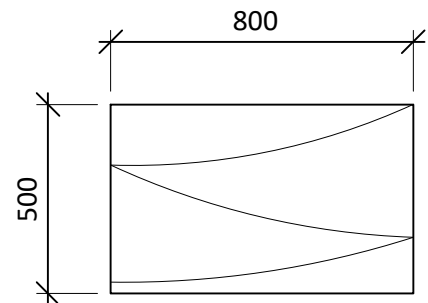

P02	Irrigation pipe removed and replaced with irrigation bag	9/18/25	TB	TB
Rev	Description	Date	Drawn	Checked
Drawing Status				
PLANNING				
 020 8549 3434 www.allenpyke.co.uk design@allenpyke.co.uk A registered practice of the Landscape Institute				
Client			Scale	
Bellway Homes Limited			1:20@A2	
South London				
Project			Project No	
Duckmoor, Billingshurst			3360	
Drawing Title			Date	
Landscape Details			17/02/25	
Tree Pit with Stake			By/Chk	
			TB/CG	
Drawing Number			Revision	
3360-APA-ZZ-XX-DT-L-3004			P02	