from Southern Water

Directorate of Planning
Horsham District Council
Parkside
Chart Way
Horsham
West Sussex
RH12 1RL

Your ref
DC/24/0516

Our ref
DSA000033600

Date
29 April 2024

Contact
Tel 0330 303 0119

Dear Sir/Madam,

Proposal: Demolition of existing garage. Erection of a part single storey rear, a two-storey side extension, part two storey rear extension and alterations to existing front porch.
Site: DC/24/0516: - 15 Trout Lane, Barns Green, West Sussex, RH13 0SU.

Thank you for your letter dated 08 April 2024.

Following the review of the submitted documents, we have the below comments for the Planning consultation.

Protection of Public Apparatus

There is an existing Build Over Agreement with Southern Water (13693_SWS-BO-DSA000030944) in place relating to the proposed development site. The public sewer should be protected strictly in accordance with the details and conditions approved during this Build Over Public Sewers application process. Any changes to the approved line or depth of foundations, or adding additional loads, shall be considered as an amendment to the agreement and shall be consulted with Southern Water.

It is possible that a sewer now deemed to be public could be crossing the development site. Therefore, should any sewer be found during construction works, an investigation of the sewer will be required to ascertain its ownership before any further works commence on site.

Southern Water Services Ltd, Registered Office: Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX Registered in England No. 2366670

Foul and Surface Water Drainage

Southern Water requires a formal application for a connection to the public sewer to be made by the applicant or developer.

To make an application visit Southern Water's Get Connected service: developerservices.southernwater.co.uk and please read our New Connections Charging Arrangements documents which are available on our website via the following link: southernwater.co.uk/developing-building/connection-charging-arrangements

Our initial investigations indicate that there are no public surface water sewers in the area to serve this development. Alternative means of draining surface water from this development are required. This should not involve disposal to a public foul sewer and should be in line with the Hierarchy of H3 of Building Regulations with preference for use of soakaways.
gov.uk/government/publications/drainage-and-waste-disposal-approved-document-h

For further advice, please contact Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX (Tel: 0330 303 0119).

Website: southernwater.co.uk or by email at: SouthernWaterPlanning@southernwater.co.uk

Yours faithfully,

Future Growth Planning Team
Developer Services

southernwater.co.uk/developing-building/planning-your-development

Southern Water Services Ltd, Registered Office: Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX Registered in England No. 2366670

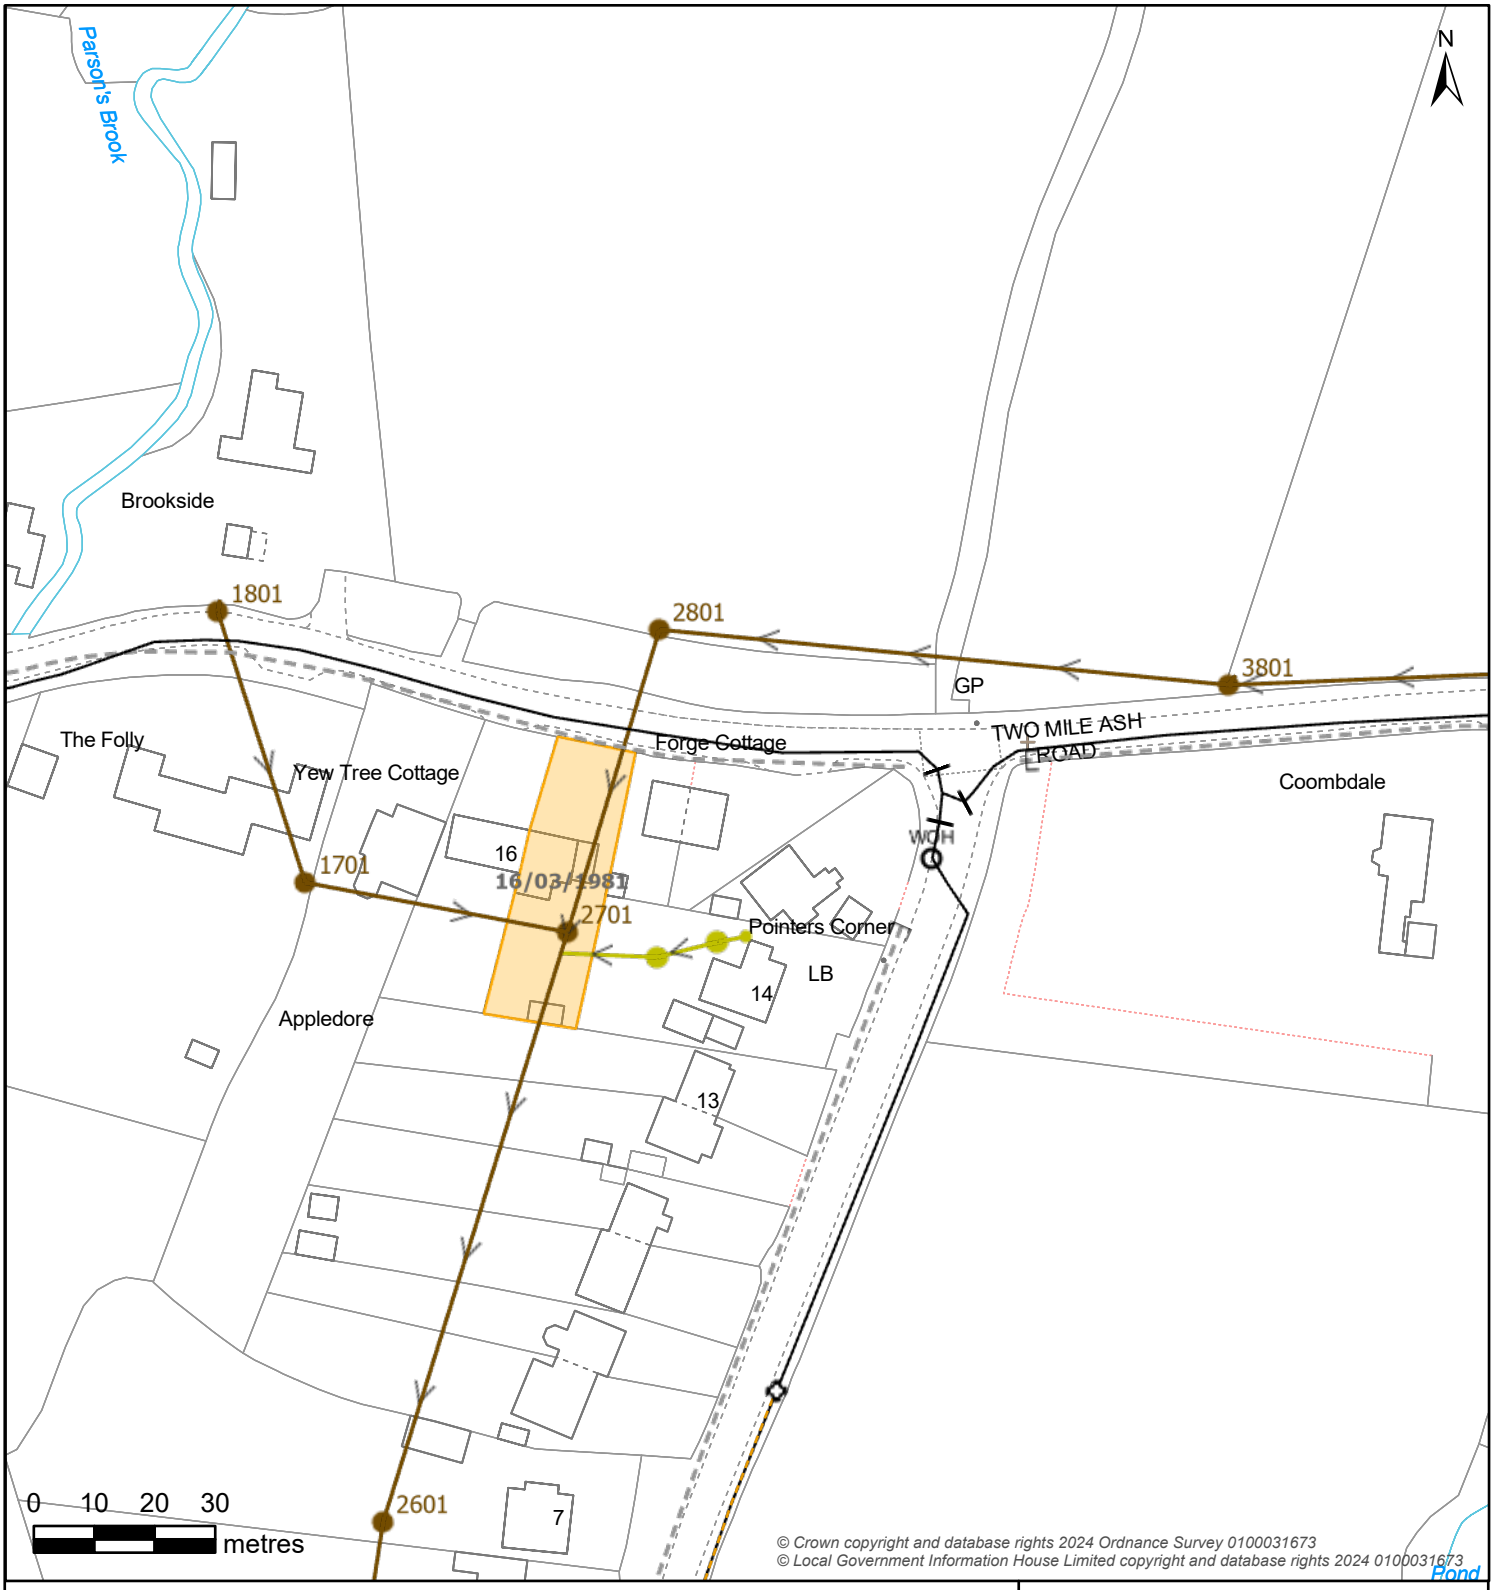

Controllable Valve			Flow Control			Inlet-Outfall	
Damboards	Penstock	Valve	Anti Flood Device	Pumped Anti Flood Device	Reflux Valve	Inlet	Outfall

Manhole											
BIF	Bifurcation	Cascade	CP	Catchpit	Head Of Public Sewer	IC	Interceptor Chamber	Manhole	S	Soakaway	WO	Washout

Outfall Headworks	Overflow Chamber		Pipe Bridge	Pumping Station	
Outfall Headworks	CSO Combined Sewer Overflow	EMO Emergency Overflow	Pipe Bridge	Micro Pumping Station	Pumping Station

Sewer Level Monitor	Storage		Treatment Works	Weir	Wastewater Site
Sewer Level Monitor	Storm Tank	Tidal Storage Tank	Treatment Works	Weir	Wastewater Site

Wastewater Pipe		Wastewater Use	Developer Services	
Culverted Water Course	Syphon	Foul	Build Over Agreement	Section 104
Drain	Tank Sewer	Combined	**Wastewater Area**	
Outfall	Trunk Sewer	Sludge	Catchment	
Overflow	Vacuum Main	Treated Effluent	Sub-Catchment	
Rising Main	Decommissioned Pipe	Surface Water		
Sewer		Private		

Map Title: SW Print

Printed By: Vijeyta.Sudarshan

Date Printed: 25/04/2024

Map Scale: 1250

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.

WATER for LIFE from Southern Water