from Southern Water

Directorate of Planning
Horsham District Council
Parkside
Chart Way
Horsham
West Sussex
RH12 1RL

Your ref
DC/24/0488

Our ref
DSA000033601

Date
29 April 2024

Contact
Tel 0330 303 0119

Dear Sir/Madam,

Proposal: Erection of a garage with office and storage on first floor.
Site: DC/24/0488: - Oakhurst West, Chiltington Road, Pulborough, West Sussex, RH20 2EE.

Thank you for your letter dated 08 April 2024.

Following the review of the submitted documents, we have the below comments for the Planning consultation.

Protection of Public Apparatus

Please see the attached extract from Southern Water records showing the approximate position of our existing foul sewers within the development site. The exact position of the public assets must be determined on site by the applicant in consultation with Southern Water before the layout of the proposed development is finalised.

- The 300 mm and 100 mm diameter gravity sewers require a clearance of 3 metres on either side of the gravity sewer to protect it from construction works and to allow for future maintenance access.

- No development or tree planting should be carried out within 3 metres of the external edge of the public gravity sewer without consent from Southern Water.

- No soakaways, swales, ponds, watercourses or any other surface water retaining or conveying features should be located within 5 metres of public or adoptable gravity sewers.

- All existing infrastructure should be protected during the course of construction works.

Please refer to: Microsoft Word - DS Stand off distances V1.1NEW.docx (southernwater.co.uk)

Southern Water Services Ltd, Registered Office: Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX Registered in England No. 2366670

It is possible that a sewer now deemed to be public could be crossing the development site. Therefore, should any sewer be found during construction works, an investigation of the sewer will be required to ascertain its ownership before any further works commence on site.

Foul and Surface Water Drainage

Southern Water requires a formal application for a connection to the public sewer to be made by the applicant or developer.

To make an application visit Southern Water's Get Connected service: developerservices.southernwater.co.uk and please read our New Connections Charging Arrangements documents which are available on our website via the following link: southernwater.co.uk/developing-building/connection-charging-arrangements

Our initial investigations indicate that there are no public surface water sewers in the area to serve this development. Alternative means of draining surface water from this development are required. This should not involve disposal to a public foul sewer and should be in line with the Hierarchy of H3 of Building Regulations with preference for use of soakaways.
gov.uk/government/publications/drainage-and-waste-disposal-approved-document-h

For further advice, please contact Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX (Tel: 0330 303 0119).

Website: southernwater.co.uk or by email at: SouthernWaterPlanning@southernwater.co.uk

Yours faithfully,

Future Growth Planning Team
Developer Services

southernwater.co.uk/developing-building/planning-your-development

Southern Water Services Ltd, Registered Office: Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX Registered in England No. 2366670

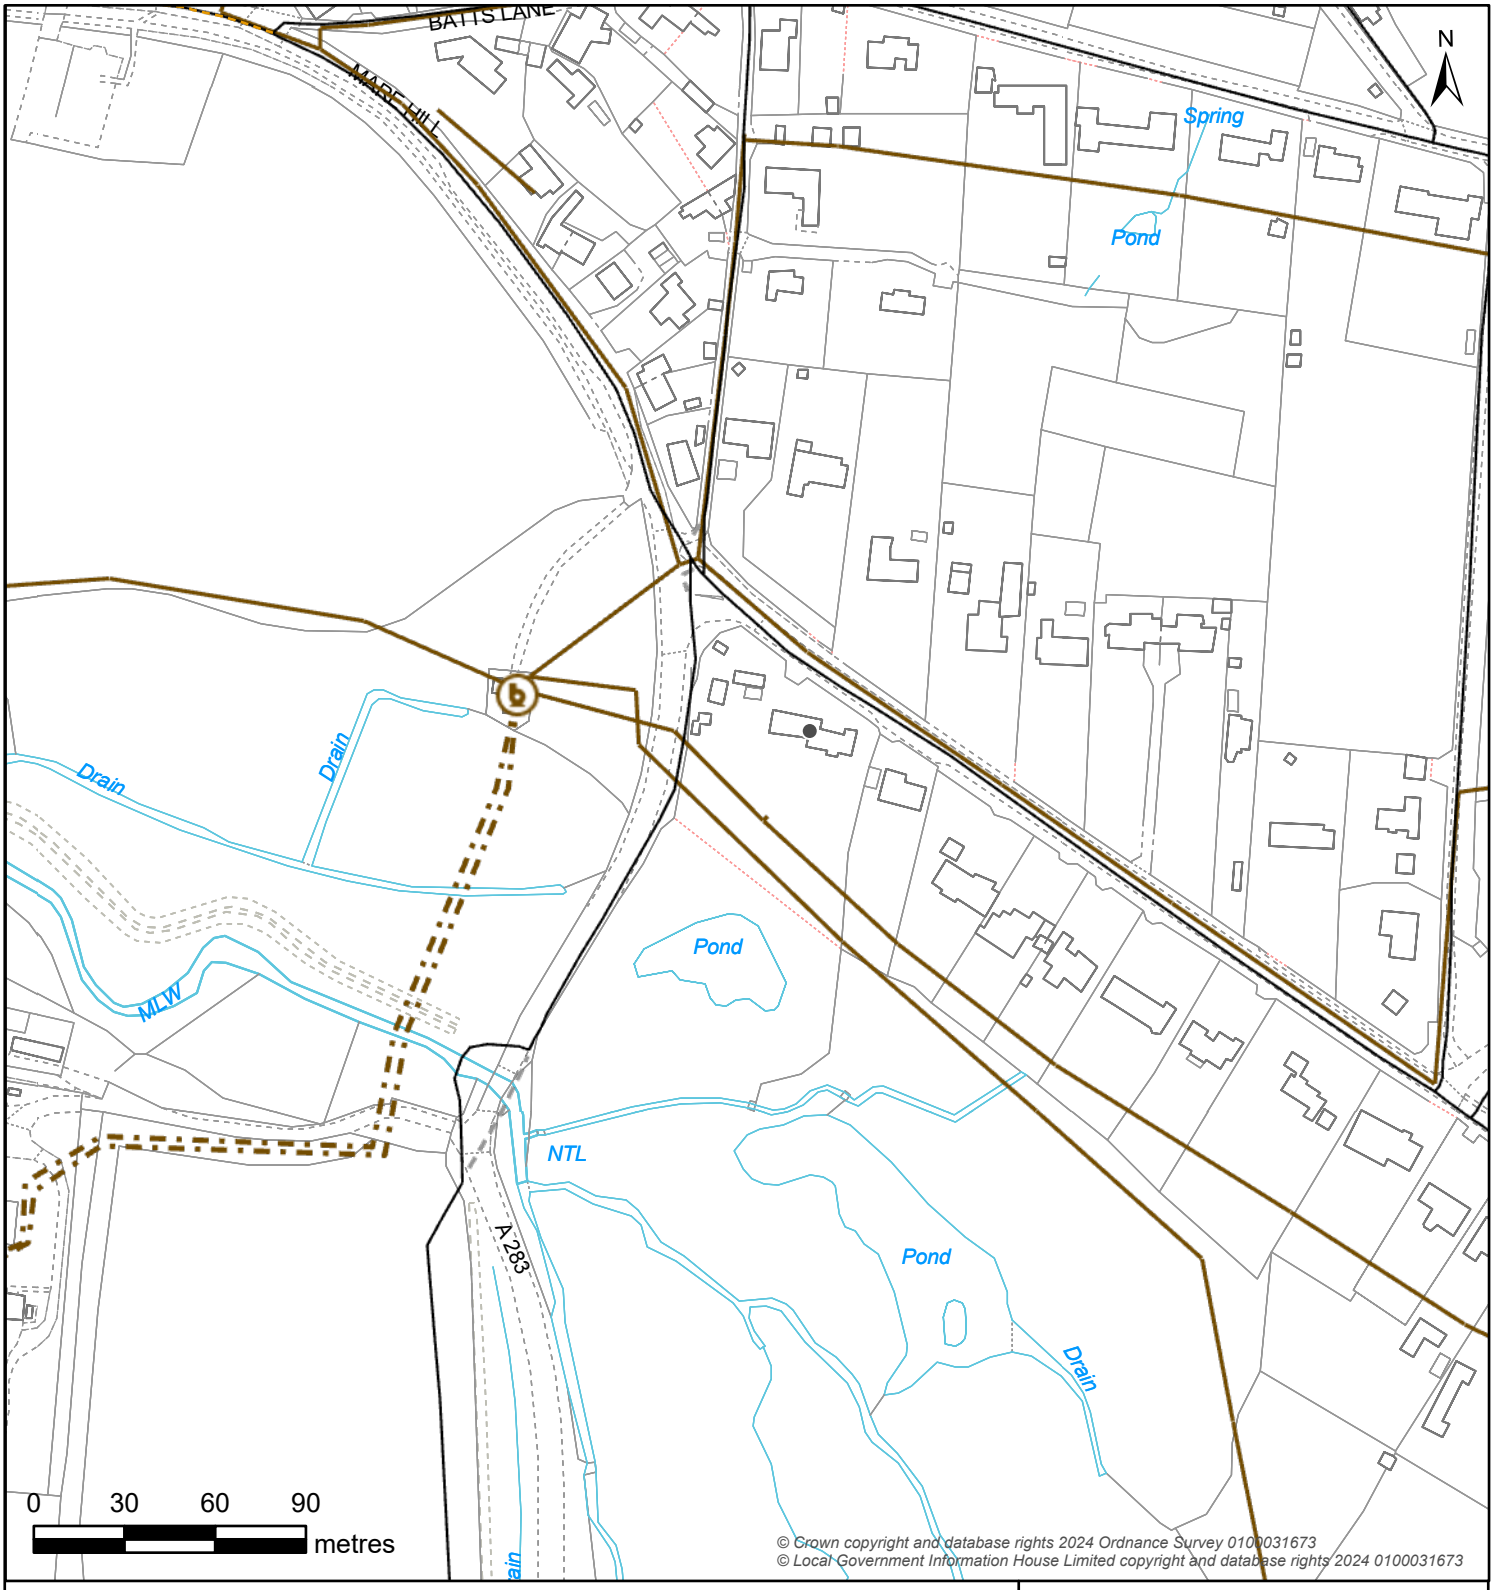

© Crown copyright and database rights 2024 Ordnance Survey 0100031673
© Local Government Information House Limited copyright and database rights 2024 0100031673

Controllable Valve
Damboards | Penstock | Valve

Flow Control
Anti Flood Device | Pumped Anti Flood Device | Reflux Valve

Inlet-Outfall
Inlet | Outfall

Manhole
BIF Bifurcation | Cascade | CP Catchpit | Head Of Public Sewer | IC Interceptor Chamber | Manhole | S Soakaway | WO Washout

Outfall Headworks
Outfall Headworks

Overflow Chamber
CSO Combined Sewer Overflow | EMO Emergency Overflow

Pipe Bridge
Pipe Bridge

Pumping Station
Micro Pumping Station | Pumping Station

Sewer Level Monitor
Sewer Level Monitor

Storage
Storm Tank | Tidal Storage Tank

Treatment Works
Treatment Works

Weir
Weir

Wastewater Site
Wastewater Site

Wastewater Pipe
- Culverted Water Course
- Drain
- Outfall
- Overflow
- Rising Main
- Sewer
- Syphon
- Tank Sewer
- Trunk Sewer
- Vacuum Main
- Decommissioned Pipe

Wastewater Use
- Foul
- Combined
- Sludge
- Treated Effluent
- Surface Water
- Private

Developer Services
Build Over Agreement | Section 104

Wastewater Area
Catchment | Sub-Catchment

Map Title: SW Print

Printed By: Vijeyta.Sudarshan

Date Printed: 25/04/2024

Map Scale: 2500

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.

WATER for LIFE from Southern Water