



Horsham District Council
Parkside
Chart Way
Horsham
West Sussex
RH12 1RL

Your ref
DC/26/0819

Our ref
DSA000055028

Date
22nd June 2026

Contact
Tel 0330 303 0119

Dear Sir/Madam,

Proposal: Single storey rear extension, conversion of garage into habitable living space.
Site: 9 Easton Crescent, Billingshurst, West Sussex, RH14 9TU.

Thank you for your correspondence, please see our comments below regarding the above application.

Existing Water Main - tree, buildings, assets within stand-off distance

The 125 mm diameter water main requires a clearance of 6 metres on either side of the water main to protect it from construction works and to allow for future maintenance access.

No excavation, mounding or tree planting should be carried out within 6 metres of the external edge of the public water main without consent from Southern Water. All existing infrastructure, including protective coatings and cathodic protection, should be protected during the course of construction works. Please refer to: <https://www.southernwater.co.uk/media/st5orjvm/stand-off-distances.pdf>

Condition

In order to protect water apparatus, Southern Water requests that if consent is granted, the following condition is attached to the planning permission; The developer must agree with Southern Water, prior to commencement of the development, the measures to be undertaken to protect/divert the public water supply main.

It is possible that a sewer now deemed to be public could be crossing the development site. Therefore, should any sewer be found during construction work, an investigation of the sewer will be required to ascertain its ownership before any work commences on site. If this happens, please call our Customer Service Desk on 0330 303 0119




For further advice, please contact Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX (Tel: 0330 303 0119)

Website: southernwater.co.uk or by email at: SouthernWaterPlanning@southernwater.co.uk

Yours faithfully,

Future Growth Planning Team

southernwater.co.uk/developing-building/planning-your-development

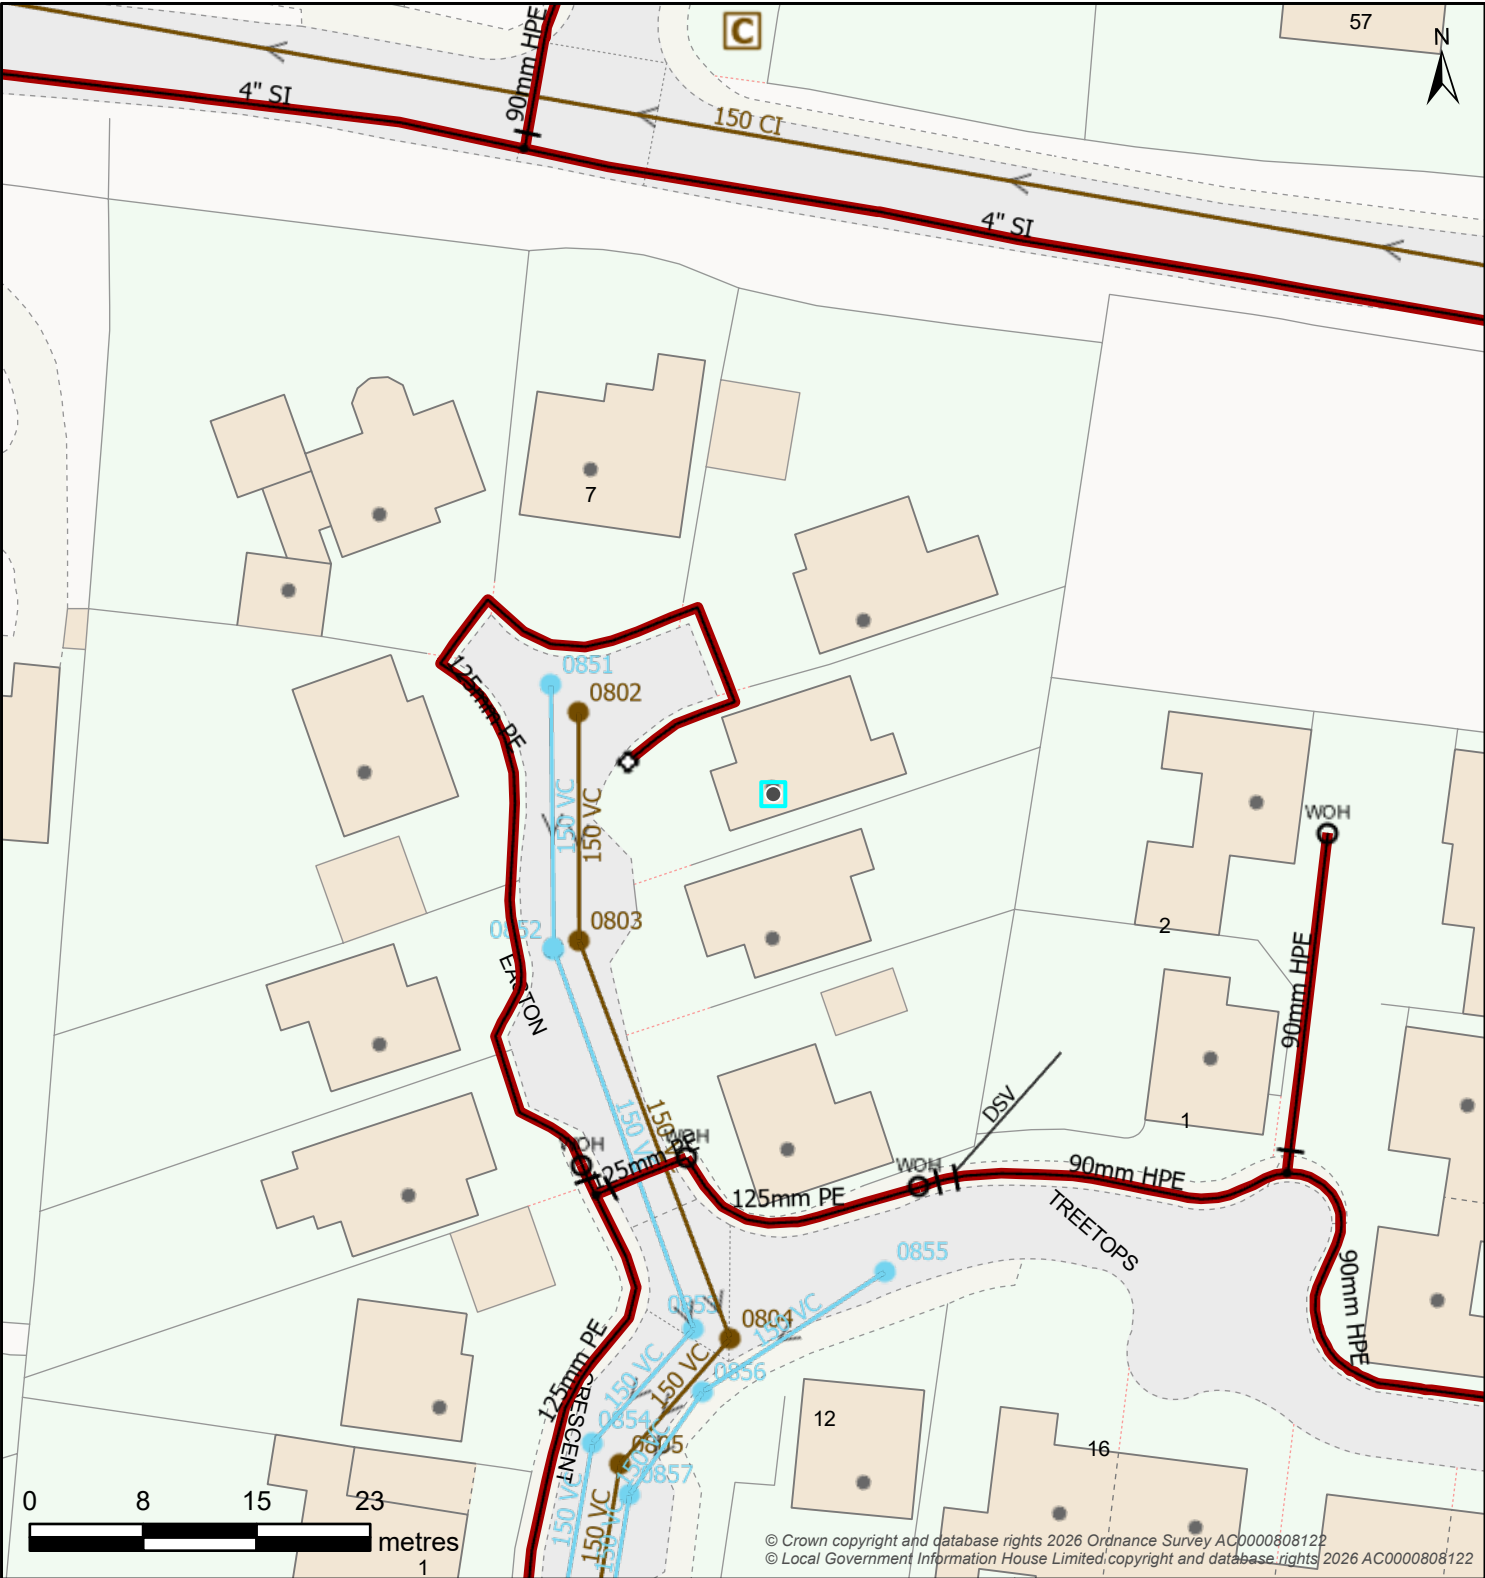

Controllable Valve			Flow Control			Inlet-Outfall	
Damboards	Penstock	Valve	Anti Flood Device	Pumped Anti Flood Device	Reflux Valve	Inlet	Outfall
Manhole							
BIF Bifurcation	Cascade	CP Catchpit	Head Of Public Sewer	IC Interceptor Chamber	Manhole	S Soakaway	WO Washout
Outfall Headworks		Overflow Chamber		Pipe Bridge		Pumping Station	
Outfall Headworks	CSO Combined Sewer Overflow	EMO Emergency Overflow	Pipe Bridge	Micro Pumping Station	Pumping Station		
Sewer Level Monitor		Storage		Treatment Works		Weir	
Sewer Level Monitor	Storm Tank	Tidal Storage Tank	Treatment Works	Weir	Wastewater Site		
Wastewater Pipe				Wastewater Use		Developer Services	
Culverted Water Course	Syphon	Tank Sewer	Trunk Sewer	Foul	Combined	Build Over Agreement	Section 104
Drain	Vacuum Main	Decommissioned Pipe	Sewer	Sludge	Treated Effluent	Surface Water	Private
Overflow				Developer Services	Wastewater Area	Catchment	Sub-Catchment
Rising Main							

Map Title: SW Print

Printed By: Anne.McFarlane2
Date Printed: 22/06/2026
Map Scale: 500

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.

