




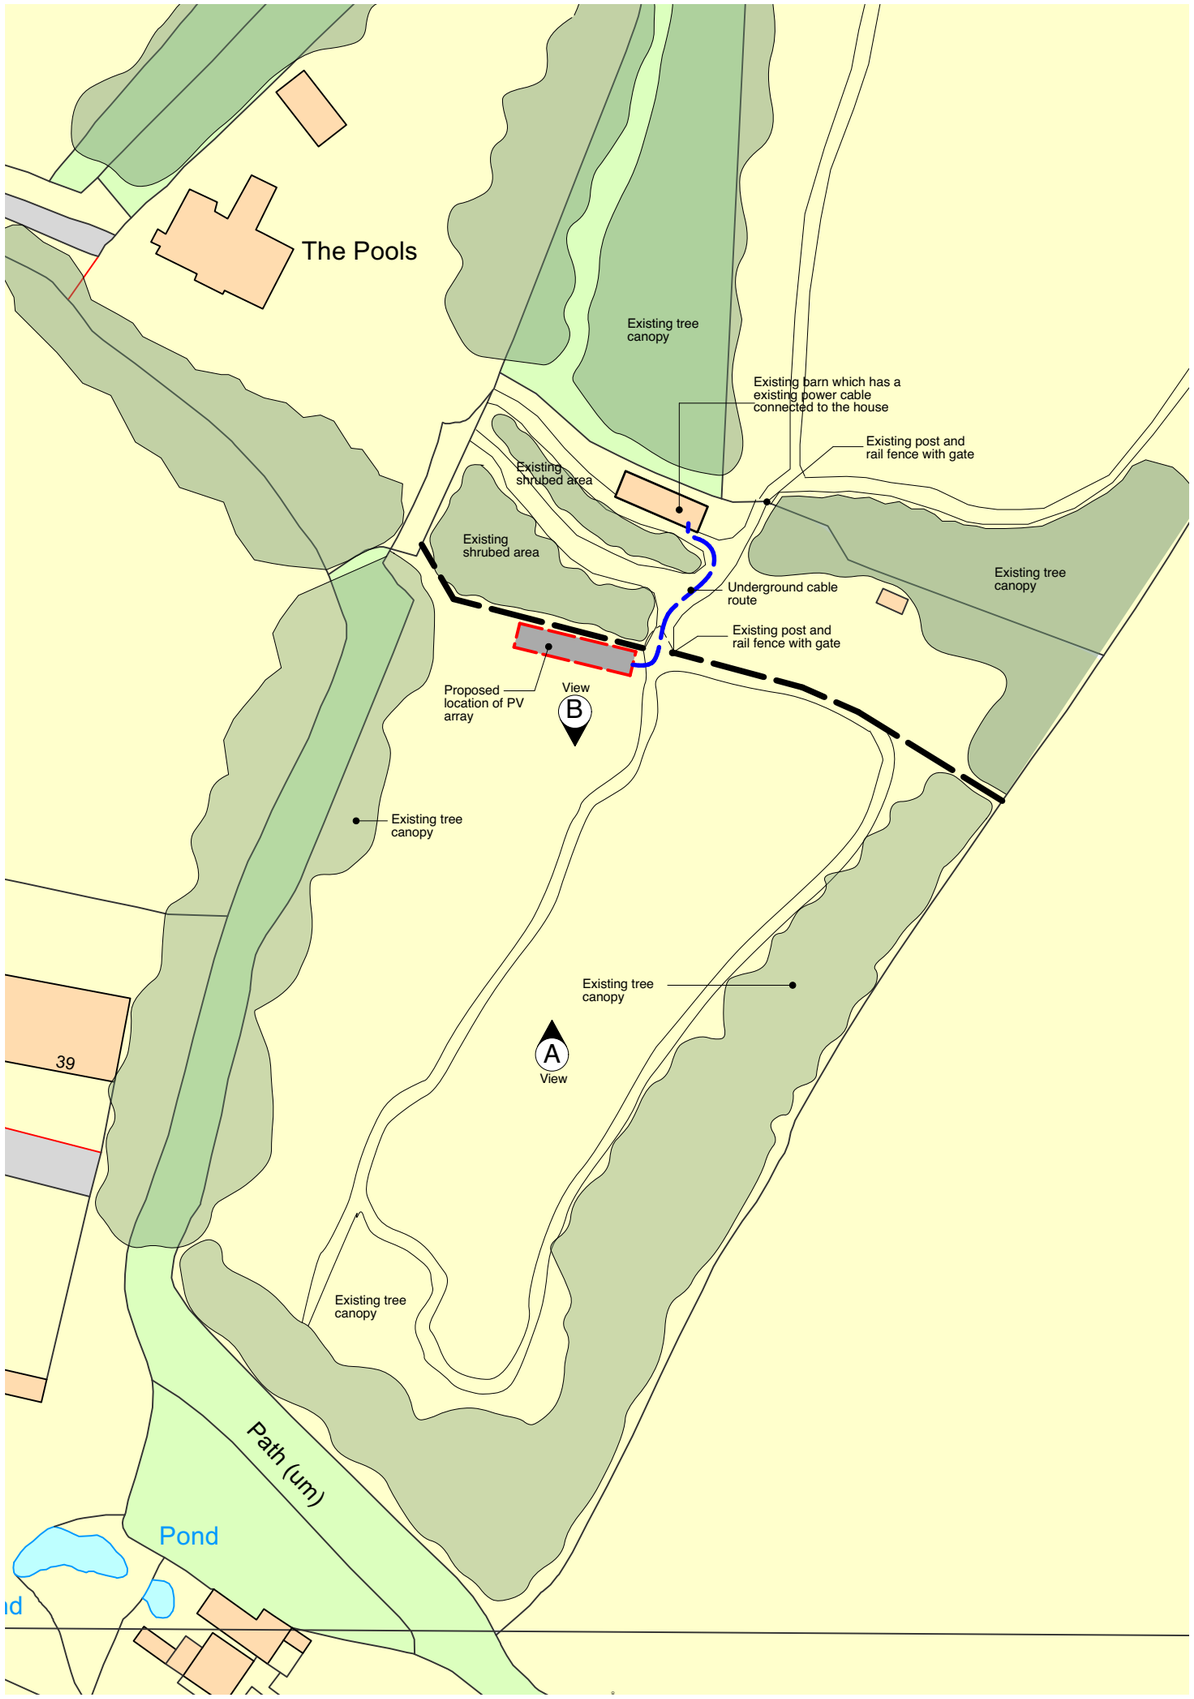

Photograph of proposed cable route through existing grass track

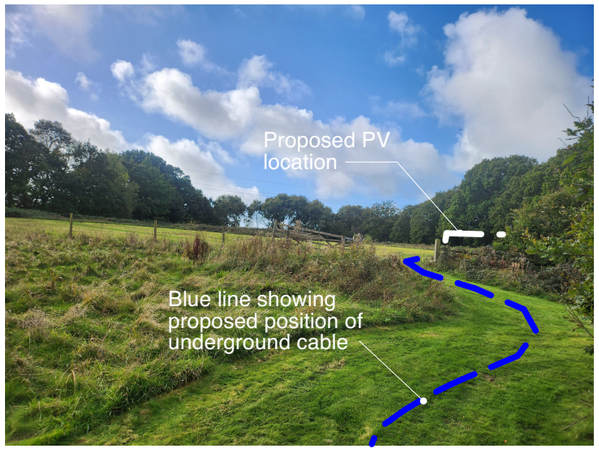

Photograph of proposed cable route through existing grass track

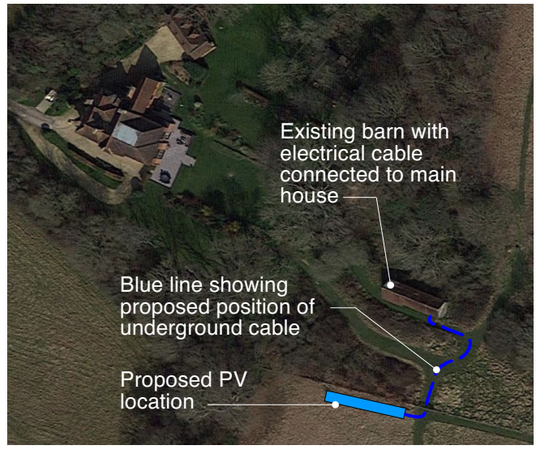

Aerial photograph of proposed cable route



Image above showing an exmple of proposed trench

• The cable trench of depth 50 cm & width of 30 cm and will be backfilled. with the existing materials. Suitable Armoured cable is used.
The Cable run will be a 1 day install, no ground is left open, or equipment left onsite overnight.

Scale bar @ 1:1000

0m 10 20 30 40 50m 60 70 80 90 100

REVISION	DATE	COMMENT	BY
-	-	-	-

HAPA ARCHITECTS

Job Name: **PROPOSED PV ARRAY AT- THE POOLS, SHOREHAM ROAD, HENFIELD, BN5 9SE**

Status: **PLANNING**

Drawing Title: **PROPOSED PV CABLE ROUTE**

Date: **APRIL '25**

Scale: **1:1000 @ A3**

Job Ref: **0346**

Drawing Number: **AL-200**