

Luminaire Schedule											
Symbol	Ref	Qty	Config	Outreach	Description	Mtg Height	Lumens	Cutoff Class	Total MF	Unit Watts	
	A	45	Single	0	Kirium 200 Bollard-Asymmetric Medium-3x-700mA-20W	1	1725	Non-Cutoff	0.840	20	

Luminous Flux Factor [LFF]: BS5489-1:2020 [Annex D2] = 1.0 [CLO]

Survival Factor [SF]: BS5489-1:2020 [Annex D2] = 1.0


Luminaire Maintenance Factor [LMF]: BS5489-1:2020 [Table C1] = 72 Months:
Environmental Zone:

E3/E4 =<6M TLS = 0.84


[LFF] * [SF] * [LMF] = Total Maintenance Factor Value

Calculation Results Summary										
Grid Reference	Measurement	Units	Eav	Emax	Emin	Uo	Ud	X Pitch	Y Pitch	
Cyclepath	Illuminance	Lux	8.61	117.6	0.0	0.00	0.00	1	1	

Luminaire Location Summary						
Col ID	Ref (Qty)	X	Y	Angle	Tilt	Dimming
1	A (1)	519654.514	133358.15	329.33	0	1.00
2	A (1)	519635.582	133321.146	334.794	0	1.00
3	A (1)	519616.895	133284.335	336.19	0	1.00
4	A (1)	519625.544	133125.494	107.007	0	1.00
5	A (1)	519863.937	133142.965	113.152	0	1.00
6	A (1)	519901.734	133161.216	115.846	0	1.00
7	A (1)	519939.013	133179.09	112.854	0	1.00
8	A (1)	519976.009	133194.391	118.479	0	1.00
9	A (1)	520011.145	133211.489	116.8	0	1.00
10	A (1)	520047.739	133229.365	114.597	0	1.00
11	A (1)	520084.764	133248.03	116.899	0	1.00
12	A (1)	520121.499	133266.369	115.443	0	1.00
13	A (1)	520158.396	133285.35	121.437	0	1.00
14	A (1)	520192.353	133305.285	122.925	0	1.00
15	A (1)	520230.46	133387.409	169.653	0	1.00
16	A (1)	520241.06	133390.476	156.524	0	1.00
17	A (1)	520220.412	133323.7	120.107	0	1.00
18	A (1)	519644.152	133340.871	335.644	0	1.00
19	A (1)	519624.625	133301.545	326.725	0	1.00
20	A (1)	519846.567	133134.58	112.536	0	1.00
21	A (1)	519884.008	133152.136	111.675	0	1.00
22	A (1)	519921.525	133170.04	110.858	0	1.00
23	A (1)	519956.701	133187.049	118.106	0	1.00
24	A (1)	519994.486	133203.967	119.416	0	1.00
25	A (1)	520031.298	133220.26	116.862	0	1.00
26	A (1)	520067.755	133236.618	105.038	0	1.00
27	A (1)	520104.64	133257.61	123.066	0	1.00
28	A (1)	520140.176	133276.42	119.116	0	1.00
29	A (1)	520178.646	133296.785	123.341	0	1.00
30	A (1)	520207.865	133315.061	120.487	0	1.00
31	A (1)	520238.176	133342.388	177.316	0	1.00
32	A (1)	520235.288	133375.147	156.038	0	1.00
33	A (1)	519805.892	133129.016	266.435	0	1.00
34	A (1)	519790.093	133133.364	244.402	0	1.00
35	A (1)	519773.032	133144.693	221.852	0	1.00
36	A (1)	519756.565	133157.433	232.63	0	1.00
37	A (1)	519742.921	133168.123	229.319	0	1.00
38	A (1)	519725.074	133182.225	227.821	0	1.00
39	A (1)	519708.225	133195.06	232.655	0	1.00
40	A (1)	519692.096	133207.012	233.484	0	1.00
41	A (1)	519675.801	133219.356	237.433	0	1.00
42	A (1)	519661.313	133233.621	213.868	0	1.00
43	A (1)	519645.925	133244.615	242.053	0	1.00
44	A (1)	519627.57	133253.415	240.611	0	1.00
45	A (1)	519615.715	133261.832	204.751	0	1.00

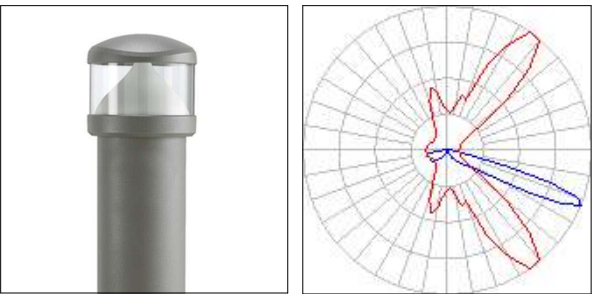

REF A:
Kirium Bollard, 200, 1M, Asymmetric Medium, 3000K, 700mA.
Painted in Black Ral 9005.

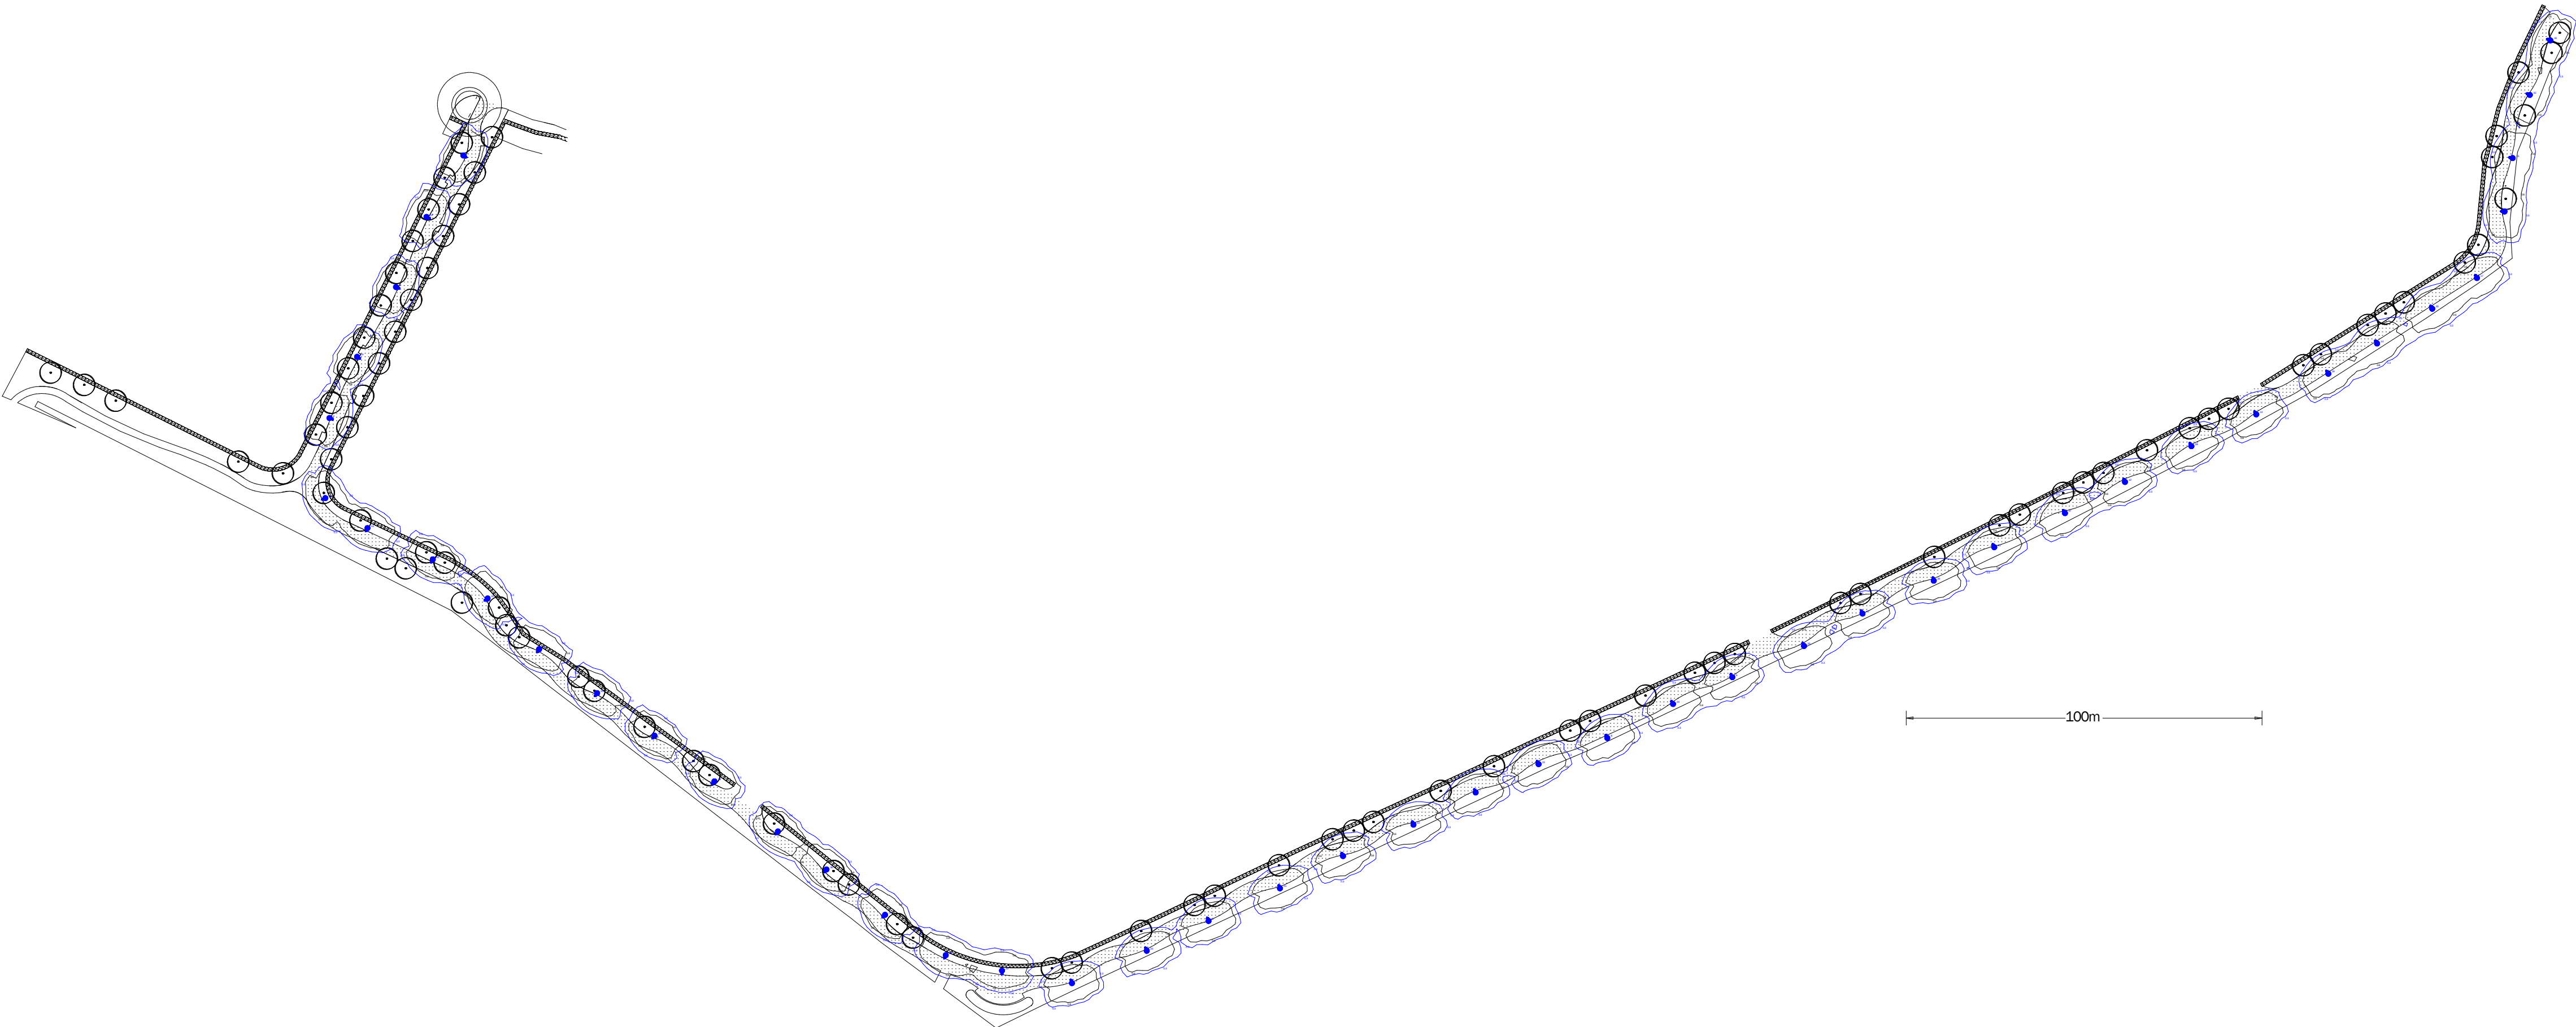

D	09/01/2026	New DWG
C	03/10/2025	Added scale bar
B	09/09/2025	Position amendments
A	11/08/2025	Based on client CAD DWG
Issue:	Date:	Description:

CDM Statement:
Please note that this proposed lighting scheme is a lighting solution that has been designed with information provided by the client. The solution does not include site, installation engineering or any risk assessment considerations for CDM.



Pindar Road, Hoddesdon Herts. EN11 0DX, UK T: 01992 474600 E:info@dw-windsor.co.uk W: www.dw-windsor.com

Project:
L&G Development, Horsham
Employment Road Cycleway

Client:	David Jarvis Associates	Contact:	Paul Gibbs
Project Management:	Steven Meredith	Lighting Design:	Emma Gregory
All measurements in Metres & lux. Do not scale from this drawing. All product images are indicative.			
Filename: 25-286-2D - 1.1 L&G Development, Horsham - Employment Road Cycleway (Layout) 25-286-2D.dwg			
Date: 09/01/2026 Scale: 1:1200 @ A1			
Project Ref: Page 1 of 1			

25-286-2D