

| Revisions: |          |               | Drawn | Inspected |
|------------|----------|---------------|-------|-----------|
| 01         | 09.03.23 | First Issue   | MC    | NG        |
| 02         | 19.05.23 | Notes Amended | MC    | NG        |
|            |          |               |       |           |
|            |          |               |       |           |
|            |          |               |       |           |
|            |          |               |       |           |
|            |          |               |       |           |
|            |          |               |       |           |
|            |          |               |       |           |
|            |          |               |       |           |

NOTES:

Surface material to be used would be Type 1 locally quarried stone.


Type 1 local quarried stone will be used for all access tracks.

Geogrid Tensor TriAx Tx160  
(or equivalent)

Geogrid Tensor TriAx Tx160  
(or equivalent)

Terram permeable separation layer

3500mm minimum

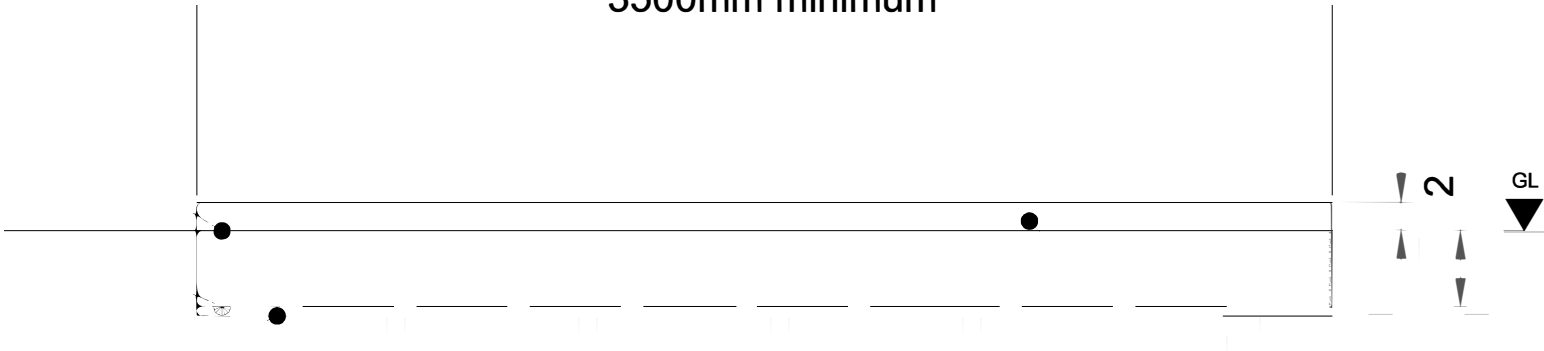


SECTION VIEW

40 mm to dust crushed stone  
(SWH803-Type 1)



Status:  
**FOR PLANNING**



| Drawing Title:               |                                   |                             |
|------------------------------|-----------------------------------|-----------------------------|
| Access Track Cross Section   |                                   |                             |
| Drawn:<br>MC                 | Checked:<br>NG                    | First Issued:<br>09.03.2023 |
| Project Code:<br><b>LCS-</b> | Drawing Number:<br><b>SD-06.2</b> |                             |
| Sheet Size:<br><b>A3</b>     | Scale:<br><b>1:20</b>             | Revision:<br><b>02</b>      |