



Horsham District Council
Parkside
Chart Way
Horsham
West Sussex
RH12 1RL

Your ref
DC/26/1204

Our ref
DSA000057266

Date
11th of September 2026

Contact
Tel 0330 303 0119

Dear Sir/Madam,

Proposal: All outstanding Reserved Matters for the erection of 82 dwellings with associated parking, landscaping, surface and foul water drainage, open space, and associated works and infrastructure pursuant to permission reference DC/25/0102.

Site: Land at Campsfield Linfield Close Southwater West Sussex.

Thank you for your correspondence, please see our comments below regarding the above application.

Yes To Capacity (FOUL)

There is currently adequate capacity in the local sewerage network to accommodate a foul flow of 0.74 l/s for the above development at manhole reference TQ16240909.

There is currently adequate capacity in the local foul sewerage network to accommodate the developments foul flow at manhole reference TQ16240909.

Connection to water distribution main

Our investigations indicate that Southern Water can facilitate water supply to service the proposed development. Southern Water requires a formal application for a connection to the water supply to be made by the applicant or developer. To make an application visit Southern Water's Get Connected service: <https://developerservices.southernwater.co.uk> and please read our New Connections Charging Arrangements documents which are available to read on our website via the following link www.southernwater.co.uk/developing-building/connection-charging-arrangements

Proposed pumping station located

If the applicant proposes to offer a new on-site drainage and pumping station for adoption as part of the foul/surface water public sewerage system, this would have to be designed and constructed to the specification of Southern Water Services Ltd.

<https://landsearch.southernwater.co.uk/media/4323/southern-water-design-and-construction-specification-water-codes-for-adoption.pdf>

In order to protect the amenity of prospective residents, no habitable rooms shall be located within 15 metres to the boundary of the proposed adoptable pumping station, due to the potential odour, vibration and noise generated by all types of pumping stations.

Condition: Construction of the development shall not commence until details of the proposed means of foul/surface water drainage disposal respecting the requirement for a non-habitable zone around the adoptable pumping station and suitable access arrangements, have been submitted to, and approved in writing by the Local Planning Authority in consultation with Southern Water.

Connection to public sewer - capacity available desktop study over 50

Southern Water requires a formal application for a connection to the public sewer to be made by the applicant or developer. To make an application visit Southern Water's Get Connected service:

<https://developerservices.southernwater.co.uk> and please read our New Connections Charging Arrangements documents which are available on our website via the following link: <https://www.southernwater.co.uk/developing-building/connection-charging-arrangements>

We request that should this planning application receive planning approval, the following informative is attached to the consent: Construction of the development shall not commence until details of the proposed means of foul sewerage and surface water disposal have been submitted to and approved in writing by the Local Planning Authority in consultation with Southern Water.

Disposal of surface water

If the applicant has not already provided documentation demonstrating compliance with the surface water hierarchy reflected in part H3 of the Building Regulations, as shown below, we will require this to be provided where surface water is being considered for discharge to our network. Whilst reuse does not strictly form part of this hierarchy, Southern Water would encourage the consideration of reuse for new developments.

- Reuse
- Infiltration
- Watercourse
- Storm Sewer
- Combined Sewer

Guidance on Building Regulations is here: <https://www.gov.uk/government/publications/drainage-and-waste-disposal-approved-document-h>

We would like to engage with you on the design for disposal of surface water for this development at the earliest opportunity and we recommend that civil engineers and landscape architects work together and with Southern Water. In many cases this may negate or reduce the need for network reinforcement and allow earlier completion of the development.



Where a surface water connection to the foul or combined sewer is being considered. Southern Water will refuse any request to discharge surface water into our 'foul only' sewer network. This includes where the surface water hierarchy has been followed and all alternative options have been exhausted. This approach ensures that we work together to better protect the environment, improve water quality, and reduce flood risk. It also supports our work to separate rainwater from sewage at source to meet storm overflow reduction targets under Defra's Storm Overflows Discharge Reduction Plan, as well as to reduce the number of sewer flooding incidents that are caused by hydraulic overload of our sewer network during periods of sustained rainfall.

Applications for surface water connections into a combined sewer will only be permitted if;

- a) there are no alternative options under the surface water disposal hierarchy.
- b) there is capacity.

The above is supported by our Surface Water Management Policy, which is available to view on our website. It is also supported by the National standards for sustainable drainage systems (SuDS) - GOV.UK which states the following in Paragraph 1.10 - Surface water runoff from the development shall not discharge to a foul drainage system'.

Condition: We request that should this application receive planning approval, the following condition is attached to the consent: Construction of the development shall not commence until details of the proposed means of surface water run off disposal in accordance with Part H3 of Building Regulations hierarchy as well as acceptable discharge points, rates and volumes have been agreed by the Lead Local Flood Authority, in consultation with Southern Water.

Proposed SUDS features

If it is the intention of the developer for Southern Water to adopt the proposed SuDS, the system shall be designed and constructed in line with the Design and Construction Guidance www.water.org.uk/sewerage-sector-guidance-approved-documents/

No Soakaways should be connected to the public surface water sewer.

Tree Planting

We have restrictions on the proposed tree planting adjacent to Southern Water sewers, rising mains or water mains. Reference should be made to Southern Water's publication "A Guide to Tree Planting near water Mains and Sewers" (https://www.southernwater.co.uk/media/pddob0vn/ds-tree-planting-guide-1_nwm.pdf) and the Sewerage Sector Guidance ([https://www.water.org.uk/sewerage-sector-guidance-approved-documents/](http://www.water.org.uk/sewerage-sector-guidance-approved-documents/)) with regards to any landscaping proposals and our restrictions and maintenance of tree planting adjacent to sewers, rising mains and water mains.

Condition: In order to protect public apparatus, Southern Water requests that if consent is granted, the following pre commencement condition is attached to the planning permission; The developer must advise the local authority (in consultation with Southern Water) of the landscaping proposals in proximity of public apparatus in order to protect it in accordance with Southern Water's guidance, prior to the commencement of the development.



Due to legislative changes effective from 1st October 2011 regarding the ownership of sewers, it is possible that a sewer now deemed to be public could be crossing the development site. Therefore, should any sewer be found during construction works, an investigation of the sewer will be required to ascertain its ownership before any further works commence on site. If this happens, please call our Customer Service Desk on 0330 303 0119


For further advice, please contact Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX (Tel: 0330 303 0119)

Website: southernwater.co.uk or by email at: SouthernWaterPlanning@southernwater.co.uk

Yours faithfully,

Future Growth Planning Team

southernwater.co.uk/developing-building/planning-your-development

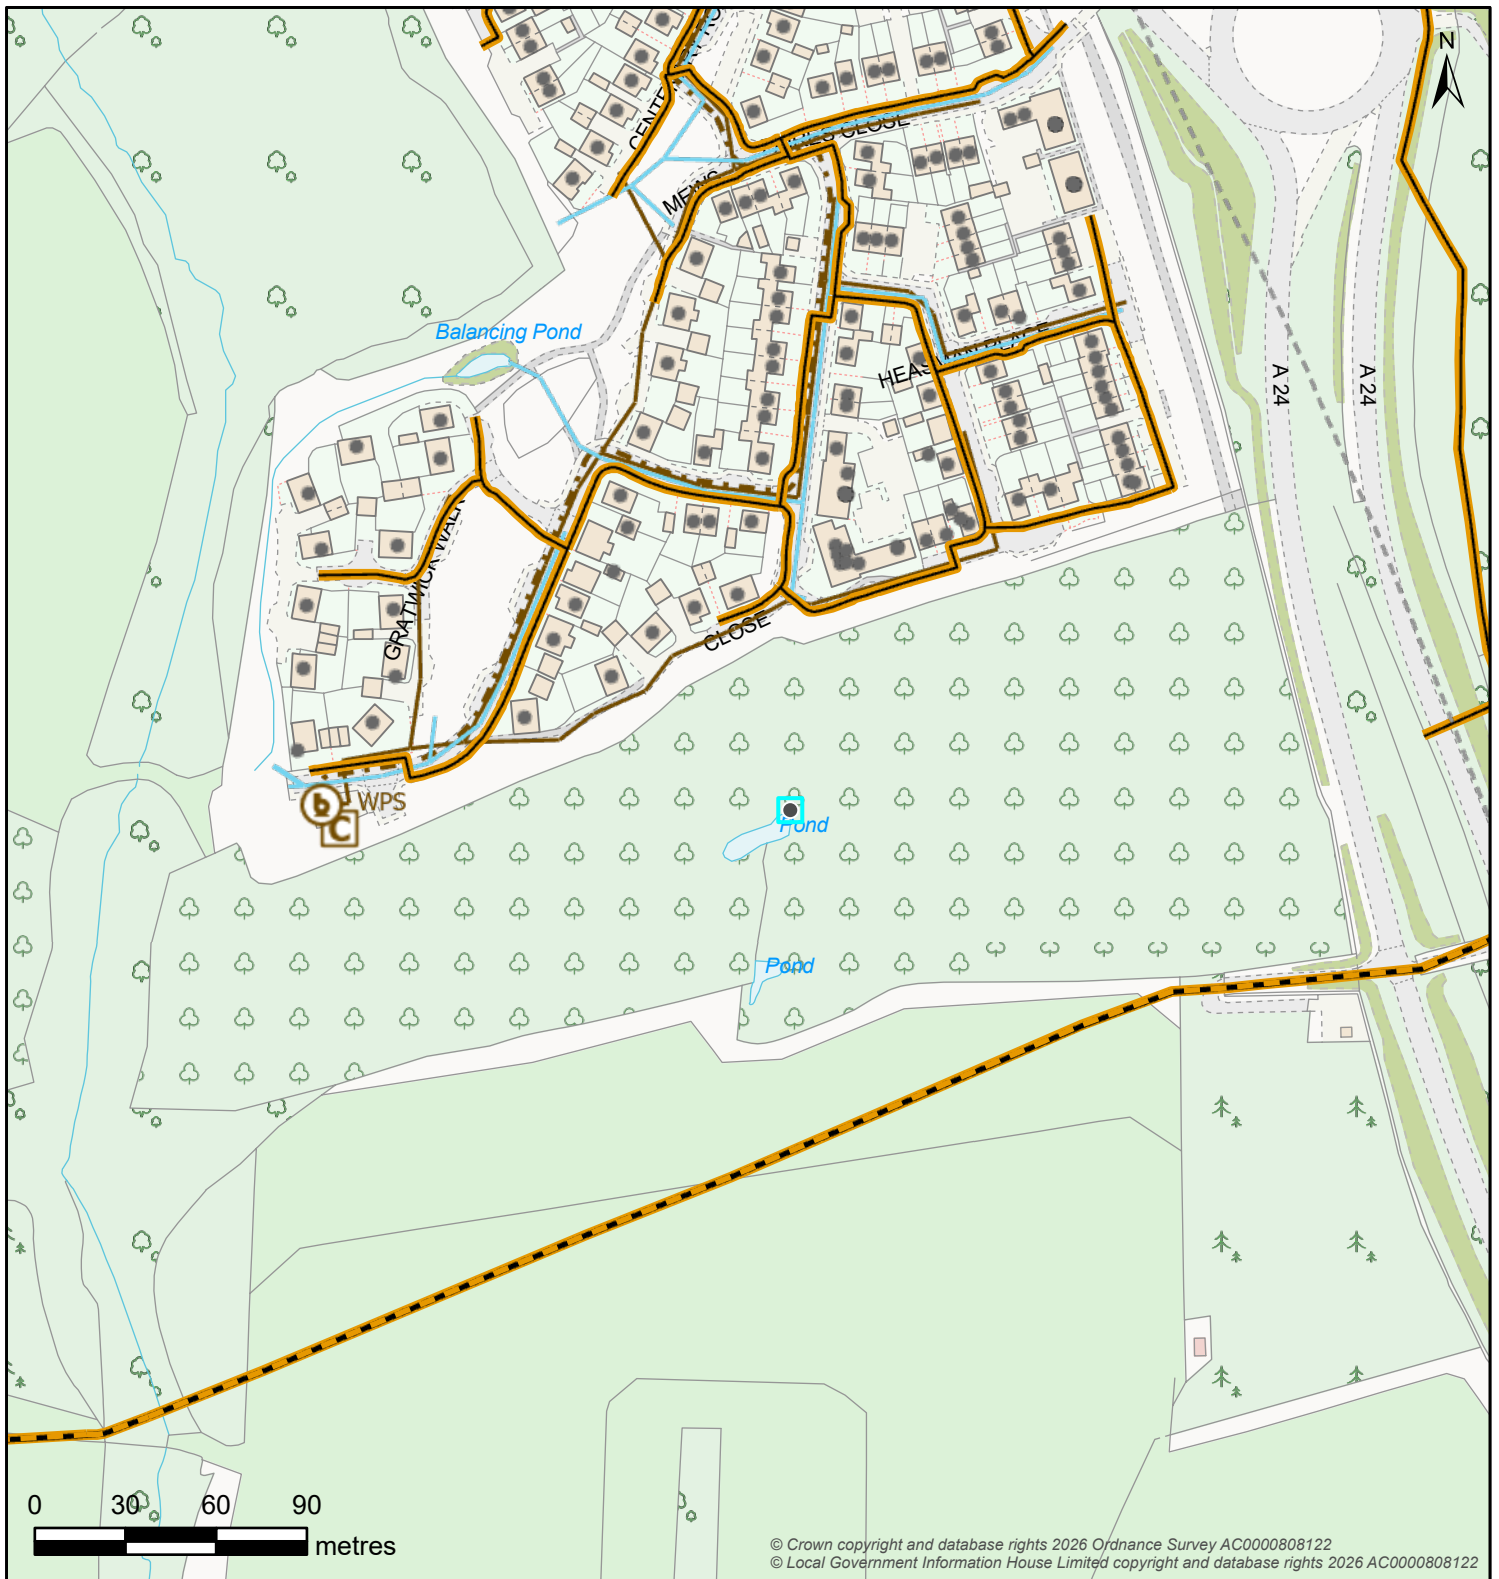

Controllable Valve			Flow Control			Inlet-Outfall	
Damboards	Penstock	Valve	Anti Flood Device	Pumped Anti Flood Device	Reflux Valve	Inlet	Outfall
Manhole							
BIF Bifurcation	Cascade	CP Catchpit	Head Of Public Sewer	IC Interceptor Chamber	Manhole	S Soakaway	WO Washout
Outfall Headworks		Overflow Chamber		Pipe Bridge		Pumping Station	
Outfall Headworks	CSO Combined Sewer Overflow	EMO Emergency Overflow	Pipe Bridge	Micro Pumping Station	Pumping Station		
Sewer Level Monitor		Storage		Treatment Works		Weir	
Sewer Level Monitor	Storm Tank	Tidal Storage Tank	Treatment Works	Weir	Wastewater Site		
Wastewater Pipe				Wastewater Use		Developer Services	
Culverted Water Course	Syphon	Tank Sewer	Trunk Sewer	Foul	Combined	Build Over Agreement	Section 104
Drain	Vacuum Main	Decommissioned Pipe	Sewer	Sludge	Treated Effluent	Catchment	Sub-Catchment
Outfall				Surface Water			
Overflow				Private			
Rising Main							

Map Title: DSA000057266 GIS

Printed By: Kelly.Donaldson

Date Printed: 07/09/2026

Map Scale: 2500

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.

