from Southern Water

Directorate of Planning
Horsham District Council
Parkside
Chart Way
Horsham
West Sussex
RH12 1RL

Your ref
DC/24/0693

Our ref
DSA000034216

Date
31 May 2024

Contact
Tel 0330 303 0119

Dear Sir/Madam,

Proposal: Subdivision of a house to create two semi detached dwellings, including the formation of a porch and detached car port.
Site: DC/24/0693: - Sandgate House, Water Lane, Storrington, West Sussex, RH20 3LY.

Thank you for your letter dated 10 May 2024.

Following the review of the submitted documents, we have the below comments for the Planning consultation.

Foul and Surface Water Drainage

The Environment Agency should be consulted directly by the applicant regarding the use of a septic tank drainage which disposes of effluent to sub-soil irrigation.

The Council's Building Control officers or technical staff should be asked to comment on the adequacy of soakaways to dispose of surface water from the proposed development.

Southern Water has noted that the applicant has submitted a Water Neutrality report which we understand the Local Planning Authority will be working in conjunction with Natural England on reviewing the developers proposals. We would not comment on the developers proposals directly, however if the LPA have any specific questions, they can be forwarded to us for a direct response.

It is possible that a sewer now deemed to be public could be crossing the development site. Therefore, should any sewer be found during construction works, an investigation of the sewer will be required to ascertain its ownership before any further works commence on site.

Southern Water Services Ltd, Registered Office: Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX Registered in England No. 2366670

For further advice, please contact Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX (Tel: 0330 303 0119).


Website: southernwater.co.uk or by email at: SouthernWaterPlanning@southernwater.co.uk

Yours faithfully,

Future Growth Planning Team
Developer Services

southernwater.co.uk/developing-building/planning-your-development

Southern Water Services Ltd, Registered Office: Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX Registered in England No. 2366670

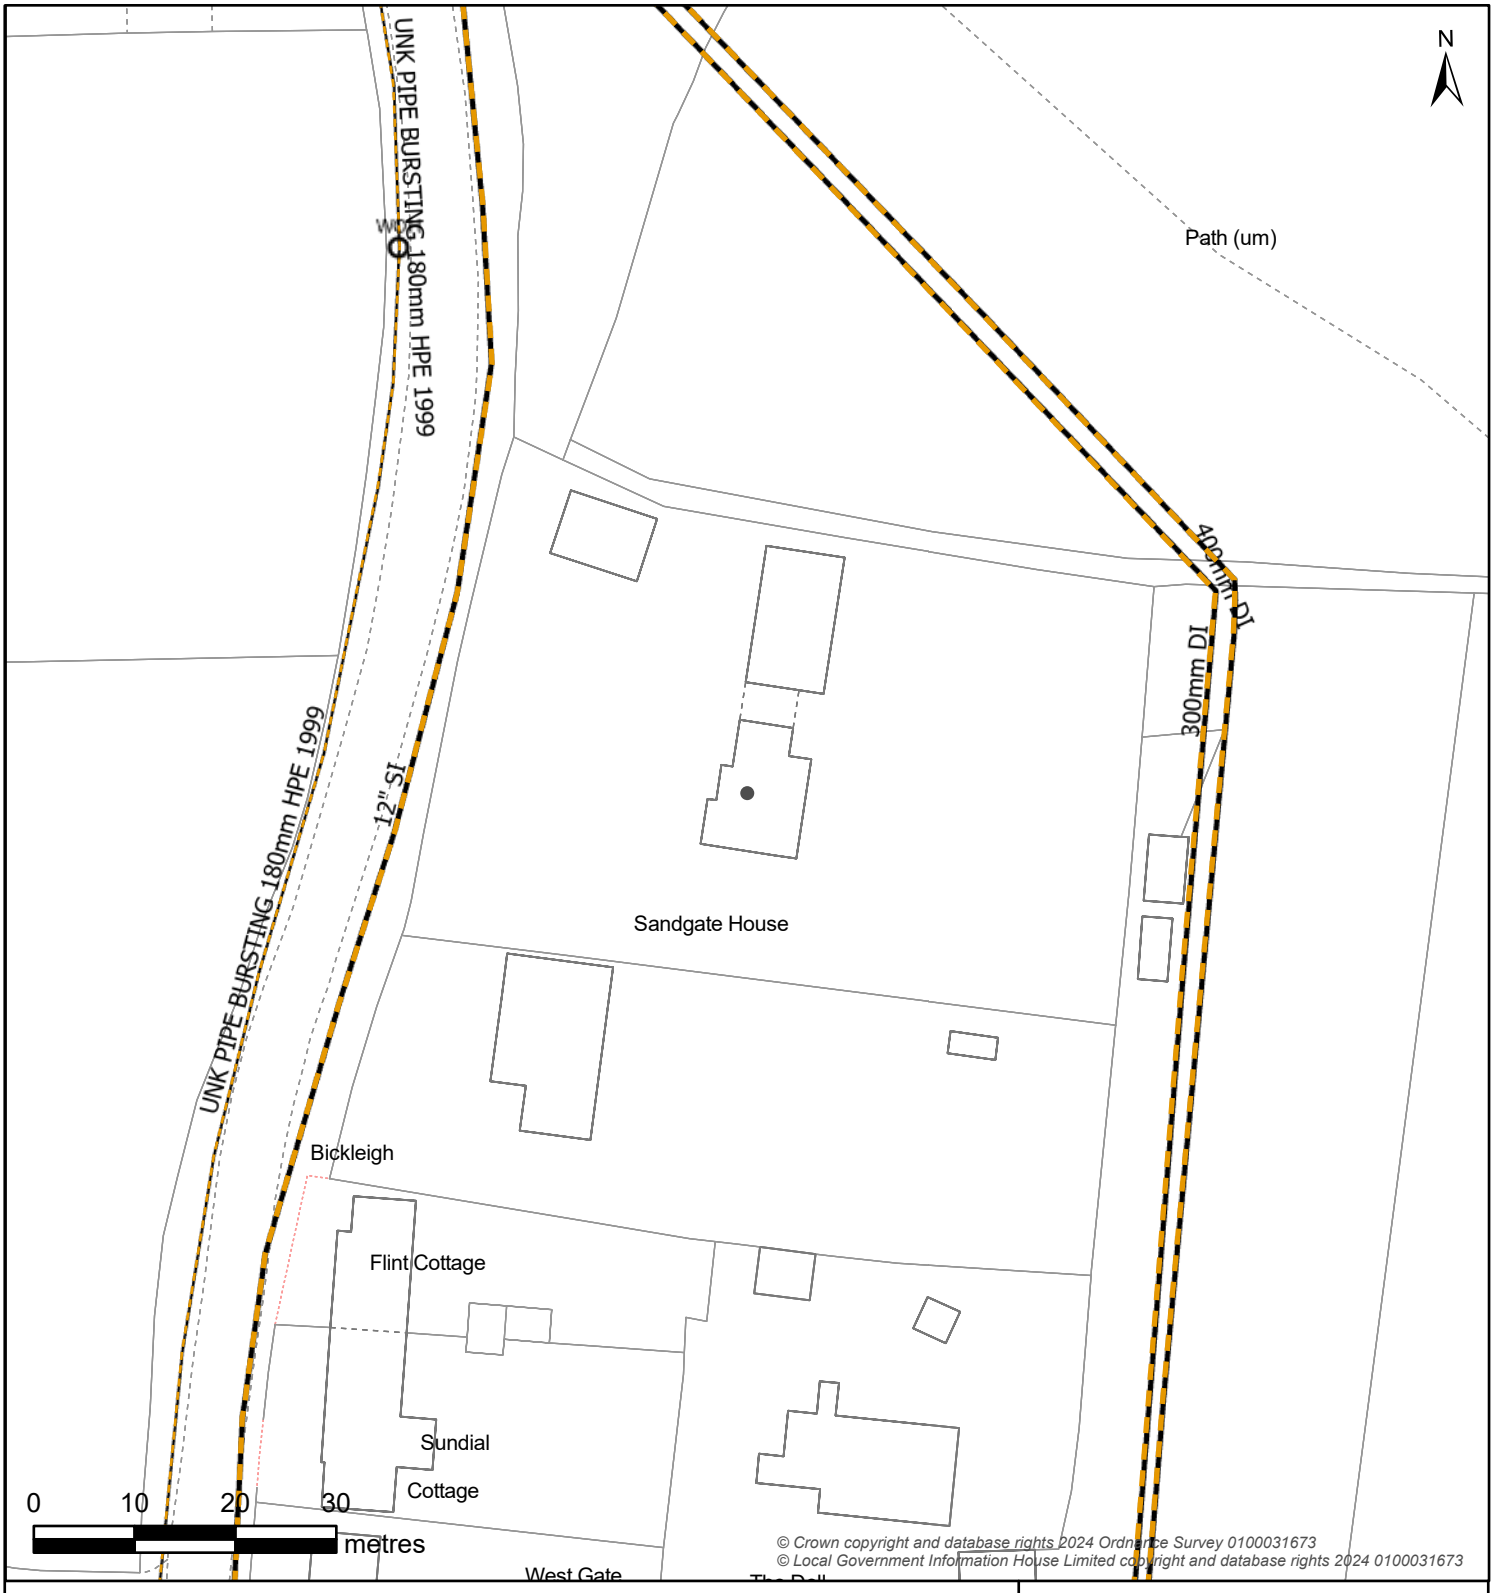

© Crown copyright and database rights 2024 Ordnance Survey 0100031673
© Local Government Information House Limited copyright and database rights 2024 0100031673

Controllable Valve
Damboards | Penstock | Valve

Flow Control
Anti Flood Device | Pumped Anti Flood Device | Reflux Valve

Inlet-Outfall
Inlet | Outfall

Manhole
BIF Bifurcation | Cascade | CP Catchpit | Head Of Public Sewer | IC Interceptor Chamber | Manhole | S Soakaway | WO Washout

Outfall Headworks
Outfall Headworks

Overflow Chamber
CSO Combined Sewer Overflow | EMO Emergency Overflow

Pipe Bridge
Pipe Bridge

Pumping Station
Micro Pumping Station | Pumping Station

Sewer Level Monitor
Sewer Level Monitor

Storage
Storm Tank | Tidal Storage Tank

Treatment Works
Treatment Works

Weir
Weir

Wastewater Site
Wastewater Site

Wastewater Pipe
Culverted Water Course
Drain
Outfall
Overflow
Rising Main
Sewer
Syphon
Tank Sewer
Trunk Sewer
Vacuum Main
Decommissioned Pipe

Wastewater Use
Foul
Combined
Sludge
Treated Effluent
Surface Water
Private

Developer Services
Build Over Agreement | Section 104

Wastewater Area
Catchment
Sub-Catchment

Map Title: SW Print

Printed By: Sanjay.Boregowda

Date Printed: 28/05/2024

Map Scale: 750

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.

WATER for LIFE from Southern Water