from Southern Water

Horsham District Council
Parkside
Chart Way
Horsham
West Sussex
RH12 1RL

Your ref
DC/26/1681

Our ref
DSA000059050

Date
12th of November 2026

Contact
Tel 0330 303 0119

Dear Sir/Madam,

Proposal: Provision of additional Gypsy and Traveller pitch with the erection of brick-built utility building, additional hardstanding and revised site layout.
Site: 2 Greenacres Farm West Chiltington Lane Billingshurst West Sussex RH14 9DR.

Thank you for your correspondence, please see our comments below regarding the above application.

Surface water discharge proposed to existing watercourse

The Council's technical staff and the relevant authority for land drainage consent should comment on the adequacy of the proposals to discharge surface water to the local watercourse.

Other means of foul disposal proposed in proximity of existing Network

Under the first time sewerage guidance the EA expect people to connect to a public sewer if the dwelling is within 30m of our network, this guidance can be found here: General binding rules for small sewage discharges (SSDs) with effect from January 2015 - GOV.UK (www.gov.uk)

Your development is further than 30 m away from our network, you may want to consider a private discharge or a connection to our network in these circumstances. Please familiarise yourself with EA guidance before progressing your drainage solution further.

Proposed Disposal to ground from package treatment plant

The Environment Agency should be consulted directly by the applicant regarding the use of a private wastewater treatment works which disposes of effluent to sub-soil irrigation.

Southern Water Services Ltd, Registered Office: Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX Registered in England No. 2366670

Due to legislative changes effective from 1st October 2011 regarding the ownership of sewers, it is possible that a sewer now deemed to be public could be crossing the development site. Therefore, should any sewer be found during construction works, an investigation of the sewer will be required to ascertain its ownership before any further works commence on site. If this happens, please call our Customer Service Desk on 0330 303 0119


For further advice, please contact Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX (Tel: 0330 303 0119)

Website: southernwater.co.uk or by email at: SouthernWaterPlanning@southernwater.co.uk

Yours faithfully,

Future Growth Planning Team
southernwater.co.uk/developing-building/planning-your-development

Southern Water Services Ltd, Registered Office: Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX Registered in England No. 2366670

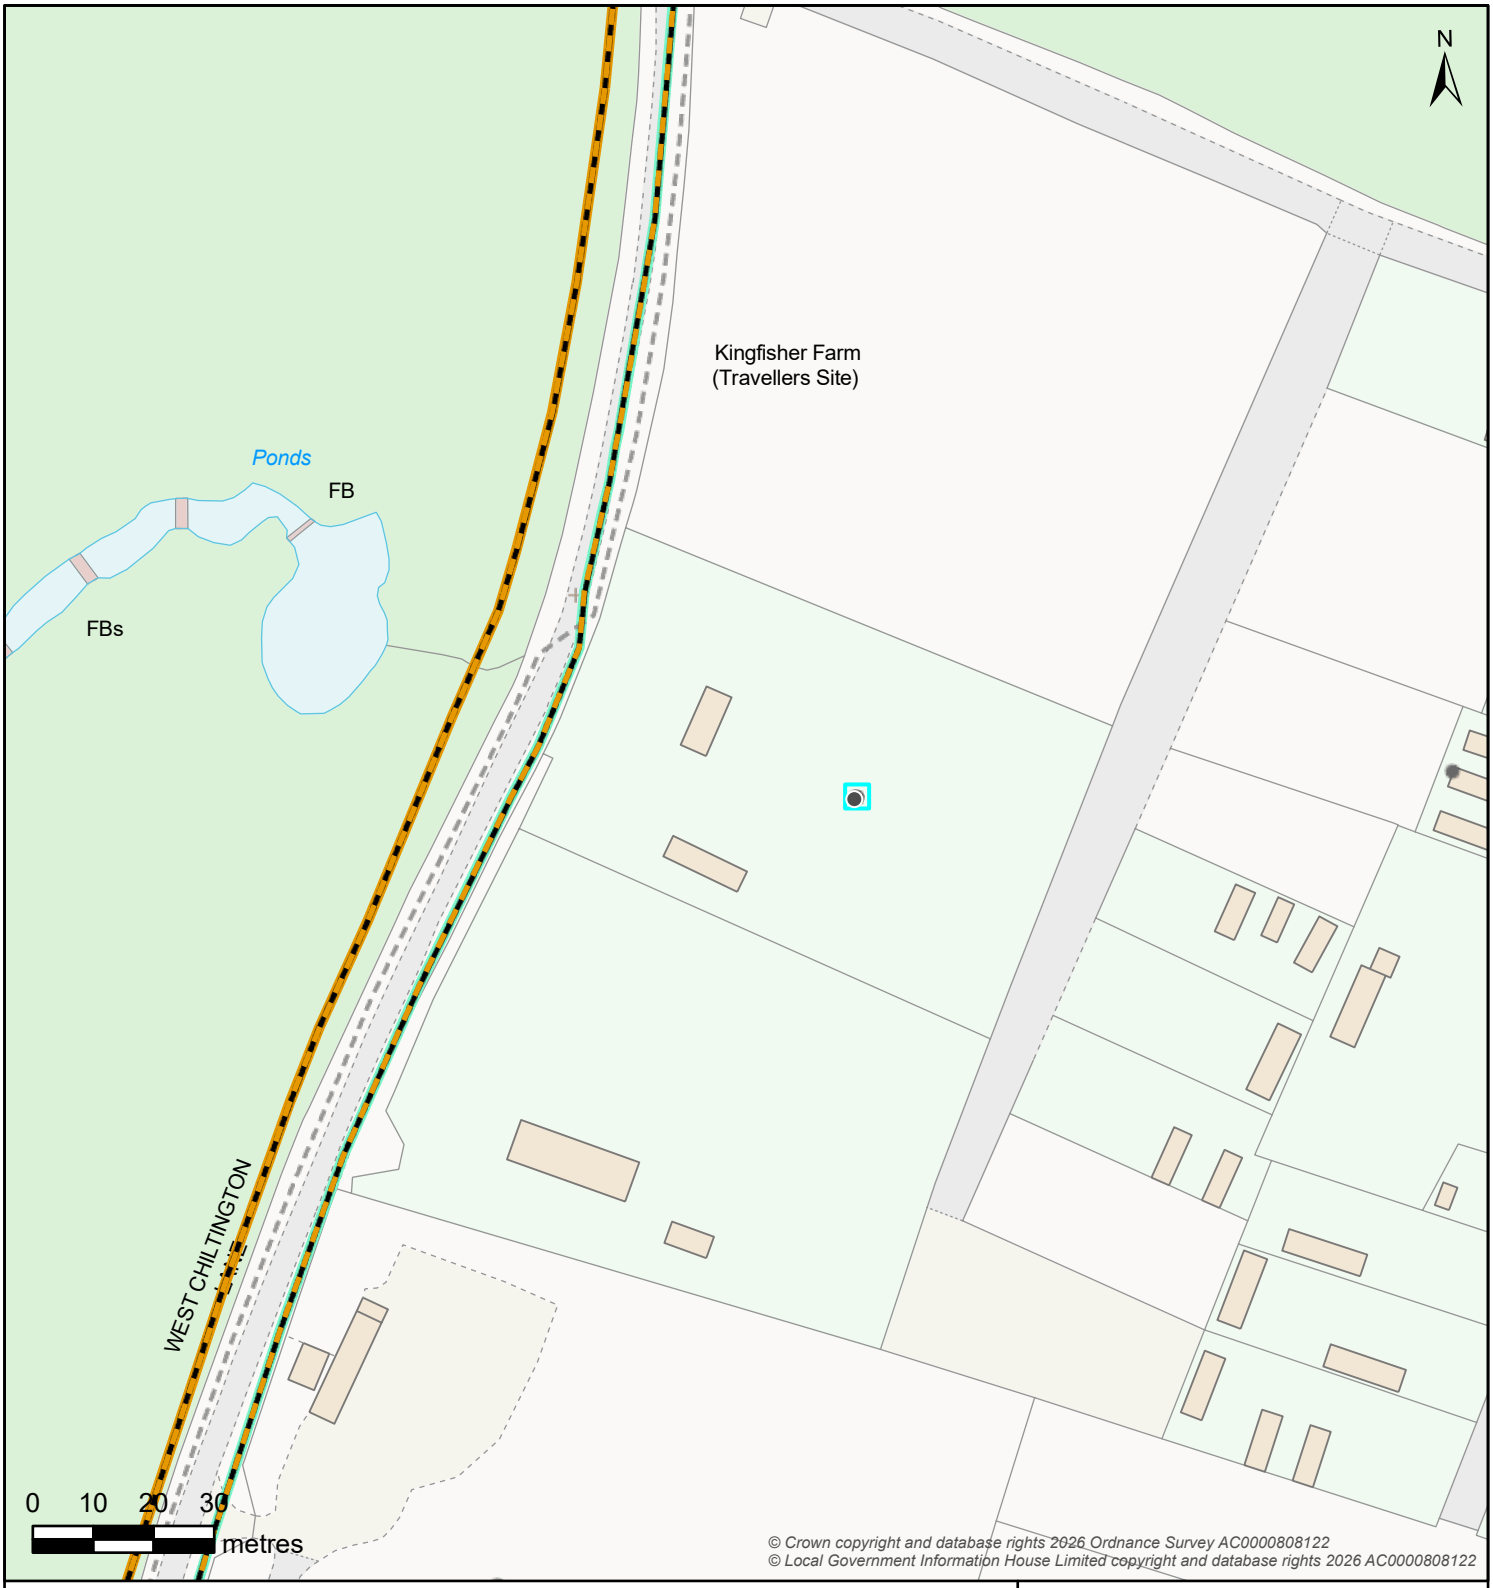

Controllable Valve
Damboards | Penstock | Valve

Flow Control
Anti Flood Device | Pumped Anti Flood Device | Reflux Valve

Inlet-Outfall
Inlet | Outfall

Manhole
BIF Bifurcation | Cascade | CP Catchpit | Head Of Public Sewer | IC Interceptor Chamber | Manhole | S Soakaway | WO Washout

Outfall Headworks
Outfall Headworks

Overflow Chamber
CSO Combined Sewer Overflow | EMO Emergency Overflow

Pipe Bridge
Pipe Bridge

Pumping Station
Micro Pumping Station | Pumping Station

Sewer Level Monitor
Sewer Level Monitor

Storage
Storm Tank | Tidal Storage Tank

Treatment Works
Treatment Works

Weir
Weir

Wastewater Site
Wastewater Site

Wastewater Pipe
- Culverted Water Course
- Drain
- Outfall
- Overflow
- Rising Main
- Sewer
- Syphon
- Tank Sewer
- Trunk Sewer
- Vacuum Main
- Decommissioned Pipe

Wastewater Use
- Foul
- Combined
- Sludge
- Treated Effluent
- Surface Water
- Private

Developer Services
Build Over Agreement | Section 104

Wastewater Area
Catchment | Sub-Catchment

Map Title: DSA000059050 GIS

Printed By: Kelly.Donaldson

Date Printed: 12/11/2026

Map Scale: 1250

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.

WATER for LIFE from Southern Water