


THE OLD HOUSE - RADIATOR SCHEDULE

Ref	Zone	Peak Load kW	Load Required for Radiators (kW)	Manufacture	Model	Size (mm) (L x H x D)	Output (w)	UIN	Accessories
1	Boot Room	0.40	0.48	Stelrad	Horizontal	628 x 600 x 159	554	463040h	PC Sum £80
2	Entry hall	1.11	0.66	Stelrad	Horizontal	858 x 600 x 159	768	463041h	PC Sum £80
3			0.66	Stelrad	Horizontal	858 x 600 x 159	768	463041h	PC Sum £80
4	Bedroom 1 (Ground floor)	0.92	1.10	Stelrad	Horizontal	1272 x 600 x 159	1152	463043h	PC Sum £80
5	Bed 1 Ensuite (Ground floor)	1.58	1.90	Removed for electric underfloor heating					
6				Removed for electric underfloor heating					
7	Bedroom 2 (First Floor)	0.25	0.30	Stelrad	Horizontal	628 x 600 x 159	554	463040h	PC Sum £80
8	Landing (First Floor)	0.31	0.37	Stelrad	Horizontal	628 x 600 x 159	554	463040h	PC Sum £80
9	Lounge area (First Floor)	0.12	0.14	Stelrad	Horizontal	628 x 600 x 159	554	463040h	PC Sum £80
10	Bathroom 3 (First Floor)	0.71	0.85	Removed for electric underfloor heating					
11	Bedroom 3 (First Floor)	0.38	0.46	Stelrad	Horizontal	628 x 600 x 159	554	463040h	PC Sum £80
12	Bathroom 5 (First Floor)	0.55	0.66	Removed for electric underfloor heating					
13	Bedroom 5 (First Floor)	0.53	0.64	Stelrad	Horizontal	858 x 600 x 159	768	463041h	PC Sum £80
14	Bathroom 4 (First Floor)	0.55	0.66	Removed for electric underfloor heating					
15	Bedroom 4 (First Floor)	0.57	0.68	Stelrad	Horizontal	858 x 600 x 159	768	463041h	PC Sum £80
16	Bathroom 2 (First Floor)	0.88	1.06	Removed for electric underfloor heating					
17	Suite (Ground floor)	0.91	1.09	Stelrad	Horizontal	1042 x 600 x 159	939	463042h	PC Sum £80
18	Kitchen & Dining area (Ground floor)	1.66	1.15	Stelrad	Horizontal	1272 x 600 x 159	1152	463043h	PC Sum £80
19			0.68	Stelrad	Horizontal	628 x 600 x 159	554	463040h	PC Sum £80
20	Suite bathroom (Ground floor)	0.79	0.95	Removed for electric underfloor heating					
21	Veranda (Ground floor)	1.75	1.05	Stelrad	Horizontal	1272 x 600 x 159	1152	463043h	PC Sum £80
22			1.05	Stelrad	Horizontal	1272 x 600 x 159	1152	463043h	PC Sum £80

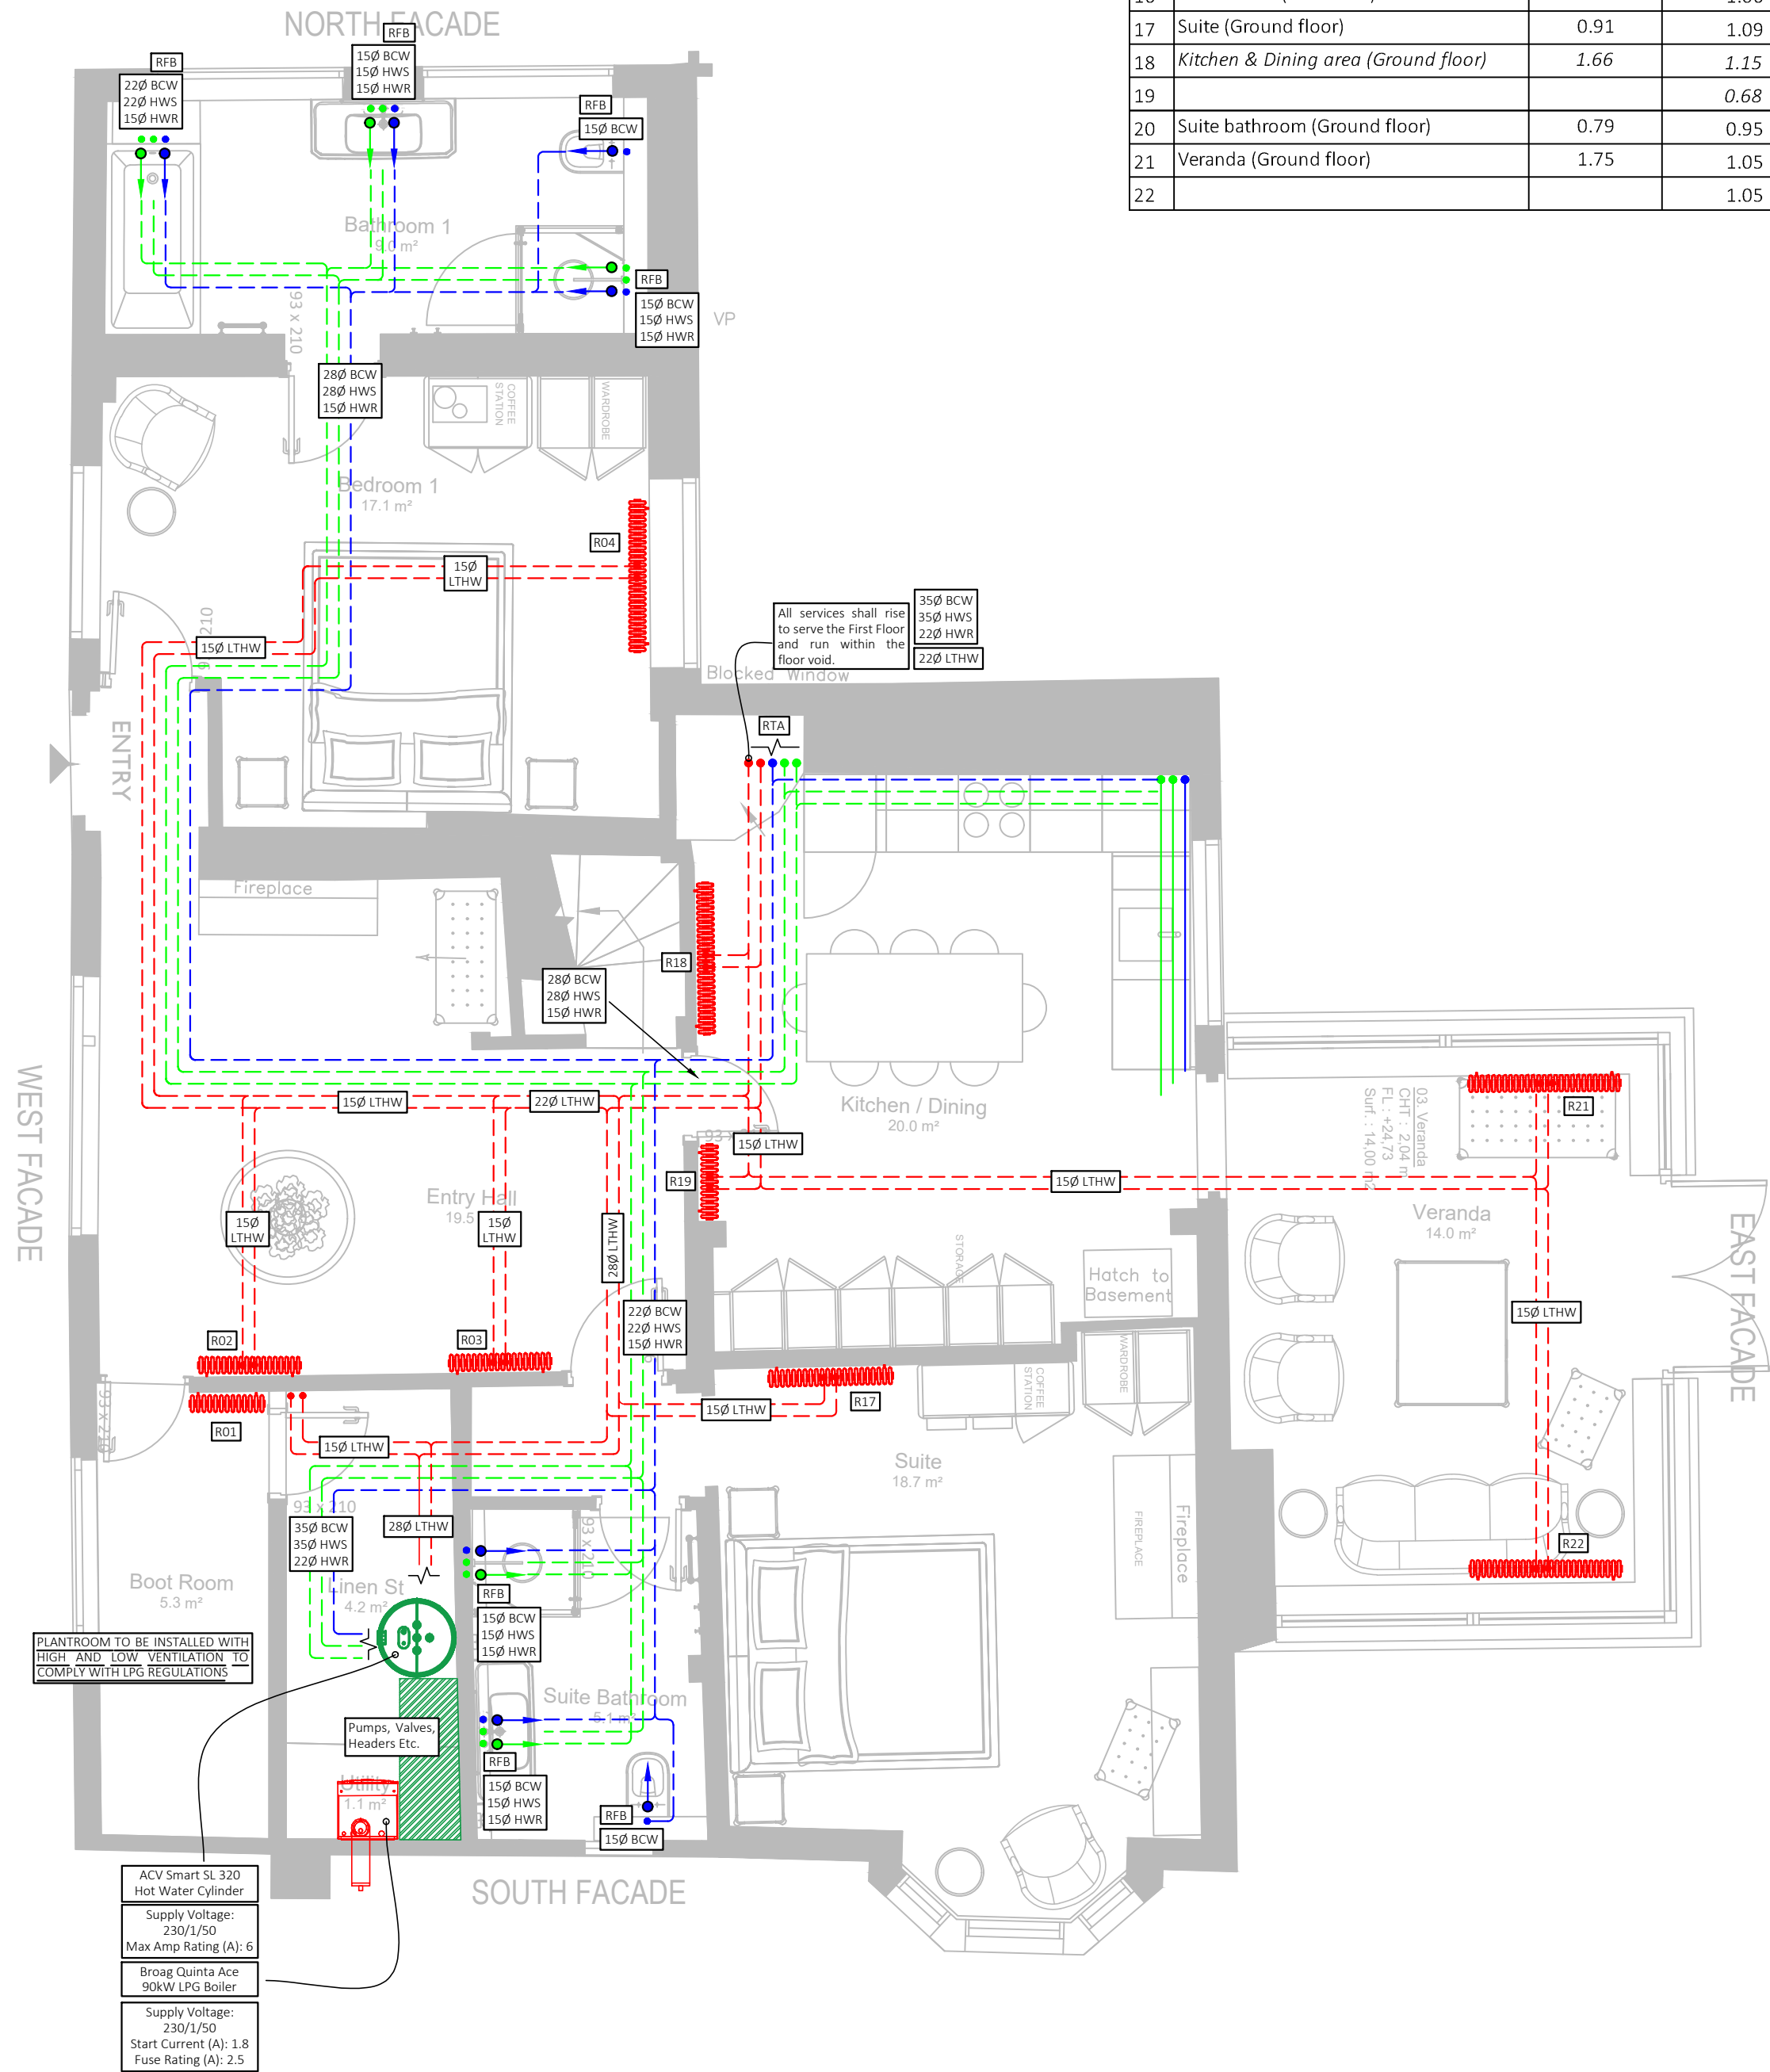

McCarthy Bainbridge Ltd
Woodruffe House, Bagshot Road,
Woking, Surrey
GU22 0QY

www.mccarthybainbridgetd.co.uk
T: 01483 799928 F: 01483 475322
E: info@mccarthybainbridgetd.co.uk

Mechanical Engineer:

Name: Nicholas Villareal
Mobile: 07802 855500
E-Mail: nick@mccarthybainbridgetd.co.uk

Electrical Engineer:

Name: Tony Bainbridge
Mobile: 07900 605722
E-Mail: tony@mccarthybainbridgetd.co.uk

CDM - DESIGN RISK INFORMATION

Residual Risks which we have not been able to design out and which others could not be reasonably expected to know about.

RISK DETAIL & STAGE	SUGGESTED CONTROL MEASURE	DESIGNER
Testing and Commissioning Works	Ensure all testing is done with other operatives knowledge. Live testing only to be undertaken under strict control. (Refer to method statement)	AJB
Electrical Connections	Ensure no connections are made to energized systems	AJB
Hazardous Materials	If any hazardous materials are located during works, cease works and advise CA	AJB

No.	Description	Date
T1	Tender Issue	16.03.26
T2	Revised Tender Issue	20.03.26

THE MUCKY DUCK
TISMAN'S COMMON,
RUDGWICK
HORSHAM, RH12 3BW

THE OLD HOUSE
GROUND FLOOR
MECHANICAL SERVICES

Project number	MBL909
Date	16/03/2026
Drawn by	NV
Revision	T2

909-MBL-OH-GF-CR-M-1008

Scale 1:50 @ A1