



Horsham District Council
Parkside
Chart Way
Horsham
West Sussex
RH12 1RL

Your ref
DC/26/0914

Our ref
DSA000056351

Date
5th August 2026

Contact
Tel 0330 303 0119

Dear Sir/Madam,

Proposal: Demolition of shed and erection of 1no. detached dwellinghouse

Site address: Land at Wickhurst Lane Broadbridge Heath Horsham West Sussex

Thank you for your correspondence, please see our comments below regarding the above application

Insufficient Information provided:

Condition:

Construction of the development shall not commence until details of the proposed means of foul and surface water drainage disposal have been submitted to, and approved in writing by the Local Planning Authority in consultation with Southern Water.

Connection to water distribution main:

Our investigations indicate that Southern Water can facilitate water supply to service the proposed development. Southern Water requires a formal application for a connection to the water supply to be made by the applicant or developer.

To make an application visit Southern Water's Get Connected service:

<https://developerservices.southernwater.co.uk> and please read our New Connections Charging Arrangements documents which are available to read on our website via the following link www.southernwater.co.uk/developing-building/connection-charging-arrangements

Connection to public sewer - capacity available desktop study under 50:

Southern Water has undertaken a desktop study of the area, and our investigations indicate that Southern Water can facilitate foul sewerage /surface water run off disposal to service the proposed development. Southern Water requires a formal application for a connection to the public sewer to be made by the applicant or developer.

To make an application visit Southern Water's Get Connected service:

<https://developerservices.southernwater.co.uk> and please read our New Connections Charging Arrangements documents which are available on our website via the following link:

<https://www.southernwater.co.uk/developing-building/connection-charging-arrangements>

We request that should this planning application receive planning approval, the following informative is attached to the consent: Construction of the development shall not commence until details of the proposed means of foul sewerage and surface water disposal have been submitted to, and approved in writing by the Local Planning Authority in consultation with Southern Water.

S106 Connection application:

Any new connections to the public sewerage system will require a Section 106 connection application to be submitted and approved by Southern Water Services.

To make an application visit Southern Water's Get Connected service:

<https://developerservices.southernwater.co.uk> and please read our New Connections Charging Arrangements documents which are available on our website via the following link:

<https://www.southernwater.co.uk/developing-building/connection-charging-arrangements>

Please note that, where there are separate systems available Southern Water will not allow surface water to connect into the public foul sewer. If this is not possible, please provide evidence that all other options have been explored.

We request that should this planning application receive planning approval, the following informative is attached to the consent: Construction of the development shall not commence until details of the proposed means of foul sewerage and surface water disposal have been submitted to and approved in writing by the Local Planning Authority in consultation with Southern Water.

Hierarchy of Building Regulations H3 for disposal of surface water - not yet provided documentation proving compliance:

If the applicant has not already provided documentation demonstrating compliance with the surface water hierarchy reflected in part H3 of the Building Regulations, as shown below, we will require this to be provided where surface water is being considered for discharge to our network. Whilst reuse does not strictly form part of this hierarchy, Southern Water would encourage the consideration of reuse for new developments.

- Reuse
- Infiltration
- Watercourse
- Storm Sewer
- Combined Sewer

Guidance on Building Regulations is here: <https://www.gov.uk/government/publications/drainage-and-waste-disposal-approved-document-h>

We would like to engage with you on the design for disposal of surface water for this development at the earliest opportunity and we recommend that civil engineers and landscape architects work together and with Southern Water. In many cases this may negate or reduce the need for network reinforcement and allow earlier completion of the development.

Where a surface water connection to the foul or combined sewer is being considered. Southern Water will refuse any request to discharge surface water into our 'foul only' sewer network. This includes where the surface water hierarchy has been followed and all alternative options have



been exhausted. This approach ensures that we work together to better protect the environment, improve water quality, and reduce flood risk. It also supports our work to separate rainwater from sewage at source to meet storm overflow reduction targets under Defra's Storm Overflows Discharge Reduction Plan, as well as to reduce the number of sewer flooding incidents that are caused by hydraulic overload of our sewer network during periods of sustained rainfall.

Applications for surface water connections into a combined sewer will only be permitted if;

a) there are no alternative options under the surface water disposal hierarchy.

b) there is capacity*.

The above is supported by our Surface Water Management Policy, which is available to view on our website. It is also supported by the National standards for sustainable drainage systems (SuDS) - GOV.UK which states the following in Paragraph 1.10 - Surface water runoff from the development shall not discharge to a foul drainage system'

Condition:

We request that should this application receive planning approval, the following condition is attached to the consent: Construction of the development shall not commence until details of the proposed means of surface water run off disposal in accordance with Part H3 of Building Regulations hierarchy as well as acceptable discharge points, rates and volumes have been agreed by the Lead Local Flood Authority, in consultation with Southern Water.

Existing Southern Water Assets – General within boundary but no tree, buildings, assets within standoff distance (approximate):

Please see the attached extract from Southern Water records showing the approximate position of our existing sewer and water main assets crossing/in the vicinity of the development site. The exact position of the public assets must be determined on site by the applicant in consultation with Southern Water before the layout of the proposed development is finalised. To get in contact to confirm the exact position of the asset please visit;

https://www.southernwater.co.uk/media/ph4fk3pe/ds-location-of-rising-mains_pb.pdf.

For information on required stand off distances from public sewers please refer to:

<https://www.southernwater.co.uk/media/st5orjvm/stand-off-distances.pdf>

Existing Gravity Sewer - tree, buildings, assets within stand-off distance:

The 225 mm diameter gravity sewer requires a clearance of 3 metres on either side of the gravity sewer to protect it from construction works and to allow for future maintenance access.

No development or tree planting should be carried out within 3 metres of the external edge of the public gravity sewer without consent from Southern Water. All existing infrastructure should be protected during the course of construction works. Please refer to:

<https://www.southernwater.co.uk/media/st5orjvm/stand-off-distances.pdf>

Condition:

In order to protect public sewers, Southern Water requests that if consent is granted, the following condition is attached to the planning permission; The developer must agree with Southern Water, prior to commencement of the development, the measures to be taken to protect the public sewers.

Proposed works involve demolition:

In order to protect and safeguard the existing water supply apparatus, Southern Water requests formal notification of any proposed demolition works prior to such works being undertaken.

It is possible that a sewer now deemed to be public could be crossing the development site. Therefore, should any sewer be found during construction works, an investigation of the sewer will be required to ascertain its ownership before any further works commence on site. If this happens, please call our Customer Service Desk on 0330 303 0119.


For further assistance, please contact Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX (TEL: 0330 303 0119)

Website: southernwater.co.uk or by email at: SouthernWaterPlanning@southernwater.co.uk

Yours faithfully,

Future Growth Planning Team
Developer Services

Southernwater.co.uk/developing-building/planning-your-development

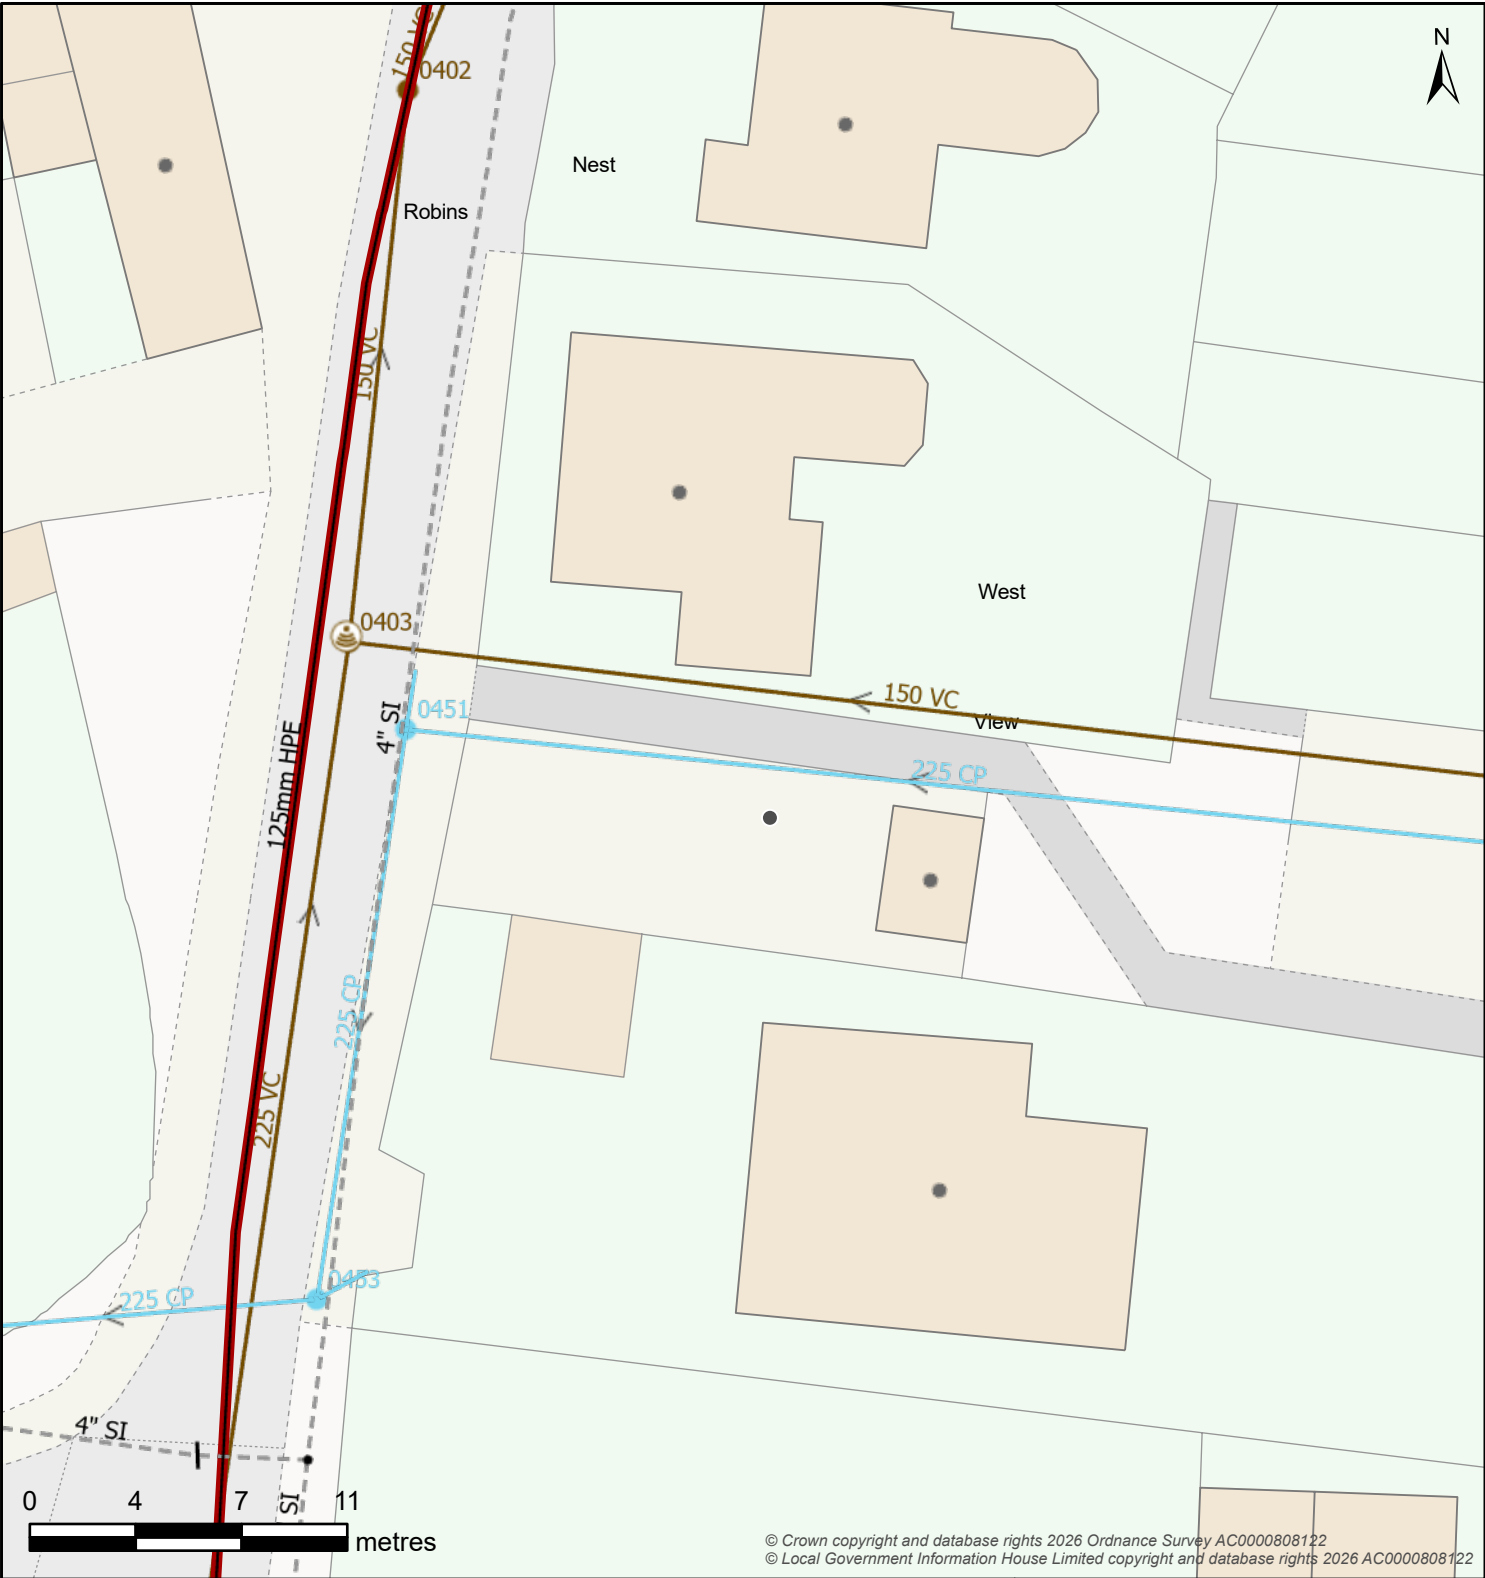

Map Title: SW Print

Printed By: Isaac.Vowles
Date Printed: 05/08/2026
Map Scale: 250

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.



Controllable Valve			Flow Control			Inlet-Outfall	
Damboards	Penstock	Valve	Anti Flood Device	Pumped Anti Flood Device	Reflux Valve	Inlet	Outfall
Manhole							
BIF Bifurcation	Cascade	CP Catchpit	Head Of Public Sewer	IC Interceptor Chamber	Manhole	S Soakaway	WO Washout
Outfall Headworks		Overflow Chamber		Pipe Bridge		Pumping Station	
Outfall Headworks	CSO Combined Sewer Overflow	EMO Emergency Overflow	Pipe Bridge	Micro Pumping Station	Pumping Station		
Sewer Level Monitor		Storage		Treatment Works		Weir	
Sewer Level Monitor	Storm Tank	Tidal Storage Tank	Treatment Works	Weir	Wastewater Site		
Wastewater Pipe				Wastewater Use		Developer Services	
Culverted Water Course	Syphon	Tank Sewer	Trunk Sewer	Foul	Combined	Build Over Agreement	Section 104
Drain	Vacuum Main	Decommissioned Pipe		Sludge	Treated Effluent	Wastewater Area	
Outfall				Surface Water	Private	Catchment	Sub-Catchment
Overflow							
Rising Main							
Sewer							