

NOTES

Structural engineer to review all services & confirm all weight loadings and support details.

The drawing shall be read together with other services drawings, equipment schedule and specifications.

All dimensions are in millimeters.

KEY

— - STRIPOUT

ALL EXISTING AC AND ALL ASSOCIATED REFRIGERANT PIPEWORK AND TRAYS TO BE STRIPPED OUT. CONDENSATE PIPEWORK TO BE MADE GOOD AND REUSED. ROUTES TO BE CONFIRMED UPON REMOVAL OF CEILINGS

BOILER AND ALL ASSOCIATED HEATING PIPEWORK TO BE STRIPPED OUT. PIPEWORK TO BE STRIPPED OUT AND CAPPED ON MAIN INCOME WITH ALL OUTLET PIPEWORK TO BE REMOVED INCLUDING AHU AND RADIATOR CONNECTIONS


SUPPLY & EXTRACT DUCTWORK FROM ABOVE

EXISTING BOILER FLUE TO ABOVE TO REMAIN AND BE CAPPED TO MAINTAIN EXTERNAL STRUCTURAL INTEGRITY

SUPPLY & EXTRACT DUCTWORK TO BELOW

RADIATOR AND ALL ASSOCIATED PIPEWORK TO BE STRIPPED OUT

EXISTING TRAY TO BE STRIPPED OUT UNLESS DEEMED ON SITE TO BE REUSED FOR PROPOSED

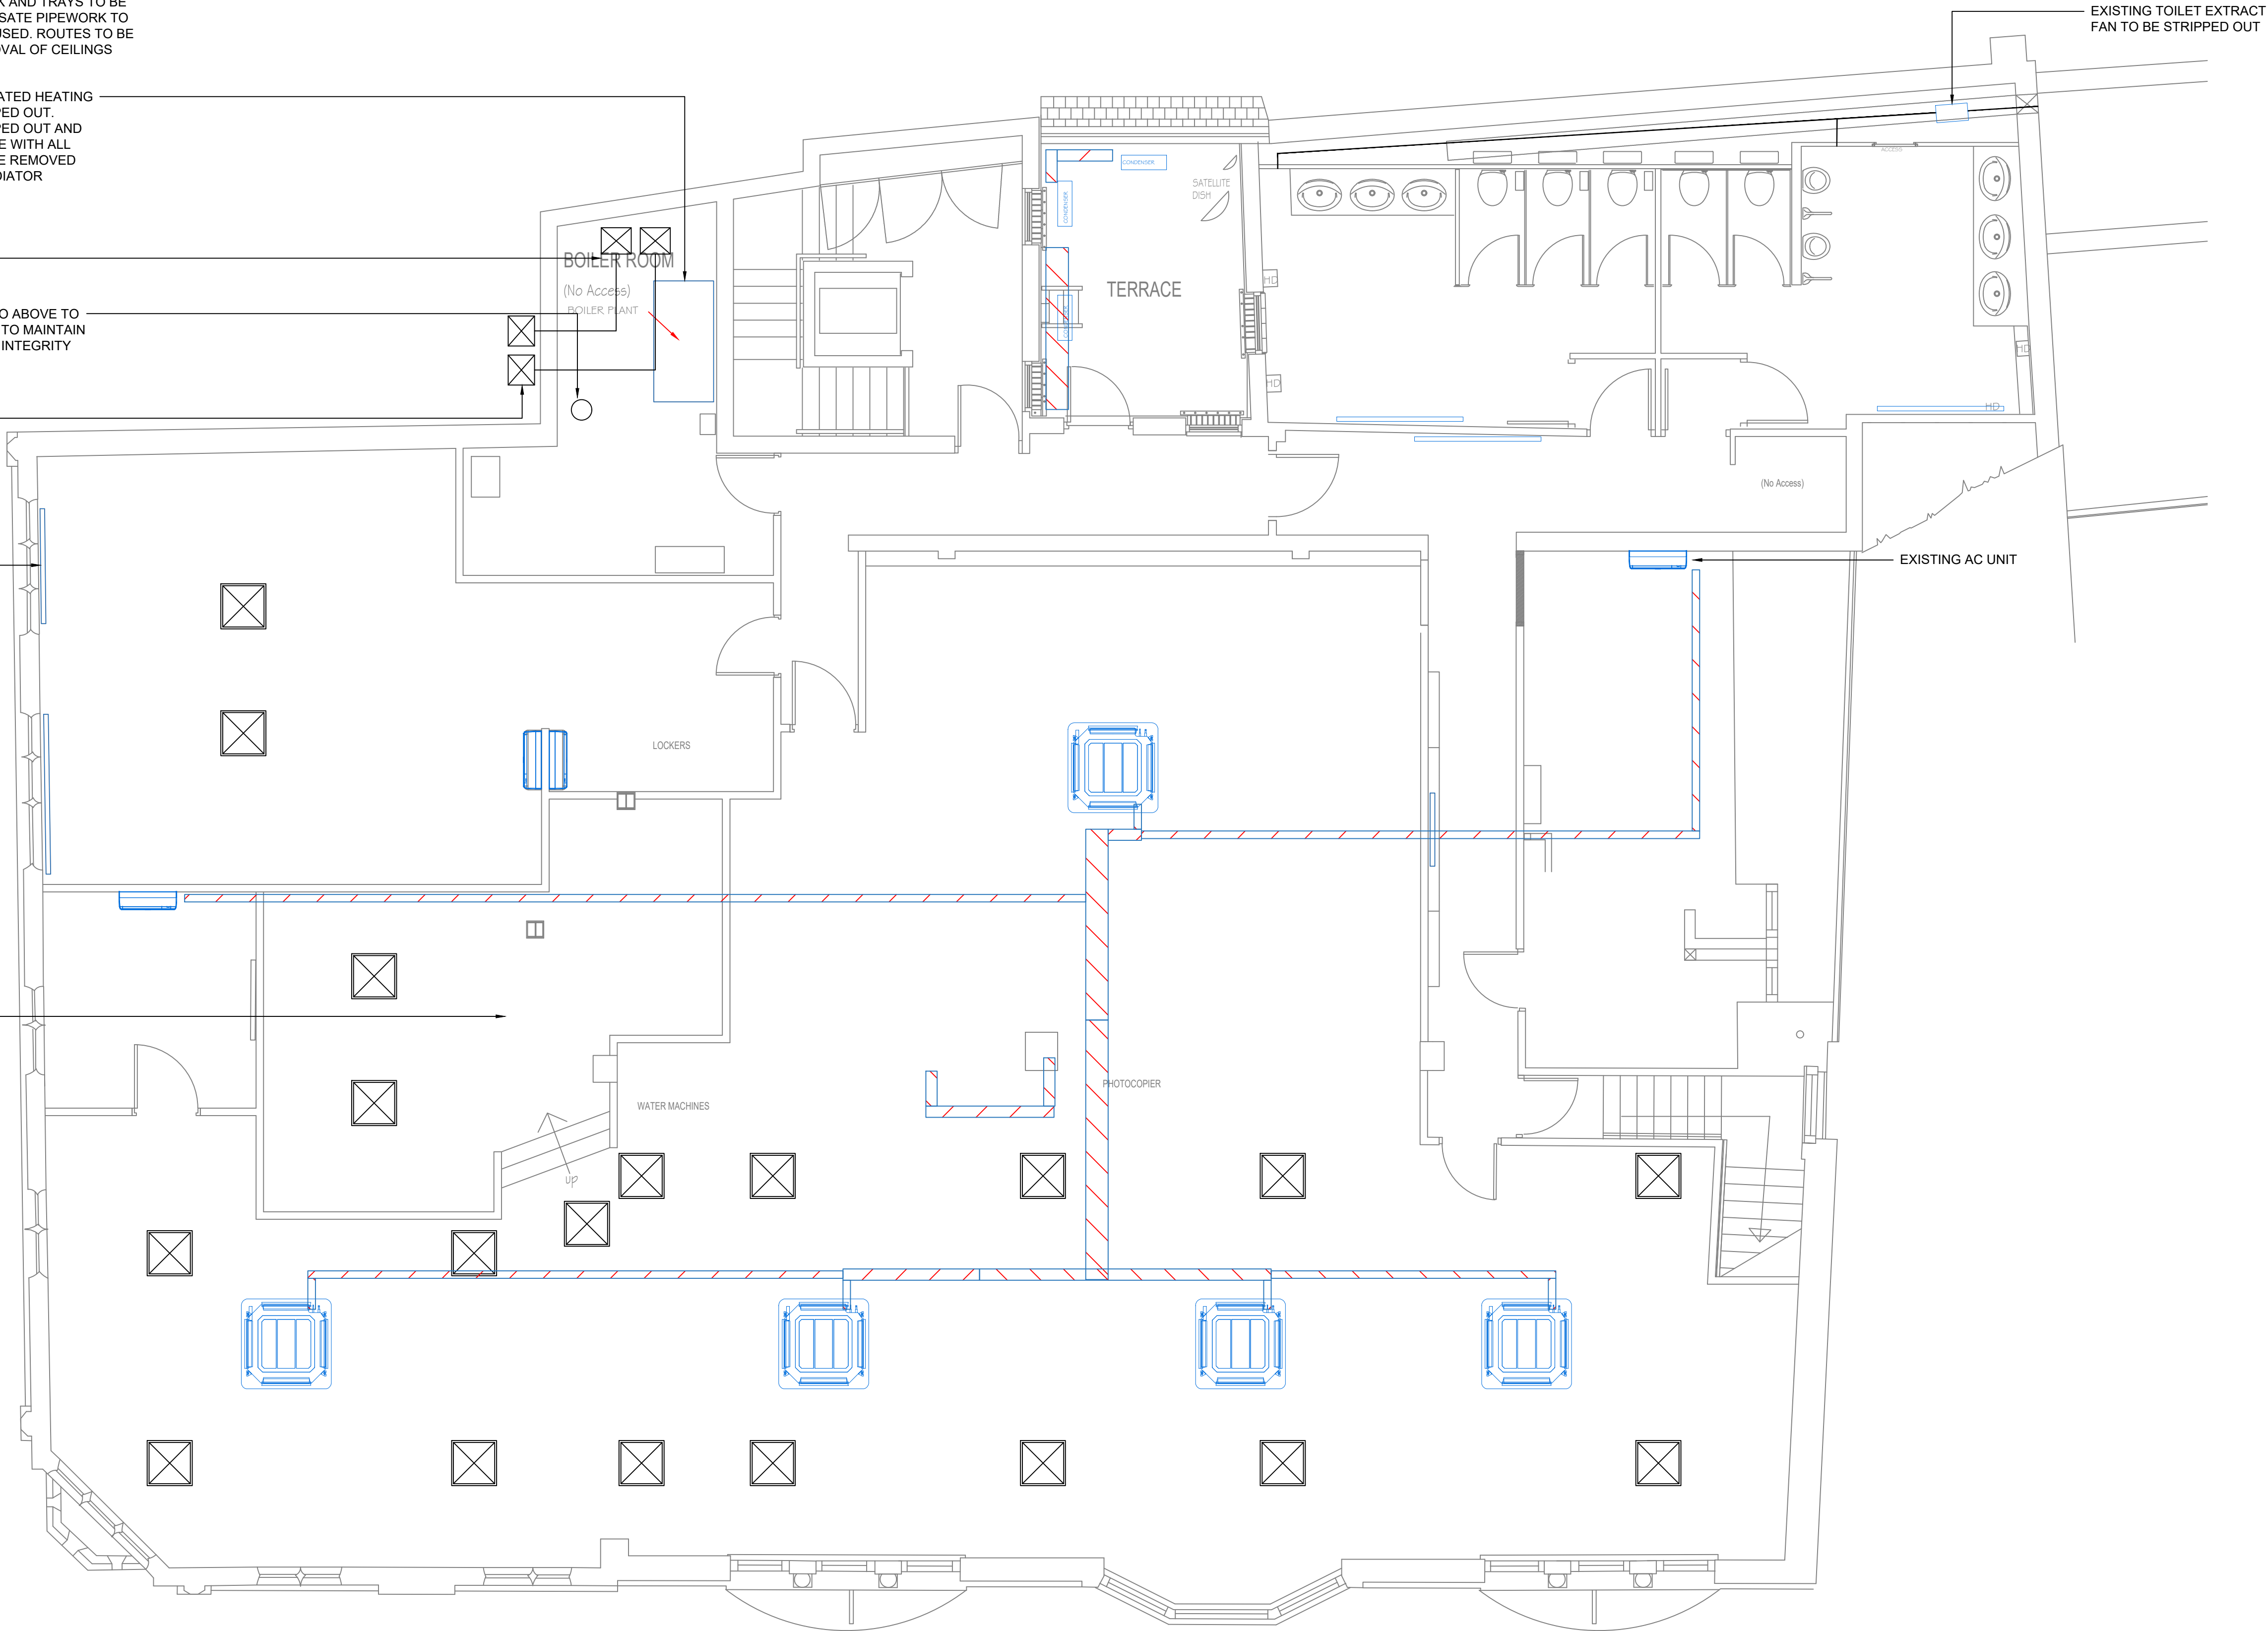

P3	12/02/26	PROPOSED	RA
P2	05/02/26	PROPOSED	RA
P1	30/01/26	PROPOSED	RA
REV	DATE	REVISION	APP
STATUS			
PROPOSED			
 2 KINGS HILL AVENUE, KINGS HILL WEST MALLING, KENT, ME19 4AQ Tel: 07132 879 555 Web: www.centrumplus.co.uk			
LLOYDS BANKING GROUP ALL DIMENSIONS TO BE VERIFIED PRIOR TO COMMENCING WORK. DRAWING TO BE READ IN CONJUNCTION WITH PROJECT SPECIFICATIONS. THIS DRAWING IS THE PROPERTY OF LLOYDS BANKING GROUP AND COPYRIGHT IS RESERVED BY THEM. THE DRAWING IS ISSUED ON CONDITION THAT IT IS NOT COPIED OR DISCLOSED BY OR TO ANY UNAUTHORISED PERSONS WITHOUT PRIOR CONSENT IN WRITING TO LLOYDS BANKING GROUP - GROUP PROPERTY. ALL MODIFIED DRAWINGS SHOULD BE RETURNED TO LLOYDS BANKING GROUP.			
GROUP PROPERTY BRISTOL - PO Box 112, Carons House, Carons Way, BRISTOL, BS99 7LB EDINBURGH - Signhill South, 12 Bankhead Crossway South, EDINBURGH, EH11 4EN HALIFAX - Trinity Road, HALIFAX, West Yorkshire, HX1 2RG			
PROJECT ADDRESS		SCALE	
LBG HORSHAM		1:50 @ A1	
DRAWING DESCRIPTION		DATE	
SECOND FLOOR MECHANICAL STRIP OUT DRAWING		12.02.26	
DRAWING NUMBER		DRAWN BY	
CPL521-XX-02-DR-M-6003		RA	
		REVISION	
		P3	