

BELLWAY HOMES LTD (SOUTH LONDON)

CHURCH LANE, ASHINGTON

NOISE ASSESSMENT

**REPORT REF.
2108611-03**

February 2023

HEAD OFFICE: 3rd Floor, The Hallmark Building, 52-56 Leadenhall Street, London, EC3M 5JE **T** | 020 7680 4088

EDINBURGH: Suite 35 4-5 Lochside Way Edinburgh EH12 9DT **T** | 0131 516 8111

ESSEX: 1 - 2 Crescent Court, Billericay, Essex, CM12 9AQ **T** | 01277 657 677

KENT: Suite 10, Building 40, Churchill Business Centre, Kings Hill, Kent, ME19 4YU **T** | 01732 752 155

MIDLANDS: Office 3, The Garage Studios, 41-43 St Mary's Gate, Nottingham, NG1 1PU **T** | 0115 697 0940

SOUTH WEST: City Point, Temple Gate, Bristol, BS1 6PL **T** | 0117 456 4994

SUFFOLK: Suffolk Enterprise Centre, 44 Felaw Street, Ipswich, IP2 8SJ **T** | 01473 407 321

Contents

	Page
1. INTRODUCTION	1
2. LOCAL AUTHORITY POLICY	3
3. ENVIRONMENTAL NOISE LEVELS.....	4
4. CONSTRUCTION PHASE	7
5. MULTI USE GAMES AREA & SPORTS PITCH NOISE.....	8
6. ROAD TRAFFIC NOISE	9
7. MITIGATION RECOMMENDATIONS	10
8. CONCLUSIONS	13

Appendices

Appendix A: Time Histories of Measured Data

Appendix B: Details of Calculations

Appendix C: Traffic Flow Data

Appendix D: Traffic Flow Change in Noise Level Calculations


Appendix E: Acoustic Design Statement

Appendix F: Relevant Policy and Guidance

Appendix G: Acoustic Terminology

Document Control Sheet

REV	ISSUE PURPOSE	AUTHOR	CHECKED	APPROVED	DATE
-	DRAFT	LD	CM	DRAFT ONLY	21/12/22
-	FINAL	LD	LD	CM	22/02/23



Distribution

This report has been prepared for the exclusive use of Bellway Homes Limited (South London). It should not be reproduced in whole or in part, or relied upon by third parties, without the express written authority of Ardent Consulting Engineers.

1. INTRODUCTION

- 1.1. Ardent Consulting Engineers were instructed by Bellway Homes Limited (South London) to undertake a Noise Assessment to support the residential development at Church Lane, Ashington (hereafter referred to as the site).

Site Location

- 1.2. The site is located in a predominantly residential area, to the eastern boundary of the site is Ashington Church of England Primary School and Church Lane, further to the east is London Road and the A24. Arable land is to the south, to the west is arable land and beyond that is Park Lane and to the north is Rectory Lane. The surrounding area and approximate site boundary (shown in red) are shown in Figure 1-1.



Figure 1-1: Site Boundary and Surrounding Area

Site Proposals

- 1.3. The proposal is for a single development of 180 units with access provided towards the south-east of the site. West of the development, the public open space will include allotments, a multi-use games area (MUGA), a sports pavilion and associated infrastructure.
- 1.4. An extract of the proposals is shown in Figure 1.2.



Figure 1-2: Site Proposals (Extract)

2. LOCAL AUTHORITY POLICY

- 2.1. West Sussex Council implement the County wide Planning Noise Advice Document: Sussex¹ which set out the approach to be adopted within noise assessments. The document adopts the NPSE aims and seeks to offer consistent advice.
- 2.2. Section 7 sets out the approach and design criteria for noise sensitive development and Section 5 sets out how outdoor sports and recreation facilities as part of the development should be considered, which is relevant to these proposals.
- 2.3. A summary of relevant sections are shown in Appendix F.

¹ Planning Noise Advice Document: Sussex, September 2021

3. ENVIRONMENTAL NOISE LEVELS

- 3.1. An environmental noise survey was undertaken at two positions across the site between 18th and 23rd November 2022 as shown in Figure 3-1.
- 3.2. Noise measurement positions were selected to obtain representative baseline noise levels due to the main observed noise sources around the site.



Figure 3-1: Measurement Positions

- 3.3. A description of the measurements positions is as follows:

- **Measurement Position 1** - The microphone was mounted at a height of approximately 1.5m above ground level.
- **Measurement Position 2** - The microphone was mounted at a height of approximately 1.5m above ground level. The microphone was set back from London Road and the A24 and is considered representative of the most westerly proposed dwellings of the application site.

3.4. The equipment used was as follows:

- Norsonic Nor140 Sound Level Meter (serial number: 1405866)
- Norsonic Nor140 Sound Level Meter (serial number: 1405869)
- Bruel & Kjaer Type 4321 Calibrator (serial number: 2463721)

3.5. All equipment used has been professionally calibrated. Field calibration of the sound level meter (and complete measurement signal chain) was undertaken before and after measurement to ensure no drift of the calibration signal. Calibration certificates are available upon request.

3.6. Observations regarding the prevailing weather conditions were taken during the surveys, the following periods have been excluded from assessment due to adverse weather conditions:

- 20th November: 02:45-08:30;
- 21st November: 09:15-17:00;
- 23rd November: 06:30-09:30.

3.7. For the remainder of the survey there was no precipitation and low wind speeds and therefore conditions were considered suitable for environmental noise measurements.

3.8. The measured noise levels taken at the site are summarised in Table 3-1. Time histories of measured data are shown in Appendix A.

Monitoring Position	Ambient Noise Level dB $L_{Aeq, T}$ Range (Representative)		Night-time dB L_{AFmax} Range (Representative)
	Daytime	Night-time	
MP1	34-58 (47)	28-56 (46)	37-72 (64)
MP2	31-59 (46)	26-61 (46)	38-86 (60)

Table 3-1: Summary of Measured Noise Levels

3.9. The representative L_{Amax} level is the value which has been exceeded fewer than 10 times in the 8-hour night-time period, i.e. one which can be considered to be 'not normally exceeded' as per the WHO guidelines.

3.10. Representative octave band levels are provided in Table 3-2. Where appropriate, these are used in glazing calculations to ensure a robust assessment of internal noise levels.

		Octave Band Centre Frequency, dB							
		63	125	250	500	1k	2k	4k	8k
MP1	L_{Aeq,T} (day)	51	48	43	43	44	36	30	32
	L_{Aeq,T} (night)	46	40	39	41	44	33	23	22
	L_{Amax,T} (night)	59	57	55	58	63	53	47	41
MP2	L_{Aeq,T} (day)	50	48	43	41	42	36	35	32
	L_{Aeq,T} (night)	46	42	39	41	44	34	34	34
	L_{Amax,T} (night)	66	59	56	56	58	49	38	37

Table 3-2: Octave Band Data for Noise Monitoring Locations

3.11. Based on the results of the noise survey, the site would be considered to be low risk when compared with Figure 1 included in Section of ProPG, as shown in Appendix F.

3.12. This would not prohibit the development as good acoustic design processes will be followed to reduce sound levels to as low as practical across the site. An acoustic design statement is presented in Appendix E.

4. CONSTRUCTION PHASE

- 4.1. Given the proximity of proposed construction activities to neighbouring noise sensitive properties such as residential areas, it is possible that site clearance, preparation and construction noise may impact nearby receptors.
- 4.2. A detailed construction programme; specific plant data and operations are not available at this stage of the project. Therefore, it is not possible to undertake a detailed assessment of likely impact at this time.
- 4.3. Reasonable construction noise limits can be derived using the Example Method 1 (the ABC Method) of BS 5228, within section E.3.2. Table E.1 from the standard is reproduced below in Table 4-1:

Table E.1 Example threshold of significant effect at dwellings			
Assessment category and threshold value period (L_{Aeq})	Threshold value, in decibels (dB)		
	Category A ^{A)}	Category B ^{B)}	Category C ^{C)}
Night-time (23.00–07.00)	45	50	55
Evenings and weekends ^{D)}	55	60	65
Daytime (07.00–19.00) and Saturdays (07.00–13.00)	65	70	75
NOTE 1 A significant effect has been deemed to occur if the total L_{Aeq} noise level, including construction, exceeds the threshold level for the Category appropriate to the ambient noise level. NOTE 2 If the ambient noise level exceeds the threshold values given in the table (i.e. the ambient noise level is higher than the above values), then a significant effect is deemed to occur if the total L_{Aeq} noise level for the period increases by more than 3 dB due to construction activity. NOTE 3 Applied to residential receptors only.			
^{A)} Category A: threshold values to use when ambient noise levels (when rounded to the nearest 5 dB) are less than these values. ^{B)} Category B: threshold values to use when ambient noise levels (when rounded to the nearest 5 dB) are the same as category A values. ^{C)} Category C: threshold values to use when ambient noise levels (when rounded to the nearest 5 dB) are higher than category A values. ^{D)} 19.00–23.00 weekdays, 13.00–23.00 Saturdays and 07.00–23.00 Sundays.			

Table 4-1: Table E.1 from BS 5228: Part 1

- 4.4. Existing ambient noise levels at the site will place the site and surroundings within Category A of Table E.1.
- 4.5. Therefore, the following ambient noise levels (as a result of construction activities) should be considered as reasonable limits to adhere to during construction works.

Time Period	Construction Noise Limits L_{Aeq} (dB)
Weekdays 07:00 – 19:00 & Saturday 07:00 – 13:00	65

Table 4-2: Construction Noise Limits

5. MULTI USE GAMES AREA & SPORTS PITCH NOISE

- 5.1. The proposals include a multi use games area (MUGA) which is situated towards the western and a sports pitch to the southern boundary of the site. It is expected that the MUGA and the sports pitch will generate noise when in use, the layout of the site means these sources are separated from both existing and proposed sensitive residential receptors by as much as possible.
- 5.2. It is considered that the MUGA and sports pitch would be beneficial to proposed development and the surrounding area and would be used primarily by the local population.
- 5.3. As noted in the Sussex noise guide there is no guidance for the assessment of noise from these facilities.
- 5.4. Traffic associated with the operation is factored into the assessment in the following section. Operational noise can be subject to careful management controls and if necessary planning conditions. In so doing it is considered that the MUGA and sports pitch would not lead to an adverse impact on the proposed development or existing sensitive receptors.

6. ROAD TRAFFIC NOISE

- 6.1. This section considers traffic noise impact of the operational stage of the site against the current baseline traffic flows.
- 6.2. Traffic flow volumes provided by Motion Transport Consultants are presented in Appendix C. These have been used to calculate the change in noise levels arising from road traffic during the operational stage of the site. The data is presented as AADT 24 hour flows.
- 6.3. The future baseline traffic flow has been compared to the increase due to operational site traffic and traffic from committed development in the area. Calculations of the change in noise levels are shown in Appendix D.
- 6.4. Table 6-1 shows the traffic flows and predicted changes in noise levels for the change in traffic flow between the future baseline and the operational site traffic site and cumulative development traffic.

Road	Existing Baseline	Future including growth and development Development	Change in Noise Level, dB
Church Close (North of Church Lane)	688	34	0.2
Church Close (South)	128	0	0.0
Church Lane	934	1101	3.4
London Road (North)	4098	636	0.6
London Road (South)	4244	465	0.5

Table 6-1: Change in Noise Levels Due to Operational Traffic to Future Baseline

- 6.5. The change in noise levels is minor on Church Lane and negligible elsewhere when compared to Table 3.54b of DMRB, LA 111.

7. MITIGATION RECOMMENDATIONS

- 7.1. The measurement data and site layout were used to undertake calculations for suitable façade treatments, outlined as follows. Calculations are presented in Appendix B.
- 7.2. The aim of this section is to identify mitigation measures capable of providing suitable levels of attenuation to achieve the required internal sound levels.
- 7.3. To achieve suitable internal amenity sound levels, windows should be closed, but not sealed, and an alternative means of ventilation (e.g. trickle ventilation) provided during normal conditions. noise levels across the site are not high and with open windows internal sound levels will be slightly elevated above the guidance criteria. Properties would be designed to allow windows to remain closed whilst providing background ventilation under normal conditions by other means, for example trickle ventilation.

External Building Fabric - Non-Glazed Elements

- 7.4. It is assumed that the non-glazed external building fabric elements comprise masonry cavity walls. This would typically provide a sound reduction performance of at least the figures shown in Table 7-1 when tested in accordance with BS EN ISO 10140-2:2010 (figures derived from: Representative Values of Airborne SRI for Some Common Structures: Appendix B of Flakt Woods 'Guide to Noise Control').

Element	Octave band centre frequency SRI, dB					
	125	250	500	1k	2k	4k
Masonry Cavity Wall	34	43	55	66	77	85

Table 7.1: Non-glazed Elements Assumed Sound Reduction Performance

External Building Fabric - Glazing

7.5. Table 7-2 sets out the required glazing performance types, these specifications take into account the glass, frame, seals and associated fittings.

Glazing Type	Sound Reduction Index, R_w	Octave band centre frequency SRI, dB					
		125	250	500	1k	2k	4k
Type 1	29	21	17	25	35	37	31

Table 7-2: Required Minimum Attenuation Values for Glazing

External Building Fabric - Ventilation

7.6. Table 7-3 sets out the required ventilation performance types:

Ventilation Type	Element Normalised level difference, D_{new}	Octave band centre frequency SRI, dB					
		125	250	500	1k	2k	4k
Type 1	35	36	34	31	34	38	38

Table 7-3: Required Minimum Attenuation Values for Ventilation

7.7. Where non-sensitive rooms and sensitive rooms form part of an open plan area, for example a dining and kitchen area, the glazing and ventilation specification for the more sensitive room should be used across the combined area.

7.8. All major building elements should be tested in accordance with BS EN ISO 10140-2:2010. Sole glass performance data would not necessarily demonstrate compliance with this specification.

7.9. It should be noted that there may be additional considerations for glazing requirements such as overheating, security, thermal performance, and air quality. Alternative glazing could be used assuming the minimum acoustic performance is met.

Overheating

7.10. Consideration has been given to the potential for adverse noise impact during potential overheating conditions; where residents may open windows to control temperature. Based on the measured sound levels the site would be considered

negligible risk of noise impact during overheating conditions during the day and night, when assessed in accordance with AVO guidance, as shown in Appendix F. Open window ventilation will be appropriate to mitigate infrequent overheating.

External Amenity Areas

7.11. Gardens are proposed to all dwellings on site. Based on the results of the noise survey, all gardens will have noise levels which meet the guidance criteria.

Construction Phase

7.12. Construction activities should only take place between the hours of 07:00 and 19:00 on weekdays and between 07:00 and 13:00 on Saturdays. No construction activity should be carried out during the night, on Sundays or on bank holidays without additional consideration to controlling noise and with the prior approval of the LPA.

7.13. During construction, the contractor will employ best practicable means to control noise from construction operations.

7.14. Temporary screening in the form of solid timber hoarding can be used where operations are adjacent to sensitive receptors. Consideration will be given to neighbouring residential properties when locating the temporary site compounds and material stockpiles.

7.15. Stationary equipment and plant such as generators will be placed as far as practicable from noise sensitive properties, and preferably in areas benefiting from existing or purpose-built attenuation such as bunding or behind non-sensitive buildings.

7.16. Delivery of materials and removal of waste from the site will be planned to minimise disturbance to neighbouring properties. Idling of plant, machinery and delivery vehicles should be prohibited when not in use.


7.17. If required noise levels can be monitored regularly in accordance with BS5228 to ensure the above set limits are not exceeded. In addition to the above all other guidance within BS5228-1 will be followed at all times.

8. CONCLUSIONS


- 8.1. A noise survey has been undertaken and the measured noise levels and site layout have been used to assess suitable glazing and ventilation specifications.
- 8.2. The site would be considered to be low risk in accordance with guidance in ProPG. Expert acoustics advice has been sought and good acoustic design processes have been followed to reduce sound levels across the site whilst considering wider design constraints. An acoustic design statement has been produced, which accompanies this report.
- 8.3. To achieve suitable internal amenity sound levels, windows should be able to remain closed, but not sealed, and an alternative means (e.g. trickle ventilation) of ventilation provided during normal conditions. Residents will have the option to open windows, whilst noting sound levels will be slightly elevated.
- 8.4. The risk of noise impact during overheating conditions within properties has been considered in accordance with AVO Guidance. The site is considered to be considered negligible risk during the day and night and open window ventilation would be suitable during infrequent overheating conditions.
- 8.5. All gardens will meet the guidance criteria set out in the standards without any additional mitigation measures being required.
- 8.6. Control measures will be implemented to manage potential impacts from construction noise.
- 8.7. The impact of the change in noise levels due to operational site traffic is at worst minor on Church Lane and is negligible on other roads.
- 8.8. This assessment demonstrates that the site is suitable for residential development subject to the recommendations included in this report.

APPENDIX A

Position 1
Environmental Noise Time History
18 November 2022 to 23 November 2022

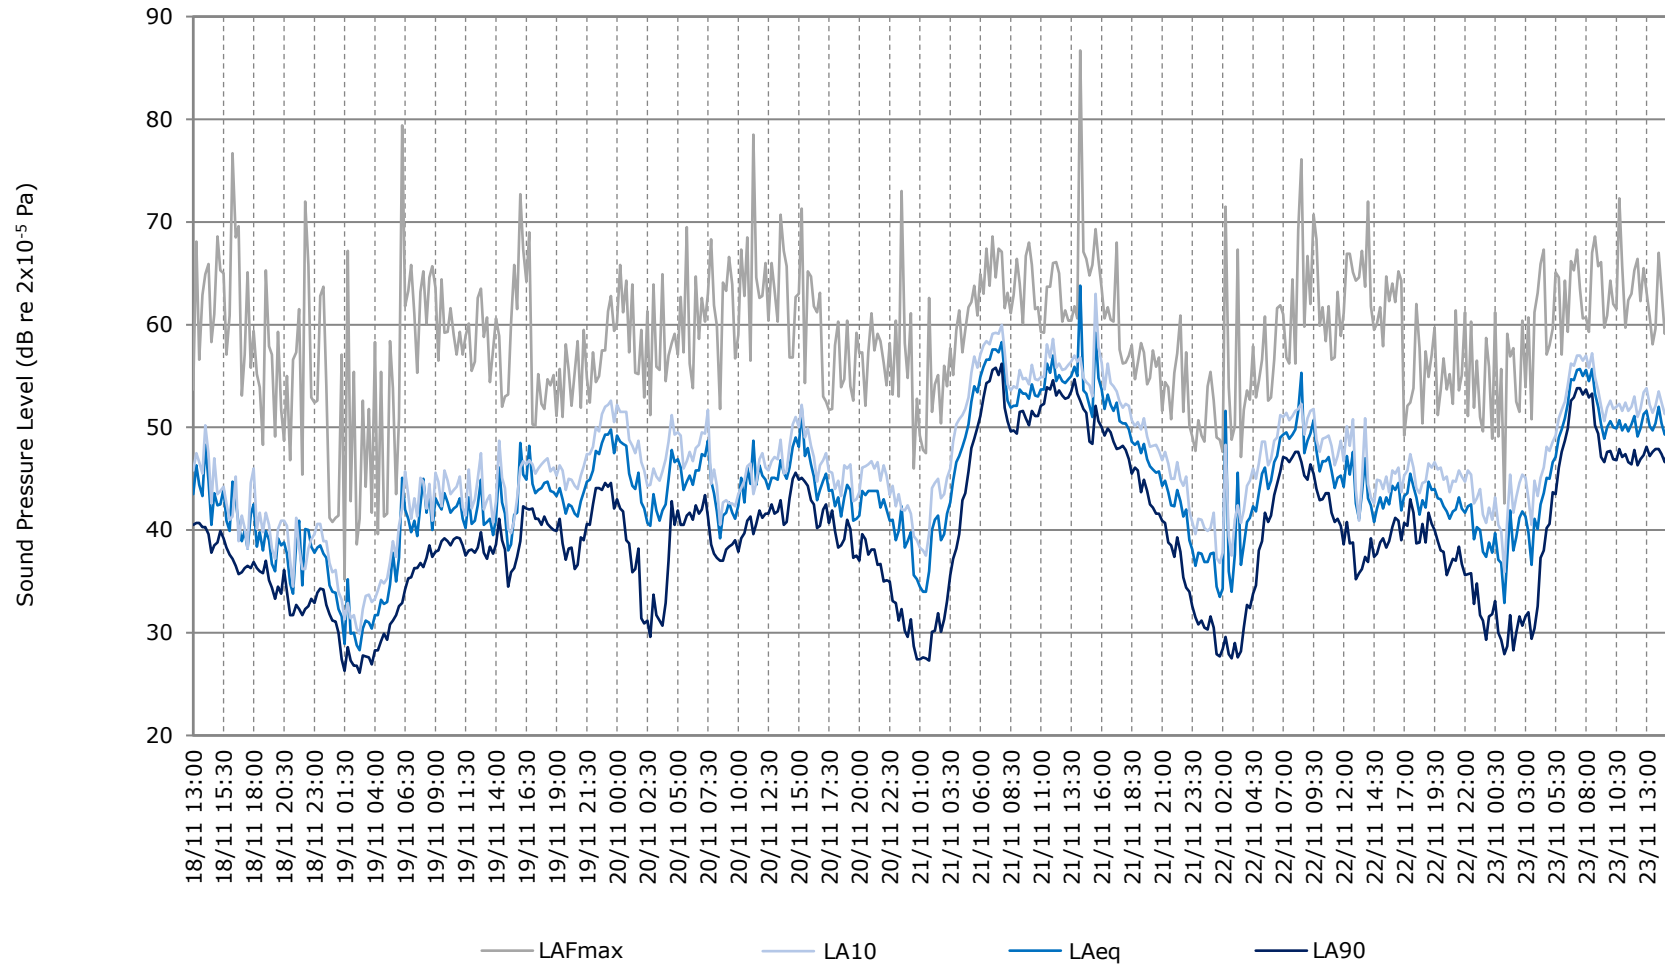

Position 2
Environmental Noise Time History
18 November 2022 to 23 November 2022

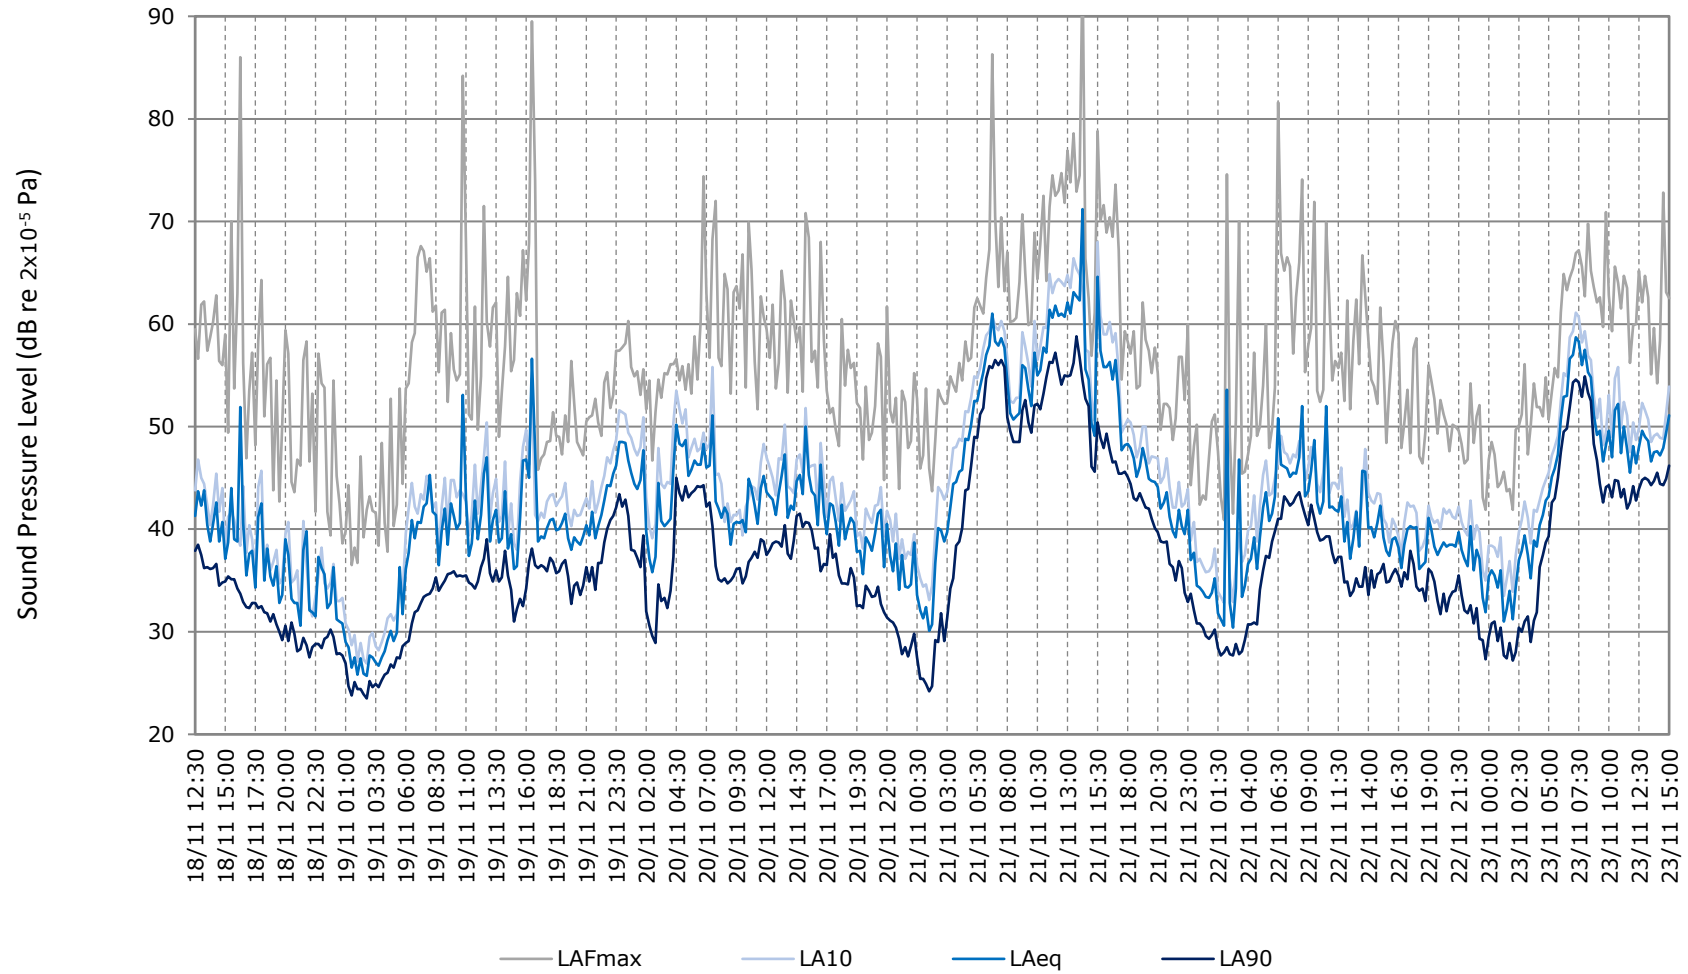

APPENDIX B

ARDENT CONSULTING ENGINEERS
Noise Break-in Calculation - Position 1

Description	
Ardent CE Project No.	2108611
Property Address	Church Lane, Ashington
Room Type	Bedroom
Parameter	L _{Aeq} , 16h

Room Dimensions and Areas	
Room volume	35.00
Total Surface area	65.50
Wall façade area	10.00
Roof façade area	0.00
Glazing area	3.60
Dne Ref Area, A0	10.00
Total façade area	13.60

- Based on typical size

Room Absorption Calculation	63	125	250	500	1000	2000	4000	8000	
Estimated Reverberation time	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	
Alpha bar	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	
Total Absorption	11.27	11.27	11.27	11.27	11.27	11.27	11.27	11.27	
10Log S/A	0.82	0.82	0.82	0.82	0.82	0.82	0.82	0.82	

- Typical Bedroom RT

Façade level	63	125	250	500	1000	2000	4000	8000	A
Measured Noise Level	51	48	43	43	44	36	30	32	47
Façade to free field	0	0	0	0	0	0	0	0	
Angle of view	0	0	0	0	0	0	0	0	
Screening (Maekewa)	0	0	0	0	0	0	0	0	
Distance correction	0	0	0	0	0	0	0	0	
Other	0	0	0	0	0	0	0	0	
Noise level at façade (Leq)	51	48	43	43	44	36	30	32	47

Composite SRI	63	125	250	500	1000	2000	4000	8000	Rw
Glazing SRI	18	21	17	25	35	37	31	40	29
Transmission Coefficient	0.015849	0.007943	0.019953	0.003162	0.000316	0.000200	0.000794	0.000100	
Wall SRI	28	34	43	55	66	77	85	85	55
Transmission Coefficient	0.001585	0.000398	0.000050	0.000003	0.000000	0.000000	0.000000	0.000000	
Roof SRI	23	26	43	52	60	65	65	65	51
Transmission Coefficient	0.005012	0.002512	0.000050	0.000006	0.000001	0.000000	0.000000	0.000000	
Ventilation, Dne	36	36	34	31	34	38	38	38	35
Transmission Coefficient	0.000251	0.000251	0.000398	0.000794	0.000398	0.000158	0.000158	0.000158	
Average Transmission Coeff	0.005545	0.002580	0.005611	0.001423	0.000377	0.000169	0.000327	0.000143	
Average SRI	23	26	23	28	34	38	35	38	33

Calculated Internal Noise Level, dB	63	125	250	500	1000	2000	4000	8000	A
Lp (Reverberant), line source	30.1	24.1	22.4	16.0	12.0	0.1	-3.0	-4.9	19
Lp (Direct)	28.2	22.3	20.6	14.2	10.2	-1.7	-4.9	-6.7	17
Lp (Rev & Direct)	32	26	25	18	14	2	-1	-3	21
BS8233	32	26	24	18	14	2	-1	-3	21

Criteria

≤ 35

≤ 35

ARDENT CONSULTING ENGINEERS
Noise Break-in Calculation - Position 1

Description	
Ardent CE Project No.	2108611
Property Address	Church Lane, Ashington
Room Type	Bedroom
Parameter	LAeq, 8h

Room Dimensions and Areas	
Room volume	35.00
Total Surface area	65.50
Wall façade area	10.00
Roof façade area	0.00
Glazing area	3.60
Dne Ref Area, A0	10.00
Total façade area	13.60

- Based on typical size

Room Absorption Calculation	63	125	250	500	1000	2000	4000	8000	
Estimated Reverberation time	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	
Alpha bar	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	
Total Absorption	11.27	11.27	11.27	11.27	11.27	11.27	11.27	11.27	
10Log S/A	0.82	0.82	0.82	0.82	0.82	0.82	0.82	0.82	

- Typical Bedroom RT

Façade level	63	125	250	500	1000	2000	4000	8000	A
Measured Noise Level	46	40	39	41	44	33	23	22	46
Façade to free field	0	0	0	0	0	0	0	0	
Angle of view	0	0	0	0	0	0	0	0	
Screening (Maekewa)	0	0	0	0	0	0	0	0	
Distance correction	0	0	0	0	0	0	0	0	
Other	0	0	0	0	0	0	0	0	
Noise level at façade (Leq)	46	40	39	41	44	33	23	22	46

Composite SRI	63	125	250	500	1000	2000	4000	8000	Rw
Glazing SRI	18	21	17	25	35	37	31	40	29
Transmission Coefficient	0.015849	0.007943	0.019953	0.003162	0.000316	0.000200	0.000794	0.000100	
Wall SRI	28	34	43	55	66	77	85	85	55
Transmission Coefficient	0.001585	0.000398	0.000050	0.000003	0.000000	0.000000	0.000000	0.000000	
Roof SRI	23	26	43	52	60	65	65	65	51
Transmission Coefficient	0.005012	0.002512	0.000050	0.000006	0.000001	0.000000	0.000000	0.000000	
Ventilation, Dne	36	36	34	31	34	38	38	38	35
Transmission Coefficient	0.000251	0.000251	0.000398	0.000794	0.000398	0.000158	0.000158	0.000158	
Average Transmission Coeff	0.005545	0.002580	0.005611	0.001423	0.000377	0.000169	0.000327	0.000143	
Average SRI	23	26	23	28	34	38	35	38	33

Calculated Internal Noise Level, dB	63	125	250	500	1000	2000	4000	8000	A
Lp (Reverberant), line source	25.0	16.1	17.8	14.5	11.5	-2.7	-10.2	-15.1	16
Lp (Direct)	23.1	14.3	16.0	12.7	9.7	-4.5	-12.1	-16.9	14
Lp (Rev & Direct)	27	18	20	17	14	-1	-8	-13	18
BS8233	27	18	20	17	13	-1	-8	-13	18

Criteria
≤ 30
≤ 30

ARDENT CONSULTING ENGINEERS
Noise Break-in Calculation - Position 1

Description	
Ardent CE Project No.	2108611
Property Address	Church Lane, Ashington
Room Type	Bedroom
Parameter	L _{Amax}

Room Dimensions and Areas	
Room volume	35.00
Total Surface area	65.50
Wall façade area	10.00
Roof façade area	0.00
Glazing area	3.60
Dne Ref Area, A0	10.00
Total façade area	13.60

- Based on typical size

Room Absorption Calcuation	63	125	250	500	1000	2000	4000	8000	
Estimated Reverberation time	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	
Alpha bar	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	
Total Absorption	11.27	11.27	11.27	11.27	11.27	11.27	11.27	11.27	
10Log S/A	0.82	0.82	0.82	0.82	0.82	0.82	0.82	0.82	

- Typical Bedroom RT

Façade level	63	125	250	500	1000	2000	4000	8000	A
Measured Noise Level	59	57	55	58	63	53	47	41	64
Façade to free field	0	0	0	0	0	0	0	0	
Angle of view	0	0	0	0	0	0	0	0	
Screening (Maekewa)	0	0	0	0	0	0	0	0	
Distance correction	0	0	0	0	0	0	0	0	
Other	0	0	0	0	0	0	0	0	
Noise level at façade (Leq)	59	57	55	58	63	53	47	41	64

Composite SRI	63	125	250	500	1000	2000	4000	8000	Rw
Glazing SRI	18	21	17	25	35	37	31	40	29
Transmission Coefficient	0.015849	0.007943	0.019953	0.003162	0.000316	0.000200	0.000794	0.000100	
Wall SRI	28	34	43	55	66	77	85	85	55
Transmission Coefficient	0.001585	0.000398	0.000050	0.000003	0.000000	0.000000	0.000000	0.000000	
Roof SRI	23	26	43	52	60	65	65	65	51
Transmission Coefficient	0.005012	0.002512	0.000050	0.000006	0.000001	0.000000	0.000000	0.000000	
Ventilation, Dne	36	36	34	31	34	38	38	38	35
Transmission Coefficient	0.000251	0.000251	0.000398	0.000794	0.000398	0.000158	0.000158	0.000158	
Average Transmission Coeff	0.005545	0.002580	0.005611	0.001423	0.000377	0.000169	0.000327	0.000143	
Average SRI	23	26	23	28	34	38	35	38	33

Calculated Internal Noise Level, dB	63	125	250	500	1000	2000	4000	8000	A
Lp (Reverberant), line source	37.8	32.8	34.1	31.5	30.4	17.6	13.8	4.5	34
Lp (Direct)	36.0	30.9	32.3	29.7	28.5	15.7	12.0	2.7	32
Lp (Rev & Direct)	40	35	36	34	33	20	16	7	36
BS8233	40	35	36	33	32	20	16	7	36

Criteria

≤ 45

≤ 45

ARDENT CONSULTING ENGINEERS
Noise Break-in Calculation - Position 2

Description	
Ardent CE Project No.	2108611
Property Address	Church Lane, Ashington
Room Type	Bedroom
Parameter	L _{Aeq} , 16h

Room Dimensions and Areas	
Room volume	35.00
Total Surface area	65.50
Wall façade area	10.00
Roof façade area	0.00
Glazing area	3.60
Dne Ref Area, A0	10.00
Total façade area	13.60

- Based on typical size

Room Absorption Calculation	63	125	250	500	1000	2000	4000	8000	
Estimated Reverberation time	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	
Alpha bar	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	
Total Absorption	11.27	11.27	11.27	11.27	11.27	11.27	11.27	11.27	
10Log S/A	0.82	0.82	0.82	0.82	0.82	0.82	0.82	0.82	

- Typical Bedroom RT

Façade level	63	125	250	500	1000	2000	4000	8000	A
Measured Noise Level	50	48	43	41	42	36	35	32	46
Façade to free field	0	0	0	0	0	0	0	0	
Angle of view	0	0	0	0	0	0	0	0	
Screening (Maekewa)	0	0	0	0	0	0	0	0	
Distance correction	0	0	0	0	0	0	0	0	
Other	0	0	0	0	0	0	0	0	
Noise level at façade (Leq)	50	48	43	41	42	36	35	32	46

Composite SRI	63	125	250	500	1000	2000	4000	8000	Rw
Glazing SRI	18	21	17	25	35	37	31	40	29
Transmission Coefficient	0.015849	0.007943	0.019953	0.003162	0.000316	0.000200	0.000794	0.000100	
Wall SRI	28	34	43	55	66	77	85	85	55
Transmission Coefficient	0.001585	0.000398	0.000050	0.000003	0.000000	0.000000	0.000000	0.000000	
Roof SRI	23	26	43	52	60	65	65	65	51
Transmission Coefficient	0.005012	0.002512	0.000050	0.000006	0.000001	0.000000	0.000000	0.000000	
Ventilation, Dne	36	36	34	31	34	38	38	38	35
Transmission Coefficient	0.000251	0.000251	0.000398	0.000794	0.000398	0.000158	0.000158	0.000158	
Average Transmission Coeff	0.005545	0.002580	0.005611	0.001423	0.000377	0.000169	0.000327	0.000143	
Average SRI	23	26	23	28	34	38	35	38	33

Calculated Internal Noise Level, dB	63	125	250	500	1000	2000	4000	8000	A
Lp (Reverberant), line source	29.4	23.4	22.3	14.0	9.9	-0.2	2.1	-4.3	18
Lp (Direct)	27.5	21.6	20.5	12.2	8.1	-2.0	0.2	-6.1	16
Lp (Rev & Direct)	32	26	25	16	12	2	4	-2	20
BS8233	31	25	24	16	12	2	4	-2	20

Criteria
≤ 35
≤ 35

ARDENT CONSULTING ENGINEERS
Noise Break-in Calculation - Position 2

Description	
Ardent CE Project No.	2108611
Property Address	Church Lane, Ashington
Room Type	Bedroom
Parameter	LAeq, 8h

Room Dimensions and Areas	
Room volume	35.00
Total Surface area	65.50
Wall façade area	10.00
Roof façade area	0.00
Glazing area	3.60
Dne Ref Area, A0	10.00
Total façade area	13.60

- Based on typical size

Room Absorption Calcuation	63	125	250	500	1000	2000	4000	8000	
Estimated Reverberation time	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	
Alpha bar	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	
Total Absorption	11.27	11.27	11.27	11.27	11.27	11.27	11.27	11.27	
10Log S/A	0.82	0.82	0.82	0.82	0.82	0.82	0.82	0.82	

- Typical Bedroom RT

Façade level	63	125	250	500	1000	2000	4000	8000	A
Measured Noise Level	46	42	39	41	44	34	34	34	46
Façade to free field	0	0	0	0	0	0	0	0	
Angle of view	0	0	0	0	0	0	0	0	
Screening (Maekewa)	0	0	0	0	0	0	0	0	
Distance correction	0	0	0	0	0	0	0	0	
Other	0	0	0	0	0	0	0	0	
Noise level at façade (Leq)	46	42	39	41	44	34	34	34	46

Composite SRI	63	125	250	500	1000	2000	4000	8000	Rw
Glazing SRI	18	21	17	25	35	37	31	40	29
Transmission Coefficient	0.015849	0.007943	0.019953	0.003162	0.000316	0.000200	0.000794	0.000100	
Wall SRI	28	34	43	55	66	77	85	85	55
Transmission Coefficient	0.001585	0.000398	0.000050	0.000003	0.000000	0.000000	0.000000	0.000000	
Roof SRI	23	26	43	52	60	65	65	65	51
Transmission Coefficient	0.005012	0.002512	0.000050	0.000006	0.000001	0.000000	0.000000	0.000000	
Ventilation, Dne	36	36	34	31	34	38	38	38	35
Transmission Coefficient	0.000251	0.000251	0.000398	0.000794	0.000398	0.000158	0.000158	0.000158	
Average Transmission Coeff	0.005545	0.002580	0.005611	0.001423	0.000377	0.000169	0.000327	0.000143	
Average SRI	23	26	23	28	34	38	35	38	33

Calculated Internal Noise Level, dB	63	125	250	500	1000	2000	4000	8000	A
Lp (Reverberant), line source	25.0	18.0	17.8	14.4	11.3	-2.1	1.4	-2.7	16
Lp (Direct)	23.1	16.2	16.0	12.6	9.5	-3.9	-0.5	-4.5	14
Lp (Rev & Direct)	27	20	20	17	14	0	4	-1	18
BS8233	27	20	20	16	13	0	3	-1	18

Criteria
≤ 30
≤ 30

ARDENT CONSULTING ENGINEERS
Noise Break-in Calculation - Position 2

Description	
Ardent CE Project No.	2108611
Property Address	Church Lane, Ashington
Room Type	Bedroom
Parameter	L _{Amax}

Room Dimensions and Areas	
Room volume	35.00
Total Surface area	65.50
Wall façade area	10.00
Roof façade area	0.00
Glazing area	3.60
Dne Ref Area, A0	10.00
Total façade area	13.60

- Based on typical size

Room Absorption Calcuation	63	125	250	500	1000	2000	4000	8000	
Estimated Reverberation time	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	
Alpha bar	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	
Total Absorption	11.27	11.27	11.27	11.27	11.27	11.27	11.27	11.27	
10Log S/A	0.82	0.82	0.82	0.82	0.82	0.82	0.82	0.82	

- Typical Bedroom RT

Façade level	63	125	250	500	1000	2000	4000	8000	A
Measured Noise Level	66	59	56	56	58	49	38	37	60
Façade to free field	0	0	0	0	0	0	0	0	
Angle of view	0	0	0	0	0	0	0	0	
Screening (Maekewa)	0	0	0	0	0	0	0	0	
Distance correction	0	0	0	0	0	0	0	0	
Other	0	0	0	0	0	0	0	0	
Noise level at façade (Leq)	66	59	56	56	58	49	38	37	60

Composite SRI	63	125	250	500	1000	2000	4000	8000	Rw
Glazing SRI	18	21	17	25	35	37	31	40	29
Transmission Coefficient	0.015849	0.007943	0.019953	0.003162	0.000316	0.000200	0.000794	0.000100	
Wall SRI	28	34	43	55	66	77	85	85	55
Transmission Coefficient	0.001585	0.000398	0.000050	0.000003	0.000000	0.000000	0.000000	0.000000	
Roof SRI	23	26	43	52	60	65	65	65	51
Transmission Coefficient	0.005012	0.002512	0.000050	0.000006	0.000001	0.000000	0.000000	0.000000	
Ventilation, Dne	36	36	34	31	34	38	38	38	35
Transmission Coefficient	0.000251	0.000251	0.000398	0.000794	0.000398	0.000158	0.000158	0.000158	
Average Transmission Coeff	0.005545	0.002580	0.005611	0.001423	0.000377	0.000169	0.000327	0.000143	
Average SRI	23	26	23	28	34	38	35	38	33

Calculated Internal Noise Level, dB	63	125	250	500	1000	2000	4000	8000	A
Lp (Reverberant), line source	44.9	35.1	35.7	29.1	25.6	12.6	5.2	0.1	32
Lp (Direct)	43.1	33.3	33.9	27.3	23.8	10.8	3.4	-1.7	30
Lp (Rev & Direct)	47	37	38	31	28	15	7	2	34
BS8233	47	37	38	31	28	15	7	2	34

Criteria

≤ 45

≤ 45

APPENDIX C

Existing Road Traffic AADT

Road	12hr	12hr to 24hr Factor	AADT two-way all vehicles	HDV%
Church Close (North of Church Lane)			688	6%
Church Close (South of Church Lane)			128	7%
Church Lane	789	1.18	934	6%
London Road (North)	3462		4098	3%
London Road (South)	3585		4244	3%


Proposed Road Traffic AADT

			Weekday Trip Rate			Daily Vehicle Movements			12hr to 24hr Factor	24hr	HDV 24hr
Land Use	Size		Arrivals	Departures	Total	Arrivals	Departures	Total			
Residential	180	units	2.266	2.307	4.573	408	415	823	1.25	1029	8
Football Pitches	2	pitches	25.75	27.358	53.108	52	55	106	1	106	0
										1135	8

Road	% Distribution	AADT All Vehicles	HDV%
Church Close (North of Church Lane)	0.0	34.0	0.0
Church Close (South of Church Lane)	0.0	0.0	0.0
Church Lane	1.0	1101.0	0.0
London Road (North)	0.6	636.0	0.0
London Road (South)	0.4	465.0	0.0
A24 North	0.4	477.0	0.0
Billingshurst Road	0.1	159.0	0.0
A24 South	0.1	159.0	0.0
Hole Street	0.3	306.0	0.0
Storrington Road	0.1	148.0	0.0
A24 South	0.1	159.0	0.0

APPENDIX D

Road link		Existing AADT two-way all vehicles	Proposed AADT two-way all vehicles	Future AADT two-way all vehicles	Change in noise level dBA
1	Church Close (North of Church Lane)	688	34	722	0.2
2	Church Close (South of Church Lane)	128	0	128	0.0
3	Church Lane	934	1101	2035	3.4
4	London Road (North)	4098	636	4734	0.6
5	London Road (South)	4244	465	4709	0.5

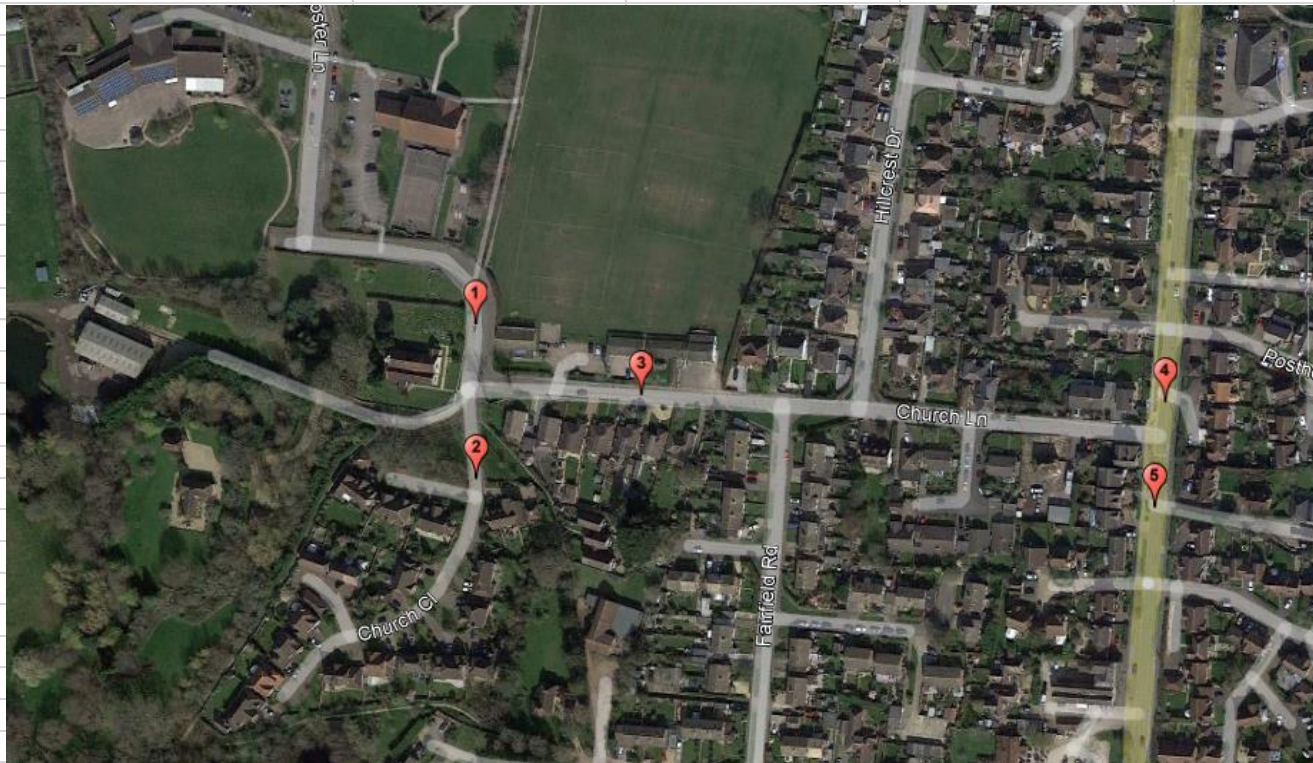

APPENDIX E

Appendix E

Acoustic Design Statement – Church Lane Ashington

This Acoustic Design Statement (ADS) accompanies the Noise Assessment and Environmental Statement for the development at Church Lane, Ashington. The approach to the ADS is in line with that set out in ProPG: Planning & Noise, May 2017

Stage 1 Assessment

The acoustic environment is controlled by road traffic noise on the surrounding road network. Noise levels are relatively consistent across the site, with slightly higher noise levels at the boundaries of the site closest to the nearby school and the surrounding road network. The site is considered to be *low* risk of adverse noise impact.

Where new residential receptors are introduced, any change in the predominant noise source is expected to be due to changes in the volume of road traffic; however the number of expected movements is low in comparison to the baseline traffic conditions and therefore it is not expected that new residential receptors will significantly increase noise levels.

Stage 2 Assessment

Element 1 – Good Acoustic Design

With a residential scheme the principles of good acoustic design are key to a successful development and to ensure there is no significant adverse noise impact on respective users of the site.

The design team have sought to follow the best practice principles including the hierarchy of noise control wherever practicable in developing the layout of the site. This is broadly set out as follows:

1. Noise control at source – through the careful positioning of potentially noisy activities away from sensitive receptors;
2. Noise control in the transmission path – by maximising acoustic screening with sensible layout by positioning higher sensitivity (internal and external) areas on the more sheltered sides of buildings;
3. Noise control at receptors – through appropriate building envelope mitigation to include glazing, ventilation and separating walls and floors.

The layout maximises the screening through the use of relatively continuous intervening buildings at the boundaries of the site, which will reduce noise levels in gardens and at dwellings which are set back from the site boundaries. This is shown in Figure E1 below.

Figure E1 – Site Layout



Alternative ventilation is proposed to all dwellings at the site, which will enable residents to keep their windows closed whilst maintaining suitable rates of background ventilation.

Element 2 – Internal Noise Levels

Based on the measured and calculated noise levels the internal noise levels in residential units can be determined. Appropriate façade attenuation will be provided to ensure compliance with Figure 2 ProPG which incorporates the guidance in BS8233:2014. In doing so Element 2 requirements of Stage 2 are met.

Glazing and ventilation specification is detailed in the noise assessment.

Element 3 – External Amenity Area Noise Levels

External sound level at private amenity areas across the site will meet the guideline values set out in the standards.

External amenity areas are located on the screened side of building from surrounding road network where possible to reduce noise levels by as much as possible, given other design considerations.

All residents will have access to private amenity areas where noise levels meet the guidance levels in ProPG and good acoustic design principles have been incorporated to reduce potential impact as much as practicably possible.

Further detail on external amenity areas is included in noise assessment.

Element 4 – Assessment of Other Relevant Issues

The good acoustic design principles which have been followed mean that the proposed development is in general compliance with the principles of the ProPG.

The development is designed as a high quality, vibrant living environment that balances the needs of the occupiers of the spaces through high quality sustainable design.

The proposed facade sound insulation performances mean that internal residential noise levels when windows are closed will be in line with the ProPG guidance levels.

Noise levels in private amenity areas are generally compliant with some slight exceedances. The design of the site has reduced noise levels in private amenity spaces as far as practicable and the residual exceedances are minimal. Alternative, high quality shared amenity areas are provided within the site and comply with the ProPG guidance levels.

Recommendation for the Decision Maker

In the context of the existing acoustic environment at the site the risk is low across the site.

Principles of good acoustic design have been followed to minimise the potential impact of noise though; careful layout and orientation of buildings; self-screening and where

appropriate façade mitigation. It is considered that the site is suitable on noise grounds and therefore planning may be granted subject to the inclusion of suitable noise conditions.

APPENDIX F

RELEVANT POLICY & GUIDANCE

National Planning Policy Framework (NPPF) – July 2021

Under the NPPF: paragraph 185 of Section 15, with regard to environmental noise; Planning policies and decisions should aim to: -

- mitigate and reduce to a minimum, potential adverse impacts resulting from noise from new development – and avoid noise giving rise to significant adverse impacts on health and the quality of life;
- identify and protect areas of tranquillity which have remained relatively undisturbed by noise and are prized for their recreational and amenity value for this reason.

Noise Policy Statement for England (NPSE)

To avoid and mitigate adverse noise effects on health arising from and impacting on new development, the NPPF makes reference to NPSE. The NPSE was published in March 2010 and covers all forms of noise, other than occupational noise. For the purposes of this report, "Neighbourhood Noise" is most relevant as NPSE defined at paragraph 2.5:

"neighbourhood noise which includes noise arising from within the community such as industrial and entertainment premises, trade and business premises, construction sites and noise in the street. "

NPSE introduces three concepts to the assessment of noise in the UK:

- NOEL – No Observed Effect Level – This is the level below which no effect can be detected and below which there is no detectable effect on health and quality of life due to noise.
- LOAEL – Lowest Observable Adverse Effect Level – This is the level above which adverse effects on health and quality of life can be detected.
- SOAEL – Significant Observed Adverse Effect Level – This is the level above which significant adverse effects on health and quality of life occur.

NPSE does not numerically define levels for the NOEL, LOAEL or SOAEL rather it makes it clear that the noise level is likely to vary depending upon the noise source, the receptor and the time of day/day of the week, etc.

National Planning Practice Guidance (2014)

The purpose of the guidance is to complement the NPPF and provide advice on how to deliver its policies.

The purpose of the guidance is to complement the NPPF and provide advice on how to deliver its policies.

The guidance includes a table (as shown in Table 1) that summarises "the noise exposure hierarchy, based on the likely average response" and which offers "examples of outcomes" relevant to the NOEL, LOAEL and SOAEL effect levels described in the NPSE.

Perception	Examples of outcomes	Increasing effect level	Action
Not noticeable	No Effect	No Observed Effect	No specific measures required
Noticeable and not intrusive	Noise can be heard, but does not cause any change in behaviour or attitude. Can slightly affect the acoustic character of the area but not such that there is a perceived change in the quality of life.	No Observed Adverse Effect	No specific measures required
		Lowest Observed Adverse Effect Level	
Noticeable and intrusive	Noise can be heard and causes small changes in behaviour and/or attitude, eg turning up volume of television; speaking more loudly; where there is no alternative ventilation, having to close windows for some of the time because of the noise. Potential for some reported sleep disturbance. Affects the acoustic character of the area such that there is a perceived change in the quality of life.	Observed Adverse Effect	Mitigate and reduce to a minimum
		Significant Observed Adverse Effect Level	
Noticeable and disruptive	The noise causes a material change in behaviour and/or attitude, eg avoiding certain activities during periods of intrusion; where there is no alternative ventilation, having to keep windows closed most of the time because of the noise. Potential for sleep disturbance resulting in difficulty in getting to sleep, premature awakening and difficulty in getting back to sleep. Quality of life diminished due to change in acoustic character of the area.	Significant Observed Adverse Effect	Avoid
Noticeable and very disruptive	Extensive and regular changes in behaviour and/or an inability to mitigate effect of noise leading to psychological stress or physiological effects, eg regular sleep deprivation/awakening; loss of appetite, significant, medically definable harm, eg auditory and non-auditory	Unacceptable Adverse Effect	Prevent

Table 1: Noise Exposure Hierarchy, Based on the Likely Average Response.

Calculation of Road Traffic Noise – 1988

For new developments, road traffic noise levels should be predicted in accordance with CRTN. This prediction method uses the traffic flow, vehicle speed, and percentage of heavy-duty vehicles (HDVs, over 3.5 tonnes), road gradient and other factors to calculate noise levels at receptor points.

Design Manual for Road and Bridges, Volume 11 (LA111 – Noise and Vibration

Changes in noise level as a result of additional vehicles on the public highway can be assessed using methodologies presented in Design Manual for Road and Bridges (DMRB LA111),

This guidance document sets out the requirements for noise and vibration assessments from road projects. The construction, operation and maintenance of highway projects can lead to changes in noise and vibration levels in the surrounding environment.

The magnitude of change (in sound level) is defined in Table 3.54a of the guidance for short term and Table 3.54b for long term, as presented in Table 2:

Short term magnitude	Short term noise change (dB L _{A10,18hr} or L _{night})
Major	Greater than or equal to 5.0
Moderate	3.0 to 4.9
Minor	1.0 to 2.9
Negligible	less than 1.0

Long term magnitude	Long term noise change (dB L _{A10,18hr} or L _{night})
Major	Greater than or equal to 10.0
Moderate	5.0 to 9.9
Minor	3.0 to 4.9
Negligible	less than 3.0

Table 2 (Table 3.54a and b DMRB, LA 111 - Magnitude of Change)

Control of Pollution Act 1974

The local authority has powers under the Control of Pollution Act 1974 to control noise from construction sites. Section 60 of the Act allows a local authority to serve a notice of its requirements for the control of site noise. This notice may include specification of plant that is or is not to be used, hours during which the construction works can be carried out and levels of noise emission. Section 61 of the Act allows a contractor or developer to take the initiative and agree with the local authority the methods of construction, steps to minimise noise and hours of work.

The Environmental Protection Act 1990

Local authorities have a duty to deal with statutory nuisances under the Environmental Protection Act 1990. For noise to amount to a statutory nuisance, it must be "prejudicial to health or a nuisance" as outlined in Section 79 of the Act. Any proposed development should not result in a statutory nuisance being declared.

Should the Local Authority declare a development to cause a statutory nuisance, an abatement notice can be served to the developer who has up to 21 days to appeal to Magistrates' Court, as detailed in Section 80 of the Act.

The Building Regulations 2010

Building Regulations approvals are required for most new buildings and for most types of works on existing buildings. Part 10 of The Building Regulations 2010 contains provisions, including power for local authorities to test building work, take samples, and provision to ensure compliance. Part E of the Regulation 'Resistance to the passage of sound' is expanded in Approved Document E, which provides robust details to control and mitigate noise within buildings. This Document is separated over four parts which include:

- E1: Protection against sound from other parts of the building and adjoining buildings;
- E2: Protection against sound within dwelling-house etc.;
- E3: Reverberation in the common internal parts of buildings containing flats or rooms for residential purposes;
- E4: Acoustic conditions in schools.

World Health Organisation

The WHO document Guidance on Community Noise specifies additional information for noise affecting noise sensitive receptors and forms the basis of many noise limitations and design ranges for internal and external ambient noise levels. It defines noise as 'a class of sounds that are considered unwanted' (by the listener), 'that adversely affects, or may affect the physiological and psychological wellbeing of people.' Much of the research around this study is based on transportation noise.

Further guidance on the recommended levels is given in the World Health Organisation (WHO) Guidelines for Community Noise. In this document it is stated that:

"To protect the majority of people from being seriously annoyed during the daytime, the outdoor sound level from steady, continuous noise should not exceed 55 dB L_{Aeq} on balconies, terraces and in outdoor living areas. To protect the majority of people from being moderately annoyed during the daytime, the outdoor sound level should not exceed 50 dB L_{Aeq} ."

WHO also states the following paragraph with regard to the effects of L_{Amax} events in a night-time period:

"For a good sleep, it is believed that indoor sound pressure levels should not exceed approximately 45dB L_{Amax} more than 10-15 times per night (Vallet & Vernet 1991)."

WHO guidance 'Night Noise Guidelines for Europe' is concerned with the longer-term average noise levels that are covered by the EU Directive on Environmental Noise, although this does appear to suggest external maximum noise levels of around 57dBA outside bedrooms during the night to achieve internal maximum levels of 42dBA.

The World Health Organisation has recently published Environmental Noise Guidelines – for the European Region (2018) to provide recommendations for protecting human health from exposure to noise sources such as transportation (road traffic, railway and aircraft), wind turbine noise and leisure noise.

The guidance document defines the 'strength' of recommendation (for protecting against noise exposure) as either 'strong' or conditional', outlined below.

Strength of Recommendation

*"A **strong** recommendation can be adopted as policy in most situations. The guideline is based on the confidence that the desirable effects of adherence to the recommendation outweigh the undesirable consequences. The quality of evidence for a net benefit – combined with information about values, preference*

and resources – inform this recommendation, which should be implemented in most circumstances.”

*"A **conditional** recommendation requires a policy-making process with substantial debate and involvement of various stakeholders. There is less certainty of its efficacy owing to lower quality of evidence of a net benefit, opposing values and preferences of individuals and populations affected or the high resource implications of the recommendation, meaning there may be circumstances or settings in which it will not apply.”*

External (free-field) recommendations included in the Environmental Noise Guidelines for the European Region are presented in Table 3 for specific noise sources.

Noise Source	dB L _{den}	dB L _{night}	dB L _{Aeq, 24hr} (yearly average)	Recommendation
Road Traffic	53	45	-	Strong
Railway	54	44	-	Strong
Aircraft	45	40	-	Strong
Wind Turbine	45	-	-	Conditional
Entertainment	-	-	70	Strong/Conditional

Table 3: Extract from Environmental Noise Guidelines for the European Region

BS8233:2014 – Guidance on Sound Insulation and Noise Reduction for Buildings

Formerly a Code of Practice, the 2014 revision of BS8233 is now presented and intended as a guidance document. The standard is mainly concerned with building design from an acoustic standpoint. It does however, contain information relevant to environmental noise more specifically by stating guidance for desirable internal noise levels for dwellings and other buildings.

Table 2 of BS8233:2014 provides suitable internal levels for spaces such as open-plan offices and restaurants and notes that an upper and lower noise levels should be considered, as presented in Table 4.

Objective	Typical Situation	Design range dB LAeq,T
Typical noise levels for acoustic privacy in shared spaces	Restaurant	40 - 55
	Open plan office	45 - 50
	Night club, public house	40 - 45
	Ballroom, banqueting hall	35 - 40

Table 4: Extract from Table 2 – Indoor ambient noise levels in spaces when they are unoccupied and privacy is also important

An extract of Table 4 of the document relevant for residential development is reproduced in Table 5.

Activity	Location	07:00 to 23:00 dB LAeq, 16hour	23:00 to 07:00 LAeq, 8hour
Resting	Living room	35	-
Dining	Dining room / area	40	-
Sleeping (daytime resting)	Bedroom	35	30

Table 5: Extract from Table 4 – Indoor ambient noise levels in dwellings

Whilst the above criteria is for dwellings, BS8233 states that these recommendations are similar for hotel guestrooms and therefore these have been adopted as the criteria for assessment.

The guidance of BS8233:2014 with regards to external amenity spaces is as follows:

"For traditional external areas that are used for amenity space, such as gardens and patios, it is desirable that the external noise level does not exceed 50 dB LAeq,T, with an upper guideline value of 55 dB LAeq,T which would be acceptable in noisier environments. However, it is also recognized that these guideline values are not achievable in all circumstances where development might be desirable. In higher noise areas, such as city centres or urban areas adjoining the strategic transport

network, a compromise between elevated noise levels and other factors, such as the convenience of living in these locations or making efficient use of land resources to ensure development needs can be met, might be warranted. In such a situation, development should be designed to achieve the lowest practicable levels in these external amenity spaces, but should not be prohibited."

ProPG: Planning and Noise - May 2017

Guidance in ProPG Planning and Noise provides an approach which aims to inform developers, practitioners and local authorities on how potential residential sites should be assessed. ProPG states that the guidance can be used for other types of residential institution and therefore it is considered applicable to the site.

The guidance also builds upon government planning policy that noise should not be treated in isolation and there should be a holistic approach to good acoustic design.

ProPG sets out a 2-stage approach; the first of which is a risk assessment to identify the likelihood of significant adverse impact, then depending on the outcome of this risk assessment the extent of the acoustic design statement required. The graphic in Figure 1 is an extract from ProPG and indicates the level of risk associated with ranges of sound levels and provides some guidance on the likely extent of work associated with progressing a development exposed to these sound levels.

In relation to maximum noise levels, ProPG states that:

"In most circumstances in noise sensitive rooms at night (e.g. bedrooms) good acoustic design can be used so that individual noise events do not normally exceed 45dB $L_{Amax,F}$ more than 10 times a night. However, where it is not reasonably practicable to achieve this guideline then the judgement of acceptability will depend not only on the maximum noise levels but also on factors such as the source, number, distribution, predictability and regularity of noise events."

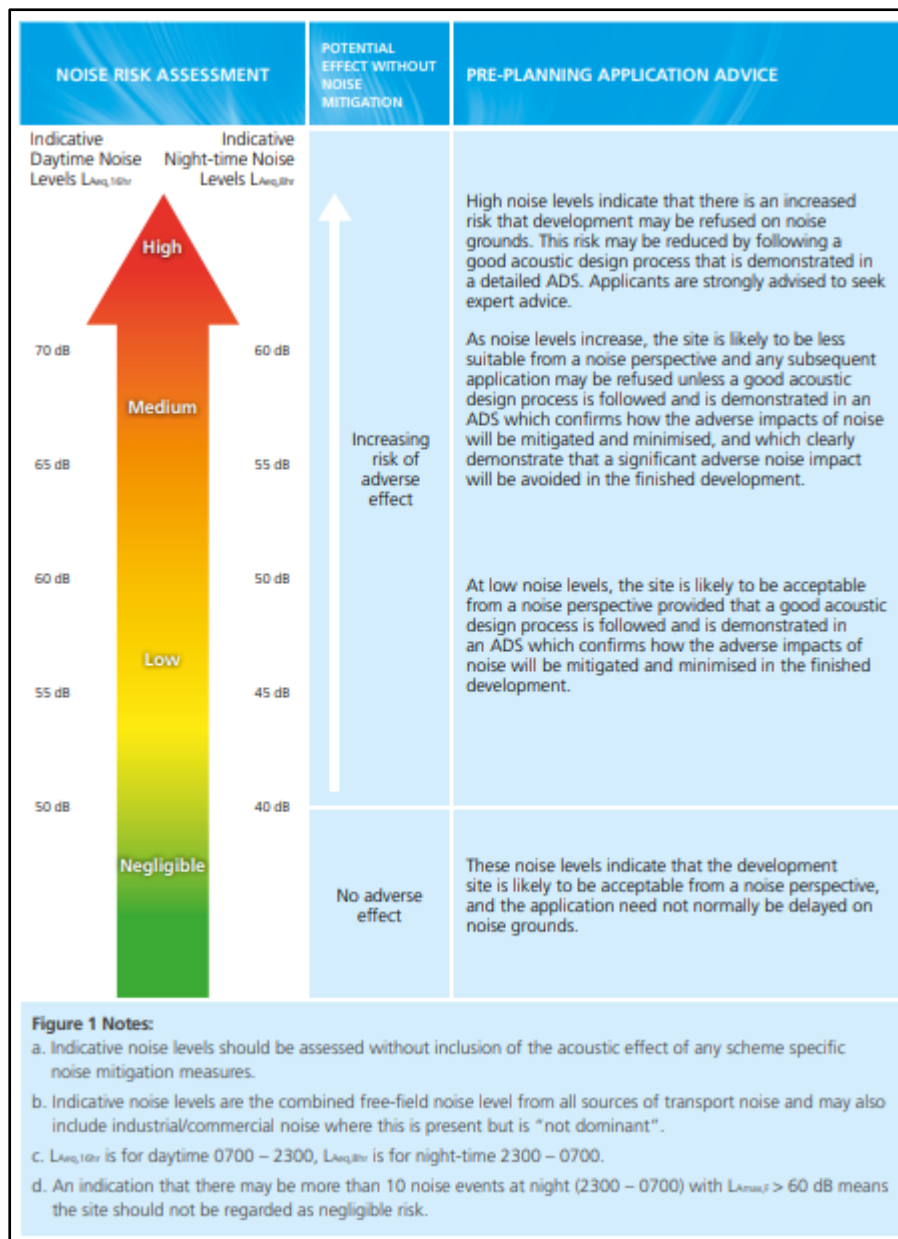


Figure 1: Extract from Figure 1 in ProPG – Initial Site Noise Risk Assessment

The second stage involves four key elements where discussion is expanded on:

- Element 1 – Good Acoustic Design Process
- Element 2 – Internal Noise Level Guidance
- Element 3 – External Amenity Area Noise Assessment
- Element 4 – Assessment of Other Relevant Issues

Having worked through the approach practitioners can present a recommendation to the decision maker.

Acoustics Ventilation and Overheating - Residential Design Guide, January 2020

Acoustics Ventilation and Overheating (AVO) recommends an approach to acoustic assessments for new residential development taking consideration for acoustics, ventilation, and overheating. AVO states that the guidance can be used for other types of residential institution and therefore it is considered applicable to the site.

Section 3 involves a two-level risk assessment approach to estimate the potential impact on occupants in the case of overheating.

The Level 1 site risk assessment is based on external free-field noise levels and the assumed scenario where a partially open window is used to mitigate overheating (Table 3-2 of the guidance).

The sound level reduction from outside to inside for a partially open window is 13dB in this instance. A Level 1 site risk assessment is considered adequate if the site falls within the 'Negligible risk' category. A Level 2 assessment can optionally be undertaken to give more confidence in the case of Low or Medium risk sites, where appropriate. The Level 2 assessment is strongly recommended for 'High' risk sites.

The Level 2 assessment suggests that assessment of the adverse effect from noise exposure should include an estimate of how frequently and for what duration the overheating condition occurs (Table 3-3 of the guidance)

Figure 2 explains the two-level noise assessment procedure for overheating conditions.

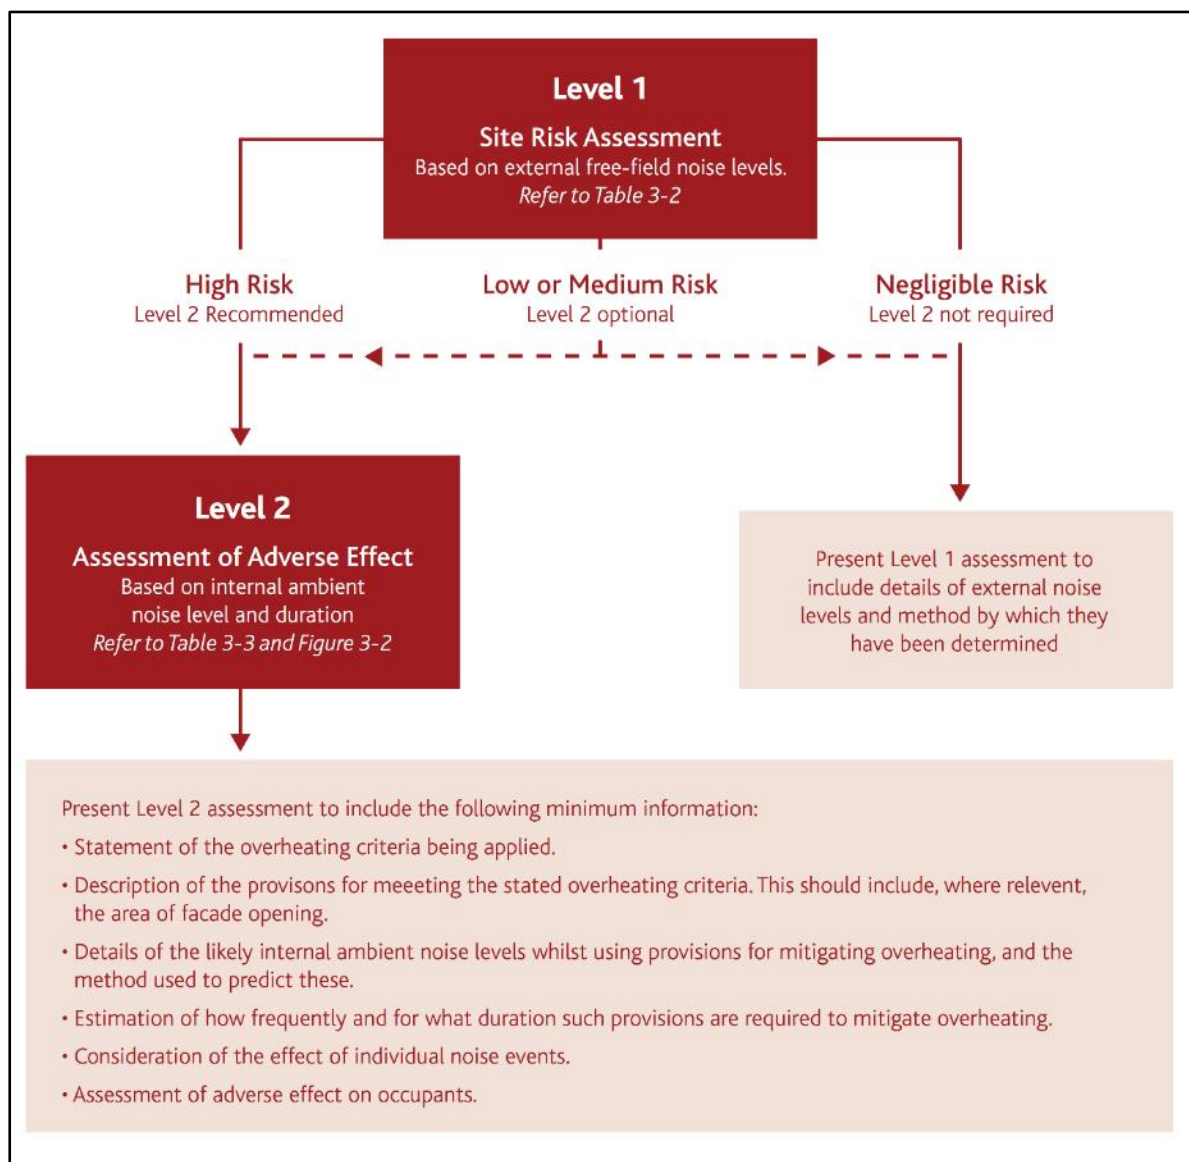


Figure 2: Two-level Assessment Procedure (Figure 3.1 of AVO Guidance)

Figure 3 shows the Level 1 site risk assessment of noise, relating to overheating conditions.

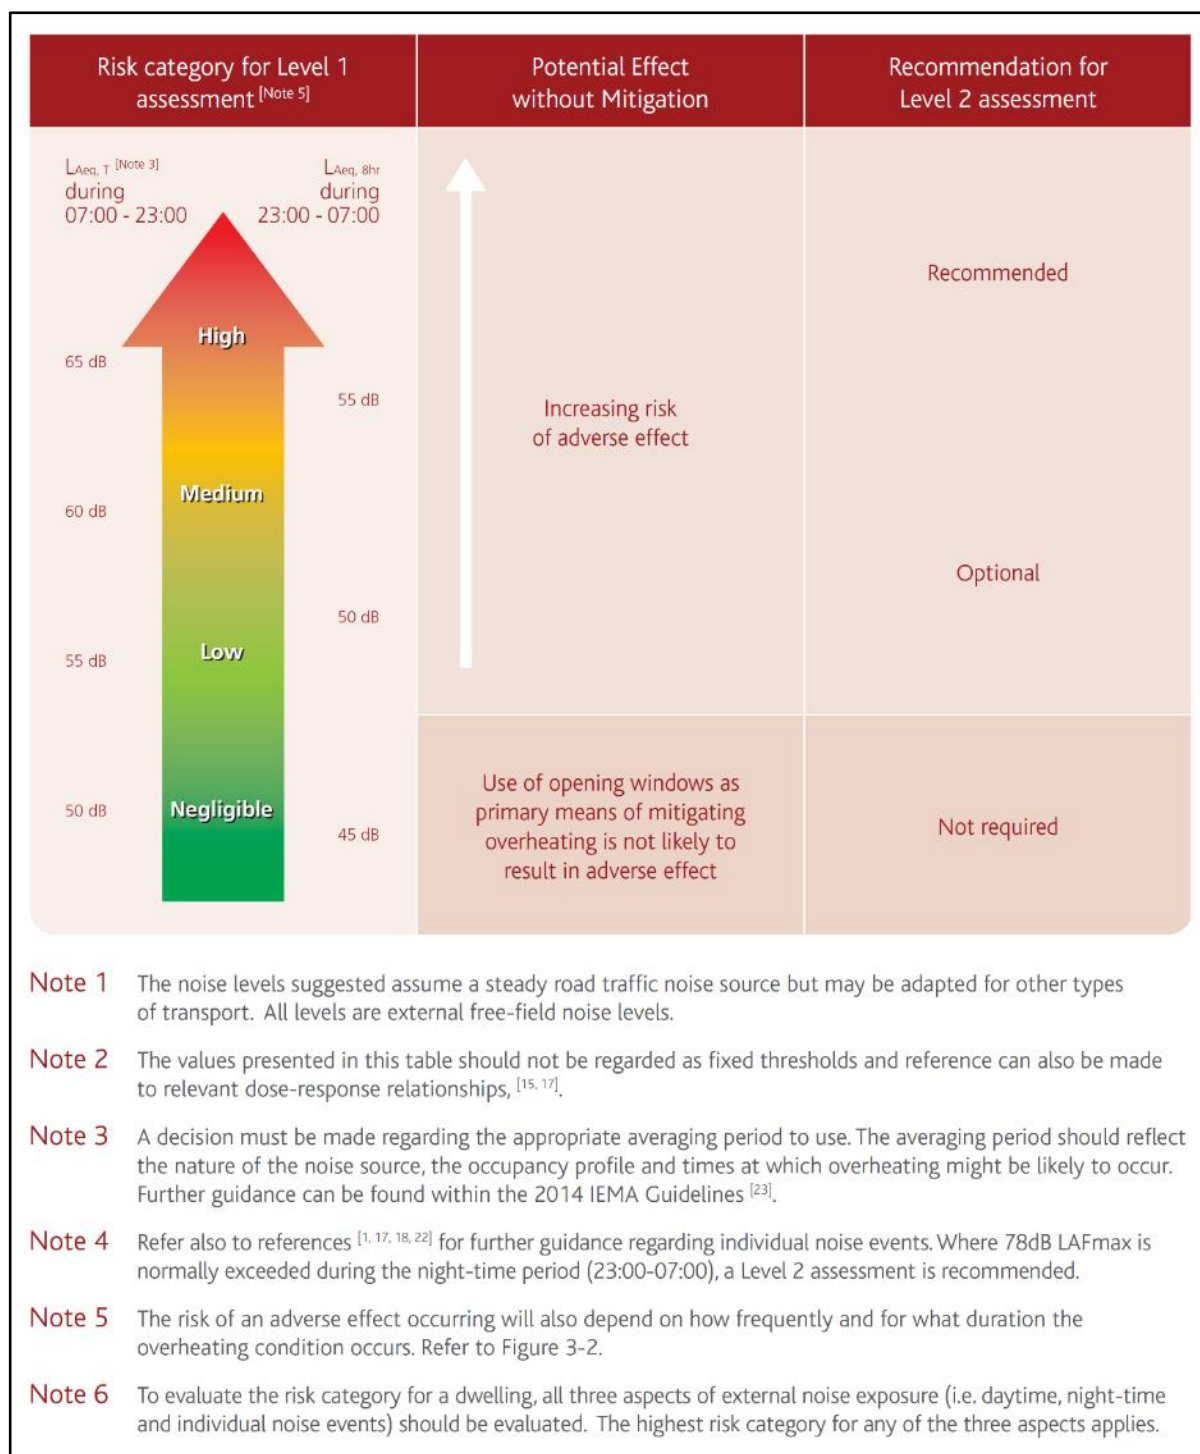


Figure 3: Level 1 Risk Assessment (Figure 3.2 of AVO guidance)

Figure 4 shows the Level 2 site risk assessment of noise, relating to overheating conditions.

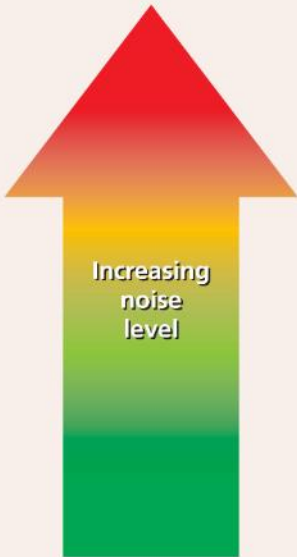
Internal ambient noise level ^[Note 2]			Examples of Outcomes ^[Note 5]	
$L_{Aeq,T}$ ^[Note 3] during 07:00 – 23:00 ^[Note 6]	$L_{Aeq,8h}$ during 23:00 – 07:00	Individual noise events during 23:00 – 07:00 ^[Note 4]		
> 50 dB	> 42 dB	Normally exceeds 65 dB $L_{AF,max}$	Noise causes a material change in behaviour e.g. having to keep windows closed most of the time	Avoiding certain activities during periods of intrusion. Having to keep windows closed most of the time because of the noise. Potential for sleep disturbance resulting in difficulty in getting to sleep, premature awakening and difficulty in getting back to sleep. Quality of life diminished due to change in acoustic character of the area.
			Increasing likelihood of impact on reliable speech communication during the day or sleep disturbance at night	At higher noise levels, more significant behavioural change is expected and may only be considered suitable if occurring for limited periods. As noise levels increase, small behaviour changes are expected e.g. turning up the volume on the television; speaking a little more loudly; having to close windows for certain activities, for example ones which require a high level of concentration. Potential for some reported sleep disturbance. Affects the acoustic environment inside the dwelling such that there is a perceived change in quality of life. At lower noise levels, limited behavioural change is expected unless conditions are prevalent for most of the time. ^[Note 8]
≤ 35 dB	≤ 30 dB	Do not normally exceed $L_{AF,max}$ 45 dB more than 10 times a night	Noise can be heard, but does not cause any change in behaviour	Noise can be heard, but does not cause any change in behaviour, attitude, or other physiological response ^[Note 9] . Can slightly affect the acoustic character of the area but not such that there is a perceived change in the quality of life.
Note 1 The noise levels suggested in Tables 3-2 and 3-3 assume a steady road traffic noise source but may be adapted for other types of transport.				

Figure 4: Level 2 Risk Assessment (Figure 3.3 of AVO guidance)

The noise levels suggested in Figure 3 and Figure 4 assume a steady road traffic noise source but may be adapted for other types of transport by taking account of the differing responses to different transport sources.

Planning Noise Advice Document: Sussex

The Planning Noise Advice Document: Sussex (PNADS) aims to provide advice for developers and their consultants to assist in making a planning application in East and West Sussex having regard to noise.

The document aims to offer clear and consistent guidance to developers on the level of information that will be required to be submitted with planning applications for noise generating developments or noise sensitive developments, better regulation by setting out existing standards that should be referred to in undertaking noise assessments, and applying these existing standards consistently in planning decisions and highlight the points that need to be considered and addressed prior to making a planning application.

Section 6 sets out the guidance regarding how to determine site suitability, the criteria for a development requiring noise assessment, the expected assessment methodology, the design criteria for noise sensitive development and criteria for the assessment of new noise sensitive developments near to existing industrial/commercial noise sources.

APPENDIX G

ACOUSTIC TERMINOLOGY

The effects of noise on human beings may be expressed in terms of physiological damage and annoyance. It is, however, only the annoyance impacts that need to be considered in detail when addressing environmental noise impacts. Annoyance also includes the immediate effects of activity interference, for example sleep disturbance and speech interference.

The practice has become to measure sound levels in decibels (dB). The decibel scale is logarithmic rather than linear and it is useful to bear in mind that a noise level change of 3dB would be equivalent to doubling the energy level (for example doubling the volume of traffic) and that an increase of 10 dB is perceived, subjectively, as a doubling of loudness. The human ear responds differently to sounds of different frequency. The ear perceives high frequency sound of a given sound pressure level more loudly than a low frequency sound at the same level. The A-weighted sound level, dB(A), takes this response into consideration and is commonly used for measurement of environmental noise in UK. It thus indicates the subjective human response to sound.

Environmental noise levels vary continuously from second to second, it is clearly impractical to specify the sound level continuously and thus time averaging is required. In practice human response has been related to various units which include allowance for the fluctuating nature of sound with time. For the purpose of this report these include:

LAeq,T : the equivalent A-weighted continuous sound level.

This unit relates to the equivalent level of continuous sound for a specific time period T, for example 16 hours for daytime noise. It contains all the sound energy of the varying sound levels over the same time period and expresses it as a continuous sound level over that period. The unit is used for assessing traffic and industrial noise for planning purposes and in particular for PPG24.

LA10,T : the A-weighted level of sound exceeded for 10% of the time period T.

This unit is used for traffic noise measurement and is the preferred unit for prediction of traffic noise in the publication, 'Calculation of Road Traffic Noise'.

LA90,T : the A-weighted level of sound exceeded for 90% of the time period T.

This unit is commonly used to represent the background noise and is used in assessing the effects of industrial noise in UK.

LAm_{ax} : the maximum A-weighted level of sound over a period of measurement.

LAr,T : the rating level.

The specific Noise plus any adjustments for the characteristic features of the noise. Used for comparison between background levels with the noise source off.

SEL : the Sound Exposure Level.

Sound exposure level abbreviated as SEL and LAE, is the total noise energy produced from a single noise event condensed into a 1 second time period.

R_w : weighted sound reduction index.

A laboratory-measured value as defined in ISO717 Part 1.

D_{nTw} :

The equivalent of R_w, but measured onsite as oppose to in a laboratory