V 3.0

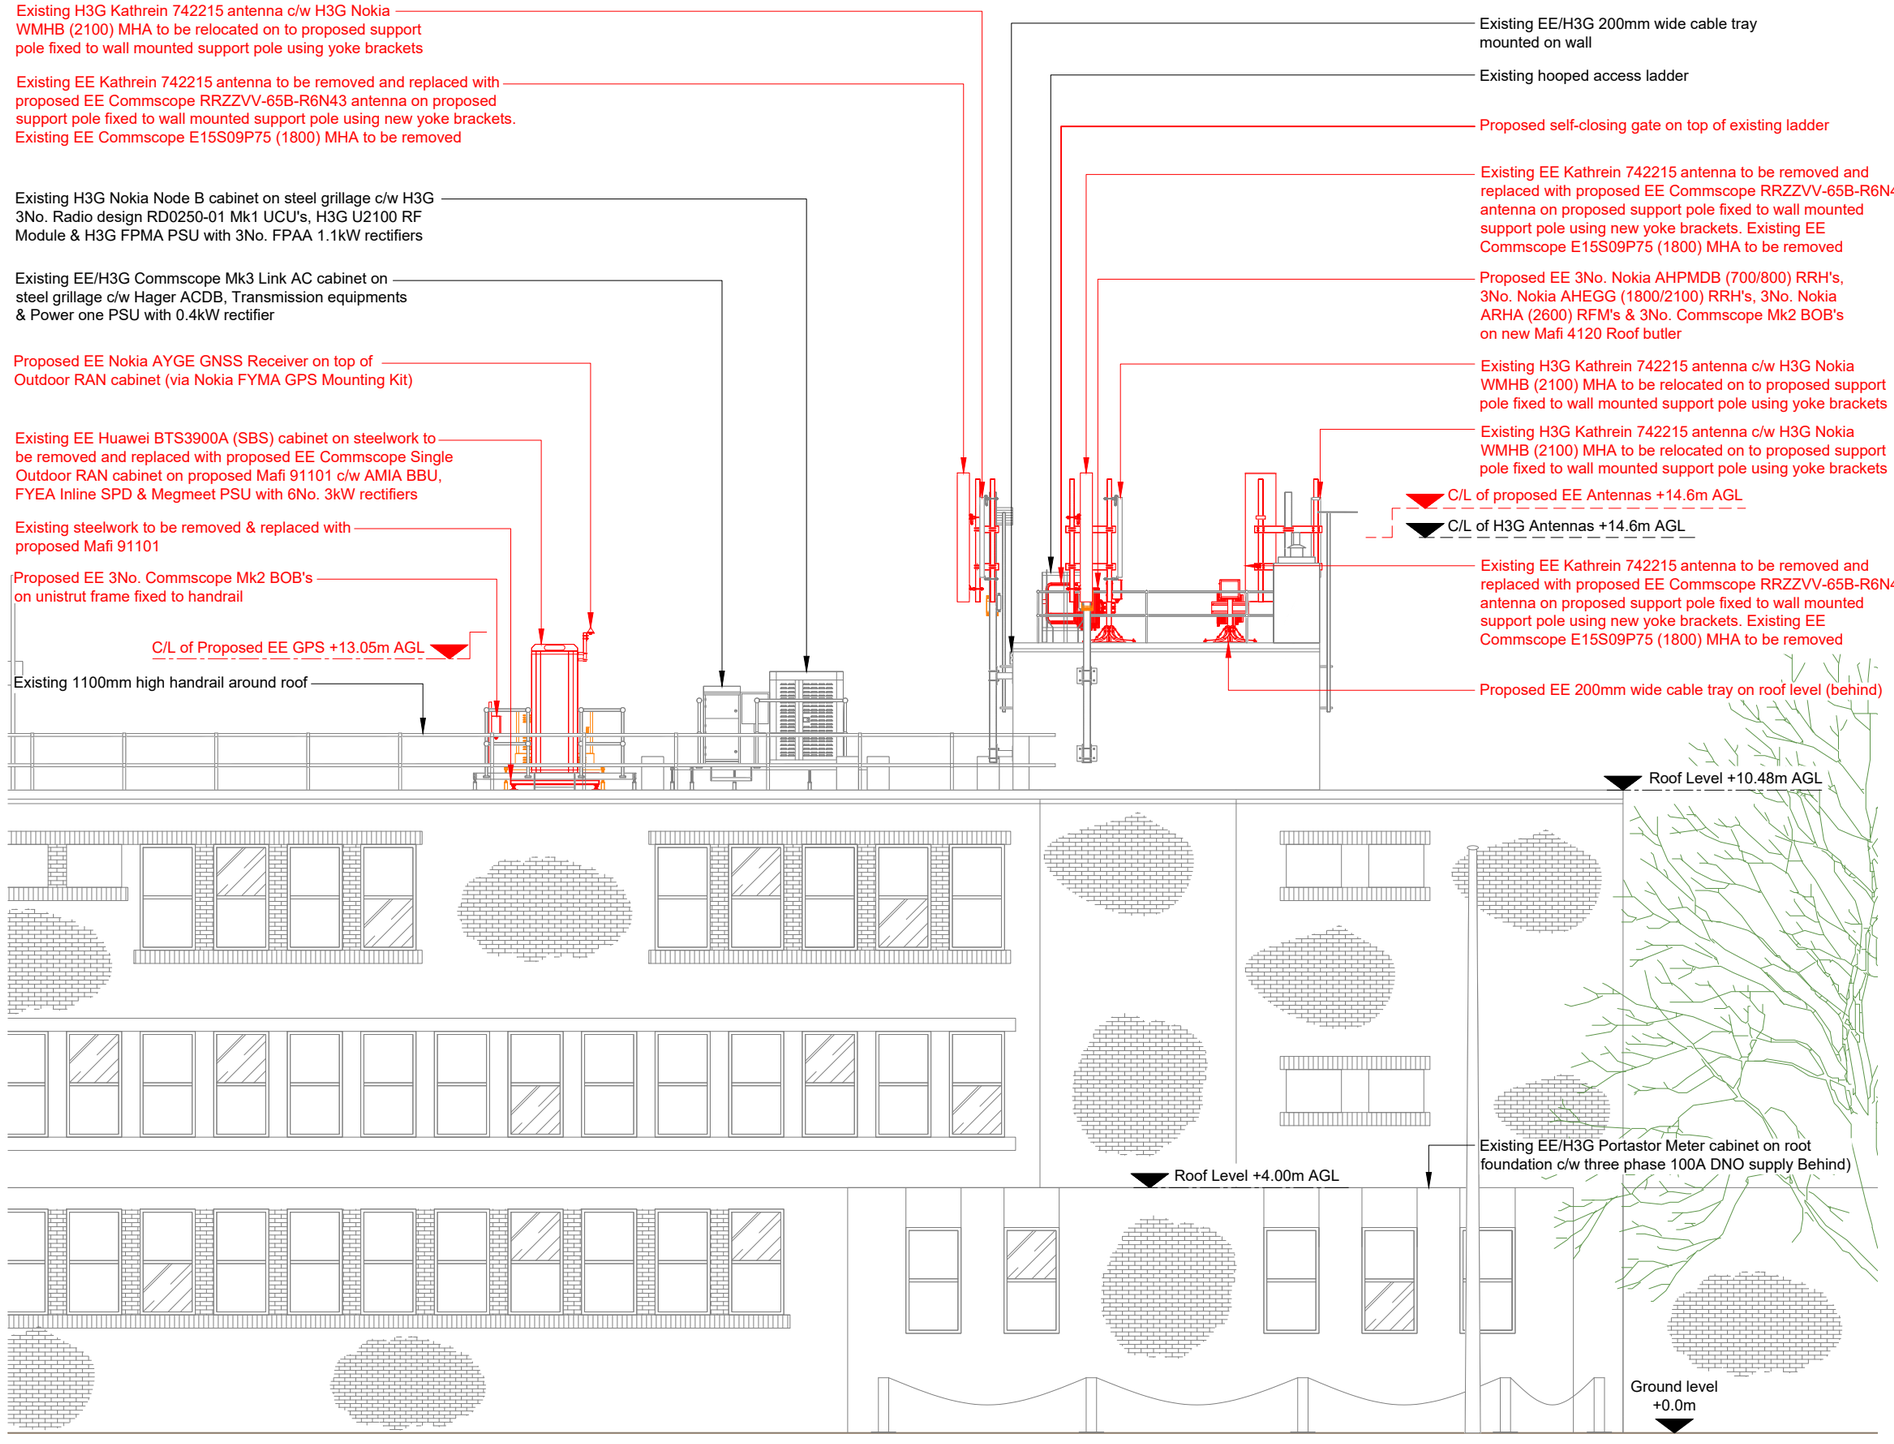

PROPOSED SITE ELEVATION A

0 1:100 2m 4

NOTES:

1. ALL DIMENSIONS IN MM UNLESS OTHERWISE NOTED.

Note:
The sub-main power & TX cables run on existing tray beneath the cabinets. All new power cables to use the existing cable tray

NOTE:
The site survey identified cracks on the internal walls within the plant room for sectors 1 and 2. It is recommended that an inspection by a structural engineer or pull test by competent person is carried out before adding any additional weight is added. The plantroom does have addition strengthening already installed

Master:	MBNL / EE / H3G:	Project:	Purpose of Issue:	Issue:
M001	EE	Vendor Swap	General Arrangement	A

Date:	28/03/2025	Revision / Upgrade Description:
Drawn:	R.Raja	First Issue
Checked:	D.Kingwell	
Approved:	L.Napolitano	

EE Limited
1 Braham Street
London
United Kingdom
E1 8EE

telent

Site Name: HORSHAM POLICE STATION

Site ID: 940666

Address:
HORSHAM POLICE STATION
HURST ROAD
HORSHAM
WEST SUSSEX
RH12 2DJ

Title: 250 PROPOSED SITE ELEVATION A

Project: VENDOR SWAP

Purpose of Issue: GENERAL ARRANGEMENT

EE Cell ID:	MBNL Cell ID:	3UK Cell ID:
51765	HSM003	RH0298

Master Drawing No: HSM003_51765_RH0298_EE_VS_GAD_A

Issue: A

v3.0