



Horsham District Council
Parkside
Chart Way
Horsham
West Sussex
RH12 1RL

Your ref
DC/26/0402

Our ref
DSA000052742

Date
8th April 2026

Contact
Tel 0330 303 0119

Dear Sir/Madam,

Proposal: Erection of a single storey front, side and rear extensions

Site: 8 Amberley Close Horsham West Sussex RH12 4LL

Rear / side extension build-over/close-to a sewer:

'It appears that the developer is intending to build-over/close-to a public foul sewer which is crossing the site. Building over a "public sewer" is not normally permitted by Southern Water. An investigation of the sewer is required to confirm its size and depth, ascertain its condition, number of properties served and potential means of access before any decision can be made as to whether it would be acceptable for Southern Water to allow building-over/close-to the sewer. The length of sewer to be built over under the terms of Part H of the Building Regulations dictates that the matter is determined by the sewerage undertaker, which in this case is Southern Water. The conditions and application associated with the build-over/close-to a public sewer are available at Southern Water's Get Connected service: <https://developerservices.southernwater.co.uk>.

For further advice, please contact Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX (Tel: 0330 303 0119).


Condition:

In order to protect drainage apparatus, Southern Water requests that if consent is granted, the following condition is attached to the planning permission; prior to the commencement of development, the developer must advise the local authority, in consultation with Southern Water, of measures which will be undertaken to protect the public sewers.

Website: southernwater.co.uk or by email at: SouthernWaterPlanning@southernwater.co.uk



Yours faithfully,
Future Growth Planning Team
southernwater.co.uk/developing-building/planning-your-development

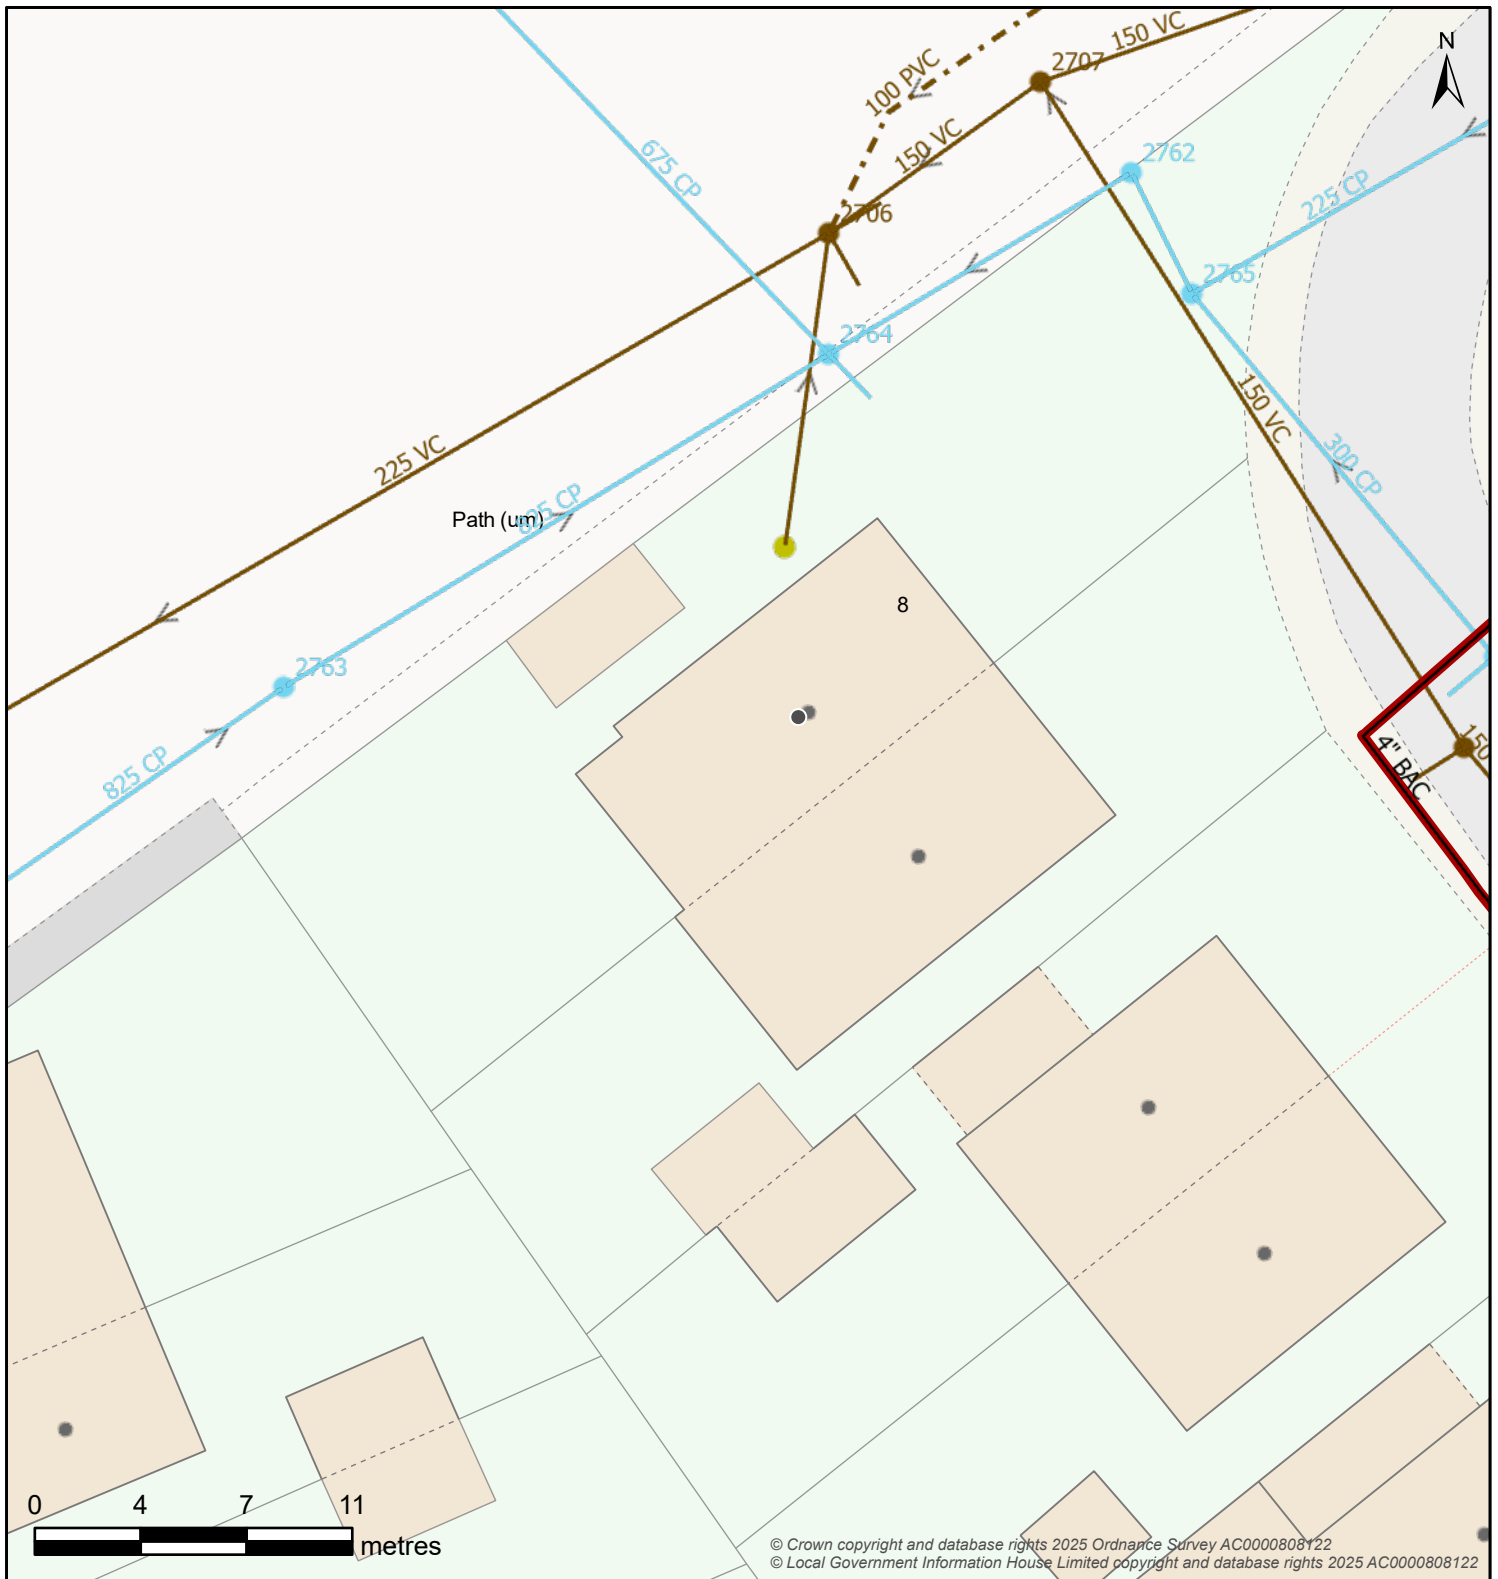

Controllable Valve			Flow Control			Inlet-Outfall	
Damboards	Penstock	Valve	Anti Flood Device	Pumped Anti Flood Device	Reflux Valve	Inlet	Outfall
Manhole							
BIF Bifurcation	Cascade	CP Catchpit	Head Of Public Sewer	IC Interceptor Chamber	Manhole	S Soakaway	WO Washout
Outfall Headworks		Overflow Chamber		Pipe Bridge		Pumping Station	
Outfall Headworks	CSO Combined Sewer Overflow	EMO Emergency Overflow		Pipe Bridge		Micro Pumping Station	Pumping Station
Sewer Level Monitor		Storage		Treatment Works		Weir	
Sewer Level Monitor	Storm Tank	Tidal Storage Tank		Treatment Works		Weir	Wastewater Site
Wastewater Pipe				Wastewater Use		Developer Services	
Culverted Water Course	Syphon	Tank Sewer		Foul		Build Over Agreement	Section 104
Drain	Trunk Sewer			Combined		Wastewater Area	
Outfall	Vacuum Main			Sludge		Catchment	
Overflow	Decommissioned Pipe			Treated Effluent		Sub-Catchment	
Rising Main				Surface Water			
Sewer				Private			

Map Title: SW Print

Printed By: Isaac.Vowles

Date Printed: 08/04/2026

Map Scale: 250

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.

