


PROTECTIVE FENCING SPEC (BS 5837:2012 Fig. 2)

- Vertical & horizontal scaffold-tube framework, well braced (bracing inside CEZ)
- Welded mesh panels, min. 2.0 m high, securely fixed to the framework
- Uprights driven min. 600 mm into ground; over retained hard standing use a rigid free-standing/ballasted base (no ground penetration)
- Signage 'CONSTRUCTION EXCLUSION ZONE - NO ACCESS' at <=10 m centres
- Erect BEFORE any demolition/plant; remain until practical completion

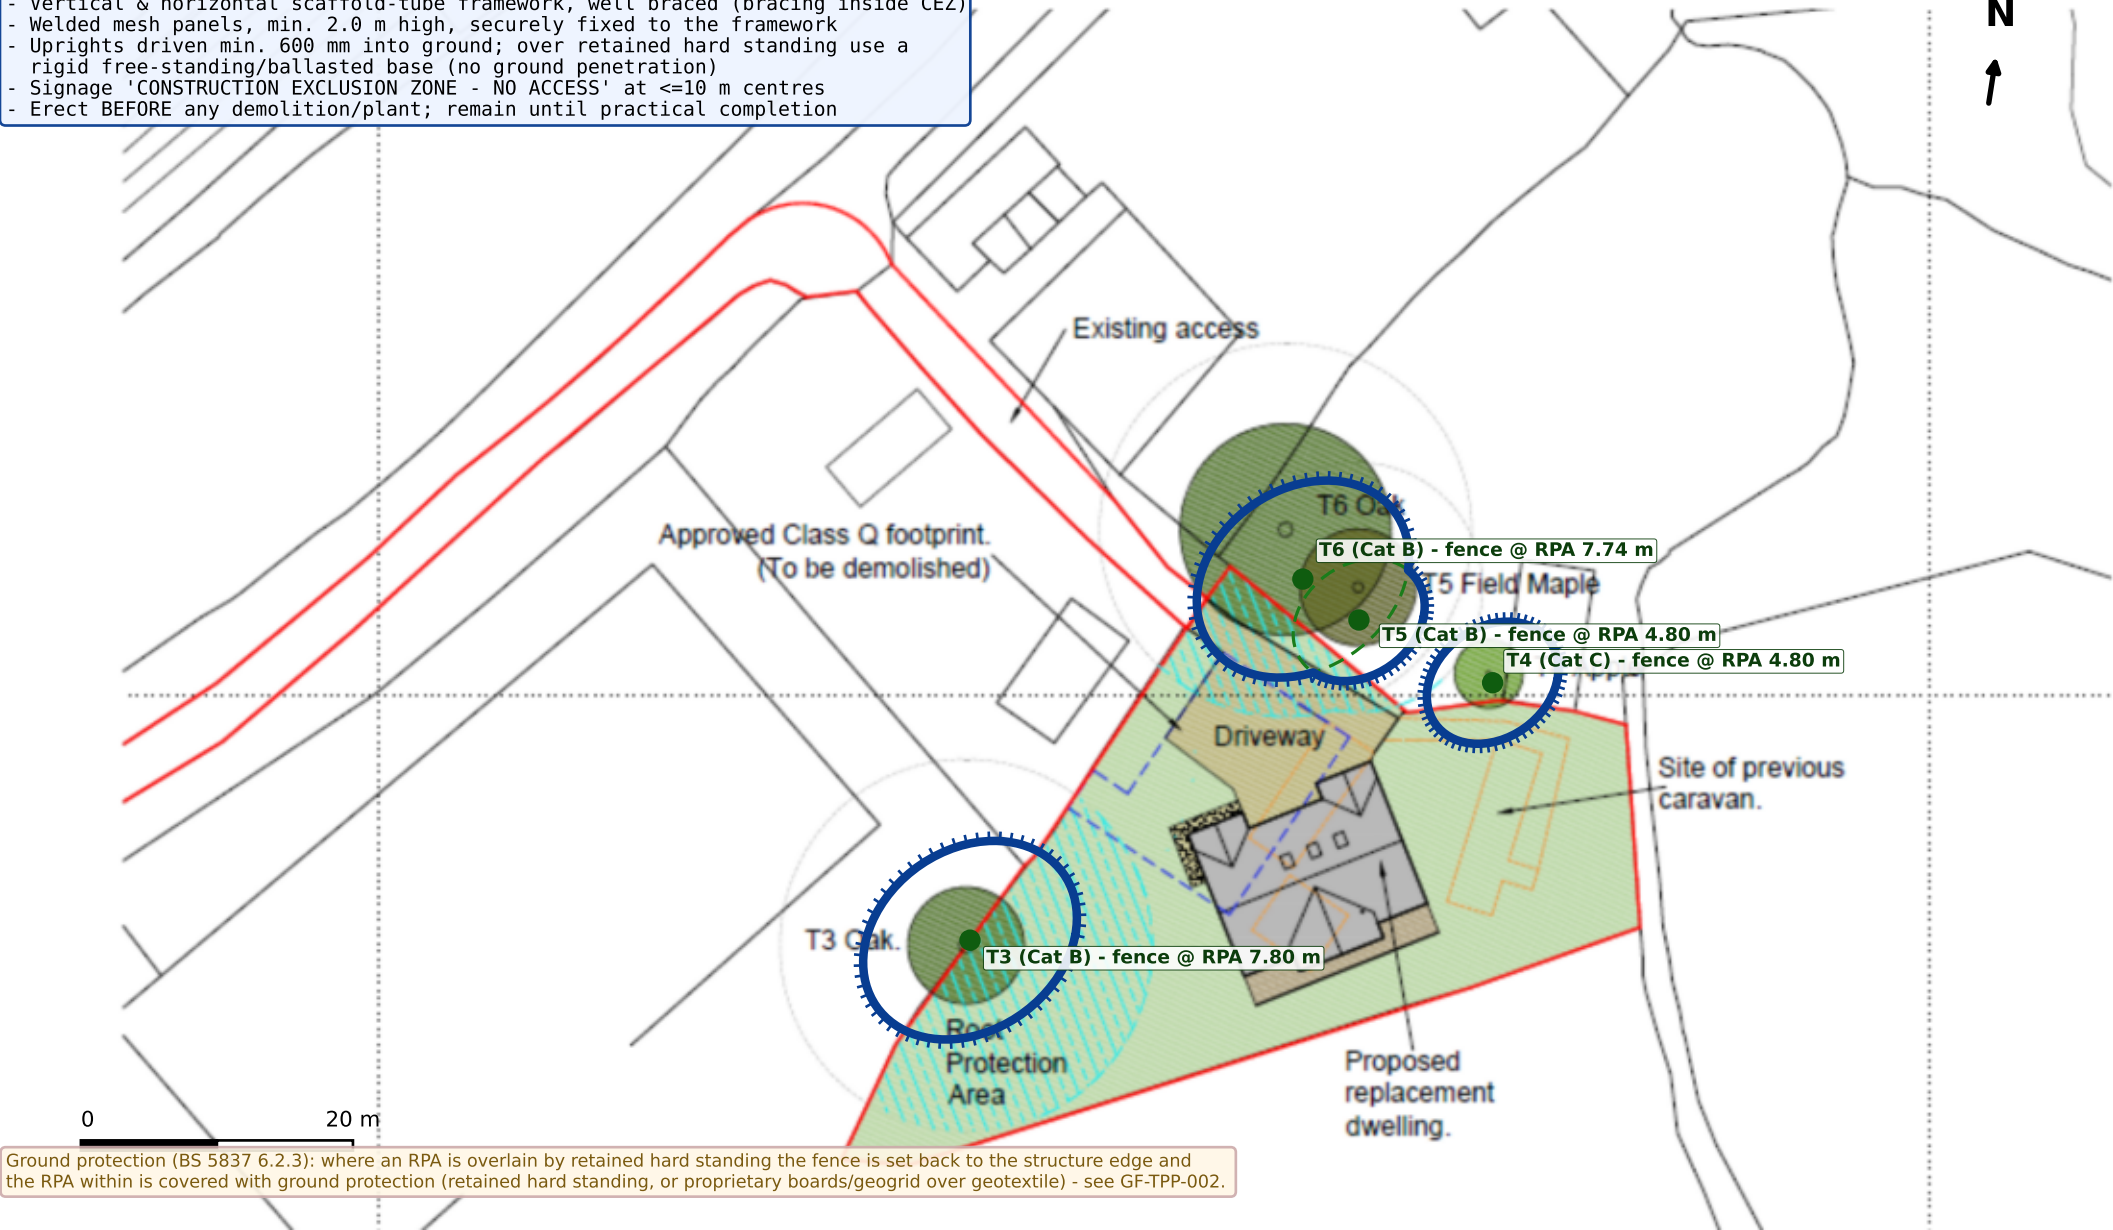

DRAWING TITLE
TREE PROTECTION & RPZ FENCING PLAN
BASE
Architect Proposed Layout Plan (154_2502 / Fig 4.1)
PROJECT
Replacement dwelling, Gorelands Farm
CLIENT
Mrs Georgina Obbard
PLANNING REF
DC/26/0597
DRAWING No
GF-TPP-001 Rev D
SCALE
Scale bar to govern (A3)
DATE
31 July 2026
PREPARED BY
Alfie Allingham BSc (Hons), FdSc, PTI
LEGEND
 RPZ / CEZ fencing boundary
 Root Protection Area (RPA)
 Tree retained
NOTES
1. RPZ/CEZ fencing boundary = the combined envelope of the retained trees' RPAs, set out to the RPA radii scheduled in Appendix A / Section 6.2 of the AIA. Georef to the architect's layout, survey GPS <1.5 m.
2. Fence spec & ground-protection / no-dig details on GF-TPP-002.
3. All works within RPAs under arboricultural supervision.