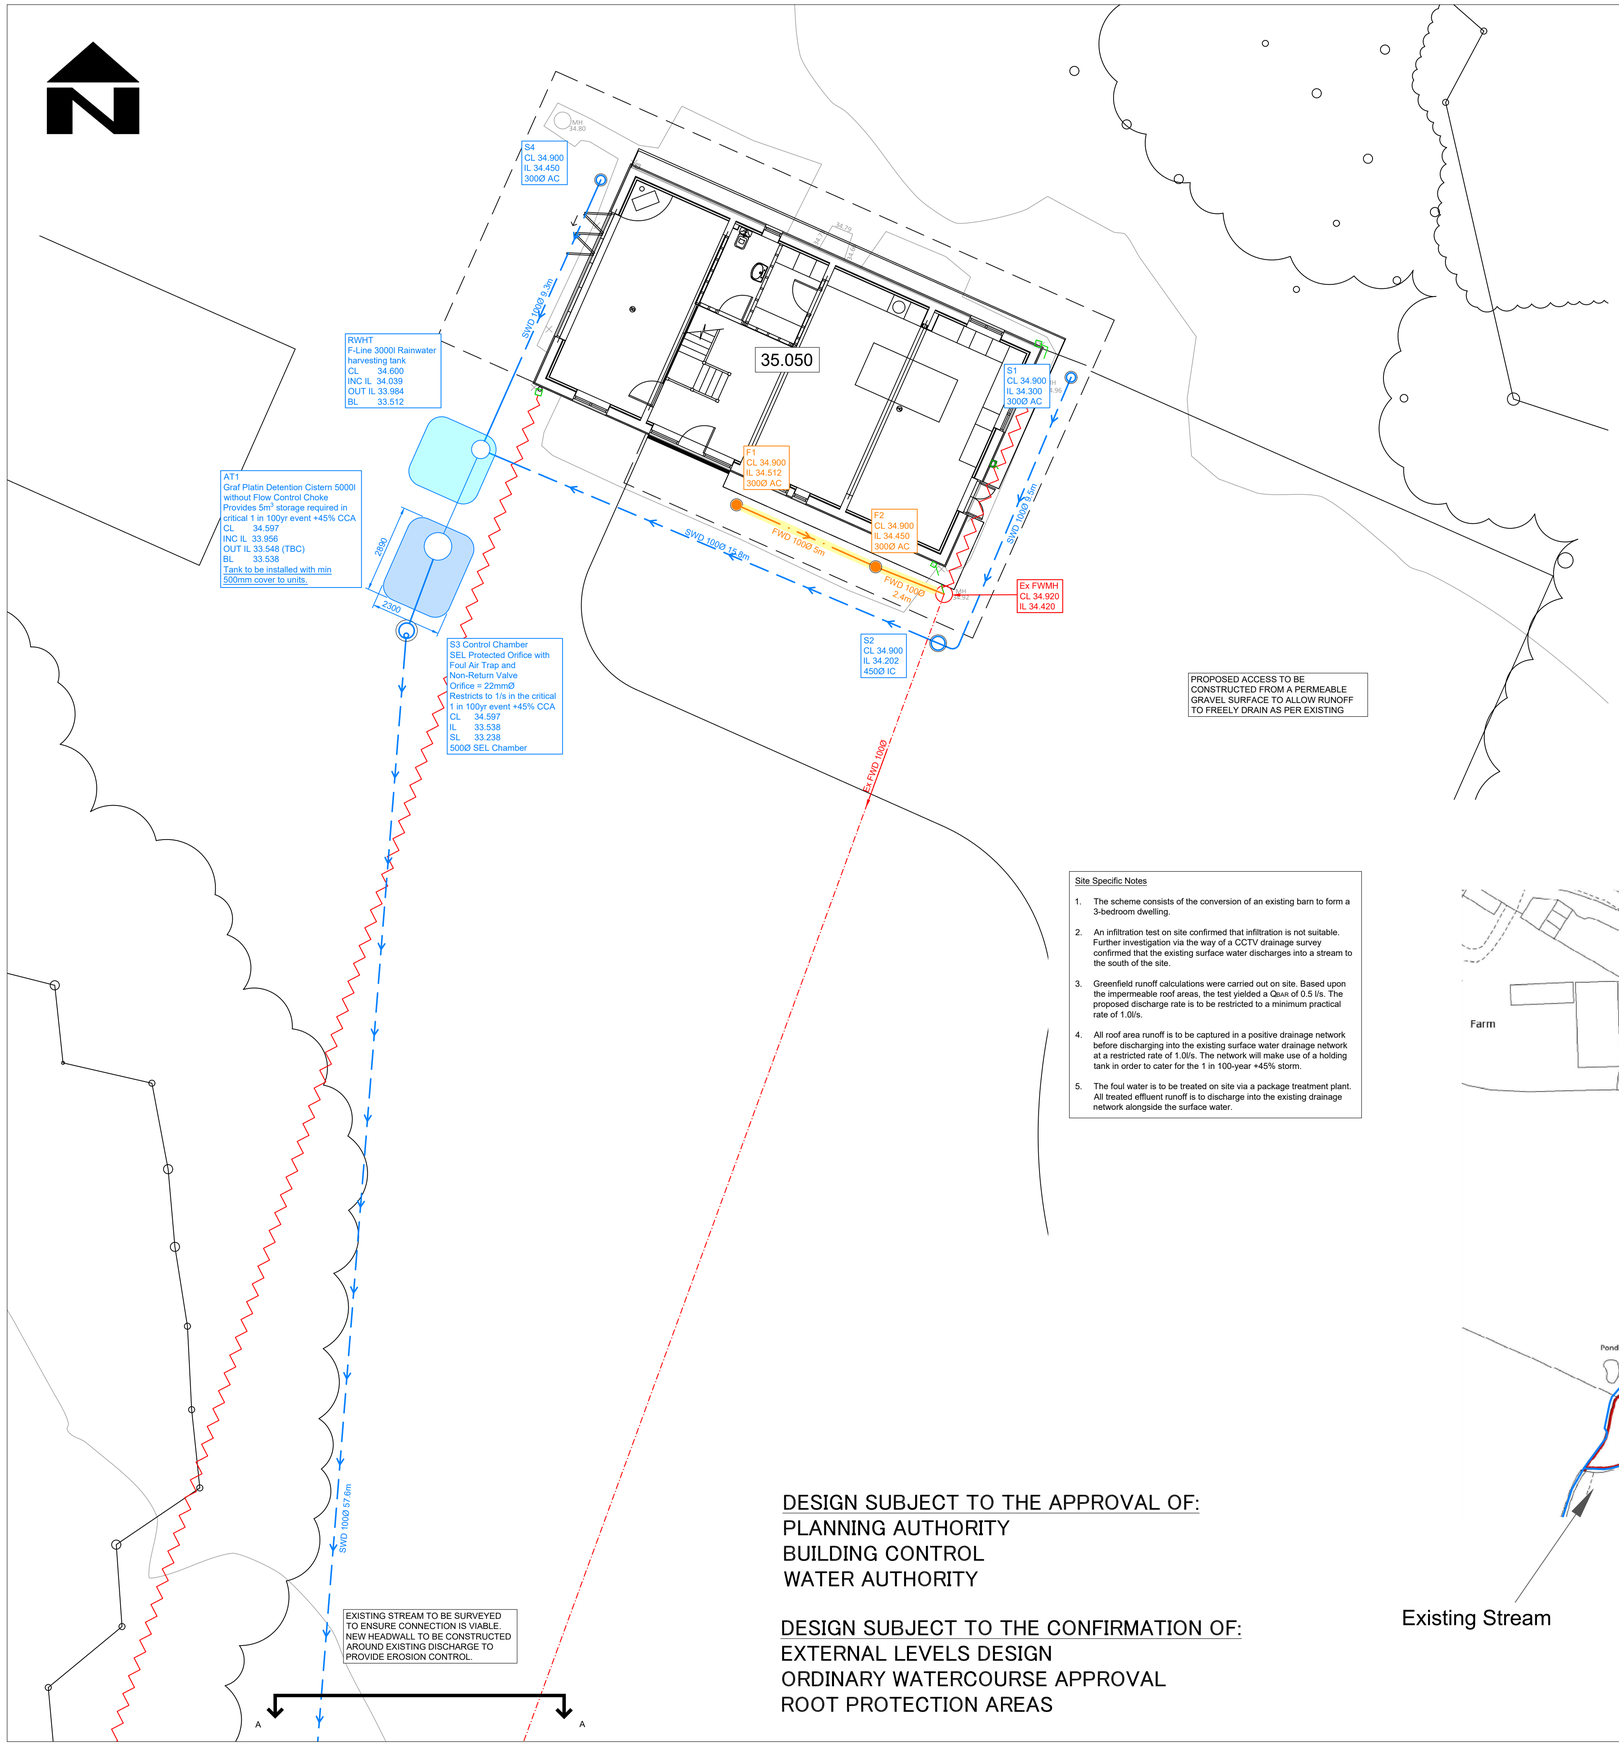

Site Specific Notes

1. The scheme consists of the conversion of an existing barn to form a 3-bedroom dwelling.
2. An infiltration test on site confirmed that infiltration is not suitable. Further investigation via the way of a CCTV drainage survey confirmed that the existing surface water discharges into a stream to the south of the site.
3. Greenfield runoff calculations were carried out on site. Based upon the impermeable roof areas, the test yielded a Q_{BAR} of 0.5 l/s. The proposed discharge rate is to be restricted to a minimum practical rate of 1.0l/s.
4. All roof area runoff is to be captured in a positive drainage network before discharging into the existing surface water drainage network at a restricted rate of 1.0l/s. The network will make use of a holding tank in order to cater for the 1 in 100-year +45% storm.
5. The foul water is to be treated on site via a package treatment plant. All treated effluent runoff is to discharge into the existing drainage network alongside the surface water.

DESIGN SUBJECT TO THE APPROVAL OF:
PLANNING AUTHORITY
BUILDING CONTROL
WATER AUTHORITY

DESIGN SUBJECT TO THE CONFIRMATION OF:
EXTERNAL LEVELS DESIGN
ORDINARY WATERCOURSE APPROVAL
ROOT PROTECTION AREAS

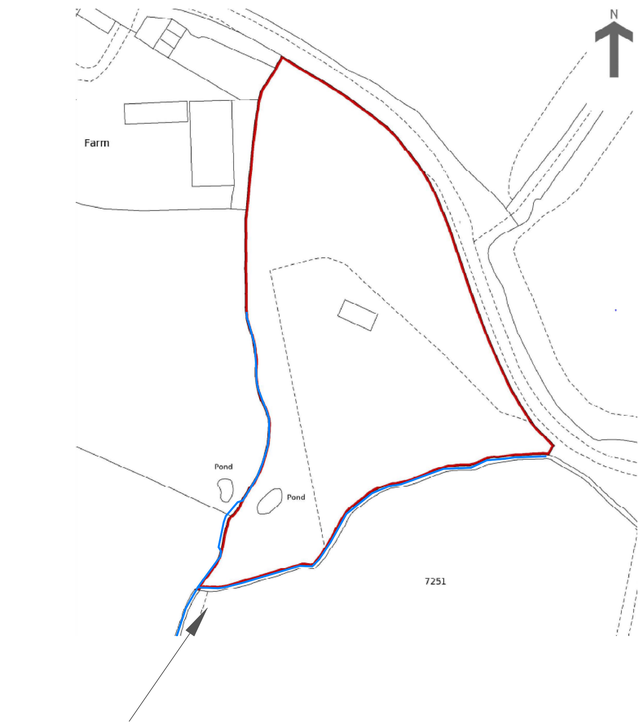

SITE LOCATION PLAN

DRAINAGE LEGEND

EXISTING FEATURES

- Ex FWD — Existing foul water sewer/drain and manhole
- Ex SWD — Existing surface water sewer/drain and manhole
- Existing foul/surface water sewer/drain and manhole to be abandoned

PROPOSED FEATURES

- Pipes at shallow depth - with concrete surround Type 'Z' Bedding or concrete slab protection to Building Regulation Part 'H' Diagram 11
- FWD — Foul Drainage
- SWD — Surface Water Drainage
- Storm water access chamber (300Ø)
- Storm water inspection chamber (450Ø)
- Storm water orifice flow control chamber (500Ø)
- Foul water access chamber (300Ø)
- Foul water inspection chamber (450Ø)
- 00.000 — Finished floor level
- 100Ø 4.5m 1:100 Z BED — Pipe info - diameter, length, gradient, bedding type

ABBREVIATIONS

MH	- MANHOLE
IC	- INSPECTION CHAMBER
AC	- ACCESS CHAMBER
CP	- CATCHPIT
BC	- BRAKE CHAMBER
RE	- RODDING EYE
IL	- INVERT LEVEL
SL	- SUMP LEVEL
RA	- RESTRICTED ACCESS COVER
CL	- COVER LEVEL
TL	- TOP OF CELLULAR SA
BL	- BASE OF CELLULAR SA
FL	- FORMATION LEVEL

STANDARD DRAINAGE NOTES

1. DO NOT SCALE FROM THIS DRAWING, REFER TO FIGURED DIMENSIONS ONLY. THE CONTRACTOR SHOULD CHECK ALL DIMENSIONS ON SITE.
2. ALL DIMENSIONS IN MILLIMETRES AND ALL LEVELS ARE IN METERS UNLESS NOTED OTHERWISE.
3. THIS DRAWING SHOULD BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT ARCHITECT AND ENGINEERING DETAILS, DRAWINGS AND SPECIFICATIONS.
4. ANY DISCREPANCIES SHOULD BE REPORTED TO THE ARCHITECT AND/OR ENGINEER IMMEDIATELY, SO THAT CLARIFICATION CAN BE SOUGHT PRIOR TO THE COMMENCEMENT OF WORK.
5. BEFORE COMMENCING CONSTRUCTION THE CONTRACTOR MUST CHECK THE INVERT LEVELS OF EXISTING SEWERS TO WHICH CONNECTIONS ARE MADE. IN ADDITION THE CONTRACTOR MUST LOCATE AND DETERMINE INVERT LEVELS OF THE EXISTING SPURS TO WHICH CONNECTIONS ARE PROPOSED. ANY DISCREPANCIES ARE TO BE NOTIFIED TO THE ENGINEER IMMEDIATELY, PRIOR TO CONSTRUCTION.
6. ALL DRAINAGE WORKS SHOULD COMMENCE AT THE PROPOSED DOWNSTREAM CONNECTION POINT, THE WORKS CONTINUING UPSTREAM FOLLOWING CONFIRMATION OF THE TIE-IN INVERT LEVELS TO THE ENGINEER. CONNECTIONS TO MANHOLES OR LARGER SIZED PIPES ETC. SHOULD BE SOFFIT TO SOFFIT UNLESS OTHERWISE INSTRUCTED BY THE ENGINEER, IF THIS IS NOT POSSIBLE INFORM THE ENGINEER IMMEDIATELY.
7. COVER LEVELS SHOWN ARE APPROXIMATE. COVERS AND FRAMES SHALL BE SET TO FINISHED GROUND LEVELS AND FALLS.
8. ALL UN-REFERENCED PIPES ARE TO BE 100mm DIA
9. ALL PIPES TO BE ADOPTED, OR CONNECTING TO ADOPTED SEWERS, TO BE VITRIFIED CLAY TO BS EN 295 AND BS65 (SWS ONLY), OR CONCRETE PIPES TO BE EN 1916 AND BS5911:PART 1.
10. ROAD GULLY OUTLET PIPES ARE TO BE 150mm DIA. WITH CONCRETE SURROUND AND FLEXIBLE JOINTS. ALL GULLIES SHALL BE FITTED WITH GRADE D400 GRATINGS AND FRAMES TO BS EN124, UNLESS OTHERWISE STATED.
11. ALL ADOPTABLE SEWERS SHALL BE CONSTRUCTED TO THE STANDARDS AND SPECIFICATION LAID DOWN DOWN IN 'SEWERS FOR ADOPTION' 6th EDITION, WITH A VIEW TO ADOPTION UPON COMPLETION OF WORKS.
12. ALL PRIVATE DRAINAGE TO BE IN ACCORDANCE WITH THE BUILDING REGULATIONS APPROVED DOCUMENT PART-H, AND TO THE SATISFACTION OF THE BUILDING CONTROL INSPECTOR.
13. THE CONTRACTOR IS TO KEEP A RECORD OF ANY VARIATIONS MADE ON SITE, INCLUDING THE RELOCATION OF SEWERS OR DRAINS, SO THAT AN AS CONSTRUCTED DRAWING CAN BE PREPARED UPON COMPLETION OF THE PROJECT.
14. STUB CONNECTIONS TO ADOPTABLE MANHOLES SHALL BE MADE FROM VITRIFIED CLAY AND CONSIST OF TWO ROCKER PIPES LAID AT THE SAME GRADIENT AS THE UP OR DOWNSTREAM PIPE.
15. IF ANY SUB SOIL DRAINAGE SYSTEMS ARE UNCOVERED DURING THE WORKS CONTACT THE ENGINEER FOR INSTRUCTIONS. SUB SOIL DRAINS ARE TO BE DIVERTED AROUND NEW WORKS AND CONNECTED INTO THE SURFACE WATER.
16. NO PRIVATE AREAS ARE TO DRAIN ONTO ADOPTABLE AREAS AND VICE VERSA.
17. ALL EXISTING MANHOLE COVER'S, GULLIES, ETC, ARE TO BE RAISED/LOWERED TO SUIT NEW LEVELS.
18. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO CONFIRM THE LOCATION AND DEPTH OF ALL EXISTING SERVICES AND UTILITIES THAT MAY BE PRESENT
19. UPON COMPLETION BUT PRIOR TO HANDOVER, CONTRACTOR TO CARRY OUT FULL CCTV SURVEY OF DRAINAGE SYSTEM WHICH IS TO BE REVIEWED BY ENGINEER TO ENSURE SATISFACTORY INSTALLATION
20. MANHOLE AND CHAMBER COVER GRADES:

- 'A15' IN ALL LANDSCAPED AREAS AND ON FOOTPATHS
- 'B125' IN ALL DRIVEWAYS
- 'C250' IN PRIVATE PARKING AREAS
- 'D400' IN CARRIAGEWAY/ACCESS ROAD

Prefixed to drawing numbers shall signify the following:-

PL = PLANNING	**Shall not be used for contract or construction purposes**
P = PRELIMINARY	**Shall not be used for contract or construction purposes**
T = TENDER	**Shall not be used for construction purposes**
C = CONSTRUCTION	These are the only drawings that shall be used for construction purposes
R = RECORD	Record of actual completed work

REV	DATE	DESCRIPTION	BY	CHK	APP
PL4	29.10.24	REVISED TO SUIT HDC COMMENTS	LH	CS	CS
PL3	10.10.24	REVISED TO SUIT HDC COMMENTS	LH	CS	CS
PL2	12.09.24	REVISED TO SUIT CLIENTS COMMENTS	LH	CS	CS
PL1	21.08.24	REVISED SITE LOCATION PLAN	LH	CS	CS
P-	20.08.24	PRELIMINARY ISSUE	LH	CS	CS

cgs civils
Consulting Civil Engineers

CLIENT: RORY NIBLOCK

ARCHITECT: SLOANE & BROWN

JOB TITLE: ROSEWOOD BARN
BARNES GREEN

DRAWING TITLE: DRAINAGE STRATEGY
SHEET 1 OF 2

DRAWN	ENGINEER	CHECKED	APPROVED
LH	C SLADE	CS	CS

DATE: AUGUST 2024 — SCALE @ A1: 1:100

JOB No.	STATUS	DRAWING No.	REV.
C3089	PL	101	PL4

FOR PLANNING ONLY