


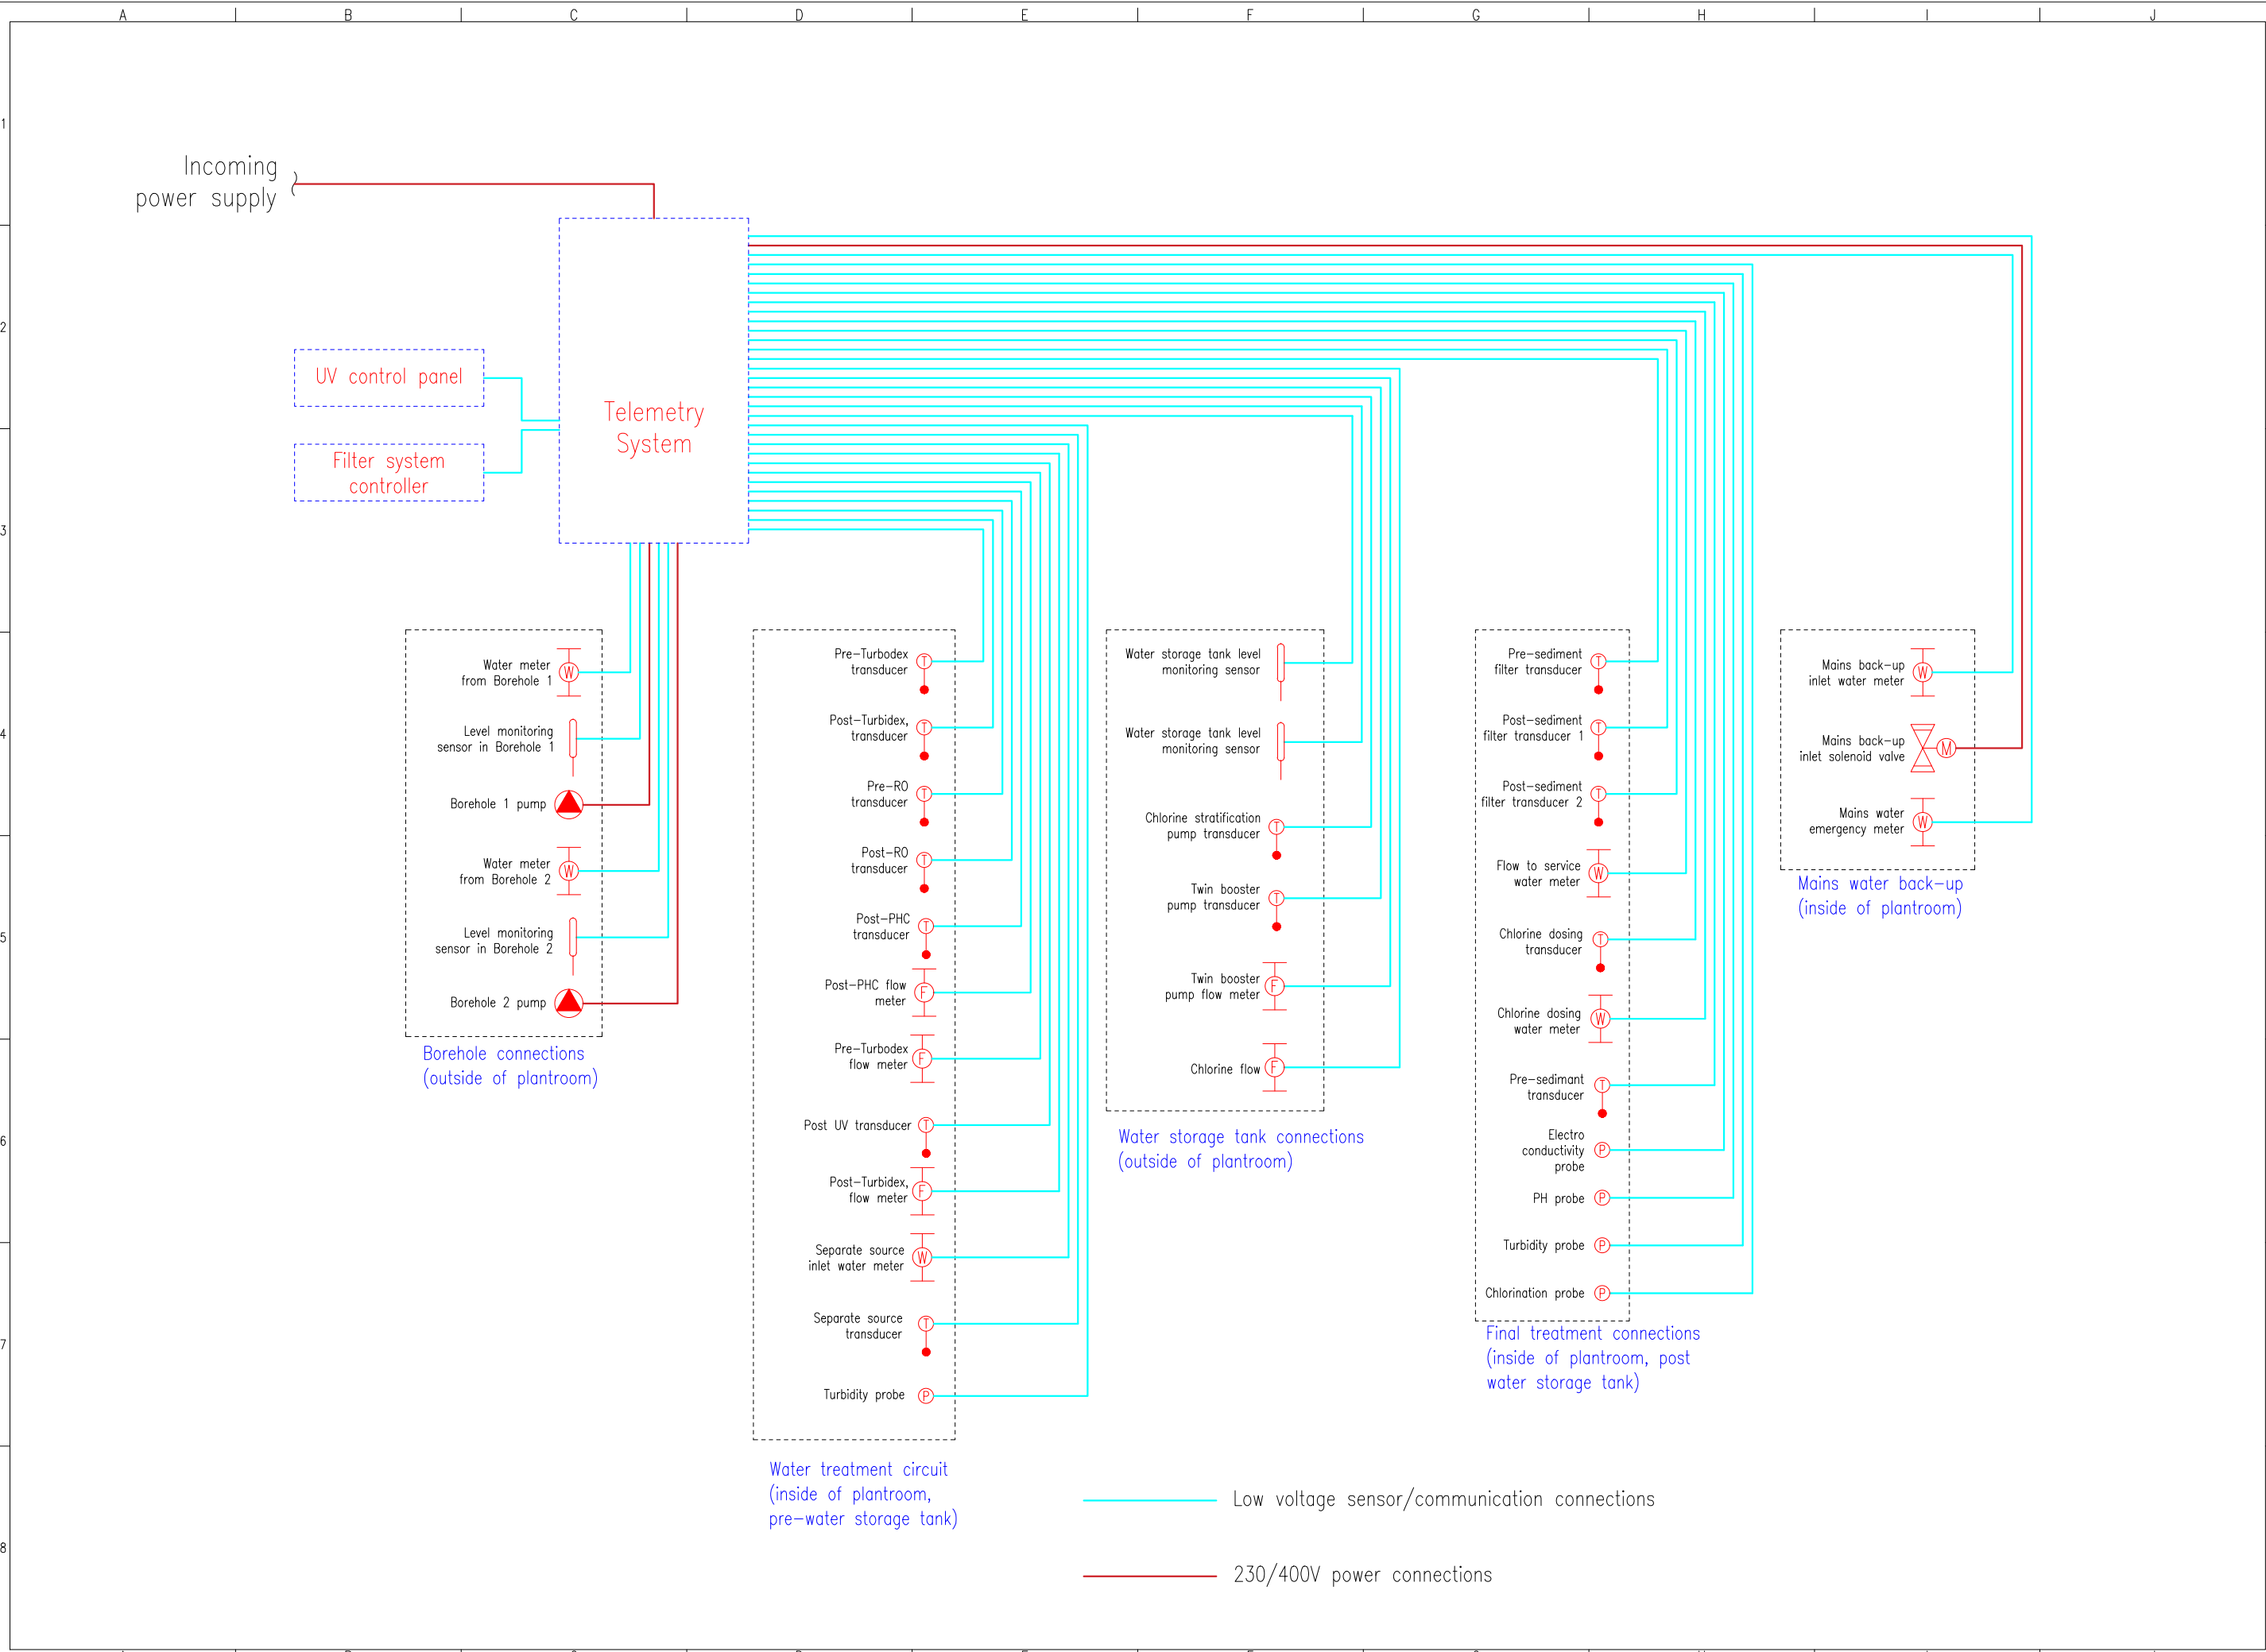

General Notes

Labour Division

Unless otherwise specified in Nicholls Bill of Quantities, all ground work, brick / block work and back filling of holes and trenches are to be priced and completed by others.

All pipe work and tanks are to be back filled with clean shingle to prevent damage to pipes.

Mains Power

Unless otherwise stated, mains power is to be provided to a IP56 Rated junction box with isolation switch at or near the plant room/borehole. All electrical connections to the mains supply as well as outlets are to be priced and completed by a qualified electrician. By others.

Water

Untreated borehole water is a category 5 supply and may harbour pathogens. A break gap of 30mm with header tank is required between the incoming mains and incoming borehole supplies.

See <http://www.wras.co.uk/> for more information.

Surface Water

Unless otherwise stated and agreed all well covers will be raised to prevent surface contamination. In some circumstances recessed covers would be acceptable but clients will need to be made aware of the risks involved.

Contractors Responsibility

It is the contractors/Clients responsibility to protect from damage any and all bespoke components installed on site by Nicholls.

Clients Responsibility

It is the clients responsibility to monitor usage and any filter equipment. This is to ensure there has been no damage by others during the surrounding works by others. Nicholls cannot be held liable for any cost incurred from damage caused by others.

Notes:

Rev001, 07/02/2024, Preliminary design
Rev002, 28/02/2024, Amendments
Rev003, 28/02/2024, Amendment

Title: BH1422 Wellcross Farm

Client: Inspired Villages

Date: 28/02/2024

Revision: Rev003

Sheet:

2 of 2

Drawn: Mr Adam Hardiman

Checked: Mr Simon Parsons

Indicative layout for design purposes only. Final position to be confirmed on site. Drawing is not to be scaled.

