from Southern Water

Horsham District Council
Parkside
Chart Way
Horsham
West Sussex
RH12 1RL

Your ref
DC/25/1205

Our ref
DSA000046901

Date
29th August 2025

Contact
Tel 0330 303 0119

Dear Sir/Madam,

Proposal: Erection of a temporary rural workers dwelling.
Site: Land West of Trickles Wood, Hole Street, Ashington, West Sussex, RH20 3DE

Thank you for your correspondence, please see our comments below regarding the above application.

Proposed soakaways

The Council's Building Control officers or technical staff should be asked to comment on the adequacy of soakaways to dispose of surface water from the proposed development. No new soakaways should be located within 5 metres of a public or adoptable gravity sewer, rising main or water main.

No Soakaways should be connected to the public surface water sewer.

Hierarchy of Building Regulations H3 for disposal of surface water - not yet provided documentation proving compliance

If the applicant has not already provided documentation demonstrating compliance with the surface water hierarchy reflected in part H3 of the Building Regulations, as shown below, we will require this to be provided where surface water is being considered for discharge to our network. Whilst reuse does not strictly form part of this hierarchy, Southern Water would encourage the consideration of reuse for new developments.

- Reuse
- Infiltration
- Watercourse
- Storm Sewer

Southern Water Services Ltd, Registered Office: Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX Registered in England No. 2366670

- Combined Sewer

Guidance on Building Regulations is here: https://www.gov.uk/government/publications/drainage-and-waste-disposal-approved-document-h

We would like to engage with you on the design for disposal of surface water for this development at the earliest opportunity and we recommend that civil engineers and landscape architects work together and with Southern Water. In many cases this may negate or reduce the need for network reinforcement and allow earlier completion of the development.

Where a surface water connection to the foul or combined sewer is being considered, this should be agreed by the Lead Local Flood Authority, in consultation with Southern Water**.**

Condition

We request that should this application receive planning approval, the following condition is attached to the consent: Construction of the development shall not commence until details of the proposed means of surface water run off disposal in accordance with Part H3 of Building Regulations hierarchy as well as acceptable discharge points, rates and volumes have been agreed by the Lead Local Flood Authority, in consultation with Southern Water.

Septic tank proposed

The Environment Agency should be consulted directly by the applicant regarding the use of a septic tank drainage which disposes of effluent to sub-soil irrigation**.**


For further advice, please contact Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX (Tel: 0330 303 0119)

Website: southernwater.co.uk or by email at: SouthernWaterPlanning@southernwater.co.uk

Yours faithfully,

Future Growth Planning Team
southernwater.co.uk/developing-building/planning-your-development

Southern Water Services Ltd, Registered Office: Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX Registered in England No. 2366670

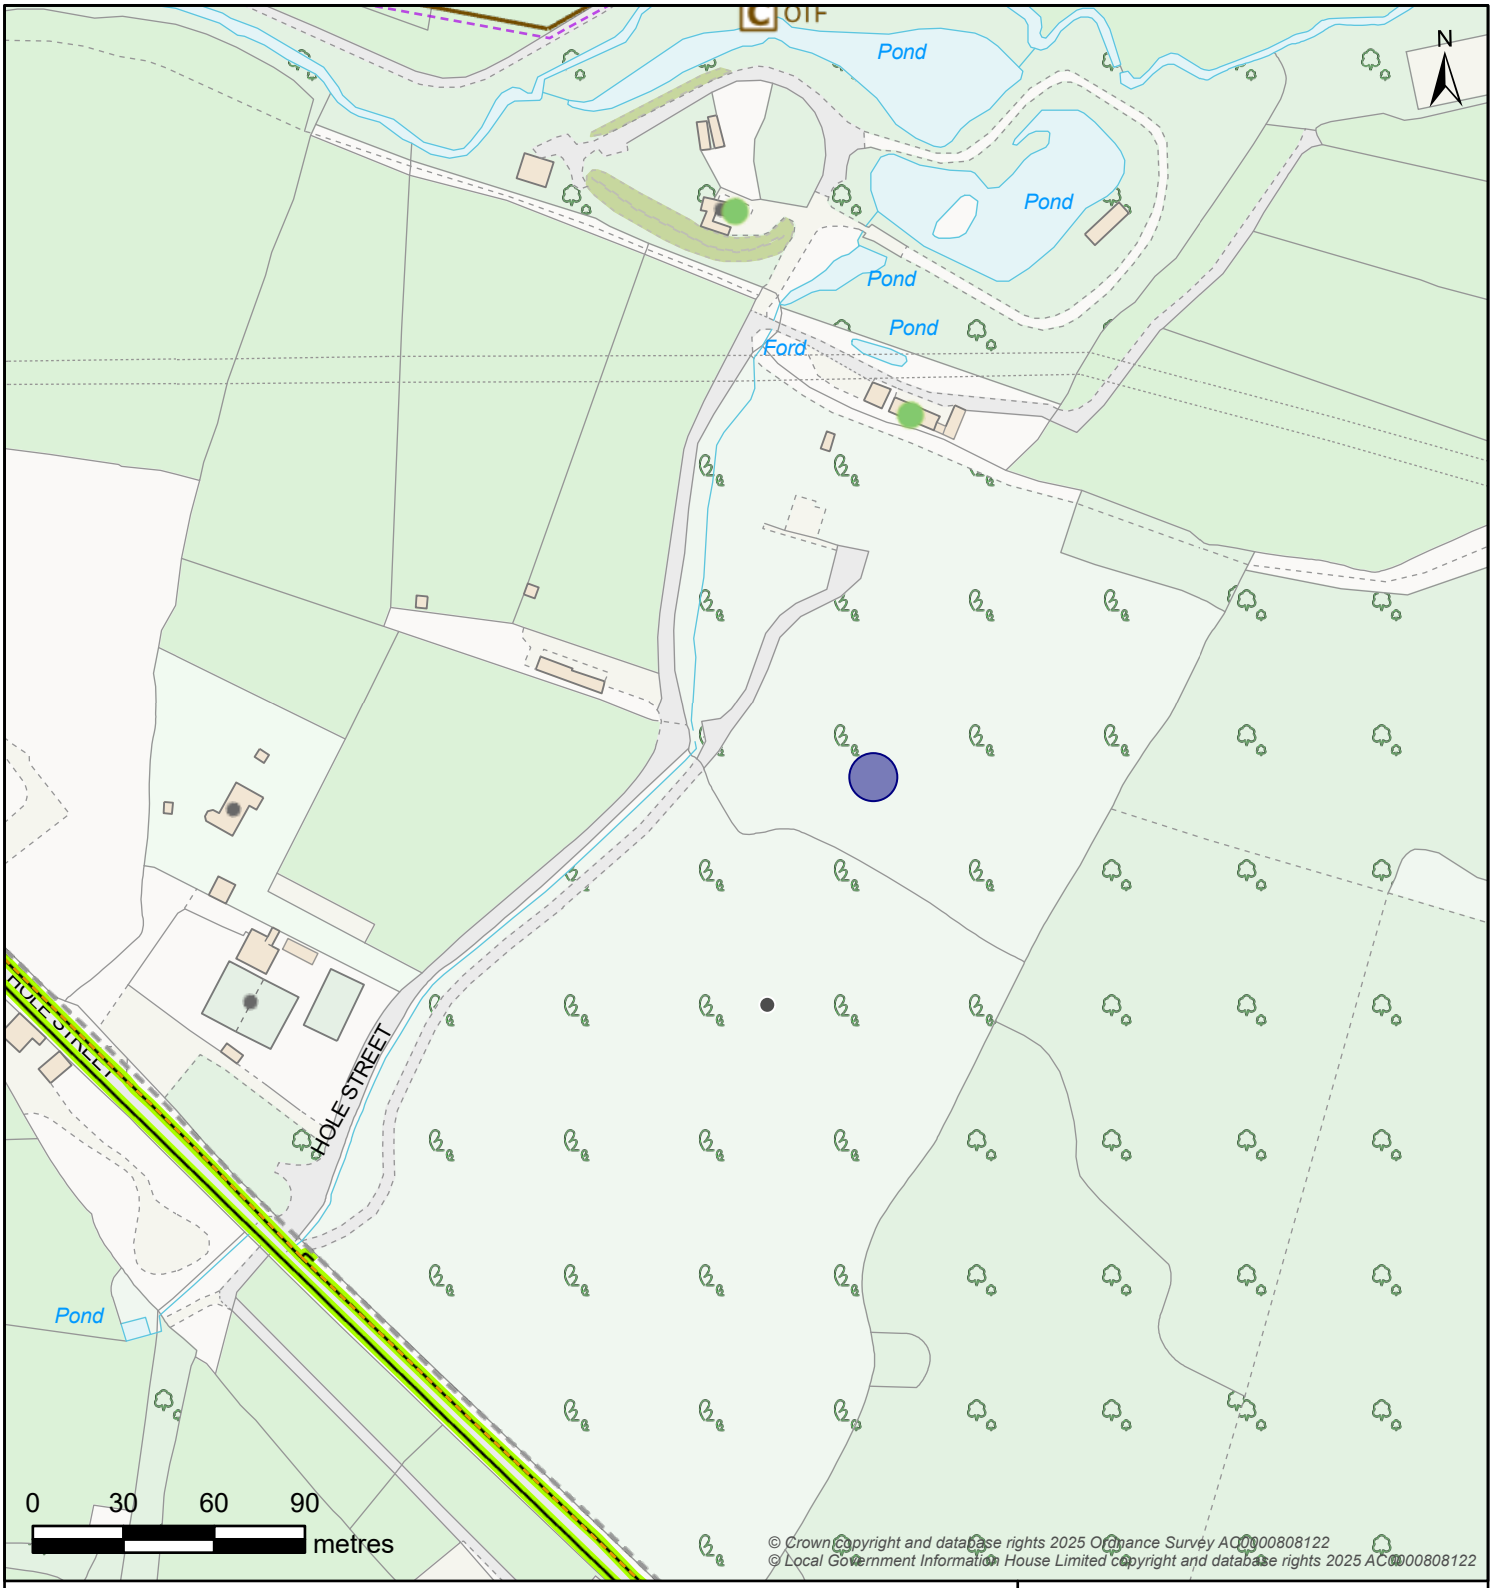

Controllable Valve			Flow Control			Inlet-Outfall	
Damboards	Penstock	Valve	Anti Flood Device	Pumped Anti Flood Device	Reflux Valve	Inlet	Outfall

Manhole											
BIF	Bifurcation	Cascade	CP	Catchpit	Head Of Public Sewer	IC	Interceptor Chamber	Manhole	S	Soakaway	WO	Washout

Outfall Headworks	Overflow Chamber		Pipe Bridge	Pumping Station	
Outfall Headworks	CSO Combined Sewer Overflow	EMO Emergency Overflow	Pipe Bridge	Micro Pumping Station	Pumping Station

Sewer Level Monitor	Storage		Treatment Works	Weir	Wastewater Site
Sewer Level Monitor	Storm Tank	Tidal Storage Tank	Treatment Works	Weir	Wastewater Site

Wastewater Pipe		Wastewater Use	Developer Services	
Culverted Water Course	Syphon	Foul	Build Over Agreement	Section 104
Drain	Tank Sewer	Combined	**Wastewater Area**	
Outfall	Trunk Sewer	Sludge	Catchment	
Overflow	Vacuum Main	Treated Effluent	Sub-Catchment	
Rising Main	Decommissioned Pipe	Surface Water		
Sewer		Private		

Map Title: SW Print

Printed By: Anne.McFarlane2

Date Printed: 29/08/2025

Map Scale: 2500

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.

WATER for LIFE from Southern Water