




bar chart 1:50

Roof lights to have emergency opening light facility.
to have min $\frac{1}{3}$ with min dimension 400. 90°
opening. Gill height min 800 Max 1100. All to
be suitably trimmed/flushed.

Concrete interlocking like Redland Pennine or other approved type on 50x25.
battens with reinforced breathable roofing felt on trussed rafters @ 600c/c
All to be manufactured lined/breathed to BS 5248. Part 3 1904. Ceiling to
be 13. plasterboard and skim. with 270. fibreglass insulation. 100. between
rafters and 170. across rafters. All to be strapped @ 2-metre centres with
30x3. MS. galv. straps. 110. h.v. gutters to 65. Run to gullies. Approx
pitch to be $37\frac{1}{2}^\circ$.

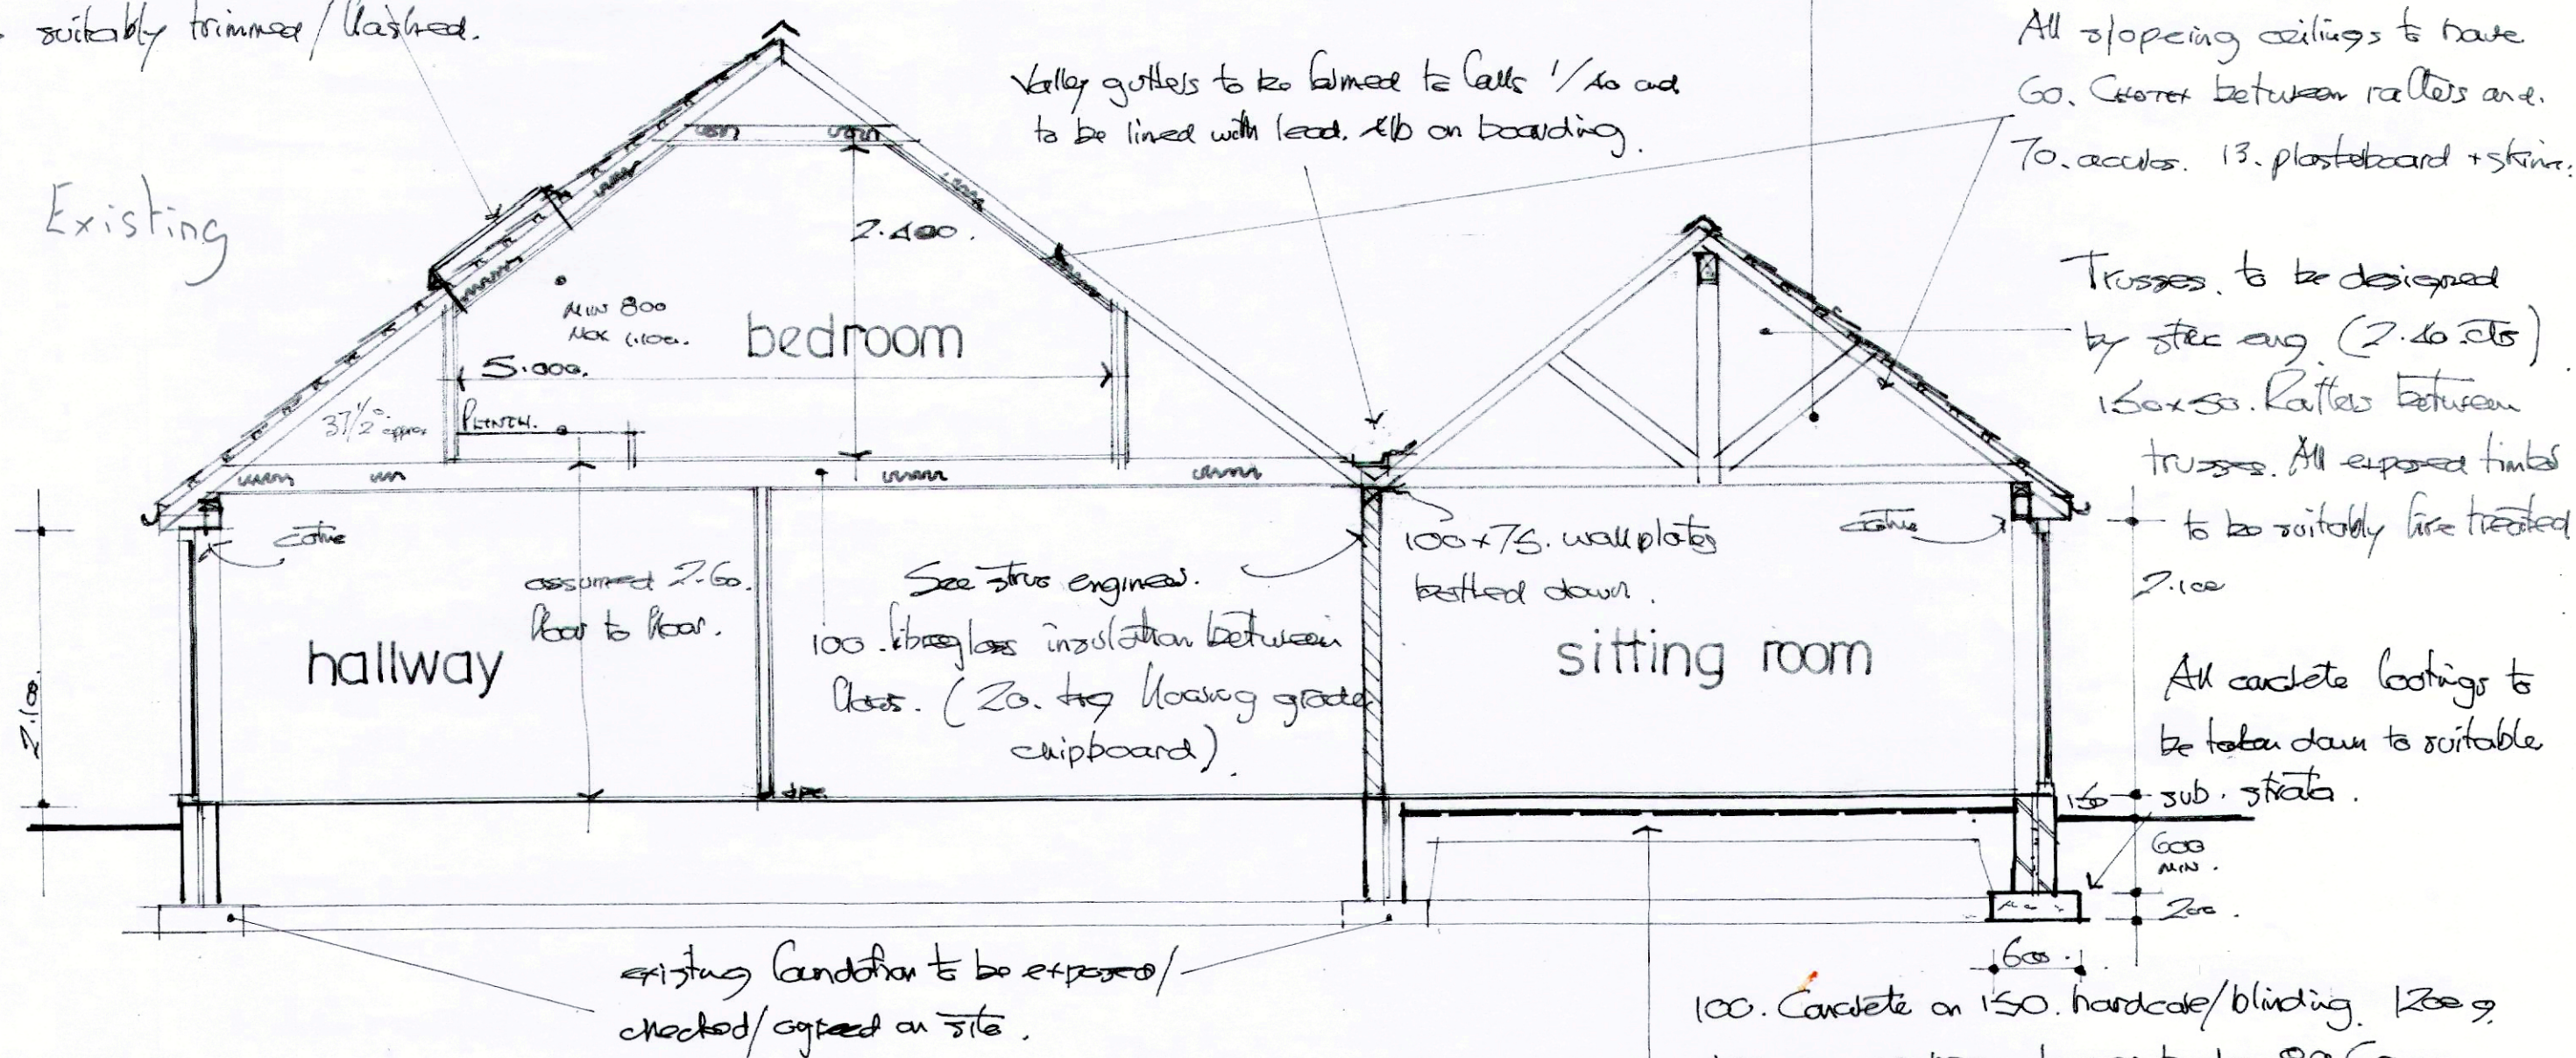

typical section

scale 1:50

5595/4a