

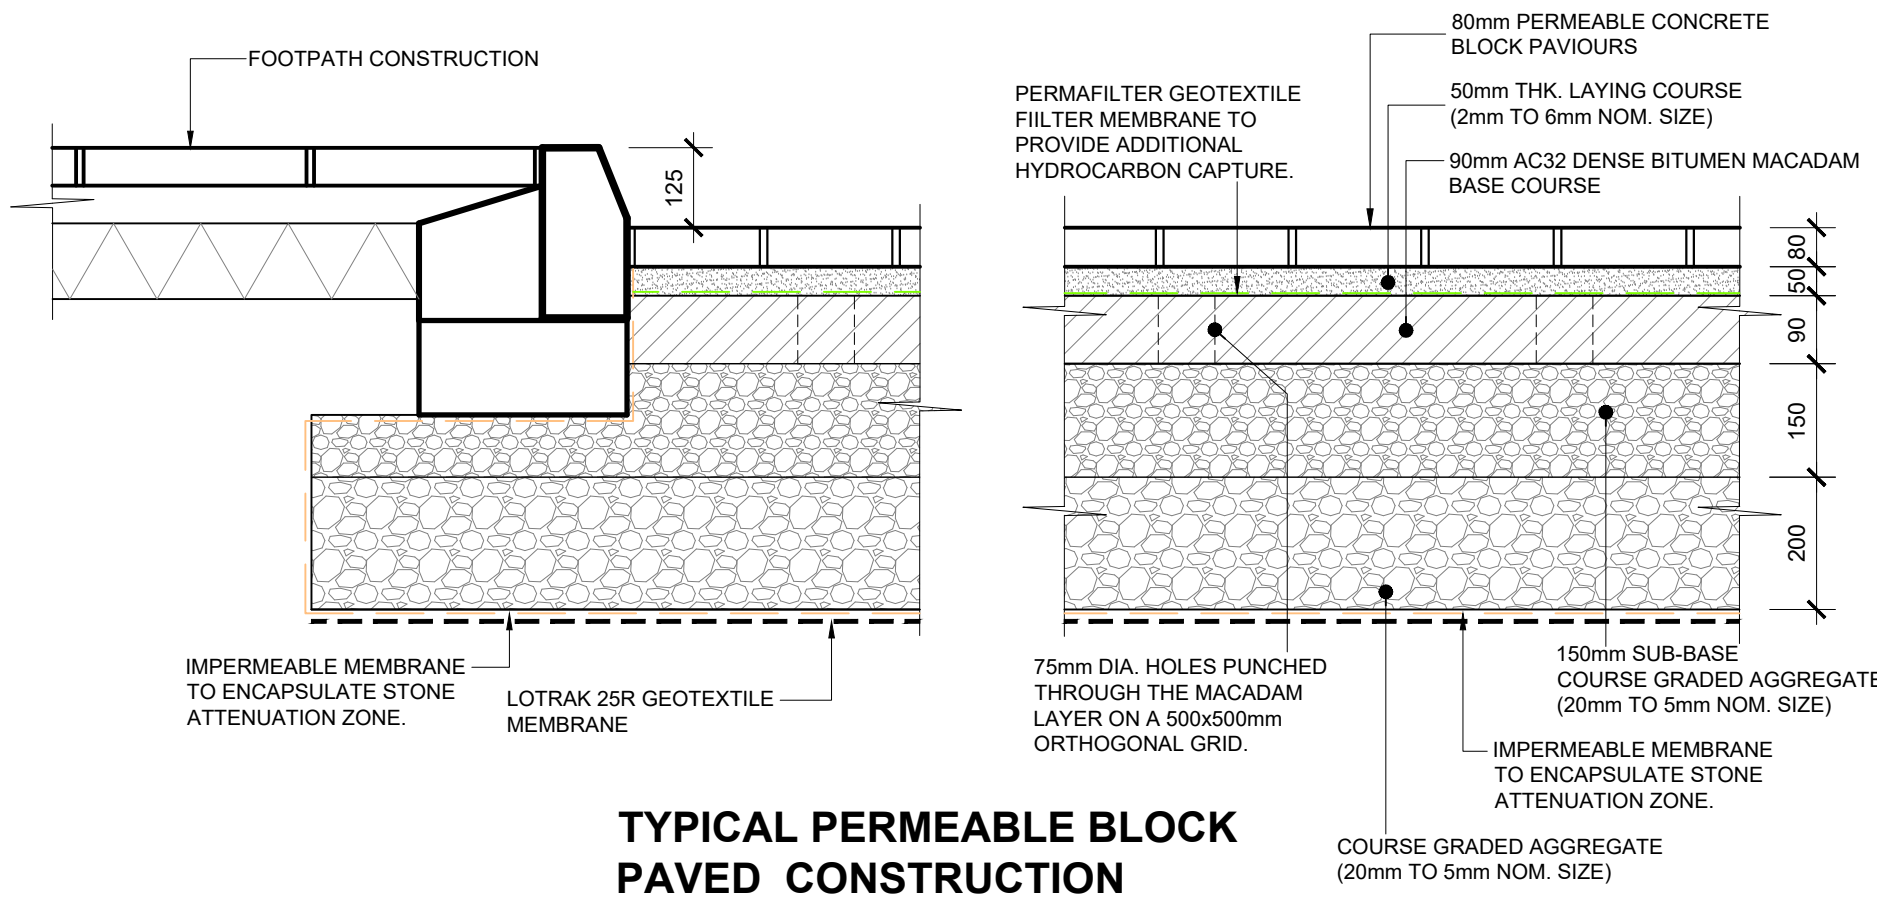


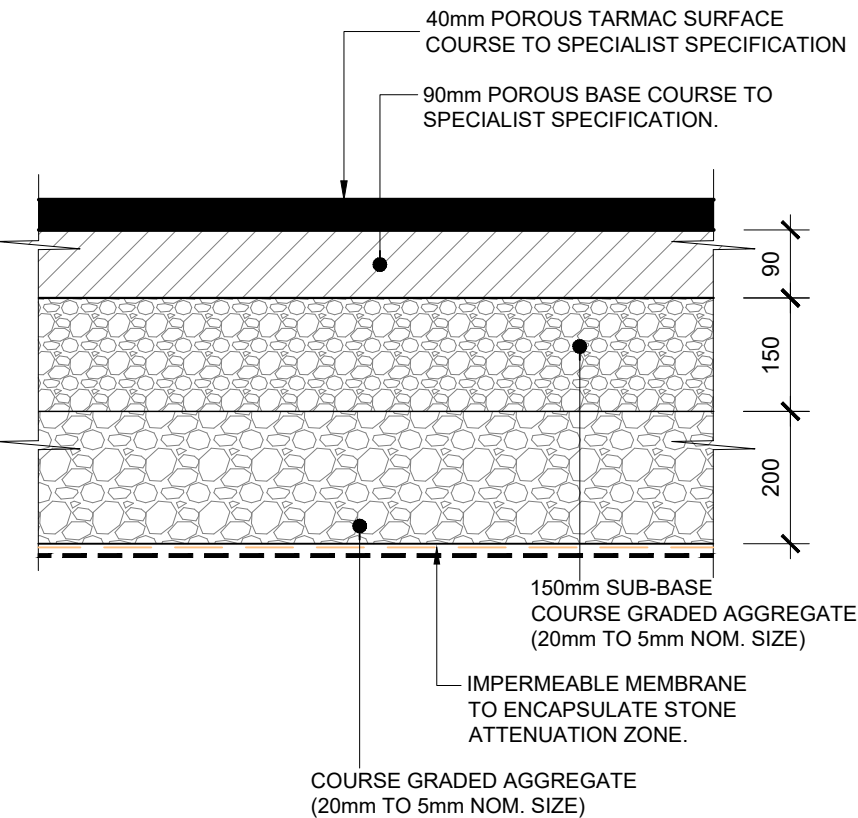


FOR LOCATION AND EXTENT OF PEDESTRIAN FOOTPATH & PATIO AREAS REFER TO ARCHITECT AND/OR LANDSCAPE CONSULTANT DRAWINGS









REQUIREMENT FOR GEOTEXTILE MEMBRANE TO BE REVIEWED ON SITE IN RELATION TO CONDITION AND EXPOSURE OF EXISTING SUB-GRADE, CONSTRUCTION TRAFFIC ROUTES AND PROGRAM OF WORKS.

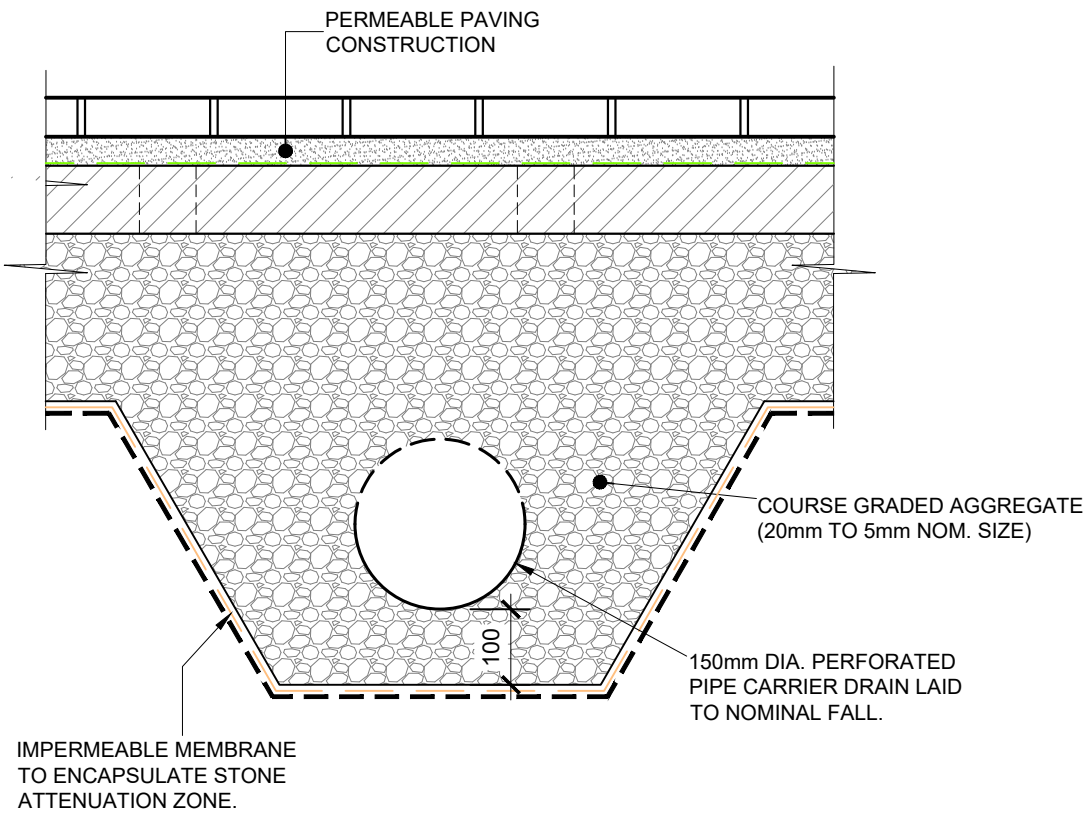

CONSTRUCTION BUILD-UPS INDICATED RELATE TO THE REQUIREMENTS IN THE FINAL/PERMANENT CONDITION & DO NOT ACCOUNT FOR TEMPORARY HAUL ROADS, LAY DOWN AREAS, CRANE OUTRIGGER LOADS, HEAVY CONSTRUCTION TRAFFIC TO SUIT CONTRACTORS PROGRAMME, LOGISTICS & CONSTRUCTION MANAGEMENT PLAN (CMP). CONTRACTOR TO ALLOW FOR ADDITIONAL TARMACADAM BASE COURSE AS NECESSARY TO SUIT THEIR CMP.

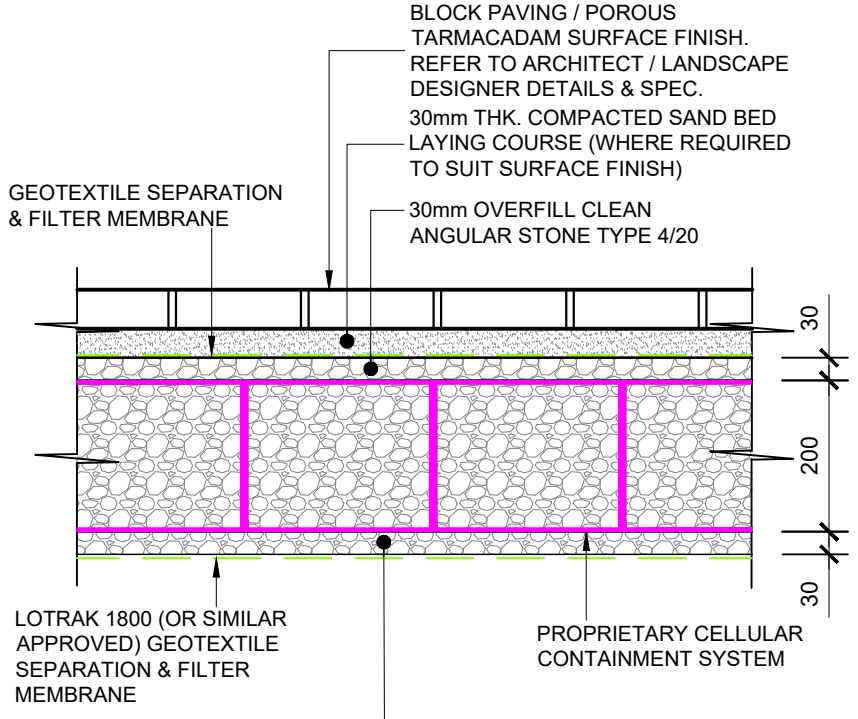

DETAIL IS INDICATIVE ONLY & SUBJECT TO DESIGN FROM CONTRACTORS PREFERRED SPECIALIST SUPPLIER.

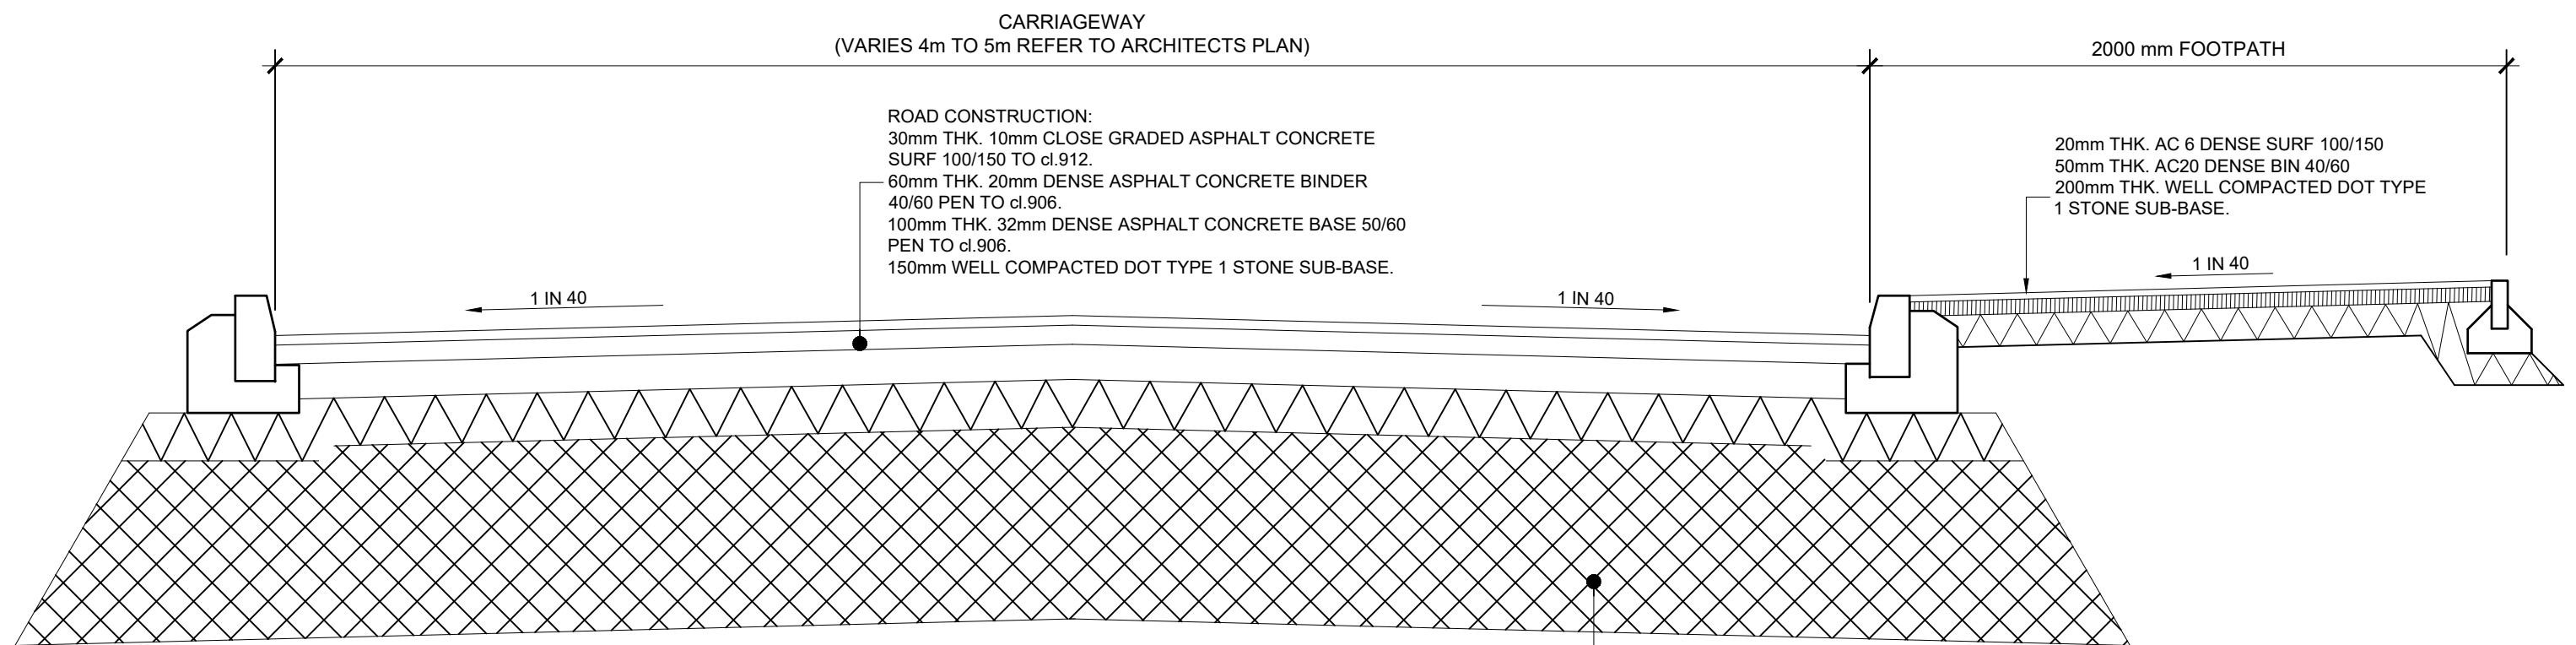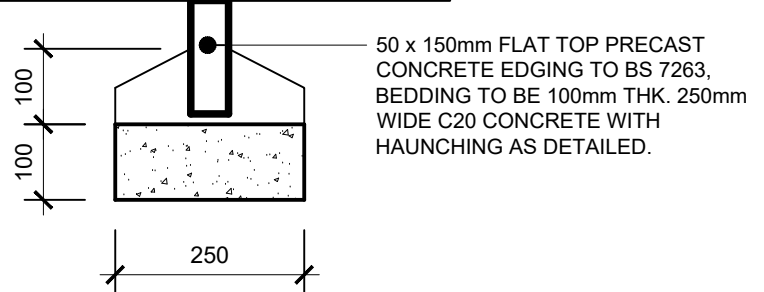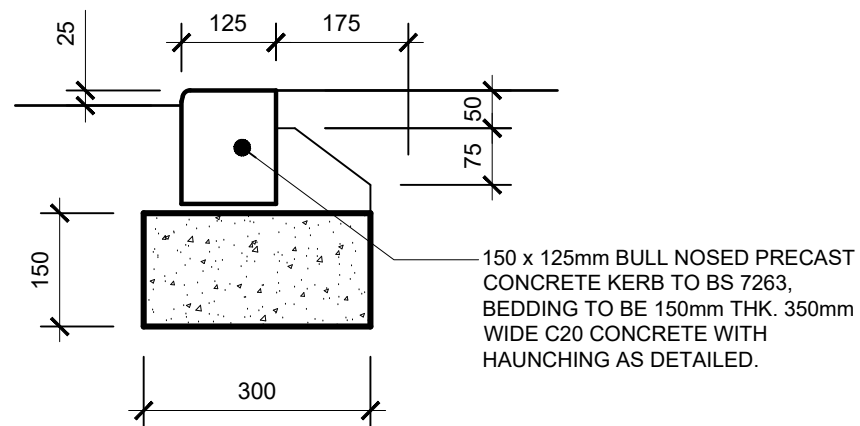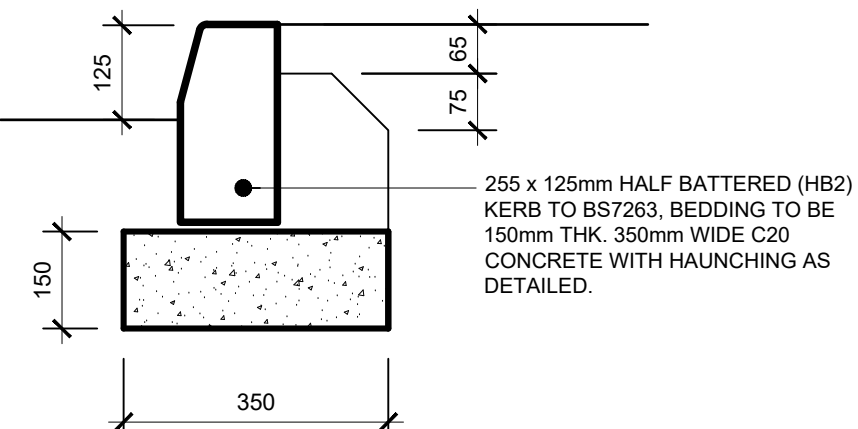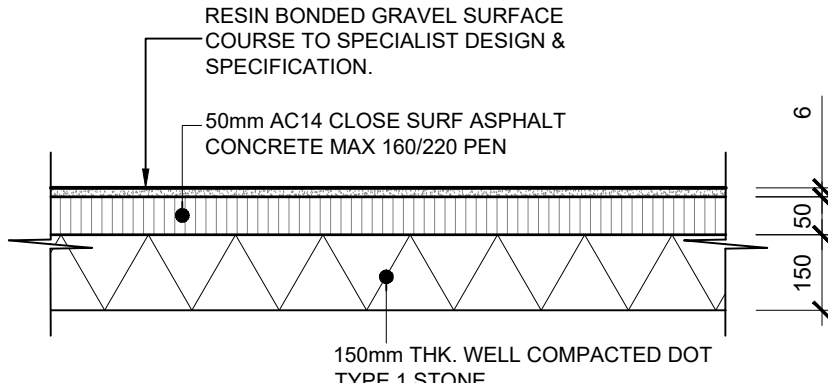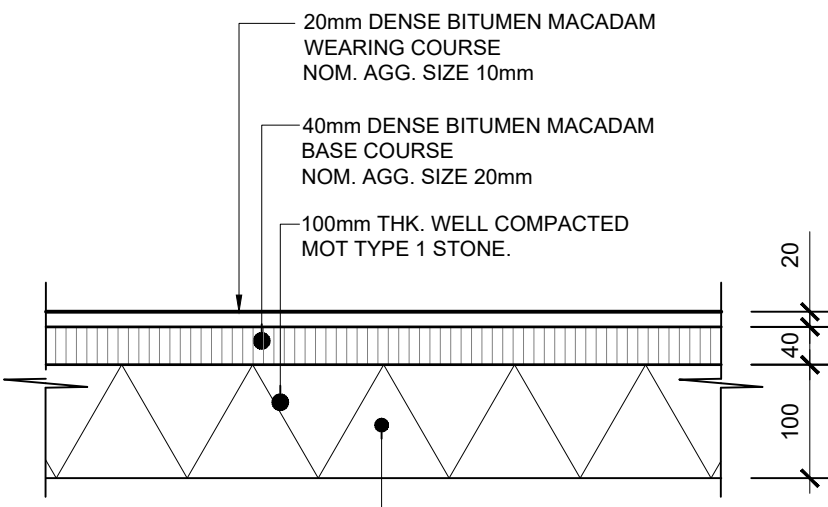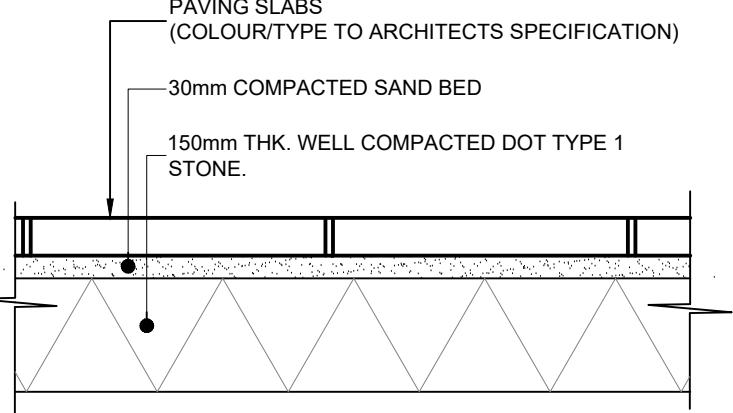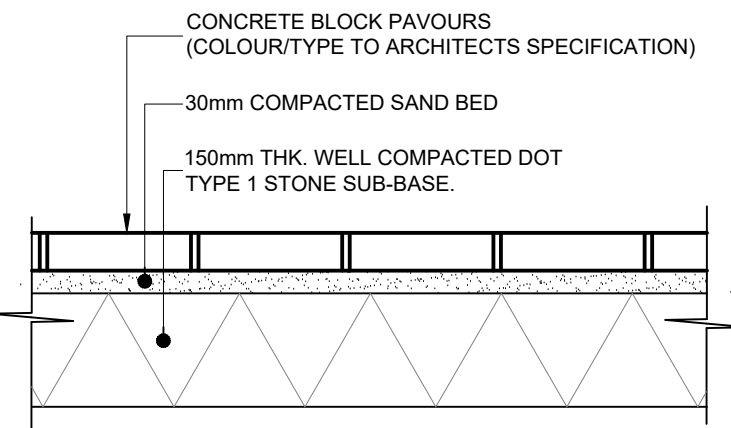

* THICKNESS OF CAPPING LAYER TO BE DETERMINED ON SITE BASED ON RESULTS OF CBR TESTS. (DETAILS ASSUME CBR TEST RESULTS OF 2-2.5%)

* 800mm CAPPING LAYER IN MAX 150mm WELL COMPACTED LAYERS. CLASS 6F1/6F2 (SITE WON) OR 6F4/6F5 (IMPORTED)

CONSTRUCTION

C1	MJC	04.08.20	CONSTRUCTION (PLANNING)
P1	MJC	26.08.20	PRELIMINARY TENDER
REV	INITIALS	DATE	DETAIL
STATUS			
CAMERON DARROCH ASSOCIATES			
CONSULTING CIVIL AND STRUCTURAL ENGINEERS			
KESTREL BUSINESS CENTRE, PRIVATE ROAD No. 2, COLWICK, NOTTINGHAM, NG4 2JR			
TEL: 0115 9400631 FAX: 0115 9400645			
E-MAIL: structures@darroch-engineering.co.uk			
CLIENT		JOB NO	
BARCHESTER		CDA-2651	
PROJECT		DRG NO	
CARE HOME, WORTHING ROAD, HORSHAM		05	
TITLE		REVISION	C1
		SCALE	1:10 @ A1
		DATE	JULY 2026
		DRAWN BY	MJC
		CHKD	SEL