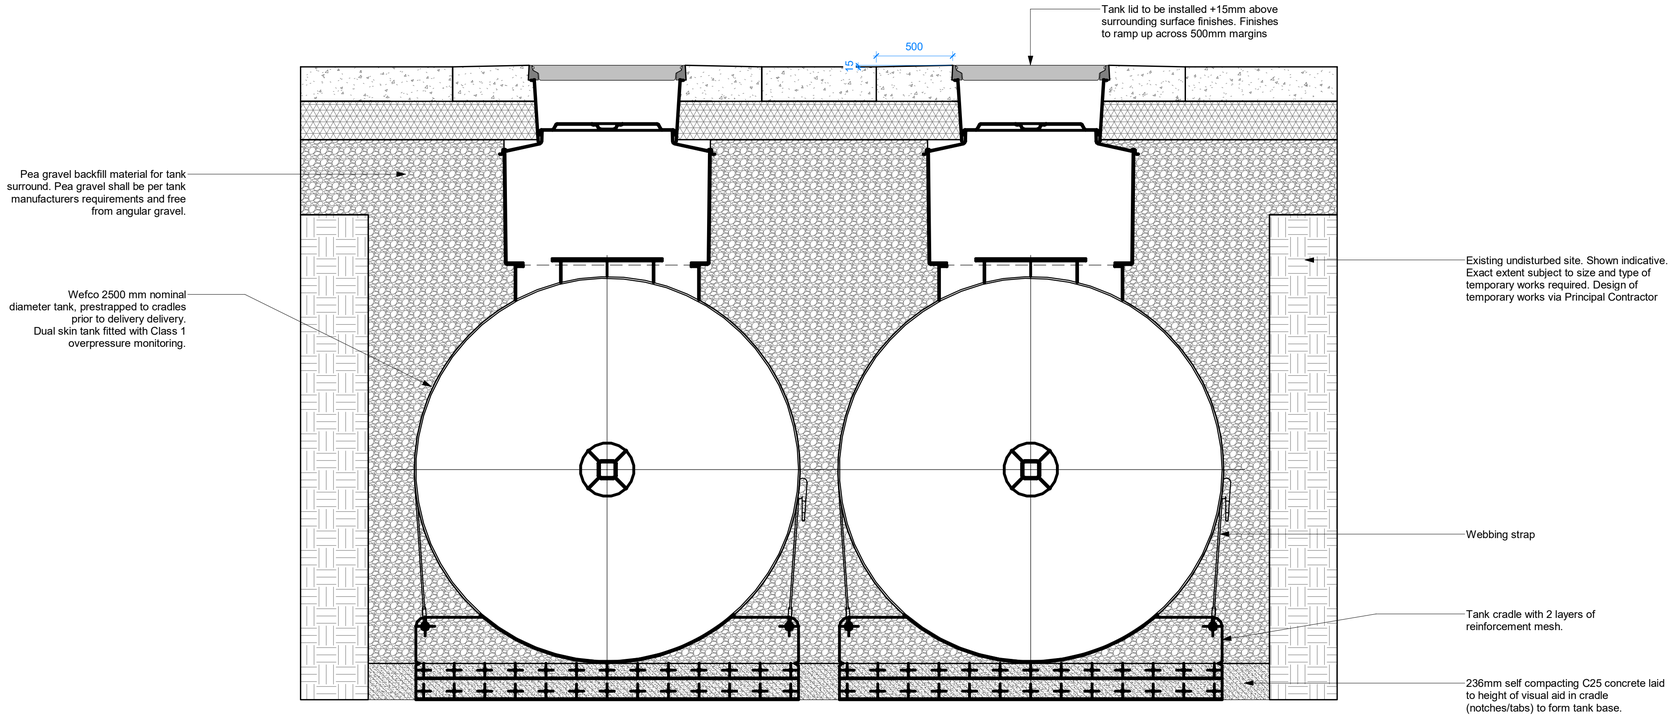

Tank Installation Levels (1:20)

Tank Installation Notes:

1. All tanks shall be installed at the same level.
2. Webbing straps shall always be used, pre-installed by tank manufacturer.
3. Tank shall be installed level.
4. Cradle and strap specification and spacing shall be by tank manufacturer. Straps and ratchets should be capable of resisting an uplift of 10,000Kg.
5. See also standard drawing UKF20, UKF42 &UKF60.

0 200 400 600 800 1000
SCALE mm
1: 20

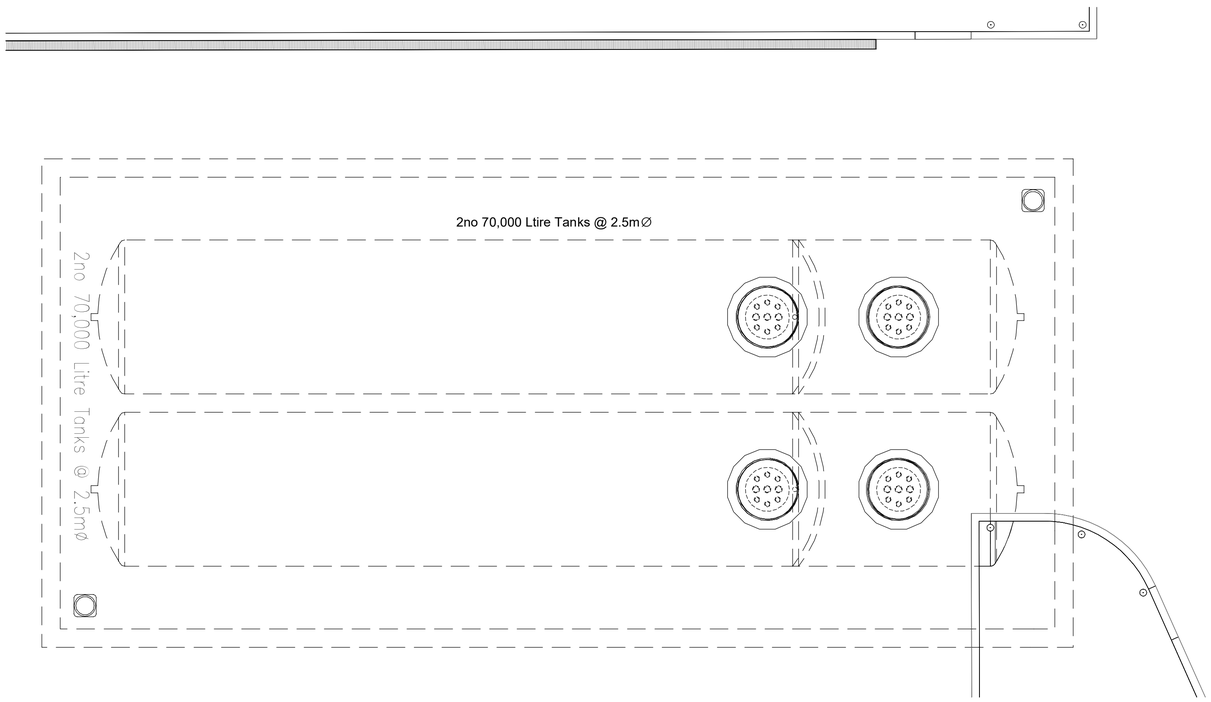

0 0.5 1 1.5 2 2.5
SCALE m
1: 50

Proposed Tank Farm
1 : 50

A	Tank size increase	25/03/25	GL	DB
	Revision	Date	By	Chk

All dimensions to be verified on site, and the Architect informed of any discrepancy. All drawings and specifications should be read in conjunction with the Health and Safety Plan; all conflicts should be reported to the appointed Principal Designer.

Esso Petroleum Company Limited
Horsham Express
Redkiln Way, Horsham, West Sussex, RH13 5QN

Sheet Name: Proposed Tank Details

Purpose of issue: Planning **Status:**

Date: 09/01/25 **Checked by:** DB

Drawn by: GL **Scale @ A1:** As indicated

Project No: A1026

ESSO pbl No: 201548 **Revision:** A

Drawing No : 025P

BOWMANRILEY
ARCHITECTS • BUILDING CONSULTANTS • INTERIORS

Do not scale from this drawing. This drawing is the copyright of Bowman Riley Architects Limited. ©
P:\Architecture\Energy\A1026 - Esso - Horsham Express T&L\A1026 - 08 Revit\SS\Horsham Site Model Planning non material amendment.rvt