



Horsham District Council
Parkside
Chart Way
Horsham
West Sussex
RH12 1RL

Your ref
DC/26/0649

Our ref
DSA000054096

Date
21st May 2026

Contact
Tel 0330 303 0119

Dear Sir/Madam,

Proposal: Erection of a front and side extension

Site address: Oakleigh Surgery High Street Partridge Green West Sussex RH13 8HX

If using the existing connections, Southern Water has determined that the flow rate for the above site will remain consistent, so capacity is not an issue, and no Southern Water assets will be affected. Therefore, Southern Water has no objections to this proposal. Please note surface water should not be disposed of into a public foul sewer and must comply with the Hierarchy of H3 of the Building Regulations. For more details, refer to the Drainage and Waste Disposal: Approved Document H on the GOV.UK website. Any new connections to the public sewerage system will require a New Sewer Connection application (also known as a Section 106) to be submitted and approved by Southern Water. Due to legislative changes effective from 1st October 2011 regarding the ownership of sewers, it is possible that some previously private sewers, now deemed public, could be crossing the above property and may not be shown on Southern Water records. Therefore, if any additional sewers are discovered during construction, an investigation will be required to determine their condition, the number of properties served, and potential access methods before any further work can proceed on site.

If not,

Insufficient Information provided:

Condition:

Construction of the development shall not commence until details of the proposed means of foul/surface water drainage disposal have been submitted to, and approved in writing by the Local Planning Authority in consultation with Southern Water.

S106 Connection application:

Any new connections to the public sewerage system will require a Section 106 connection application to be submitted and approved by Southern Water Services.

To make an application visit Southern Water's Get Connected service:

<https://developerservices.southernwater.co.uk> and please read our New Connections Charging Arrangements documents which are available on our website via the following link:
<https://www.southernwater.co.uk/developing-building/connection-charging-arrangements>

Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX
[southernwater.co.uk](https://www.southernwater.co.uk)

Southern Water Services Ltd, Registered Office: Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX Registered in England No. 2366670



Please note that, where there are separate systems available Southern Water will not allow surface water to connect into the public foul sewer. If this is not possible, please provide evidence that all other options have been explored.


We request that should this planning application receive planning approval, the following informative is attached to the consent: Construction of the development shall not commence until details of the proposed means of foul sewerage and surface water disposal have been submitted to and approved in writing by the Local Planning Authority in consultation with Southern Water.


It is possible that a sewer now deemed to be public could be crossing the development site. Therefore, should any sewer be found during construction works, an investigation of the sewer will be required to ascertain its ownership before any further works commence on site. If this happens, please call our Customer Service Desk on 0330 303 0119.

Website: southernwater.co.uk or by email at: SouthernWaterPlanning@southernwater.co.uk

Yours faithfully,

Future Growth Planning Team southernwater.co.uk/developing-building/planning-your-development

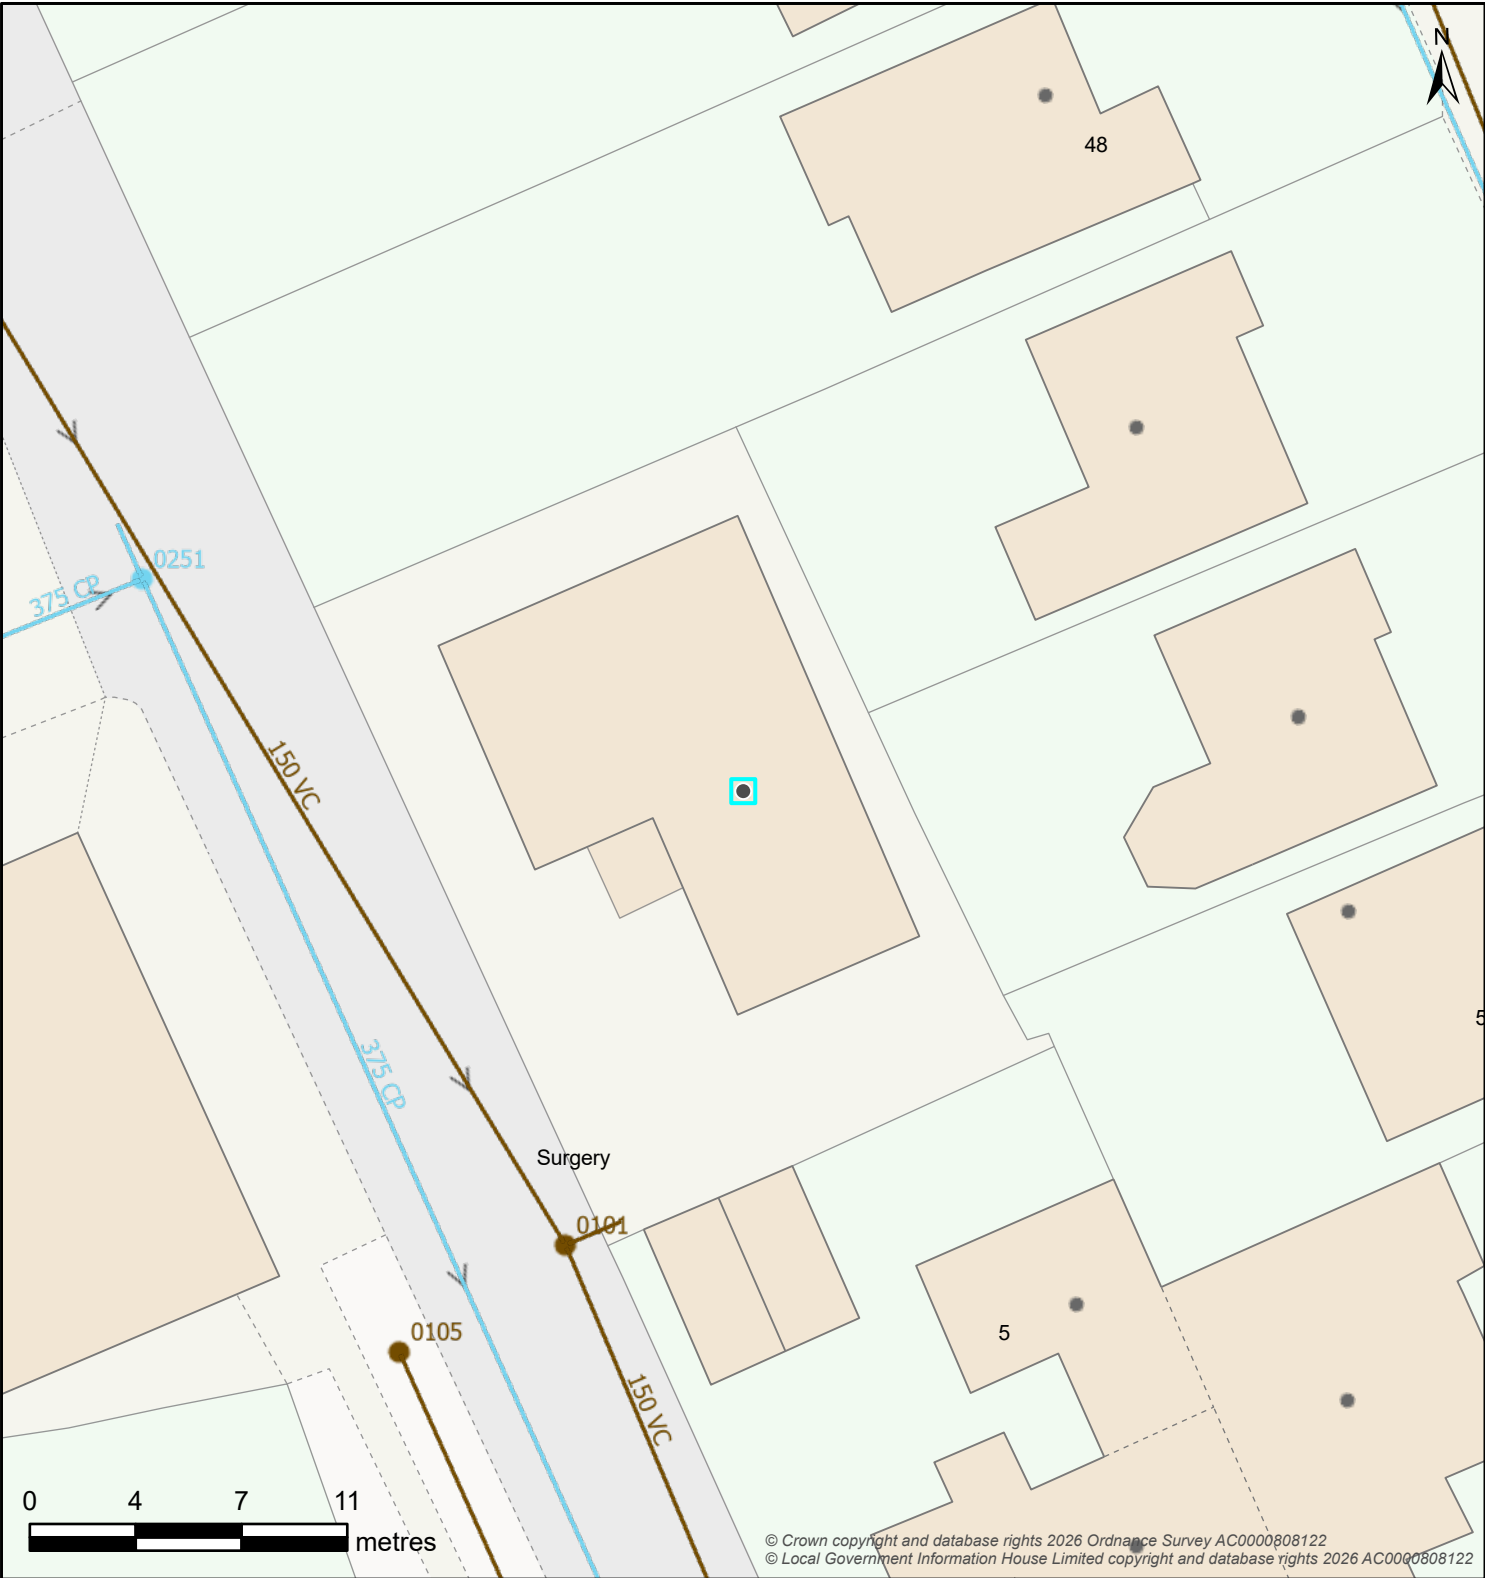

Boundary Box		Break Pressure Tank		Capped End		Hydrant		
 Boundary Box	 Break Pressure Tank	 Capped End	 Emptying Plug	 Fire Hydrant	 Washout Hydrant			
Pressure Monitoring		Service Reservoir		Meter		Valve - Controllable		
 Logger	 Covered	 Tower	 Meter	 Open Valve	 Closed Valve	 Stop Tap		
Site			Valve - Flow					
 Abstraction Point	 Supply Works	 Air Valve	 Non-Return Valve	 Washout Empty Valve				
 Booster Station	 Transfer Station	Valve - Pressure			Pipe Bridge			
 Surface Reservoir	 Underground Source	 Pressure Reducing Valve	 Pressure Sustaining Valve	 Pipe Bridge				
Water Pipe			Water Area					
 Communication	 Trunk	 Decommissioned	 Water Supply Zone			 District Meter Area		
 Distribution	 Raw	 Discolouration						
 Non-Potable	 Private							

Map Title: SW Print

Printed By: Isaac.Vowles
Date Printed: 21/05/2026
Map Scale: 250

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.

