



Horsham District Council
Parkside
Chart Way
Horsham
West Sussex
RH12 1RL

Your ref
DC/26/1274

Our ref
DSA000057185

Date
8th September 2026

Contact
Tel 0330 303 0119

Dear Sir/Madam,

Proposal: Demolition of existing buildings and erection of apartment building, together with associated refuse and bike storage and landscaping.

Site address: Reflections Hair and Sunbed Centre 37 London Road Pulborough West Sussex

Thank you for your correspondence, please see our comments below regarding the above application

Insufficient Information provided:

Condition:

Construction of the development shall not commence until details of the proposed means of surface water drainage disposal have been submitted to, and approved in writing by the Local Planning Authority in consultation with Southern Water.

Proposed works involve demolition:

In order to protect and safeguard the existing water supply apparatus, Southern Water requests formal notification of any proposed demolition works prior to such works being undertaken.

Connection to public sewer - capacity available desktop study under 50:

Southern Water has undertaken a desktop study of the area, and our investigations indicate that Southern Water can facilitate foul sewerage /surface water run off disposal to service the proposed development. Southern Water requires a formal application for a connection to the public sewer to be made by the applicant or developer.

To make an application visit Southern Water's Get Connected service:

<https://developerservices.southernwater.co.uk> and please read our New Connections Charging Arrangements documents which are available on our website via the following link:

<https://www.southernwater.co.uk/developing-building/connection-charging-arrangements>

We request that should this planning application receive planning approval, the following informative is attached to the consent: Construction of the development shall not commence until details of the proposed means of foul sewerage and surface water disposal have been submitted to, and approved in writing by the Local Planning Authority in consultation with Southern Water.

SuDS:

The supporting documents make reference to drainage using Sustainable Drainage Systems (SuDS). Where SuDS form part of a continuous sewer system, and are not an isolated end of pipe SuDS component, adoption of SuDS will be considered if requested by the developer if they comply with: Design and Construction Guidance (Appendix C), CIRIA guidance and Southern Water SuDS Guidance available here:

<https://www.water.org.uk/sewerage-sector-guidance-approved-documents/>

<https://www.ciria.org/ItemDetail?iProductCode=C753F&Category=FREEPUBS>

<https://www.southernwater.co.uk/media/l4ndl3db/suds-final-080824.pdf>

Where SuDS rely upon facilities which are not adoptable by sewerage undertakers the applicant will need to ensure that arrangements exist for the long-term maintenance of the SuDS facilities. It is critical that the effectiveness of these systems is maintained in perpetuity. Good management will avoid flooding from the proposed surface water system, which may result in the inundation of the foul sewerage system.

Thus, where a SuDS scheme is to be implemented, the drainage details submitted to the Local Planning Authority should:

- Specify the responsibilities of each party for the implementation of the SuDS scheme.
- Specify a timetable for implementation.
- Provide a management and maintenance plan for the lifetime of the development.

This should include the arrangements for adoption by any public authority or statutory undertaker and any other arrangements to secure the operation of the scheme throughout its lifetime.

This initial assessment does not prejudice any future assessment or commit to any adoption agreements under Section 104 of the Water Industry Act 1991.

Tree Planting:

We have restrictions on the proposed tree planting adjacent to Southern Water sewers, rising mains or water mains. Reference should be made to Southern Water's publication "A Guide to Tree Planting near water Mains and Sewers"

(https://www.southernwater.co.uk/media/pddob0vn/ds-tree-planting-guide-1_nwm.pdf) and the

Sewerage Sector Guidance (<https://www.water.org.uk/sewerage-sector-guidance-approved-documents/>) with regards to any landscaping proposals and our restrictions and maintenance of tree planting adjacent to sewers, rising mains and water mains.

Condition:

'In order to protect public apparatus, Southern Water requests that if consent is granted, the following pre commencement condition is attached to the planning permission; The developer must advise the local authority (in consultation with Southern Water) of the landscaping proposals in proximity of public apparatus in order to protect it in accordance with Southern Water's guidance, prior to the commencement of the development.

Connection to water distribution main:

Our investigations indicate that Southern Water can facilitate water supply to service the proposed development. Southern Water requires a formal application for a connection to the water supply to be made by the applicant or developer.

To make an application visit Southern Water's Get Connected service:

<https://developerservices.southernwater.co.uk> and please read our New Connections Charging Arrangements documents which are available to read on our website via the following link www.southernwater.co.uk/developing-building/connection-charging-arrangements

Existing Southern Water Assets – General within boundary but no tree, buildings, assets within standoff distance (approximate):

Please see the attached extract from Southern Water records showing the approximate position of our existing sewer and water main assets crossing/in the vicinity of the development site. The exact position of the public assets must be determined on site by the applicant in consultation with Southern Water before the layout of the proposed development is finalised. To get in contact to confirm the exact position of the asset please visit;

https://www.southernwater.co.uk/media/ph4fk3pe/ds-location-of-rising-mains_pb.pdf.

For information on required stand off distances from public sewers please refer to:

<https://www.southernwater.co.uk/media/st5orjvm/stand-off-distances.pdf>

Existing Gravity Sewer - tree, buildings, assets within stand-off distance:

The 225 mm diameter gravity sewer requires a clearance of 3 metres on either side of the gravity sewer to protect it from construction works and to allow for future maintenance access.

No development or tree planting should be carried out within 3 metres of the external edge of the public gravity sewer without consent from Southern Water. All existing infrastructure should be protected during the course of construction works. Please refer to:

<https://www.southernwater.co.uk/media/st5orjvm/stand-off-distances.pdf>

Condition:

In order to protect public sewers, Southern Water requests that if consent is granted, the following condition is attached to the planning permission; The developer must agree with Southern Water, prior to commencement of the development, the measures to be taken to protect the public sewers

It is possible that a sewer now deemed to be public could be crossing the development site. Therefore, should any sewer be found during construction works, an investigation of the sewer will be required to ascertain its ownership before any further works commence on site. If this happens, please call our Customer Service Desk on 0330 303 0119.


For further assistance, please contact Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX (TEL: 0330 303 0119)

Website: southernwater.co.uk or by email at: SouthernWaterPlanning@southernwater.co.uk

Yours faithfully,

Future Growth Planning Team
Developer Services

[Southernwater.co.uk/developing-building/planning-your-development](https://southernwater.co.uk/developing-building/planning-your-development)

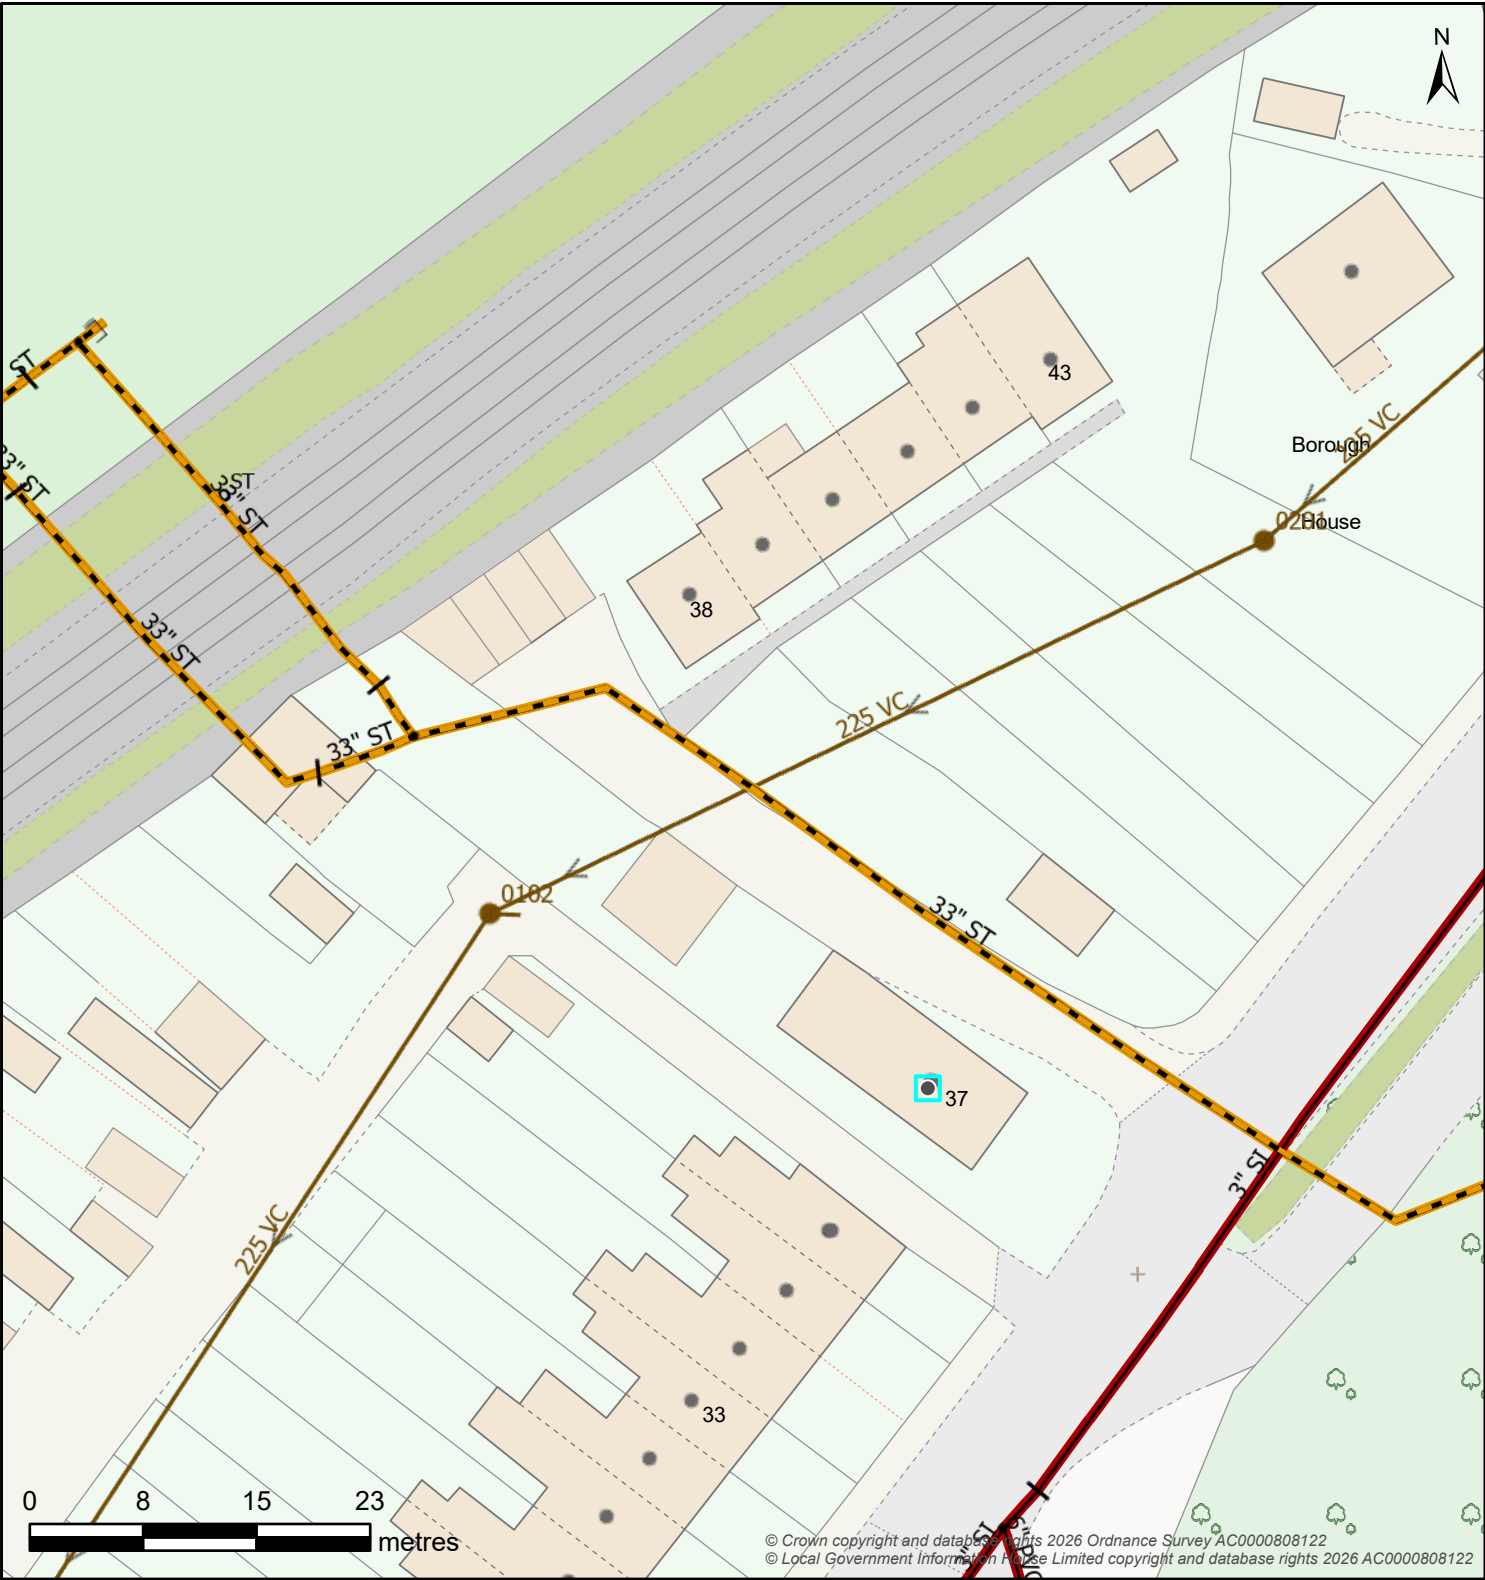

Map Title: SW Print

Printed By: Isaac.Vowles
Date Printed: 09/09/2026
Map Scale: 500

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.



Controllable Valve			Flow Control			Inlet-Outfall	
Damboards	Penstock	Valve	Anti Flood Device	Pumped Anti Flood Device	Reflux Valve	Inlet	Outfall
Manhole							
BIF Bifurcation	Cascade	CP Catchpit	Head Of Public Sewer	IC Interceptor Chamber	Manhole	S Soakaway	WO Washout
Outfall Headworks		Overflow Chamber		Pipe Bridge		Pumping Station	
Outfall Headworks	CSO Combined Sewer Overflow	EMO Emergency Overflow	Pipe Bridge	Micro Pumping Station	Pumping Station		
Sewer Level Monitor		Storage		Treatment Works		Weir	
Sewer Level Monitor	Storm Tank	Tidal Storage Tank	Treatment Works	Weir	Wastewater Site		
Wastewater Pipe				Wastewater Use		Developer Services	
Culverted Water Course	Syphon	Tank Sewer	Trunk Sewer	Foul	Combined	Build Over Agreement	Section 104
Drain	Vacuum Main	Decommissioned Pipe	Sewer	Sludge	Treated Effluent	Catchment	Sub-Catchment
Outfall				Surface Water			
Overflow				Private			
Rising Main							