from Southern Water

Directorate of Planning
Horsham District Council
Parkside
Chart Way
Horsham
West Sussex
RH12 1RL

Your ref
DC/24/0833

Our ref
DSA000035090

Date
27 June 2024

Contact
Tel 0330 303 0119

Dear Sir/Madam,

Proposal: Erection of a single storey side extension, replacement conservatory, and extension of 1.8m high timber fence.
Site: DC/24/0833: - 18 Stoneybrook, Horsham, West Sussex, RH12 1UN.

Thank you for your letter dated 10 June 2024.

Following the review of the submitted documents, we have the below comments for the Planning consultation.

Protection of Public Apparatus

It appears that the developer is intending to build-over a public foul sewer which is crossing the site. Building over a “public sewer” is not normally permitted by Southern Water. An investigation of the sewer is required to confirm its size and depth, ascertain its condition, number of properties served and potential means of access before any decision can be made as to whether it would be acceptable for Southern Water to allow building-over the sewer.

The length of sewer to be built over under the terms of Part H of the Building Regulations dictates that the matter is determined by the sewerage undertaker, which in this case is Southern Water. The conditions and application associated with the build-over a public sewer are available at Southern Water's Get Connected service: developerservices.southernwater.co.uk

It is possible that a sewer now deemed to be public could be crossing the development site. Therefore, should any sewer be found during construction works, an investigation of the sewer will be required to ascertain its ownership before any further works commence on site.

In order to protect drainage apparatus, Southern Water requests that if consent is granted, the following condition is attached to the planning permission; prior to the commencement of development, the developer must advise the local authority, in consultation with Southern Water, of measures which will be undertaken to protect the public sewers.

Southern Water Services Ltd, Registered Office: Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX Registered in England No. 2366670

Foul and Surface Water Drainage

Southern Water requires a formal application for any new connection to the public sewer to be made by the applicant or developer.

To make an application visit Southern Water's Get Connected service: developerservices.southernwater.co.uk and please read our New Connections Charging Arrangements documents which are available on our website via the following link: southernwater.co.uk/developing-building/connection-charging-arrangements

In situations where surface water is being considered for discharge to our network, we require the below hierarchy for surface water to be followed which is reflected in part H3 of the Building Regulations. Whilst reuse does not strictly form part of this hierarchy, Southern Water would encourage the consideration of reuse for new developments.

- Reuse

- Infiltration

- Watercourse

- Storm Sewer

- Combined Sewer

Guidance on Building Regulations is here:
gov.uk/government/publications/drainage-and-waste-disposal-approved-document-h

For further advice, please contact Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX (Tel: 0330 303 0119).

Website: southernwater.co.uk or by email at: SouthernWaterPlanning@southernwater.co.uk

Yours faithfully,

Future Growth Planning Team
Developer Services

southernwater.co.uk/developing-building/planning-your-development

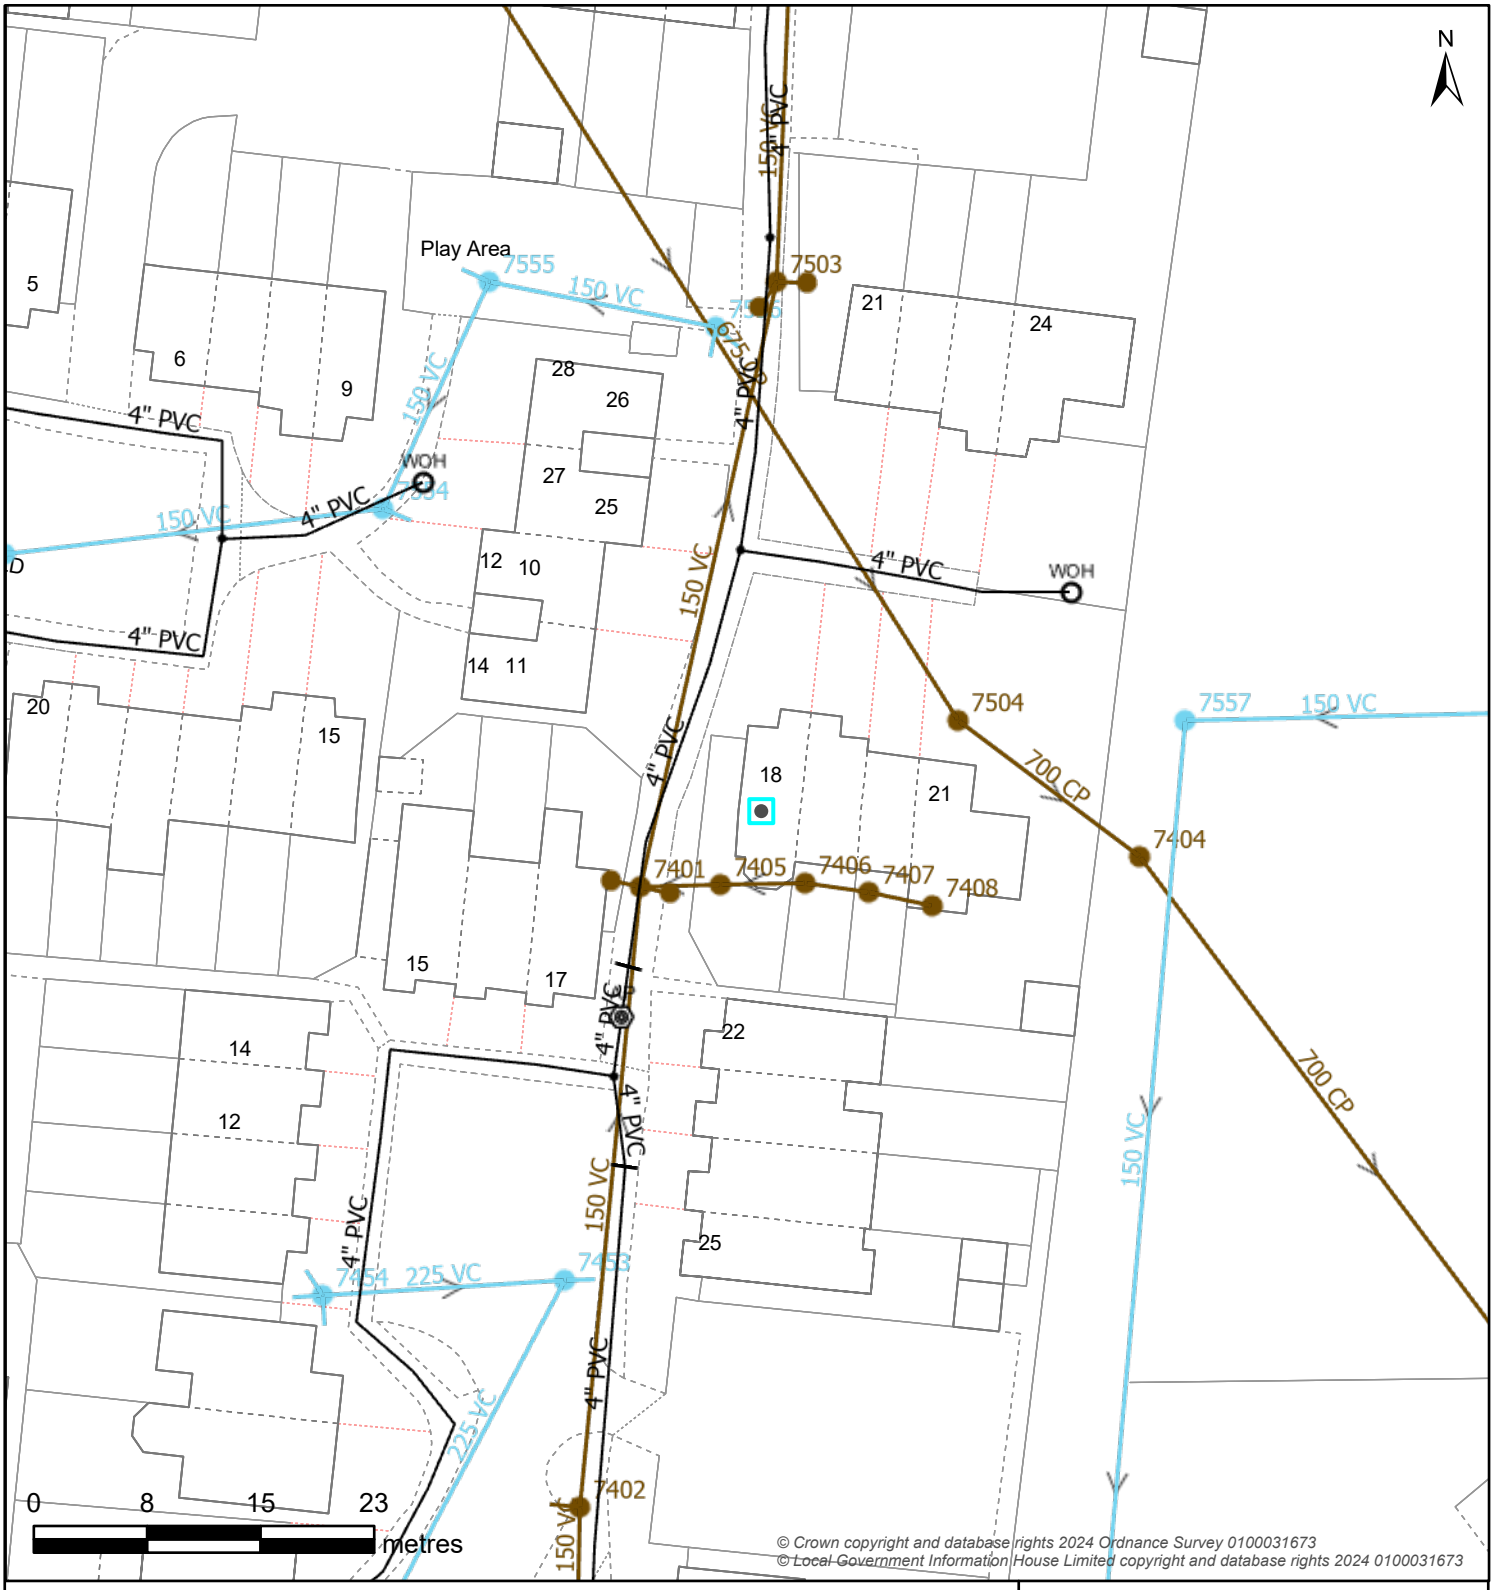

© Crown copyright and database rights 2024 Ordnance Survey 0100031673
© Local Government Information House Limited copyright and database rights 2024 0100031673

Controllable Valve			Flow Control			Inlet-Outfall	
Damboards	Penstock	Valve	Anti Flood Device	Pumped Anti Flood Device	Reflux Valve	Inlet	Outfall

Manhole											
BIF	Bifurcation	Cascade	CP	Catchpit	Head Of Public Sewer	IC	Interceptor Chamber	Manhole	S	Soakaway	WO	Washout

Outfall Headworks	Overflow Chamber		Pipe Bridge	Pumping Station	
Outfall Headworks	CSO Combined Sewer Overflow	EMO Emergency Overflow	Pipe Bridge	Micro Pumping Station	Pumping Station

Sewer Level Monitor	Storage		Treatment Works	Weir	Wastewater Site
Sewer Level Monitor	Storm Tank	Tidal Storage Tank	Treatment Works	Weir	Wastewater Site

Wastewater Pipe		Wastewater Use	Developer Services	
Culverted Water Course	Syphon	Foul	Build Over Agreement	Section 104
Drain	Tank Sewer	Combined	**Wastewater Area**	
Outfall	Trunk Sewer	Sludge	Catchment	
Overflow	Vacuum Main	Treated Effluent	Sub-Catchment	
Rising Main	Decommissioned Pipe	Surface Water		
Sewer		Private		

Map Title: GIS

Printed By: Shamil.Abdul

Date Printed: 26/06/2024

Map Scale: 500

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.

WATER for LIFE from Southern Water