from Southern Water

Directorate of Planning
Horsham District Council
Parkside
Chart Way
Horsham
West Sussex
RH12 1RL

Your ref
DC/23/1619

Our ref
DSA000029443

Date
18 December 2023

Contact
[redacted]

Dear Sir/Madam,

Proposal: Variation of condition 1 on previously approved application DC/21/1986 (Demolition of existing storage annex, erection of a single storey side extension to west elevation. Loft Conversion with installation of dormer windows to existing roof. Erection of a two-storey extension to east elevation and a two-storey link and change of use to extend the residential curtilage) Relating to amendments to plan, including alterations to fenestration, elevations and height.
Site: DC/23/1619: - Newlands, Frylands Lane, Wineham, Henfield, West Sussex, BN5 9BS.

Thank you for your letter dated 27 November 2023.

Southern Water has no objections to the above variation of condition 1. The comments in our response dated 26 October 2021 remain unchanged and valid.

For further advice, please contact Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX [redacted]

Website: southernwater.co.uk or by email at: [redacted]

Yours faithfully,

Future Growth Planning Team
Developer Services

southernwater.co.uk/developing-building/planning-your-development

Southern Water Services Ltd, Registered Office: Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX Registered in England No. 2366670

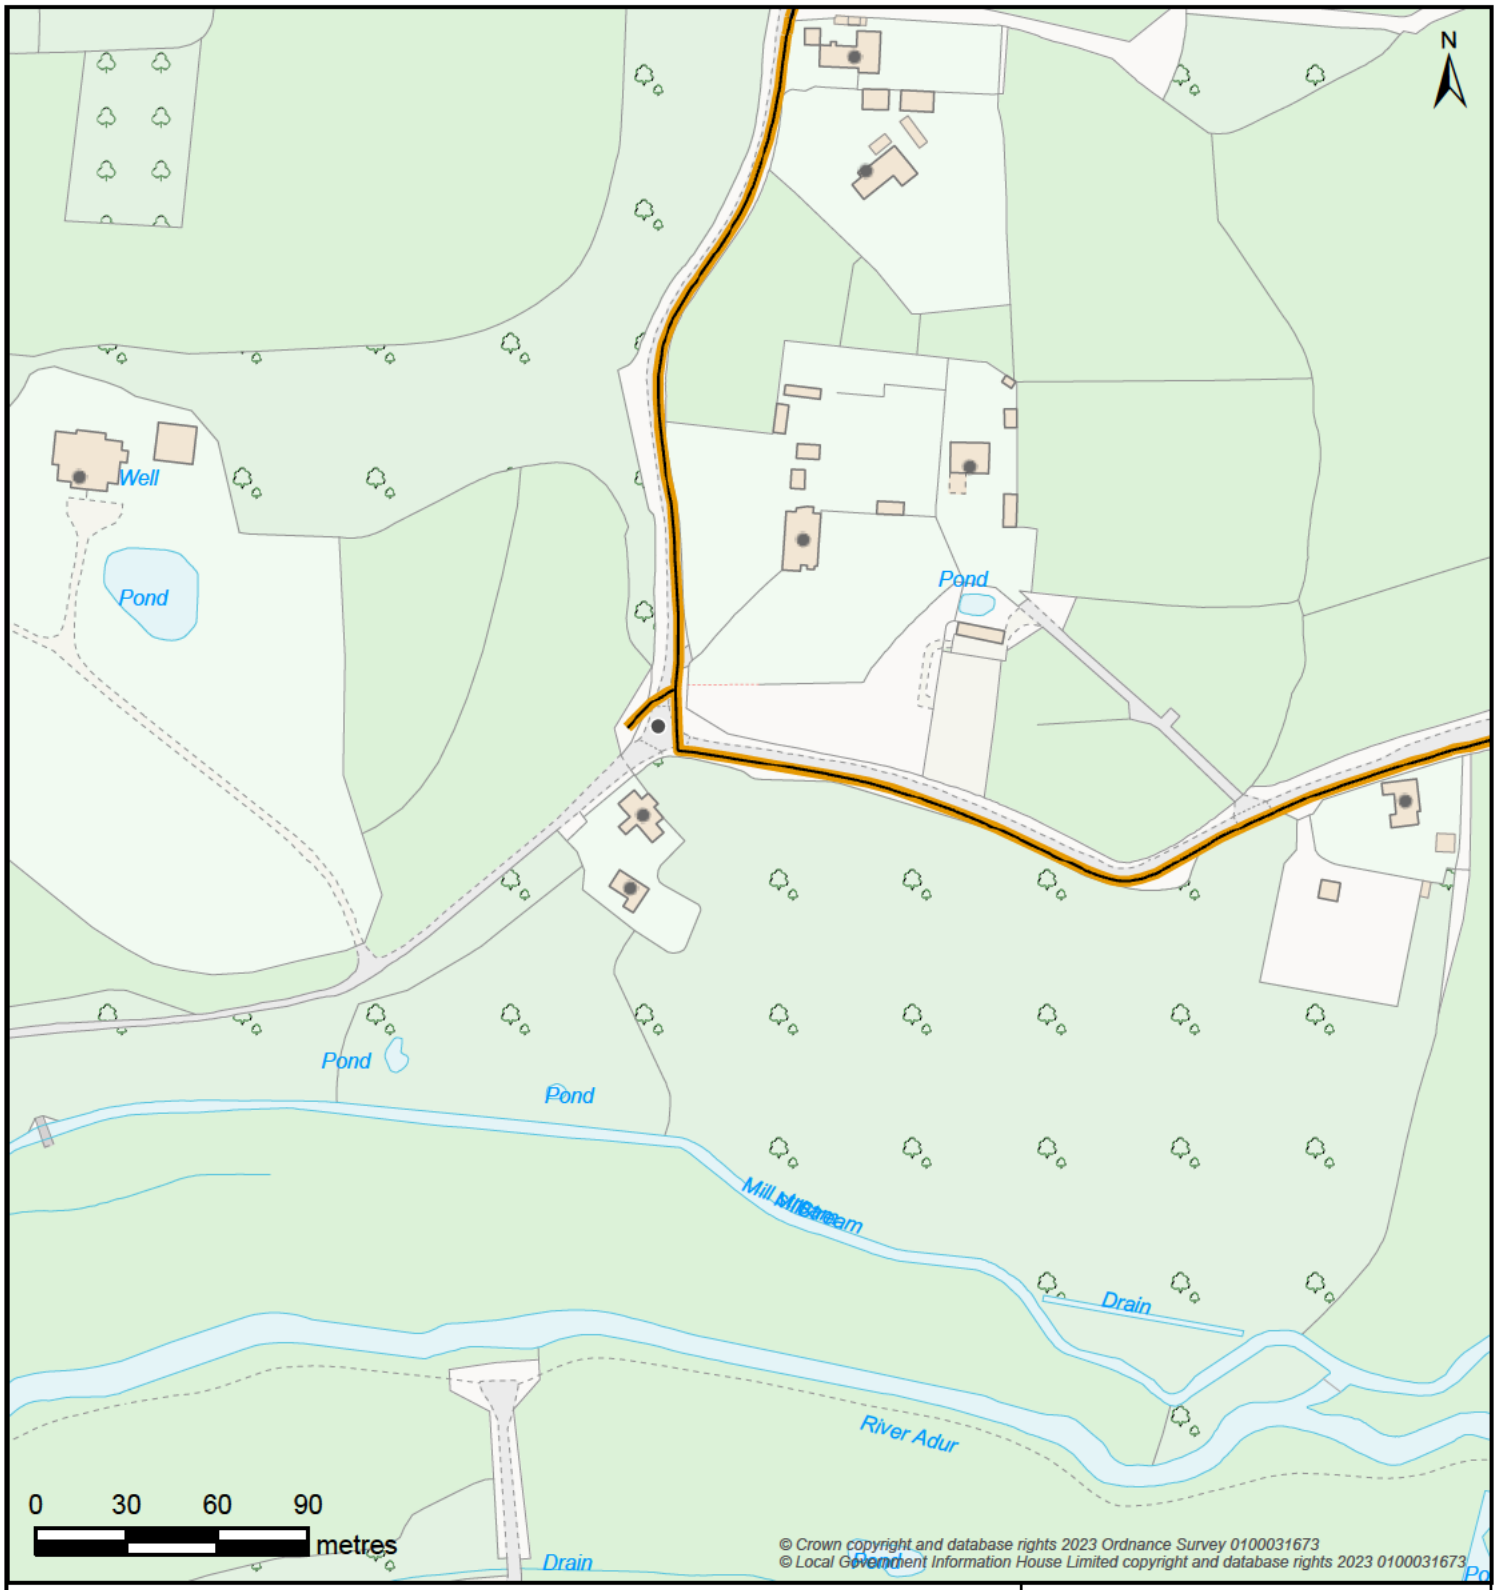

© Crown copyright and database rights 2023 Ordnance Survey 0100031673
© Local Government Information House Limited copyright and database rights 2023 0100031673

Boundary Box	Break Pressure Tank	Capped End	Hydrant
Boundary Box	BPT Break Pressure Tank	Capped End	Emptying Plug; Fire Hydrant; WOH Washout Hydrant

Pressure Monitoring	Service Reservoir	Meter	Valve - Controllable
Logger	Covered; Tower	Meter	Open Valve; Closed Valve; Stop Tap

Site	Valve - Flow
Abstraction Point; Supply Works; Booster Station; Transfer Station; Surface Reservoir; Underground Source	AV Air Valve; NRV Non-Return Valve; WO Washout Empty Valve

Valve - Pressure	Pipe Bridge
PRV Pressure Reducing Valve; PSV Pressure Sustaining Valve	Pipe Bridge

Water Pipe	Water Area
Communication; Trunk; Decommissioned; Distribution; Raw; Discolouration; Non-Potable; Private	Water Supply Zone; District Meter Area

Map Title: SW Print

Printed By: Vignesh.Sheety

Date Printed: 15/12/2023

Map Scale: 2500

The positions of pipes on this plan are believed to be correct, but Southern Water Services Ltd accept no responsibility in the event of inaccuracy. The actual positions should be determined on-site

WATER for LIFE from Southern Water