from Southern Water

Horsham District Council
Parkside
Chart Way
Horsham
West Sussex
RH12 1RL

Your ref
DC/26/1080

Our ref
DSA000059335

Date
25th November 2026

Contact
Tel 0330 303 0119

Dear Sir/Madam,

Proposal: Erection of a detached dwellinghouse (Full Application).
Site address: Mill Hill House Guildford Road Rudgwick West Sussex

Thank you for your correspondence, please see our comments below regarding the above application.

Insufficient Information provided:

Conditon:

Construction of the development shall not commence until details of the proposed means of foul and surface water drainage disposal have been submitted to, and approved in writing by the Local Planning Authority in consultation with Southern Water.

Tree Planting:

We have restrictions on the proposed tree planting adjacent to Southern Water sewers, rising mains or water mains. Reference should be made to Southern Water's publication “A Guide to Tree Planting near water Mains and Sewers” (https://www.southernwater.co.uk/media/pddob0vn/ds-tree-planting-guide-1_nwm.pdf) and the Sewerage Sector Guidance (https://www.water.org.uk/sewerage-sector-guidance-approved-documents/) with regards to any landscaping proposals and our restrictions and maintenance of tree planting adjacent to sewers, rising mains and water mains.

Condition:

In order to protect public apparatus, Southern Water requests that if consent is granted, the following pre commencement condition is attached to the planning permission; The developer must advise the local authority (in consultation with Southern Water) of the landscaping proposals in proximity of public apparatus in order to protect it in accordance with Southern Water's guidance, prior to the commencement of the development.

Southern Water Services Ltd, Registered Office: Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX Registered in England No. 2366670

Connection to public sewer - capacity available desktop study under 50:

Southern Water has undertaken a desktop study of the area, and our investigations indicate that Southern Water can facilitate foul sewerage disposal to service the proposed development. Southern Water requires a formal application for a connection to the public sewer to be made by the applicant or developer.
To make an application visit Southern Water's Get Connected service: https://developerservices.southernwater.co.uk and please read our New Connections Charging Arrangements documents which are available on our website via the following link: https://www.southernwater.co.uk/developing-building/connection-charging-arrangements
We request that should this planning application receive planning approval, the following informative is attached to the consent: Construction of the development shall not commence until details of the proposed means of foul sewerage and surface water disposal have been submitted to, and approved in writing by the Local Planning Authority in consultation with Southern Water.

Proposed soakaways:

The Council's Building Control officers or technical staff should be asked to comment on the adequacy of soakaways to dispose of surface water from the proposed development. No new soakaways should be located within 5 metres of a public or adoptable gravity sewer, rising main or water main.

No Soakaways should be connected to the public surface water sewer.

S106 Connection application:

Any new connections to the public sewerage system will require a Section 106 connection application to be submitted and approved by Southern Water Services.
To make an application visit Southern Water's Get Connected service: https://developerservices.southernwater.co.uk and please read our New Connections Charging Arrangements documents which are available on our website via the following link: https://www.southernwater.co.uk/developing-building/connection-charging-arrangements
Please note that, where there are separate systems available Southern Water will not allow surface water to connect into the public foul sewer.
We request that should this planning application receive planning approval, the following informative is attached to the consent: Construction of the development shall not commence until details of the proposed means of foul sewerage and surface water disposal have been submitted to and approved in writing by the Local Planning Authority in consultation with Southern Water.

It is possible that a sewer now deemed to be public could be crossing the development site. Therefore, should any sewer be found during construction works, an investigation of the sewer will be required to ascertain its ownership before any further works commence on site. If this happens, please call our Customer Service Desk on 0330 303 0119.

For further assistance, please contact Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX (TEL: 0330 303 0119)

Website: southernwater.co.uk or by email at: SouthernWaterPlanning@southernwater.co.uk

Yours faithfully,

Future Growth Planning Team
Developer Services

Southernwater.co.uk/developing-building/planning-your-development

Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX
southernwater.co.uk

Southern Water Services Ltd, Registered Office: Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX Registered in England No. 2366670

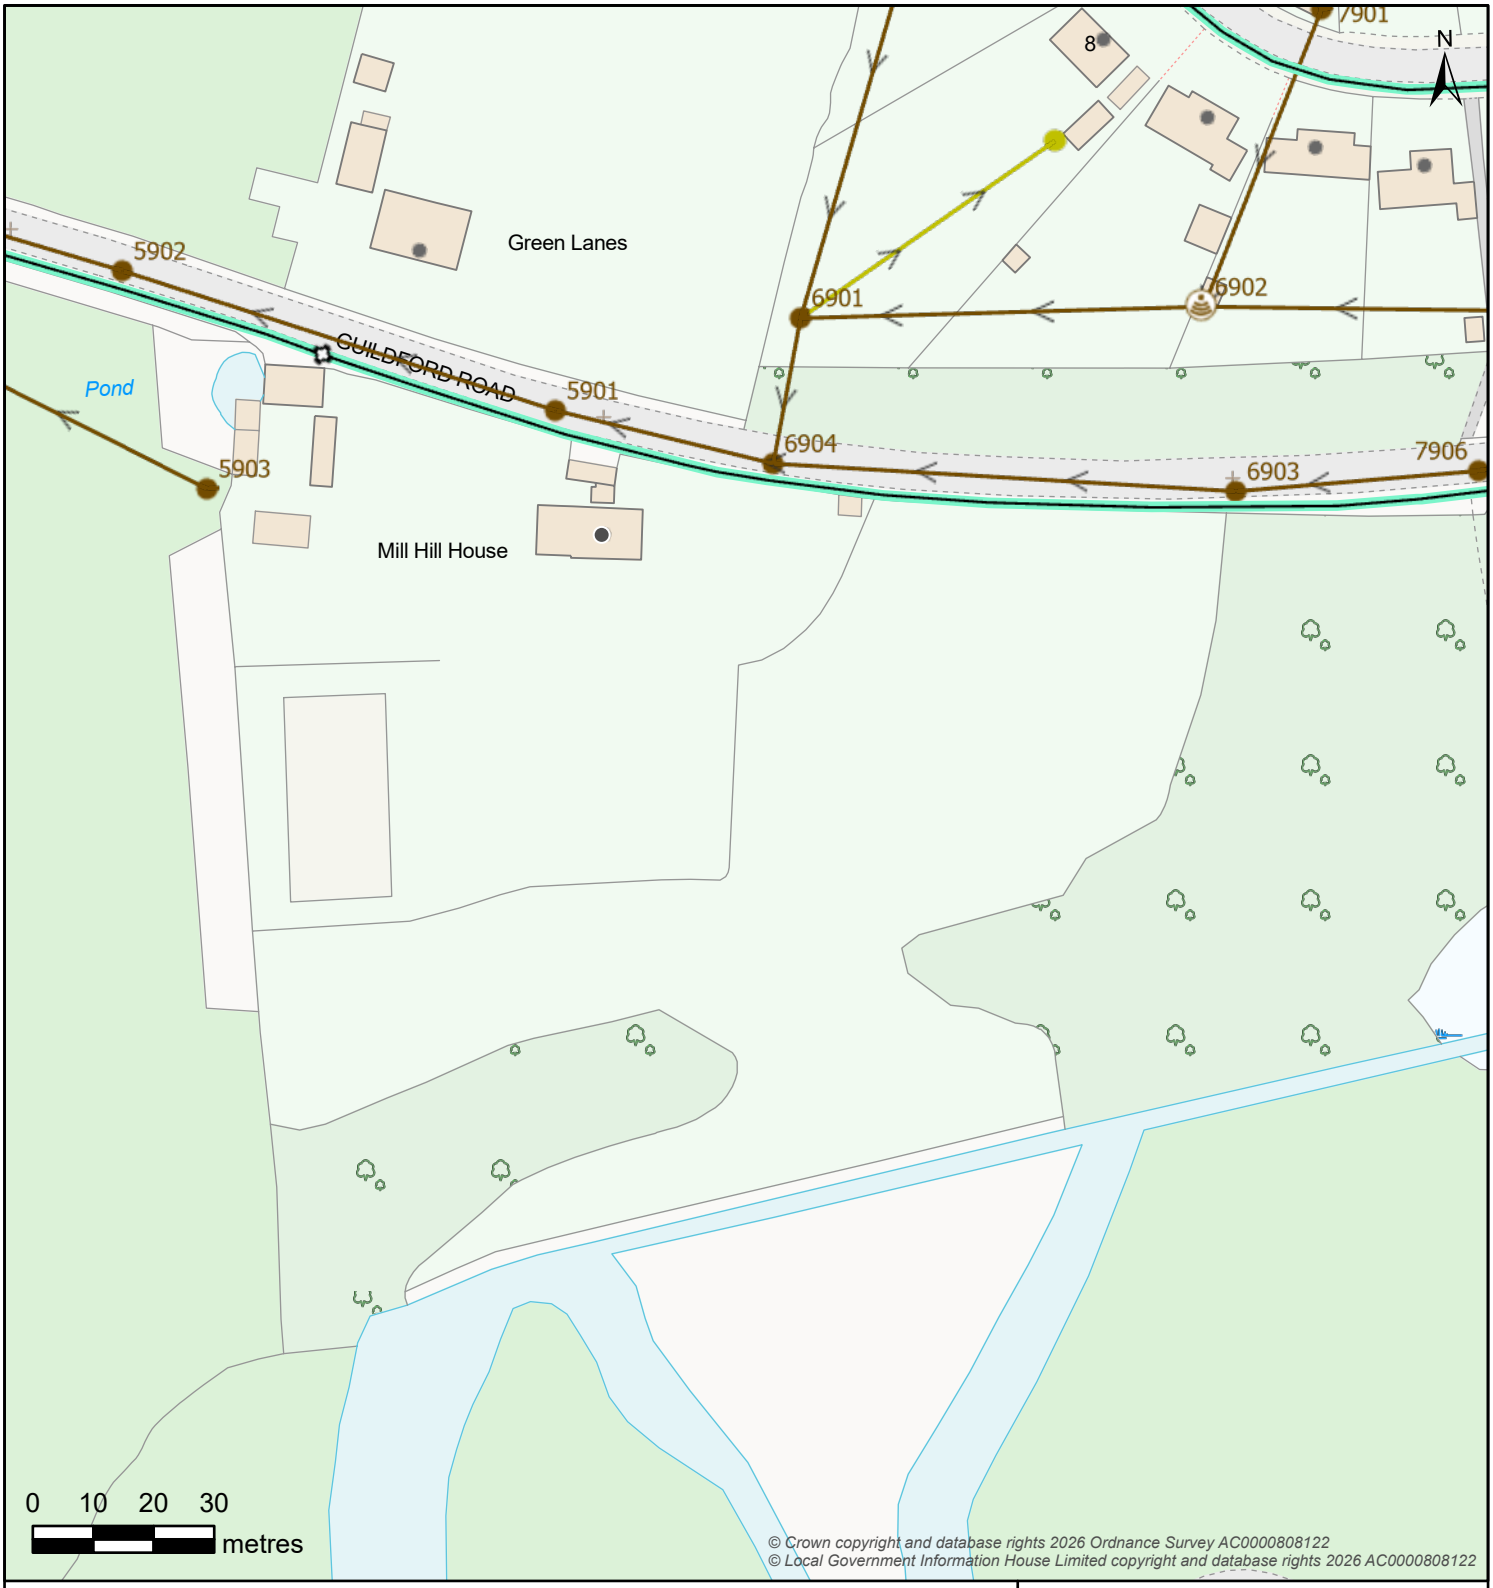

© Crown copyright and database rights 2026 Ordnance Survey AC0000808122
© Local Government Information House Limited copyright and database rights 2026 AC0000808122

Controllable Valve			Flow Control			Inlet-Outfall	
Damboards	Penstock	Valve	Anti Flood Device	Pumped Anti Flood Device	Reflux Valve	Inlet	Outfall

Manhole									
BIF Bifurcation	Cascade	CP Catchpit	Head Of Public Sewer	IC Interceptor Chamber	Manhole	S Soakaway	WO Washout

Outfall Headworks	Overflow Chamber		Pipe Bridge	Pumping Station	
Outfall Headworks	CSO Combined Sewer Overflow	EMO Emergency Overflow	Pipe Bridge	Micro Pumping Station	Pumping Station

Sewer Level Monitor	Storage		Treatment Works	Weir	Wastewater Site
Sewer Level Monitor	Storm Tank	Tidal Storage Tank	Treatment Works	Weir	Wastewater Site

Wastewater Pipe		Wastewater Use	Developer Services	
Culverted Water Course	Syphon	Foul	Build Over Agreement	Section 104
Drain	Tank Sewer	Combined	Wastewater Area	
Outfall	Trunk Sewer	Sludge	Catchment	
Overflow	Vacuum Main	Treated Effluent	Sub-Catchment	
Rising Main	Decommissioned Pipe	Surface Water		
Sewer		Private		

Map Title: SW Print

Printed By: Isaac.Vowles

Date Printed: 25/11/2026

Map Scale: 1250

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.

WATER for LIFE from Southern Water