
Kitchen to have A separate ceiling-mounted MVHR unit supplies fresh outdoor air and extracts room air to outside.

The proposed maintenance plan comprises:

- Monthly inspection of the cooker hood and grease filters, with cleaning adjusted to cooking use.
- Replacement of activated-carbon filters in accordance with the hood manufacturer's instructions.
- Inspection, cleaning and replacement of MVHR filters at the manufacturer's recommended intervals.
- Inspection and cleaning of ventilation grilles, and checks of the MVHR fans, heat exchanger and condensate drain in accordance with the manufacturer's instructions.
- Retention of inspection, cleaning, filter replacement and servicing records by the community centre operator.

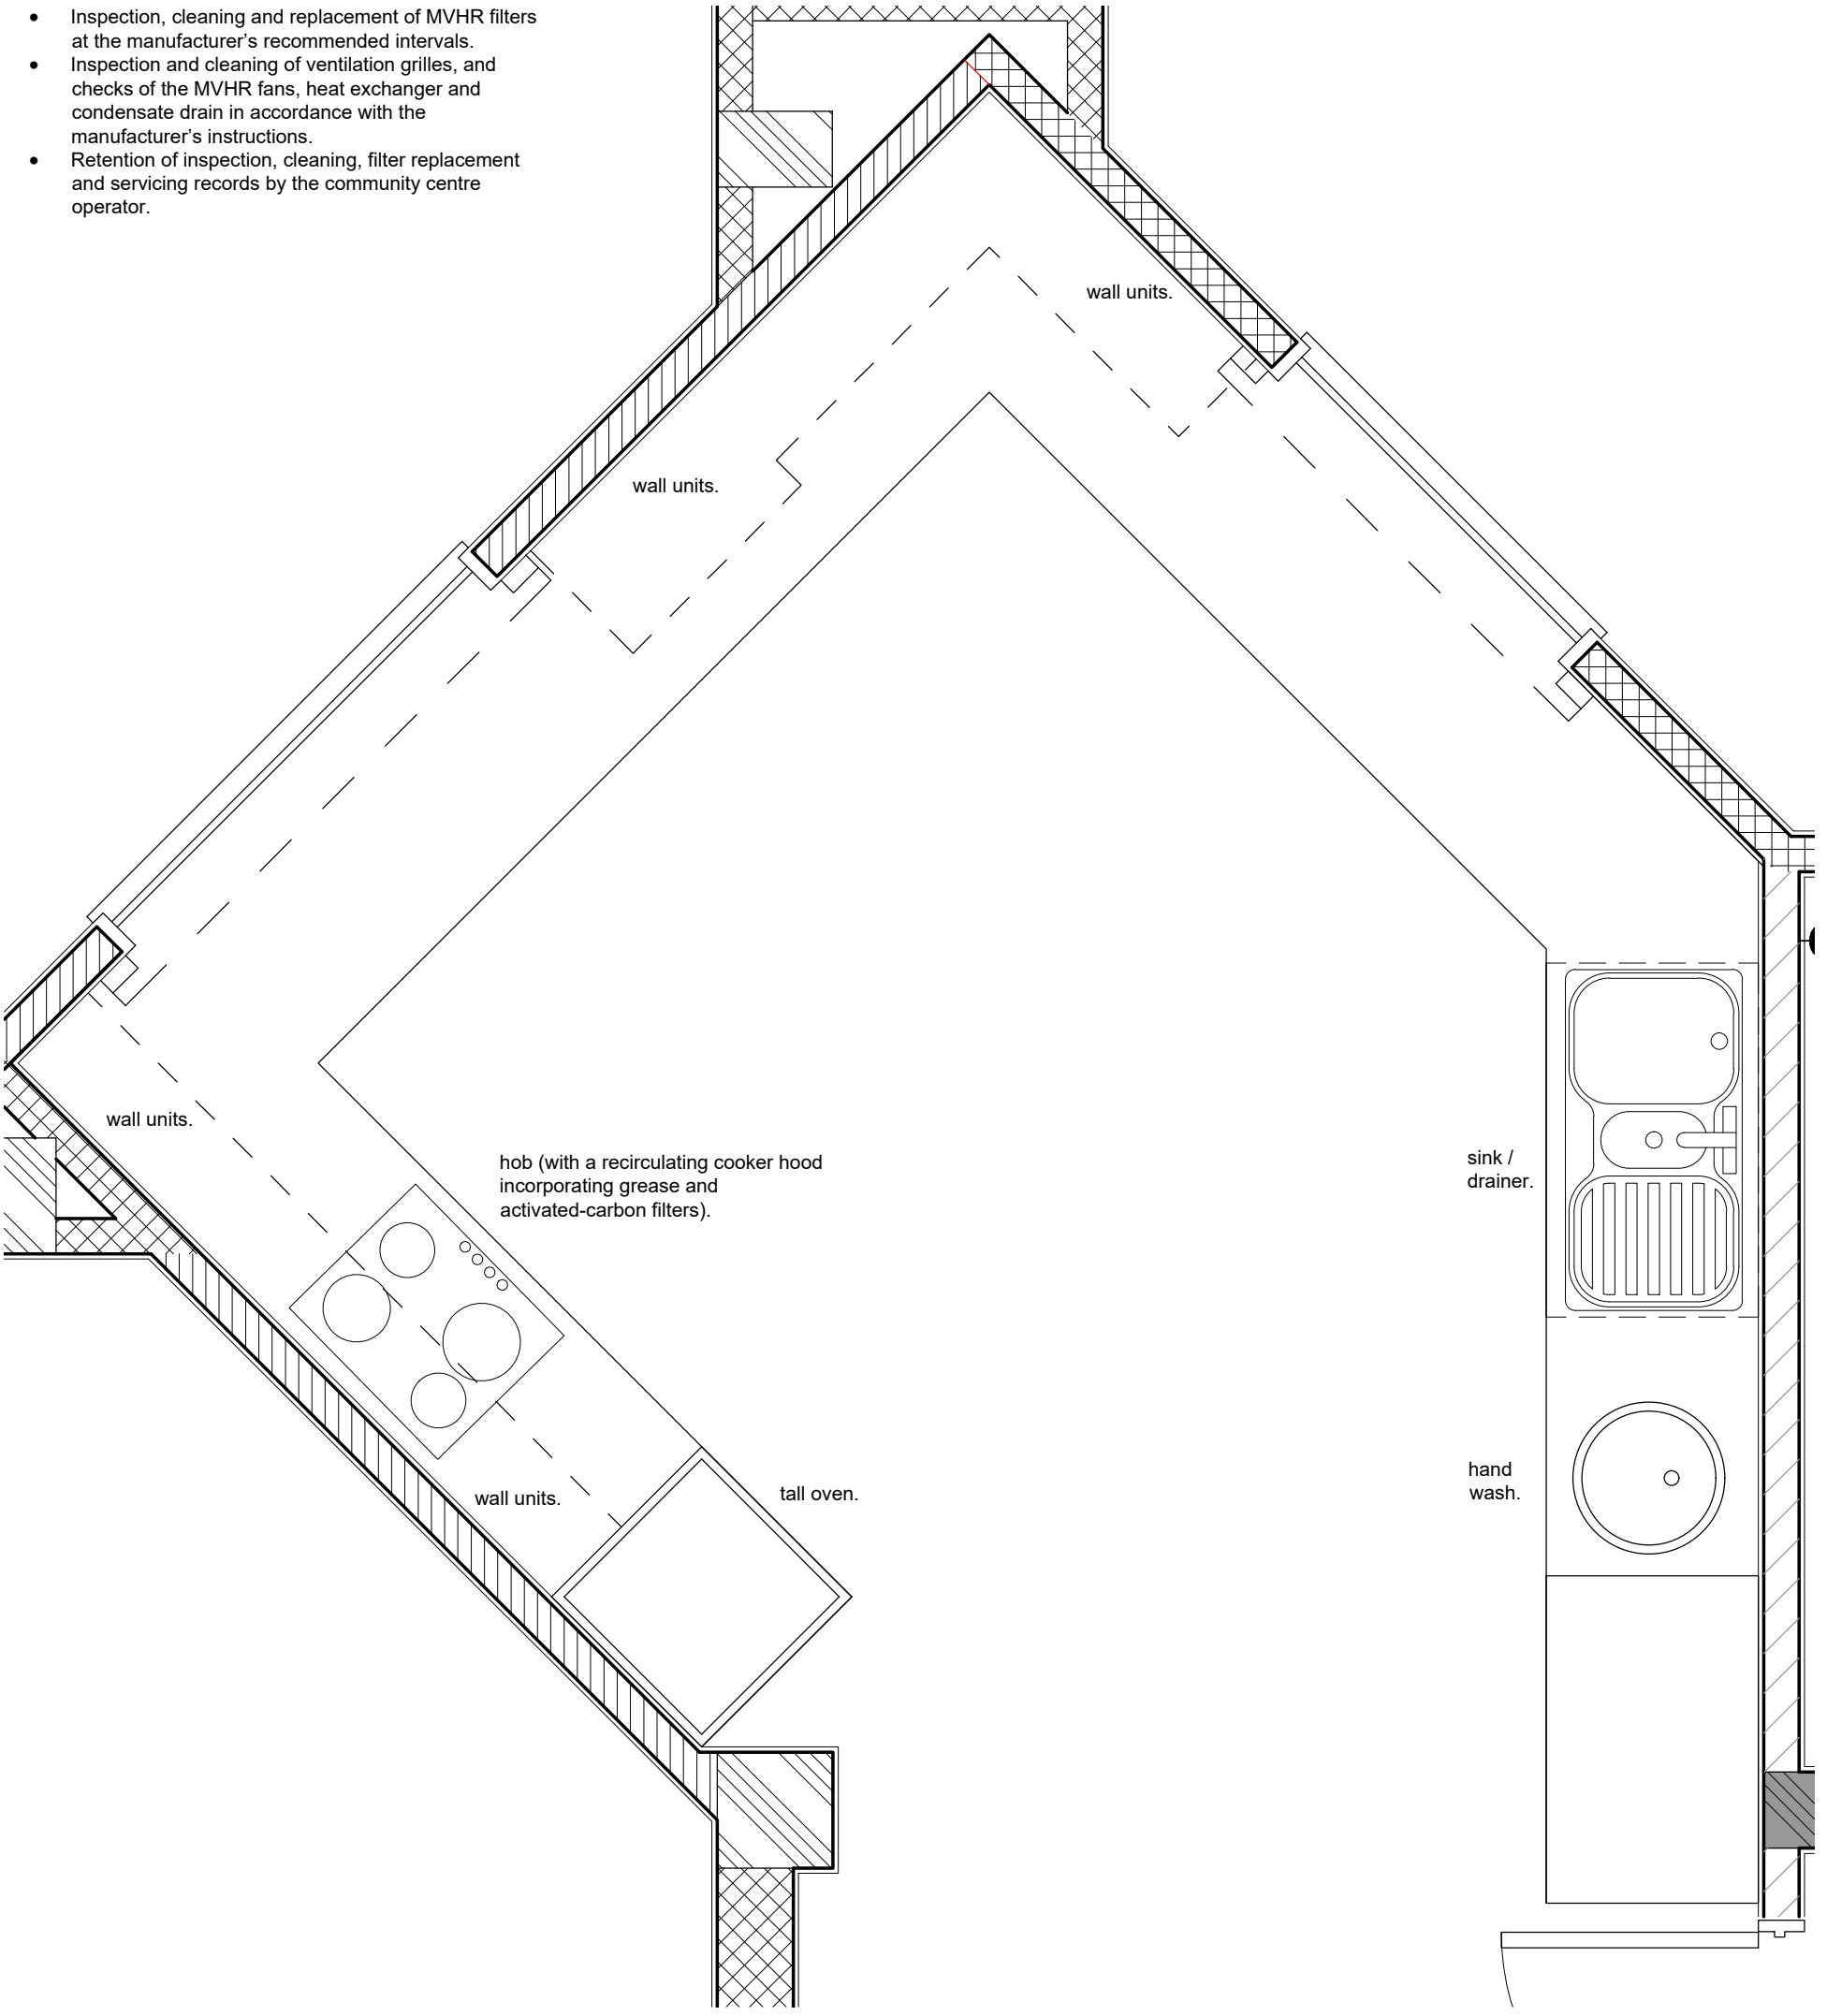


| REV. | DATE | REVISIONS: | BY | STATUS: |
|---|---|---|---|---|
| | | | | Construction |

| | | | |
|---|---|---|---|
| CLIENT: Legal & General | | PROJECT: Community Centre at Mowbray, North Horsham | |
| SCALE: 1:50 / 1:10 (A3 ORIGINAL) | | DRAWING: Kitchen Layout | |
| DRAWN: SMR<br>DATE: 24/03/26 | 24009 | SK16 | – |


architecture planning masterplanning
Broadmede House, Farnham Business Park,
Weydon Lane, Farnham, Surrey GU9 8QT.
info@osparchitecture.com www.osparchitecture.com
Tel: 01252 267878



© COPYRIGHT EXISTS ON THE DESIGNS AND INFORMATION SHOWN ON THIS DRAWING

This drawing may be scaled or cross referenced to the scale bar for planning application purposes only. Do not scale for any other purpose, use figured dimensions only. Subject to site survey and all necessary consents. All dimensions to be checked by user and any discrepancies, errors or omissions to be reported to the Architect before work commences. This drawing is to be read in conjunction with all other relevant materials.

OS Licence No. AC0000851327