
Sam.Whitehouse

From: FRS Water and Access <FRSWaterandAccess@westsussex.gov.uk>
Sent: 03 September 2025 16:29
To: Sam.Whitehouse
Subject: RE: DC/25/0138 - Hazardous Substance Consent

Good afternoon Sam,

My apologies, West Sussex Fire & Rescue Service do not generally comment on planning applications that are compliant with AD-B Volume 2: B5 requirements. As shown on a screen shot of out mapping system there is a fire hydrant outside the site, within 45m of the gas storage tanks, there is also a 315,000-litre water tank supplied on site, specifically for firefighting purposes, both shown below.

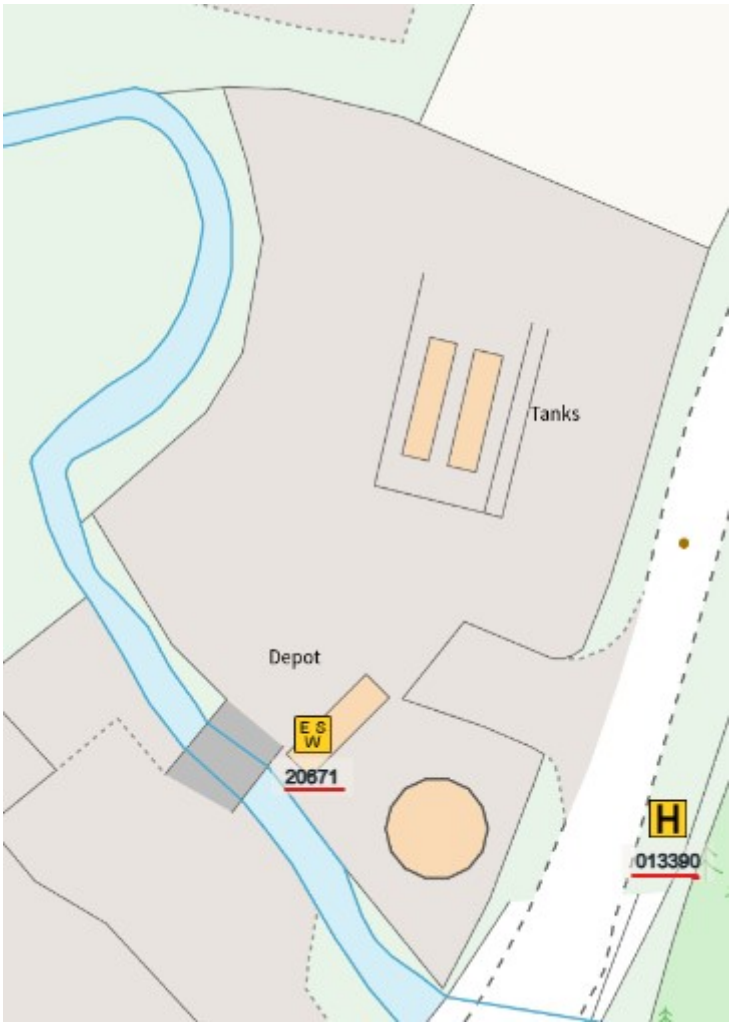

Also, the access for a fire appliance to this site is also compliant with requirements, so there are no concerns with this site. A fire safety inspection has also been carried out at the site to ensure all fire safety arrangements are in place.

Hope this answers your question.

Regards
Ian