



Horsham District Council
Parkside
Chart Way
Horsham
West Sussex
RH12 1RL

Your ref
DC/26/0592

Our ref
DSA000053630

Date
11th September 2026

Contact
Tel 0330 303 0119

Dear Sir/Madam,

Proposal: Reserved matters application for the erection of 133 dwellings following approval of outline application DC/22/1052 as amended by DC/25/1886, relating to appearance, landscaping, layout and scale.

Site: Land at Lower Broadbridge Farm, Billingshurst Road, Broadbridge Heath, Horsham, West Sussex, RH12 3LR.

Thank you for your correspondence, please see our comments below regarding the above application.

Following a review of the documents submitted Southern Waters' comments of 11th May 2026 remain valid, as detailed below.

Connection to water distribution main

Our investigations indicate that Southern Water can facilitate water supply to service the proposed development. Southern Water requires a formal application for a connection to the water supply to be made by the applicant or developer.

To make an application visit Southern Water's Get Connected service:

<https://developerservices.southernwater.co.uk> and please read our New Connections Charging Arrangements documents which are available to read on our website via the following link www.southernwater.co.uk/developing-building/connection-charging-arrangements.

Yes To Capacity (FOUL)

There is currently adequate capacity in the local surface water network to accommodate a surface water flow of 1.15 l/s (6l/s Pumped), for the above development at manhole reference TQ14312102.

Proposed new pumping station located within the development Site.

If the applicant proposes to offer a new on-site drainage and pumping station for adoption as part of the foul/surface water public sewerage system, this would have to be designed and constructed to the specification of Southern Water Services Ltd.

<https://landsearch.southernwater.co.uk/media/4323/southern-water-design-and-construction-specification-water-codes-for-adoption.pdf>

In order to protect the amenity of prospective residents, no habitable rooms shall be located within 15 metres to the boundary of the proposed adoptable pumping station, due to the potential odour, vibration and noise generated by all types of pumping stations.

Condition

Construction of the development shall not commence until details of the proposed means of foul/surface water drainage disposal respecting the requirement for a non-habitable zone around the adoptable pumping station and suitable access arrangements, have been submitted to, and approved in writing by the Local Planning Authority in consultation with Southern Water.

Tree Planting

We have restrictions on tree planting adjacent to Southern Water sewers, rising mains or water mains. Reference should be made to Southern Water's publication "A Guide to Tree Planting near water Mains and Sewers" (https://www.southernwater.co.uk/media/pddob0vn/ds-tree-planting-guide-1_nwm.pdf) and the Sewerage Sector Guidance (<https://www.water.org.uk/sewerage-sector-guidance-approved-documents/>) with regards to any landscaping proposals and our restrictions and maintenance of tree planting adjacent to sewers, rising mains and water mains.

Condition

In order to protect public apparatus, Southern Water requests that if consent is granted, the following pre commencement condition is attached to the planning permission; The developer must advise the local authority (in consultation with Southern Water) of the landscaping proposals in proximity of public apparatus in order to protect it in accordance with Southern Water's guidance, prior to the commencement of the development.

Proposed SUDS features

If it is the intention of the developer for Southern Water to adopt the proposed SuDS, the system shall be designed and constructed in line with the Design and Construction Guidance www.water.org.uk/sewerage-sector-guidance-approved-documents/.

No Soakaways should be connected to the public surface water sewer.

The supporting documents make reference to drainage using Sustainable Drainage Systems (SuDS). Where SuDS form part of a continuous sewer system, and are not an isolated end of pipe SuDS component, adoption of SuDS will be considered if requested by the developer if they

comply with: Design and Construction Guidance (Appendix C), CIRIA guidance and Southern Water SuDS Guidance available here:

<https://www.water.org.uk/sewerage-sector-guidance-approved-documents/>

<https://www.ciria.org/ItemDetail?iProductCode=C753F&Category=FREEPUBS>

<https://www.southernwater.co.uk/media/l4ndl3db/suds-final-080824.pdf>

Where SuDS rely upon facilities which are not adoptable by sewerage undertakers the applicant will need to ensure that arrangements exist for the long-term maintenance of the SuDS facilities. It is critical that the effectiveness of these systems is maintained in perpetuity. Good management will avoid flooding from the proposed surface water system, which may result in the inundation of the foul sewerage system.

Thus, where a SuDS scheme is to be implemented, the drainage details submitted to the Local Planning Authority should:

- Specify the responsibilities of each party for the implementation of the SuDS scheme.
- Specify a timetable for implementation.
- Provide a management and maintenance plan for the lifetime of the development.

This should include the arrangements for adoption by any public authority or statutory undertaker and any other arrangements to secure the operation of the scheme throughout its lifetime.

This initial assessment does not prejudice any future assessment or commit to any adoption agreements under Section 104 of the Water Industry Act 1991.

Surface water discharge proposed to existing watercourse

The Council's technical staff and the relevant authority for land drainage consent should comment on the adequacy of the proposals to discharge surface water to the local watercourse.

S106 Connection application

Any new connections to the public sewerage system will require a Section 106 connection application to be submitted and approved by Southern Water Services.

To make an application visit Southern Water's Get Connected service:

<https://developerservices.southernwater.co.uk> and please read our New Connections Charging Arrangements documents which are available on our website via the following link:

<https://www.southernwater.co.uk/developing-building/connection-charging-arrangements>

Please note that, where there are separate systems available, Southern Water will not allow surface water to connect into the public foul sewer. If this is not possible, please provide evidence that all other options have been explored.

It is possible that a sewer now deemed to be public could be crossing the development site. Therefore, should any sewer be found during construction work, an investigation of the sewer will be required to ascertain its ownership before any works commence on site. If this happens, please call our Customer Service Desk on 0330 303 0119

For further advice, please contact Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX (Tel: 0330 303 0119)




Website: southernwater.co.uk or by email at: SouthernWaterPlanning@southernwater.co.uk

Yours faithfully,

Future Growth Planning Team

southernwater.co.uk/developing-building/planning-your-development

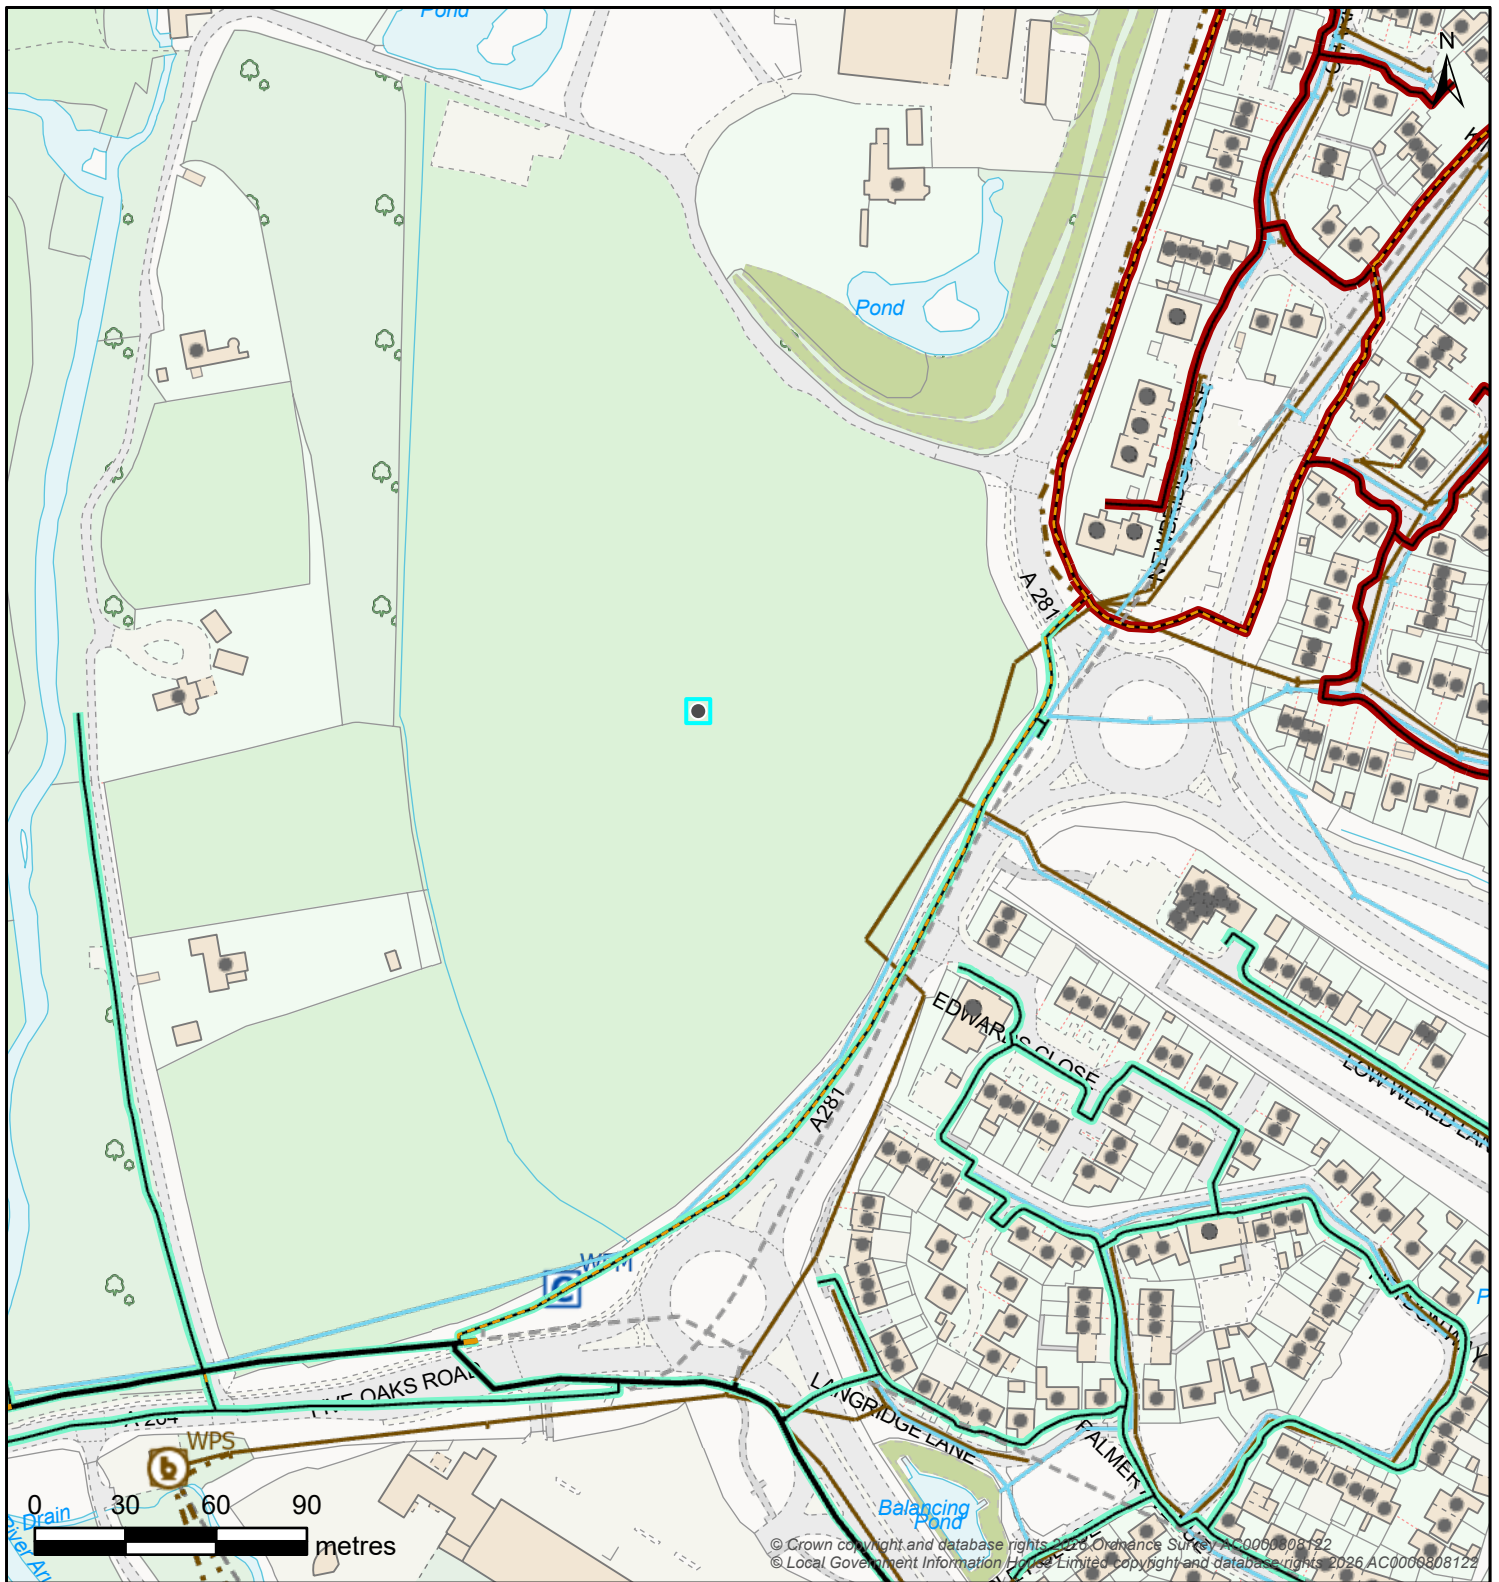

Controllable Valve			Flow Control			Inlet-Outfall	
Damboards	Penstock	Valve	Anti Flood Device	Pumped Anti Flood Device	Reflux Valve	Inlet	Outfall
Manhole							
BIF Bifurcation	Cascade	CP Catchpit	Head Of Public Sewer	IC Interceptor Chamber	Manhole	S Soakaway	WO Washout
Outfall Headworks		Overflow Chamber		Pipe Bridge		Pumping Station	
Outfall Headworks	CSO Combined Sewer Overflow	EMO Emergency Overflow	Pipe Bridge	Micro Pumping Station	Pumping Station		
Sewer Level Monitor		Storage		Treatment Works		Weir	
Sewer Level Monitor	Storm Tank	Tidal Storage Tank	Treatment Works	Weir	Wastewater Site		
Wastewater Pipe				Wastewater Use		Developer Services	
Culverted Water Course	Syphon	Tank Sewer	Trunk Sewer	Foul	Combined	Build Over Agreement	Section 104
Drain	Vacuum Main	Decommissioned Pipe		Sludge	Treated Effluent	Wastewater Area	
Outfall				Surface Water	Private	Catchment	Sub-Catchment
Overflow							
Rising Main							
Sewer							

Map Title: SW Print

Printed By: Anne.McFarlane2

Date Printed: 11/09/2026

Map Scale: 2500

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.



from
Southern
Water.