



Horsham District Council
Parkside
Chart Way
Horsham
West Sussex
RH12 1RL

Your ref
DC/26/0640

Our ref
DSA000054147

Date
22nd May 2026

Contact
Tel 0330 303 0119

Dear Sir/Madam,

Proposal: Demolition of existing dwelling and erection of 24no. dwellings.
Site: Cedar Cottage, Sandygate Lane, Lower Beeding, West Sussex, RH13 6LR.

Thank you for your correspondence, please see our comments below regarding the above application.

Existing Gravity Sewer - tree, buildings, assets within stand-off distance

The 150 mm diameter gravity sewer requires a clearance of 3 metres on either side of the gravity sewer to protect it from construction works and to allow for future maintenance access. No development or tree planting should be carried out within 3 metres of the external edge of the public gravity sewer without consent from Southern Water. All existing infrastructure should be protected during the course of construction works. Please refer to:
<https://www.southernwater.co.uk/media/st5orjvm/stand-off-distances.pdf>

Condition

In order to protect public sewers, Southern Water requests that if consent is granted, the following condition is attached to the planning permission; The developer must agree with Southern Water, prior to commencement of the development, the measures to be taken to protect the public sewers.

Proposed SUDS features

If it is the intention of the developer for Southern Water to adopt the proposed SuDS, the system shall be designed and constructed in line with the Design and Construction Guidance
www.water.org.uk/sewerage-sector-guidance-approved-documents/.

No Soakaways should be connected to the public surface water sewer.

The supporting documents make reference to drainage using Sustainable Drainage Systems (SuDS). Where SuDS form part of a continuous sewer system, and are not an isolated end of pipe SuDS component, adoption of SuDS will be considered if requested by the developer if they comply with: Design and Construction Guidance (Appendix C), CIRIA guidance and Southern Water SuDS Guidance available here:

<https://www.water.org.uk/sewerage-sector-guidance-approved-documents/>

<https://www.ciria.org/ItemDetail?iProductCode=C753F&Category=FREEPUBS>

<https://www.southernwater.co.uk/media/l4ndl3db/suds-final-080824.pdf>

Where SuDS rely upon facilities which are not adoptable by sewerage undertakers the applicant will need to ensure that arrangements exist for the long-term maintenance of the SuDS facilities. It is critical that the effectiveness of these systems is maintained in perpetuity. Good management will avoid flooding from the proposed surface water system, which may result in the inundation of the foul sewerage system.

Thus, where a SuDS scheme is to be implemented, the drainage details submitted to the Local Planning Authority should:

- Specify the responsibilities of each party for the implementation of the SuDS scheme.
- Specify a timetable for implementation.
- Provide a management and maintenance plan for the lifetime of the development.

This should include the arrangements for adoption by any public authority or statutory undertaker and any other arrangements to secure the operation of the scheme throughout its lifetime.

This initial assessment does not prejudice any future assessment or commit to any adoption agreements under Section 104 of the Water Industry Act 1991.

Proposed works involve demolition.

In order to protect and safeguard the existing water supply apparatus, Southern Water requests formal notification of any proposed demolition works prior to such works being undertaken.

Yes To Capacity (FOUL)

There is currently adequate capacity in the local sewerage network to accommodate a foul flow of 4.01 l/s for the above development at manhole reference TQ21279202.

Yes To Capacity (SURFACE WATER)

There is currently adequate capacity in the local surface water network to accommodate a surface water flow of 4 l/s for the above development at manhole reference TQ21279350.

S106 Connection application

Any new connections to the public sewerage system will require a Section 106 connection application to be submitted and approved by Southern Water Services.

To make an application visit Southern Water's Get Connected service:



<https://developerservices.southernwater.co.uk> and please read our New Connections Charging Arrangements documents which are available on our website via the following link:
<https://www.southernwater.co.uk/developing-building/connection-charging-arrangements>

Please note that, where there are separate systems available Southern Water will not allow surface water to connect into the public foul sewer. If this is not possible, please provide evidence that all other options have been explored.


It is possible that a sewer now deemed to be public could be crossing the development site. Therefore, should any sewer be found during construction work, an investigation of the sewer will be required to ascertain its ownership before any works commence on site. If this happens, please call our Customer Service Desk on 0330 303 0119

For further advice, please contact Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX (Tel: 0330 303 0119)

Website: southernwater.co.uk or by email at: SouthernWaterPlanning@southernwater.co.uk

Yours faithfully,

Future Growth Planning Team
southernwater.co.uk/developing-building/planning-your-development

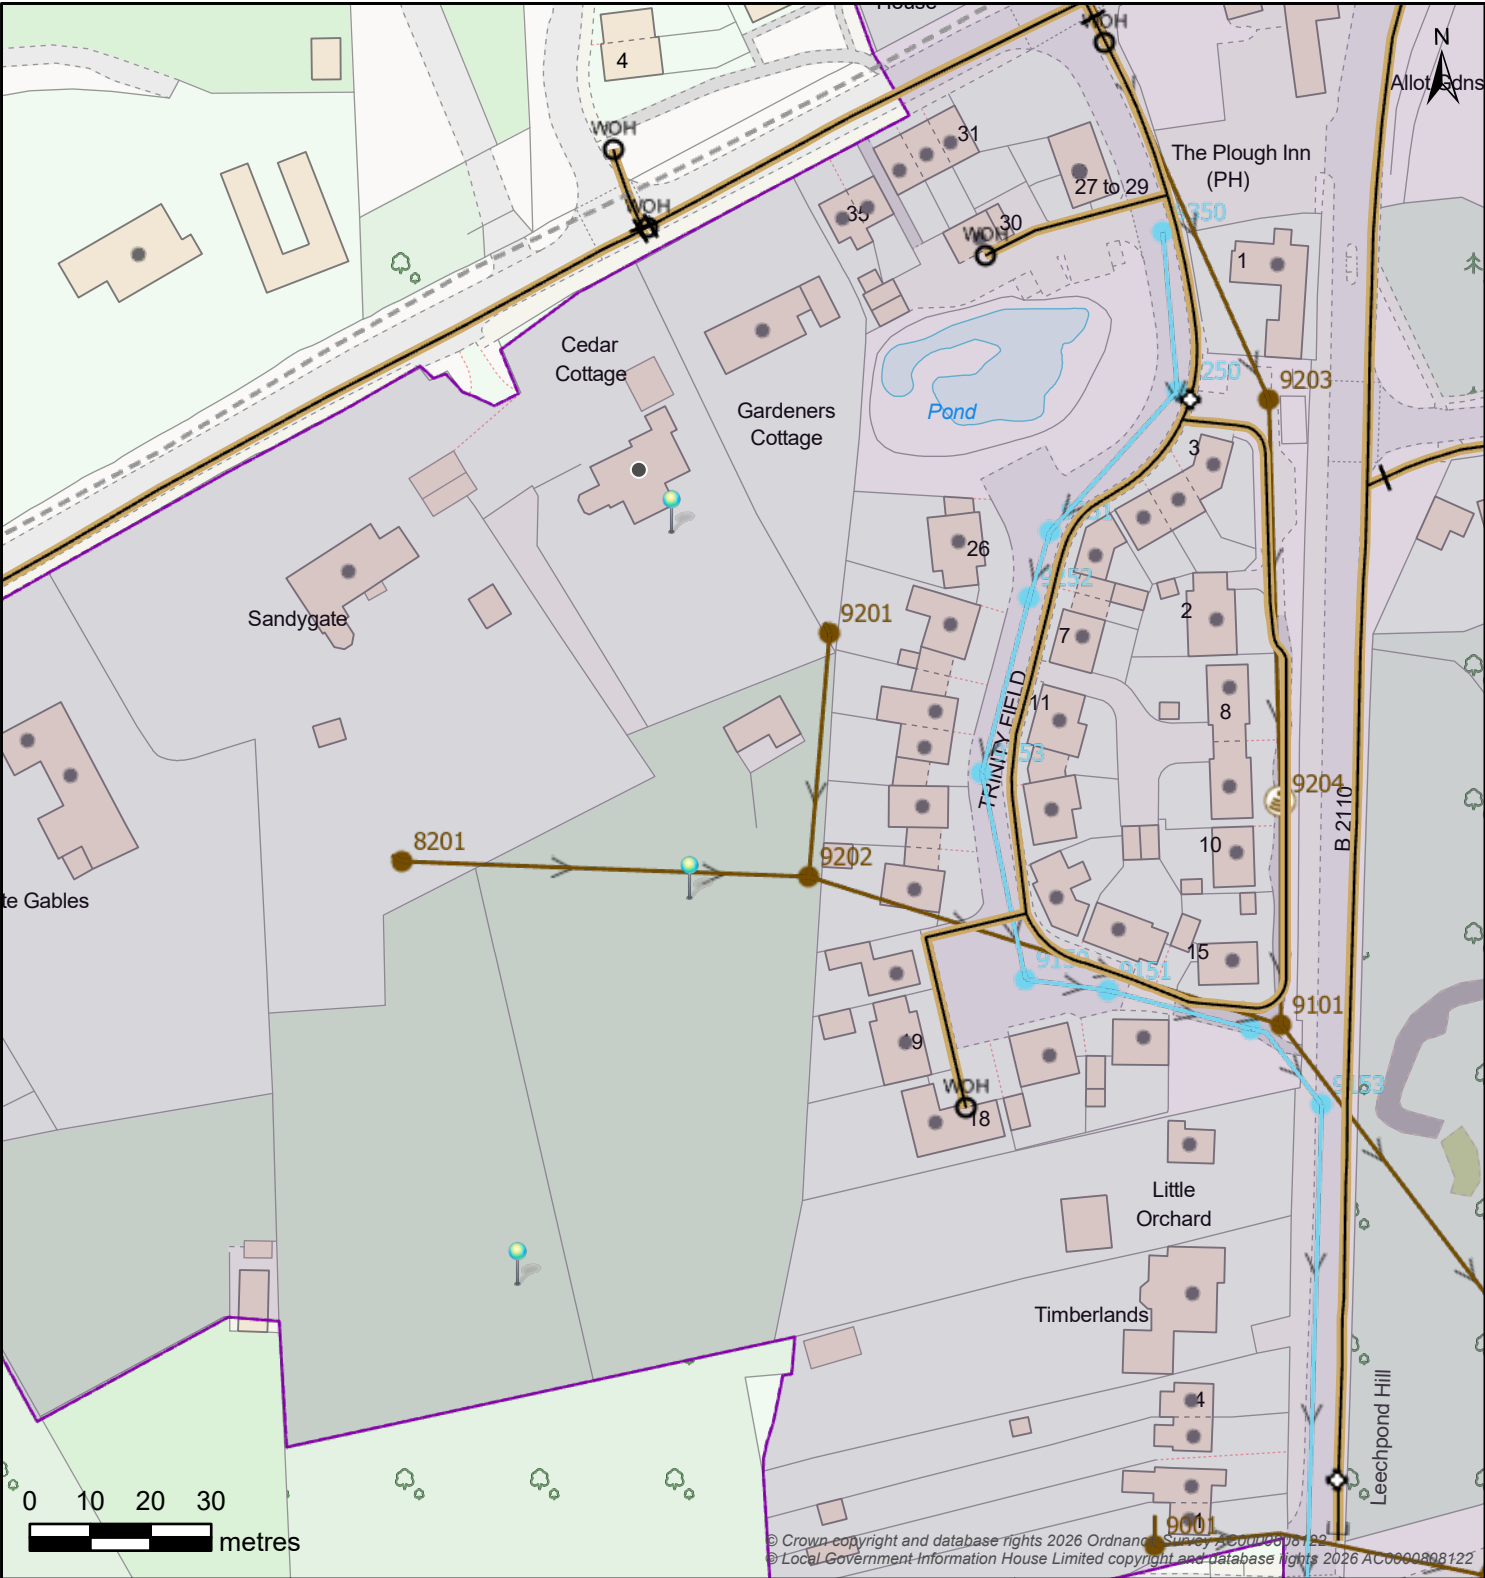

Map Title: SW Print

Printed By: Anne.McFarlane2
Date Printed: 22/05/2026
Map Scale: 1250

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.



Controllable Valve			Flow Control			Inlet-Outfall	
Damboards	Penstock	Valve	Anti Flood Device	Pumped Anti Flood Device	Reflux Valve	Inlet	Outfall
Manhole							
BIF Bifurcation	Cascade	CP Catchpit	Head Of Public Sewer	IC Interceptor Chamber	Manhole	S Soakaway	WO Washout
Outfall Headworks		Overflow Chamber		Pipe Bridge		Pumping Station	
Outfall Headworks	CSO Combined Sewer Overflow	EMO Emergency Overflow	Pipe Bridge	Micro Pumping Station	Pumping Station		
Sewer Level Monitor		Storage		Treatment Works		Weir	
Sewer Level Monitor	Storm Tank	Tidal Storage Tank	Treatment Works	Weir	Wastewater Site		
Wastewater Pipe				Wastewater Use		Developer Services	
Culverted Water Course	Syphon	Tank Sewer	Trunk Sewer	Foul	Combined	Build Over Agreement	Section 104
Drain	Vacuum Main	Decommissioned Pipe	Sludge	Treated Effluent	Surface Water	Catchment	Sub-Catchment
Outfall			Private				
Overflow							
Rising Main							
Sewer							