



from
**Southern
Water** 

Horsham District Council
Parkside
Chart Way
Horsham
West Sussex
RH12 1RL

Your ref
DC/26/0965

Our ref
DSA000055243

Date
25th of June 2026

Contact
Tel 0330 303 0119

Dear Sir/Madam,

Proposal: Prior Notification for Change of Use of Agricultural Building to 2 nos dwellinghouses.
Site: Oxcopse Farm Hooklands Lane Shipley West Sussex RH13 8PY.

Thank you for your correspondence, please see our comments below regarding the above application.

Insufficient Information provided

Construction of the development shall not commence until details of the proposed means of foul/surface water drainage disposal have been submitted to and approved in writing by the Local Planning Authority in consultation with Southern Water.


It is possible that a sewer now deemed to be public could be crossing the development site. Therefore, should any sewer be found during construction works, an investigation of the sewer will be required to ascertain its ownership before any further works commence on site.

For further advice, please contact Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX (Tel: 0330 303 0119)

Website: southernwater.co.uk or by email at: SouthernWaterPlanning@southernwater.co.uk

Yours faithfully,

Future Growth Planning Team
southernwater.co.uk/developing-building/planning-your-development

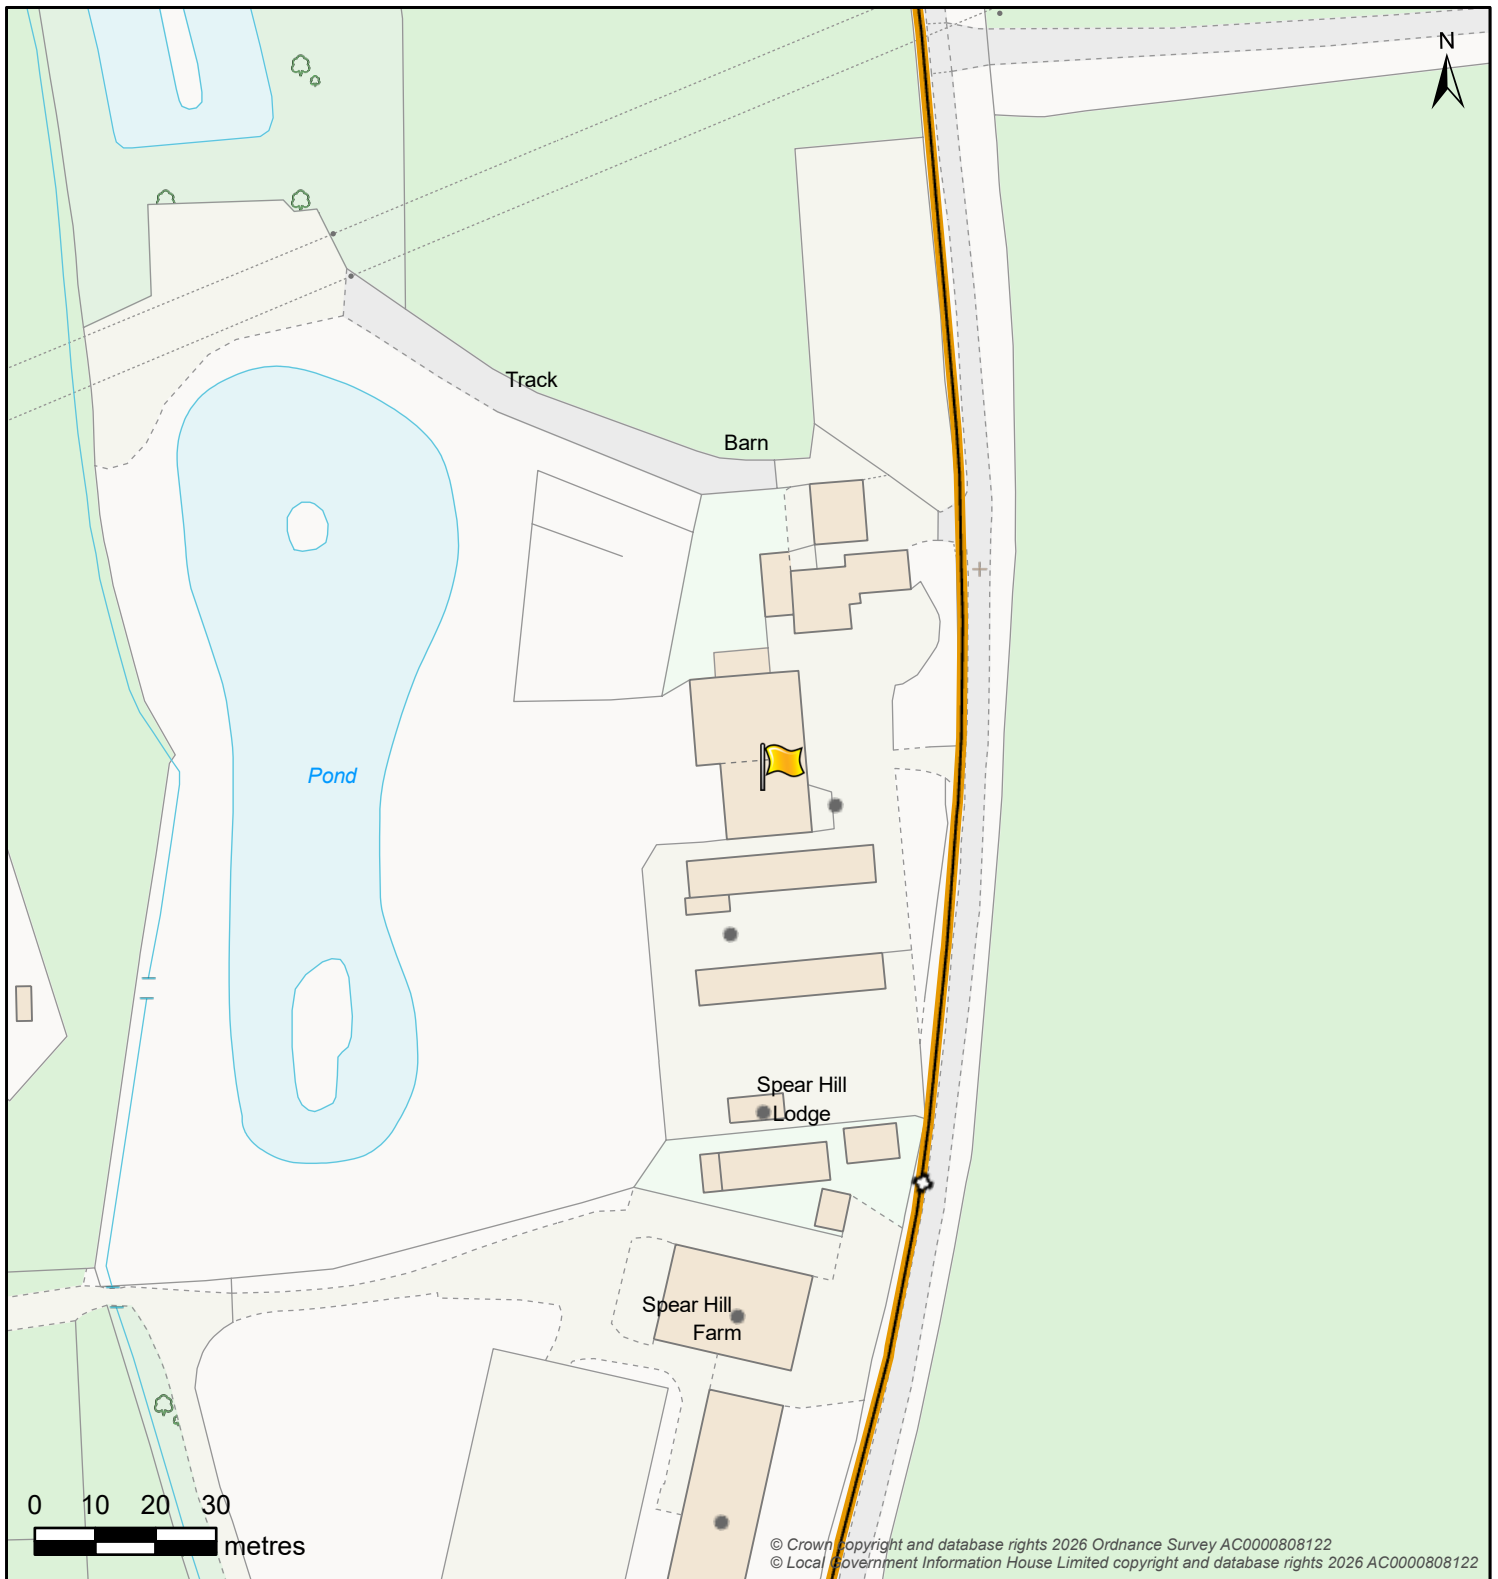

Controllable Valve			Flow Control			Inlet-Outfall	
Damboards	Penstock	Valve	Anti Flood Device	Pumped Anti Flood Device	Reflux Valve	Inlet	Outfall
Manhole							
BIF Bifurcation	Cascade	CP Catchpit	Head Of Public Sewer	IC Interceptor Chamber	Manhole	S Soakaway	WO Washout
Outfall Headworks		Overflow Chamber		Pipe Bridge		Pumping Station	
Outfall Headworks	CSO Combined Sewer Overflow	EMO Emergency Overflow	Pipe Bridge	Micro Pumping Station	Pumping Station		
Sewer Level Monitor		Storage		Treatment Works		Weir	
Sewer Level Monitor	Storm Tank	Tidal Storage Tank	Treatment Works	Weir	Wastewater Site		
Wastewater Pipe				Wastewater Use		Developer Services	
Culverted Water Course	Syphon	Tank Sewer	Trunk Sewer	Foul	Combined	Build Over Agreement	Section 104
Drain	Vacuum Main	Decommissioned Pipe		Sludge	Treated Effluent	Wastewater Area	
Outfall				Surface Water	Private	Catchment	Sub-Catchment
Overflow							
Rising Main							
Sewer							

Map Title: DSA000055243 GIS

Printed By: Kelly.Donaldson

Date Printed: 25/06/2026

Map Scale: 1250

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.

