



Horsham District Council
Parkside
Chart Way
Horsham
West Sussex
RH12 1RL

Your ref
DC/26/0939

Our ref
DSA000055242

Date
25th of June 2026

Contact
Tel 0330 303 0119

Dear Sir/Madam,

Proposal: Demolition of existing greenhouse and erection of pool house and excavation of swimming pool with associated landscaping works.

Site: Fairlee Bucks Green Rudgwick West Sussex RH12 3JE.

Thank you for your correspondence, please see our comments below regarding the above application.

Insufficient Information provided

Construction of the development shall not commence until details of the proposed means of foul/surface water drainage disposal have been submitted to and approved in writing by the Local Planning Authority in consultation with Southern Water.

Tree Planting

We have restrictions on the proposed tree planting adjacent to Southern Water sewers, rising mains or water mains. Reference should be made to Southern Water's publication "A Guide to Tree Planting near water Mains and Sewers" (https://www.southernwater.co.uk/media/pddob0vn/ds-tree-planting-guide-1_nwm.pdf) and the Sewerage Sector Guidance (<https://www.water.org.uk/sewerage-sector-guidance-approved-documents/>) with regards to any landscaping proposals and our restrictions and maintenance of tree planting adjacent to sewers, rising mains and water mains.

Condition: In order to protect public apparatus, Southern Water requests that if consent is granted, the following pre commencement condition is attached to the planning permission; The developer must advise the local authority (in consultation with Southern Water) of the landscaping proposals in proximity of public apparatus in order to protect it in accordance with Southern Water's guidance, prior to the commencement of the development.



Proposed works involve demolition

In order to protect and safeguard the existing water supply apparatus, Southern Water requests formal notification of any proposed demolition works prior to such works being undertaken.


It is possible that a sewer now deemed to be public could be crossing the development site. Therefore, should any sewer be found during construction works, an investigation of the sewer will be required to ascertain its ownership before any further works commence on site.

For further advice, please contact Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX (Tel: 0330 303 0119)

Website: southernwater.co.uk or by email at: SouthernWaterPlanning@southernwater.co.uk

Yours faithfully,

Future Growth Planning Team
southernwater.co.uk/developing-building/planning-your-development

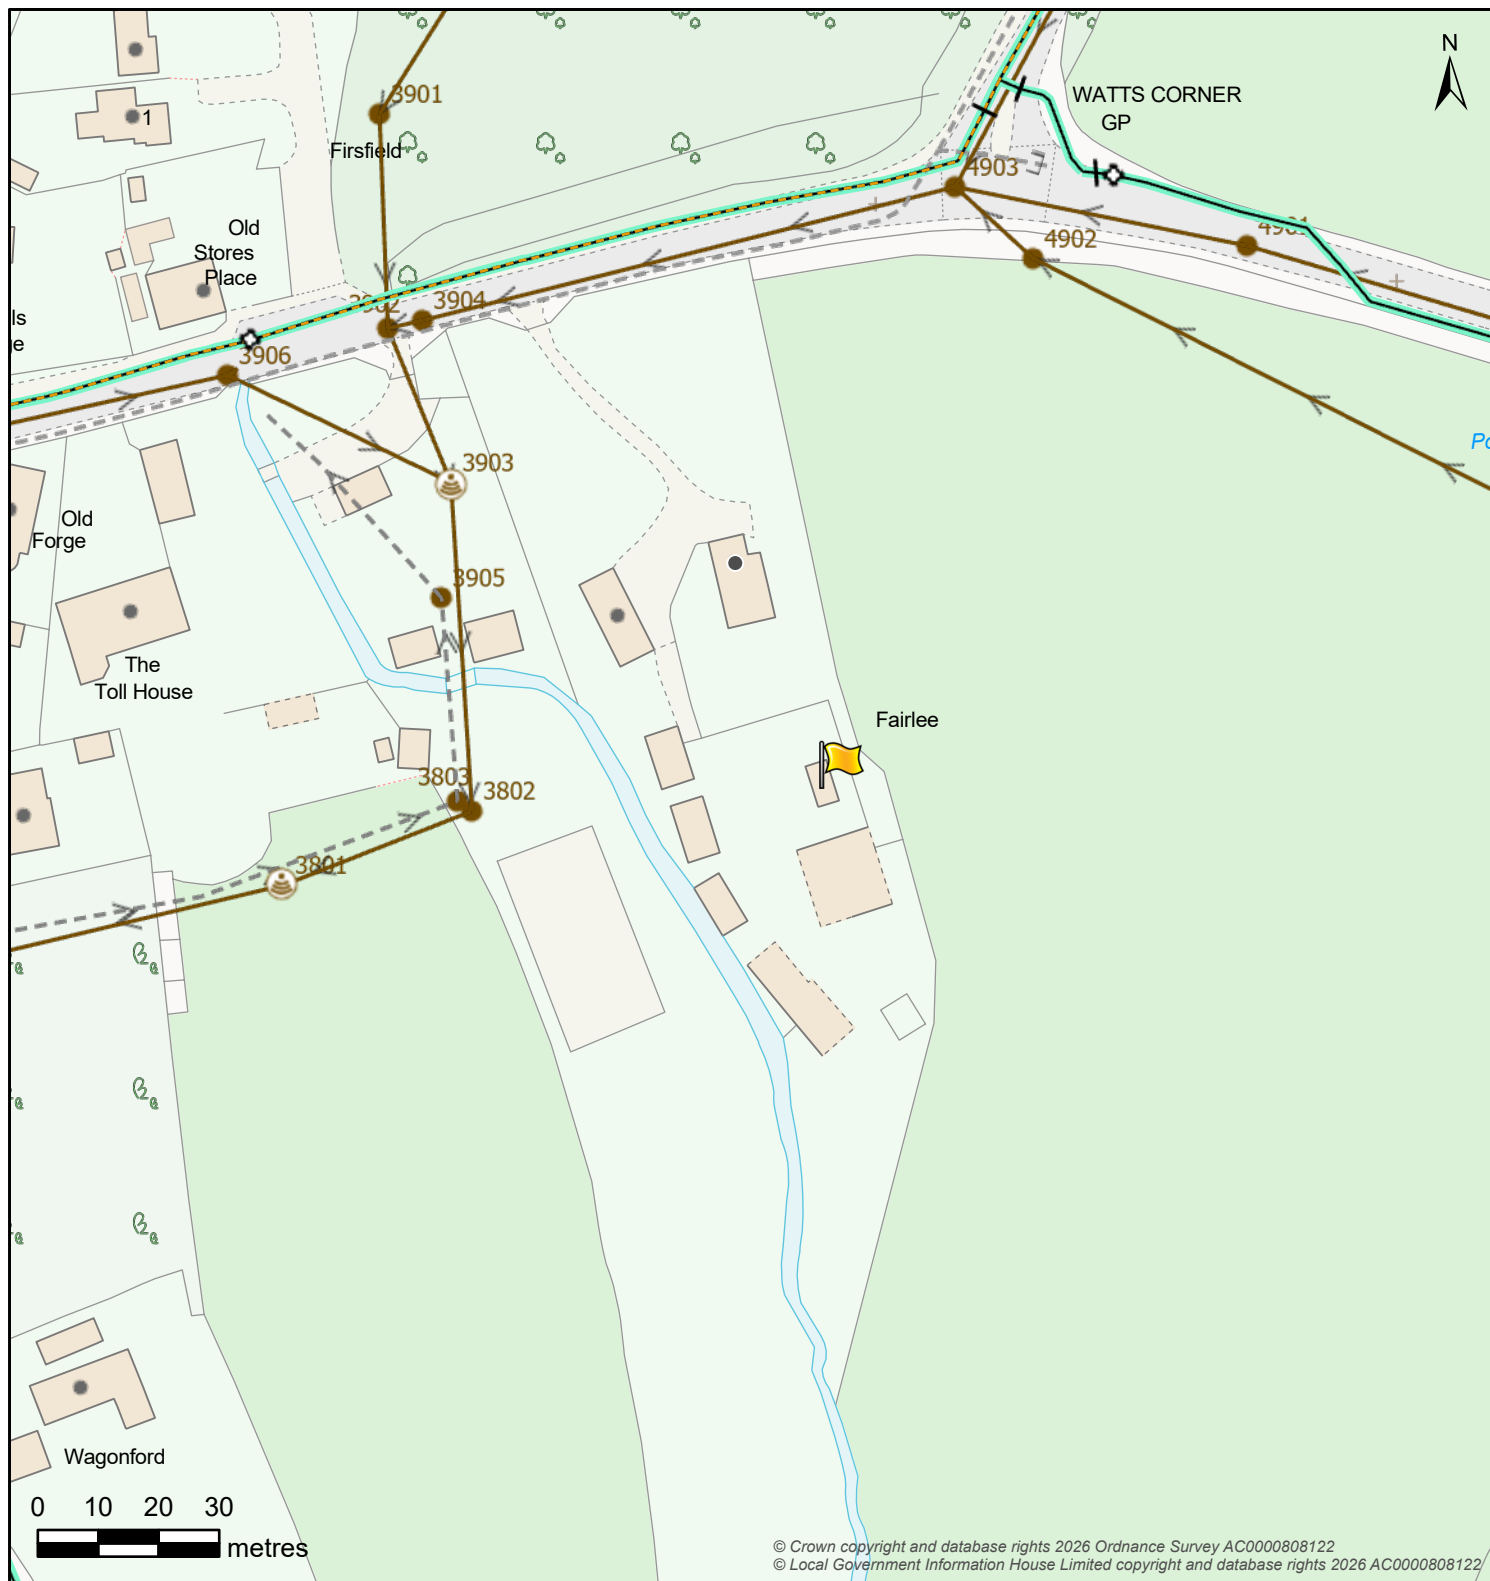

Controllable Valve			Flow Control			Inlet-Outfall	
Manhole							
BIF Bifurcation	Cascade	CP Catchpit	HOP Head Of Public Sewer	IC Interceptor Chamber	Manhole	S Soakaway	WO Washout
Outfall Headworks		Overflow Chamber		Pipe Bridge		Pumping Station	
	CSO Combined Sewer Overflow	EMO Emergency Overflow					
Sewer Level Monitor		Storage		Treatment Works		Weir	
Wastewater Pipe				Wastewater Use		Developer Services	

Map Title: DSA000055242 GIS

Printed By: Kelly.Donaldson

Date Printed: 25/06/2026

Map Scale: 1250

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.

