from Southern Water

Directorate of Planning
Horsham District Council
Parkside
Chart Way
Horsham
West Sussex
RH12 1RL

Your ref
DC/24/0018

Our ref
DSA000031176

Date
12 February 2024

Contact
Tel 0330 303 0119

Dear Sir/Madam,

Proposal: Change of use of the existing building to provide 6 bedspaces for students with special educational needs with associated alterations (Listed Building Consent).
Site: DC/24/0018: - Broadview, Guildford Road, Broadbridge Heath, West Sussex, RH12 3PQ.

Thank you for your letter dated 22 January 2024.

Following the review of the submitted documents, we have the below comments for the Planning consultation.

Foul and Surface Water Drainage

The Environment Agency should be consulted directly by the applicant regarding the use of a private wastewater treatment works which disposes of effluent to sub-soil irrigation.

Our initial investigations indicate that there are no public surface water sewers in the area to serve this development. Alternative means of draining surface water from this development are required. This should not involve disposal to a public foul sewer and should be in line with the Hierarchy of H3 of Building Regulations with preference for use of soakaways.
gov.uk/government/publications/drainage-and-waste-disposal-approved-document-h

It is possible that a sewer now deemed to be public could be crossing the development site. Therefore, should any sewer be found during construction works, an investigation of the sewer will be required to ascertain its ownership before any further works commence on site.

Southern Water Services Ltd, Registered Office: Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX Registered in England No. 2366670

For further advice, please contact Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX (Tel: 0330 303 0119).

Website: southernwater.co.uk or by email at: SouthernWaterPlanning@southernwater.co.uk

Yours faithfully,

Future Growth Planning Team
Developer Services

southernwater.co.uk/developing-building/planning-your-development

Southern Water Services Ltd, Registered Office: Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX Registered in England No. 2366670

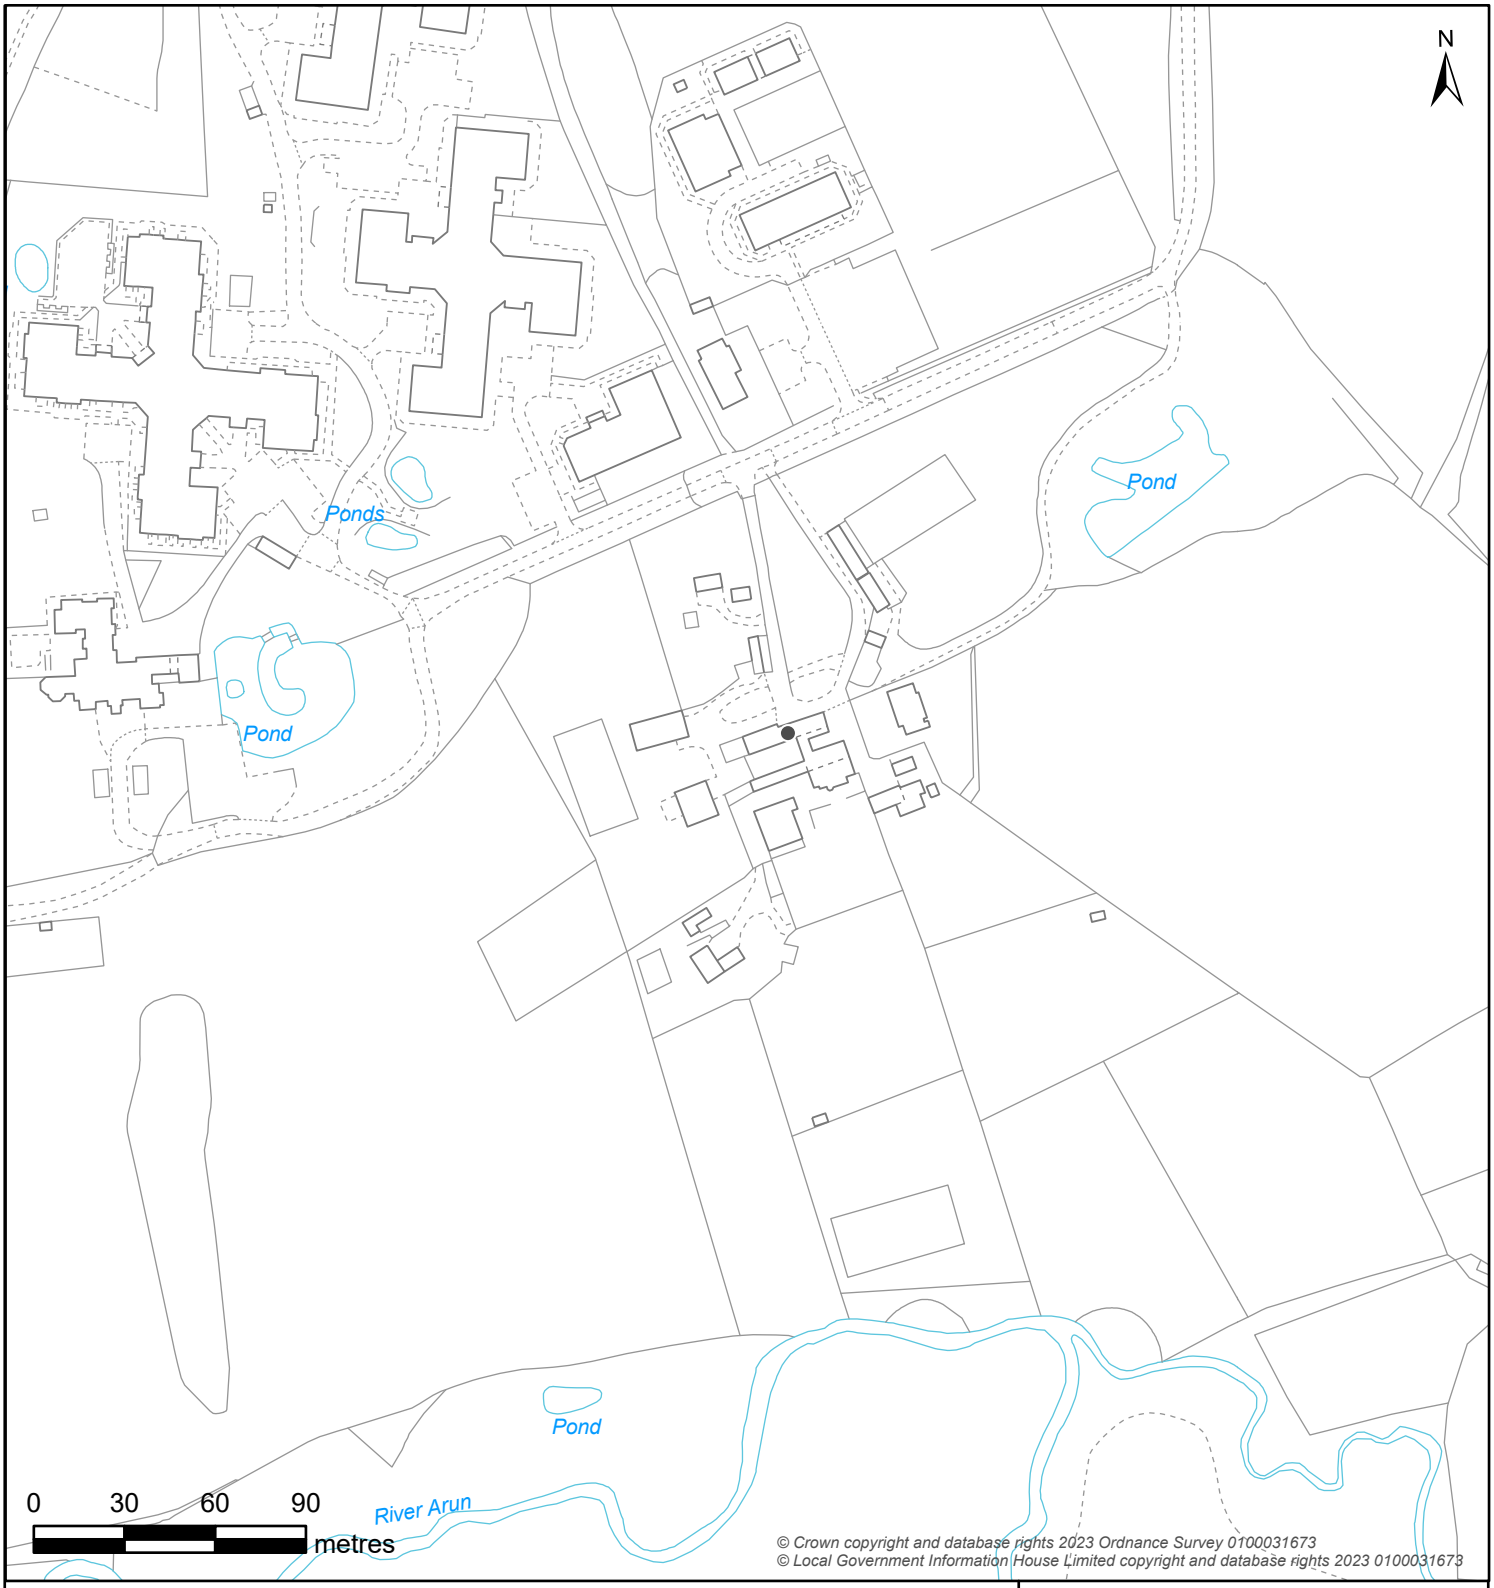

© Crown copyright and database rights 2023 Ordnance Survey 0100031673
© Local Government Information House Limited copyright and database rights 2023 0100031673

Boundary Box	Break Pressure Tank	Capped End	Hydrant
Boundary Box	BPT Break Pressure Tank	Capped End	Emptying Plug; Fire Hydrant; WOH Washout Hydrant

Pressure Monitoring	Service Reservoir	Meter	Valve - Controllable
Logger	Covered; Tower	Meter	Open Valve; Closed Valve; Stop Tap

Site	Valve - Flow
Abstraction Point; Supply Works; Booster Station; Transfer Station; Surface Reservoir; Underground Source	AV Air Valve; NRV Non-Return Valve; WO Washout Empty Valve

Valve - Pressure	Pipe Bridge
PRV Pressure Reducing Valve; PSV Pressure Sustaining Valve	Pipe Bridge

Water Pipe	Water Area
Communication; Trunk; Decommissioned; Distribution; Raw; Discolouration; Non-Potable; Private	Water Supply Zone; District Meter Area

Map Title: SW Print

Printed By: Sachin.Lamani

Date Printed: 09/02/2024

Map Scale: 2500

The positions of pipes on this plan are believed to be correct, but Southern Water Services Ltd accept no responsibility in the event of inaccuracy. The actual positions should be determined on-site

WATER for LIFE from Southern Water