


125mm
Rigi Duct
185ax
0.75m

UK Power Networks	IF IN DOUBT - ASK! PHONE 0800 056 5566 EMERGENCY - If you damage a cable, call 0800 782 8838 (24hrs) URGENTLY	ALWAYS LOOK UP BE FORE Refer to ISE Guidance note 556	Also produced at 1:2500 scale are Geo-Schematic which show LV mains cables and overhead lines (in some cases all voltages). Prior to carrying out excavations you must refer to the 1:500 records to determine the location of all known underground plant and equipment.
	IF IN DOUBT - ASK! PHONE 0800 056 5566 EMERGENCY - If you damage a cable, call 0800 782 8838 (24hrs) URGENTLY	ALWAYS LOOK UP BE FORE Refer to ISE Guidance note 556	Also produced at 1:2500 scale are Geo-Schematic which show LV mains cables and overhead lines (in some cases all voltages). Prior to carrying out excavations you must refer to the 1:500 records to determine the location of all known underground plant and equipment.



A

7. The undersigned hereby certifies that the above information is true and correct to the best of his knowledge and belief, and that he is not aware of any information that would cause the above information to be untrue or incorrect.


Signature of the undersigned: _____

Name of the undersigned: _____

Title of the undersigned: _____


Date: _____

Cross Section : 2518557

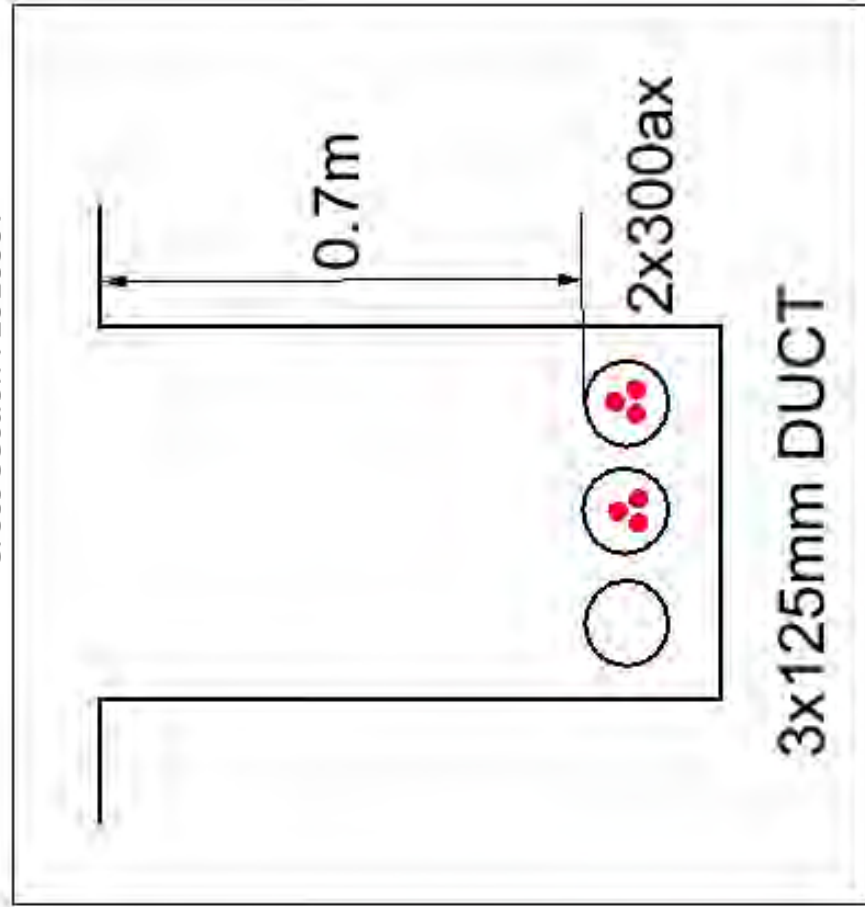


Cross Section
2518557

 UK Power Networks	IF IN DOUBT - ASK! PHONE 0800 056 5866 EMERGENCY - if you damage overhead lines or cables, call 0800 782 8038 (24hrs) URGENTLY	ALWAYS LOOK UP BE FORRE YOU START WORK Refer to HSE guidance note 556 	Also produced at 1:2500 scale are Geo-Schematics which show LV mains cables and overhead lines (in some cases all voltages). Prior to carrying out excavations you must refer to the 1:500 records to determine the location of all known underground plant and equipment.
UK Power Networks	IF IN DOUBT - ASK! PHONE 0800 056 5866 EMERGENCY - if you damage overhead lines or cables, call 0800 782 8038 (24hrs) URGENTLY	ALWAYS LOOK UP BE FORRE YOU START WORK Refer to HSE guidance note 556 	Also produced at 1:2500 scale are Geo-Schematics which show LV mains cables and overhead lines (in some cases all voltages). Prior to carrying out excavations you must refer to the 1:500 records to determine the location of all known underground plant and equipment.

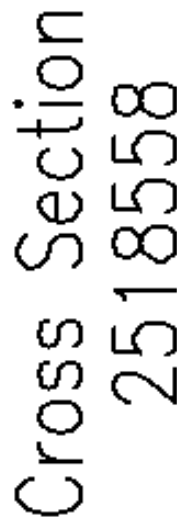

	IF IN DOUBT - ASK! PHONE 0800 036 5844 EMERGENCY - If you damage a cable or line Phone 0800 783 88 38 (24/7) URGENTLY		ALWAYS LOOK UP BEFORE YOU DIG Refer to HSE Guidance note 556
Most cables are 1500V cables and are 1500V cables which show 1500V cables and 1500V cables. Prior to carrying out excavations you must refer to the 1500V records to determine the location of all known underground plant and equipment.			

Cross Section : 2518555

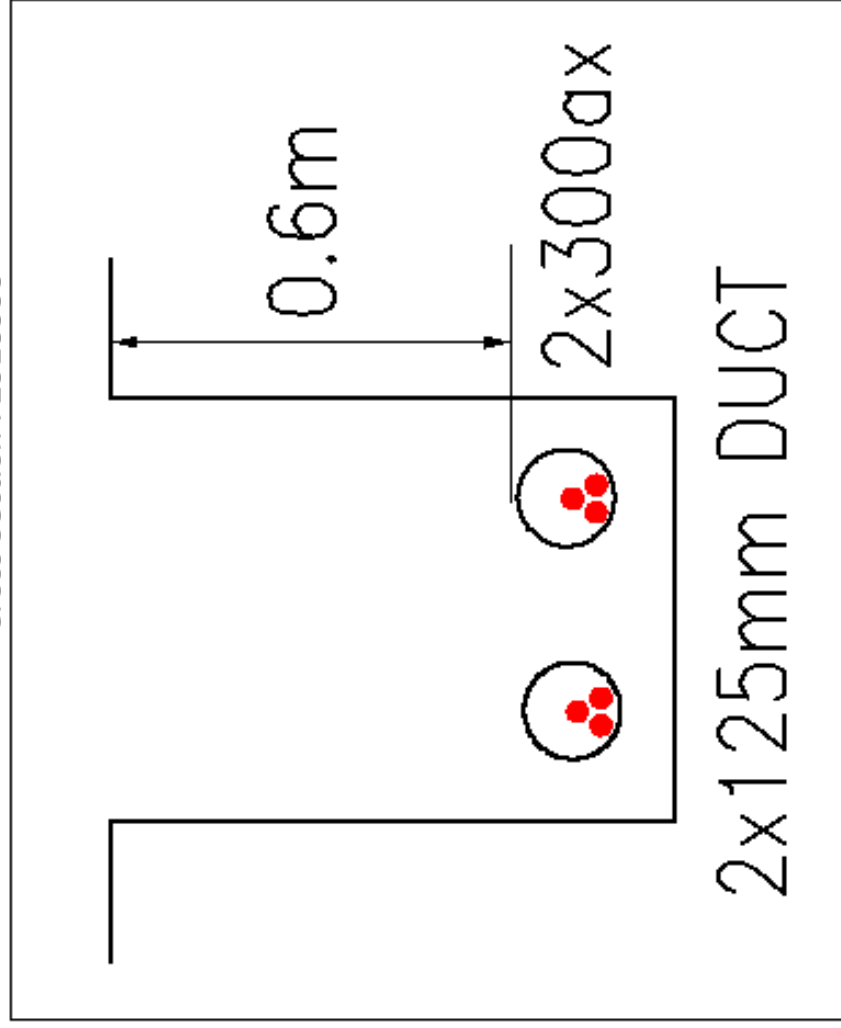

Cross Section
2518555

[illegible]


0.7m

2x300ax

3x125mm DUCT

	IF IN DOUBT - ASK! PHONE 0800 056 5866 EMERGENCY - If you damage Phone 0800 782 8838 (24hrs) URGENTLY	ALWAYS LOOK UP BE FORE Refer to ISE Guidance note 556
	Approx produced at 1:2500 scale are Geo-Schematic which show LV mains cables and overhead lines (in some cases all voltages). Prior to carrying out excavations you must refer to the 1:500 records to determine the location of all known underground plant and equipment.	

Cross Section : 2518554

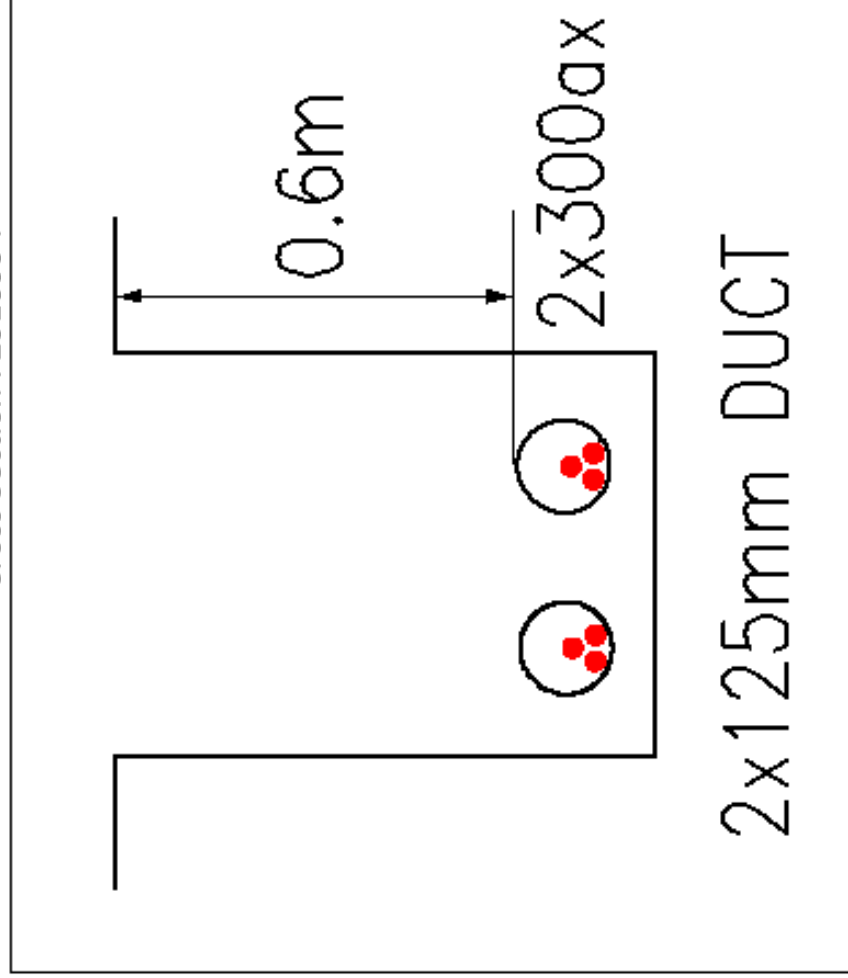

Cross Section
2518554

[illegible]



Network Records NetMAP Symbols Booklet - South East England

Version 1.2

Released October 2010

Always check with your local Network Records office or the UK Power Networks server to ensure that you are using the most up to date copy of this booklet - Tel: 08000 565866

(i)

Index:-

Page no:	Contents:
1	Guidance notes.
2	The area covered by this guide.
3	<u>1:500 (& 1:1250) view</u>
	Scenery.
4	Scenery (UK Power Networks use only).
7	Primary distribution line route (EHV).
8	Secondary distribution cables (HV/LV).
9	Secondary distribution cable terminology.
12	Cable ducts.
13	Poles.
14	EHV, HV and LV sites.
15	Joints.
16	Street furniture
17	Miscellaneous.
18	Connectivity.
19	Abbreviations.
20	Cable phasing.
21	Operational status colours.
22	<u>1:2500 view</u> (UK Power Networks use only).
	Notes.
23	Primary distribution line route.
24	Secondary distribution cables.
25	Primary and secondary sites.
27	Switch types.
28	<u>1:10000 view</u> (UK Power Networks use only).
	Notes.
29	Secondary distribution cables.
30	Primary and secondary sites.

(ii)

Guidance notes.

Important notice:


If you do not understand the NetMAP record that you are using, please contact the UK Power Networks Network Records team for guidance on
Tel: 08000 565866.

- The position of apparatus shown on NetMAP is believed to be correct, but the original landmarks may have altered since the apparatus was installed.
- It must be assumed that there is at least one service to each property, lamp column, street sign etc.
- Third party cables are not usually shown.
- When viewed in black and white, the line-style indicates the voltage.
- All LV cables are 4 core and all HV cables are 3 core – unless otherwise stated.
- All cables are copper – unless otherwise stated.




**Plan Provision Team
and CableWatch
Fore Hamlet
Ipswich
Suffolk IP3 8AA
Tel: 08000 565866**

The area covered by this guide:

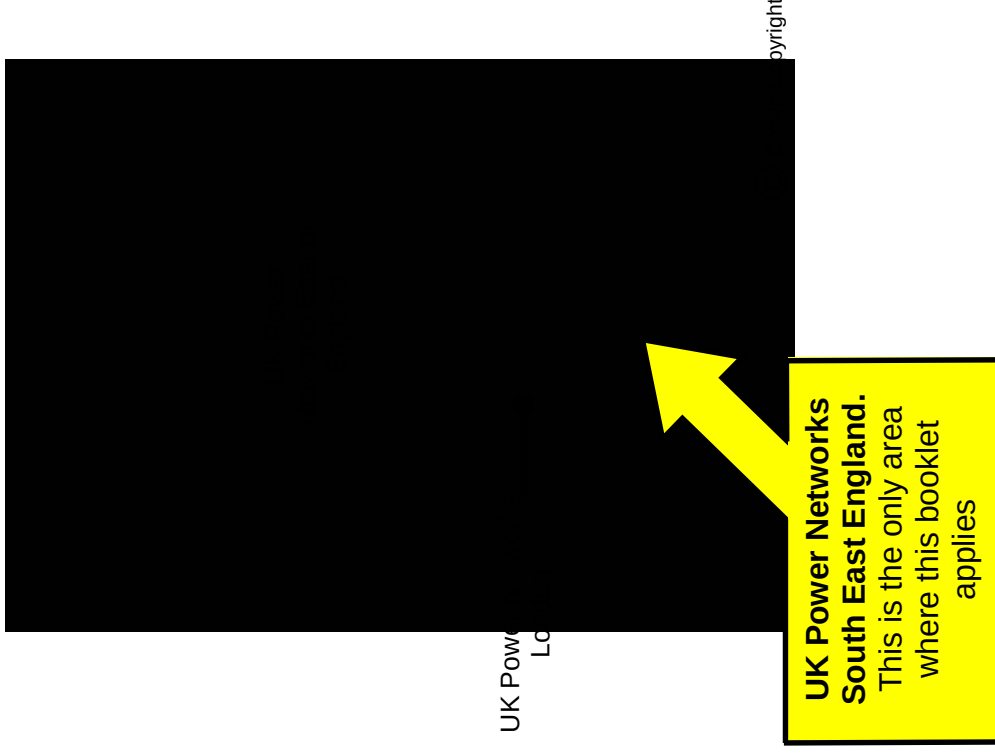


1:500 (& 1:1250) view	
Scenery	
NetMAP system	Description
   	Secondary buildings and fence lines Building line Kerb line UK Power Networks / SPN licence boundary (not visible unless selected)


Scenery for UK Power Networks use only - boxed in red	
NetMAP system	Description
 Inset Network – Contact xxxx IDNO for further information  Proposed Cross Rail route (only visible to UK Power Networks and their immediate contractors)  High pressure pipelines in the general vicinity (only visible to UK Power Networks and their immediate contractors)	Area of inset network - not the asset of UK Power Networks (only visible to UK Power Networks and their immediate contractors) Note: Pipelines are only viewable on NetMAP by UK Power Networks staff and their immediate contractors. Do not carry out any excavation without consent from the relevant agency - legally protected high pressure petroleum products pipeline route in the general vicinity - consult www.linewatch.co.uk for contacts and guidance. Pipeline contact numbers can also be found on the intranet – out of hours, contact our Control Centre.
 Water - surface water (only visible to UK Power Networks and their immediate contractors)  Water - Source Protection Zone 1 (only visible to UK Power Networks and their immediate contractors)  Water - Source Protection Zone 2 (only visible to UK Power Networks and their immediate contractors)  Water - Source Protection Zone 3 (only visible to UK Power Networks and their immediate contractors)	Water - surface water (only visible to UK Power Networks and their immediate contractors) Water - Source Protection Zone 1 (only visible to UK Power Networks and their immediate contractors) Water - Source Protection Zone 2 (only visible to UK Power Networks and their immediate contractors) Water - Source Protection Zone 3 (only visible to UK Power Networks and their immediate contractors)

section continued on next page

Scenery for UK Power Networks use only - boxed in red	
NetMAP system	Description
	Historical - Scheduled Monuments (only visible to UK Power Networks and their immediate contractors)
	Historical - Parks and Gardens (only visible to UK Power Networks and their immediate contractors)
	Historical - Areas of Archaeological Potential (AAP) (only visible to UK Power Networks and their immediate contractors)
	Nature - Ramsar Wetlands of International Importance (only visible to UK Power Networks and their immediate contractors)
	Nature - Special Area of Conservation (SAC) (only visible to UK Power Networks and their immediate contractors)
	Nature - Special Protected Area (SPA) (only visible to UK Power Networks and their immediate contractors)
	Nature - Site of Special and Scientific Interest (SSSI) (only visible to UK Power Networks and their immediate contractors)
section continued on next page	

Scenery for UK Power Networks use only - boxed in red	
NetMAP system	Description
	Nature - Local Nature Reserve (only visible to UK Power Networks and their immediate contractors)
	Nature - National Nature Reserve (only visible to UK Power Networks and their immediate contractors)
	Nature - Area of Outstanding Natural Beauty (AONB) (only visible to UK Power Networks and their immediate contractors)
	Nature - National Park (only visible to UK Power Networks and their immediate contractors)
	Fluid filled cables - very high sensitivity (only visible to UK Power Networks and their immediate contractors)
	Fluid filled cables - high sensitivity (only visible to UK Power Networks and their immediate contractors)
	Fluid filled cables - medium sensitivity (only visible to UK Power Networks and their immediate contractors)
	Fluid filled cables - low sensitivity (only visible to UK Power Networks and their immediate contractors)

Primary distribution line route (1:500 view)		
NetMAP system		Description
  		275–400kV National Grid route 132kV cable route 33kV cable route
Approximate routes only – see separate record		

Secondary distribution cables (1:500 view)		
NetMAP system	Description	
            	11kV underground cable 11kV overhead line 6.6kV underground cable 6.6kV overhead line <6.6kV underground cable <6.6kV overhead line LV underground cable LV overhead line Pilot cable LV street lighting (pl) Service overhead line Service underground Logical service connection	


Secondary distribution cable terminology (1:500 view)	
HV underground	
sta (no text) XLPE bos scs ua c/c Poly BOTES of 33 kV design ax cx	PILCSTA (paper insulated lead covered steel tape armour) PILCSWA (paper insulated lead covered steel wire armour) XLPE (cross linked polyethylene) insulation CAS (corrugated aluminium sheath) belted construction CAS (corrugated aluminium sheath) with screened cores PILC (paper insulated lead covered) unarmoured Concentric cores Poly (polyethylene) insulation BOTES – Board of Trade earth screen Oil filled Constructed to 33 kV specification Triplex with aluminium conductor Triplex with copper conductor
HV overhead	
(no text) pvc cat +ew ccc	Bare open wire Open wire PVC covered ABC (aerial bundled or bunched conductor) with supporting strain wire Open wire with extra earth conductor Compact covered conductor
Overhead line materials	
scs cc st sil ccs cpl	Steel cored aluminium Cadmium copper Steel Simdlec Copper covered steel Compactal
section continued on next page	


Secondary distribution cable terminology continued (1:500 view)	
LV underground mains and services	
w we H He ua (no text) XLPE DISTRI c/c s/c CONSAC vb Capothene tby swa sac Solidal LSF Trough	Waveform Waveform with separate earth wire Hybrid – copper neutral with aluminium phase conductor Hybrid with separate earth wire PILC (paper insulated lead covered) unarmoured PILC (paper insulated lead covered) with/without armour XLPE (cross linked polyethylene) insulation PISTA (paper insulated steel tape armour) 4c SAC (solid aluminium core) with lead covered neutral Concentric cores Split concentric with separated neutral and earth wires Paper insulated aluminium sheathed 3 core with solid aluminium cores Vulcanised bitumen/rubber insulation Capothene core insulation Tape braid and yarn PILSWA (paper insulated lead steel wire armour) PILSTA (paper insulated steel tape armour) solid aluminium core 4 sector SAC with solid aluminium cores Low smoke and fume (orange cable) Cable laid in filled trough
LV overhead mains and services	
(no text) ABC cat pvc c/c H ue vir	Bare open wire Aerial bundled (or bunched) conductor ABC (aerial bundled or bunched conductor) with supporting strain wire PVC covered open wire Concentric cores Hybrid – copper neutral with aluminium phase conductor Under eaves – hessian covered lead cable Vulcanised India rubber insulation
section continued on next page	

Secondary distribution cable terminology continued (1:500 view)	
Various annotation	
.1 185 a ITC	Cable size (sq. inches) Cable size (sq. millimetres) Aluminium Instrument traced cable or ITC - cable traced electronically using Cable Avoidance Tool (CAT) or similar


Cable ducts (1:500 view)	
NetMAP system	Description
Extent of Ducts 2 x 125 pvc Duct 2 way Duct 1 way (no text) Spare duct Cross section arrow A or 746345 A or 746345 LV 95ax	Duct 2 way Duct 1 way (no text) Spare duct Cross section arrow Cross section showing: duct, tile depth, tile, single LV cable and HV Triplex cable
Duct materials	
(no text) pvc st asb fbr wi cp t/e	Earthenware pvc Steel Asbestos Fibre Iron Concrete pipe Trenchless excavation


Poles (1:500 view)		
NetMAP system	Description	
       	Section pole Pole number (unique) Single leg H pole 3 member 4 member Strut Pole support (stay) Flying stay Tower 33kV to 400kV	

EHV, HV and LV sites (1:500 view)		
NetMAP system		Description
Note: EHV and HV sites are identified by a unique 6 digit number (SPENS)		
		Ground mounted primary substation showing name, transformer voltage and SPENS number
		Pole mounted substation showing name and SPENS number
		Ground mounted substation showing name and SPENS number
		2 way link box
		4 way link box
		Link box without busbar
		(options similar to 1:2500 view) LV distribution pillar
		Voltage regulator
		Voltage balancer
		Open point
		Open point – out of phase
		Overhead open point
Note: For LV linking, use the 1:2500 view		

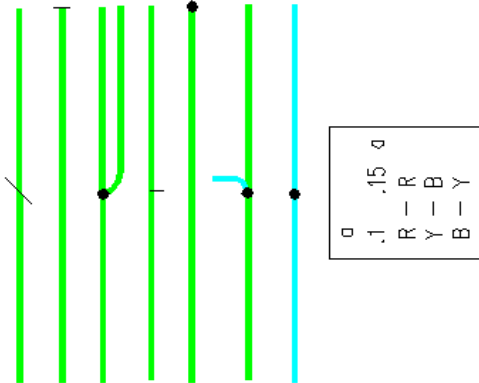Joints (1:500 view)		
NetMAP system	Description	
	Straight (same for HV) Pot end (same for HV) Branch (same for HV) Sleeve repair Capped end Service to LV main Under eaves service Jointing phase drawing	

Street furniture (1:500 view)		
NetMAP system	Description	
	Pole mounted street light	
	Street light	
	Zebra crossing	
	Road sign	
	Ballard	
	Pelican crossing	
	Traffic controller	
	Advertising sign	
	Amplifier station	
	Control cubicle	
	<u>Text displayed/description</u>	
	Pay and display	
	Bus shelter	
	TBS	
	Kiosk	
	Water meter	
	PL pillar	
	TCB	
	Unknown	

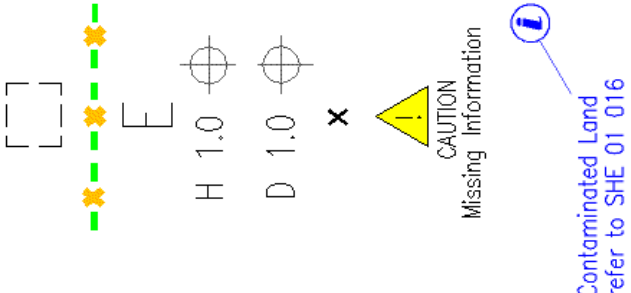Miscellaneous (1:500 view)	
NetMAP system	Description
	Underground chamber or draw pit Earth conductor Earth pin Height marker Depth marker Supply point Missing data in or near this location Contaminated land reference


Connectivity (1:500 view)	
NetMAP system	Description
	Edge node Node Connector Pole termination (nothing visible unless selected) Edge nodes, nodes, connectors and pole termination joints may not appear on screen unless turned on and selected.


Abbreviations (1:500 view)		
NetMAP system	Description	
NR SU AB (M) V05 MS MP pmt pl TBS TCB CET IT CAT +sl +sw 2c PESL Added Excluded IIP VSxxxx CB	No record Size unknown Abandoned PME available Year LV linking verified Milestone Marker post Pole mounted transformer Public lighting Temporary builder's supply Telephone call box Cable electronically traced Instrument traced (same as CET) Cable avoidance tool (same as CET) Street lighting Switch wire 2 core Public Electricity Supply License Supplied by SPN Not supplied by SPN Assumed open point Vacant site Callender box	



Cable phasing (1:500 view)		
Old core colours	Shown on map	New core colours
Neutral Red Yellow Blue	Neutral R Y B	Blue Brown Black Grey
Note:– Scott is a different phasing system		

Operational status colours (1:500 view)	
PROPOSAL ——— Symbols and cables appear in ORANGE	
OUT OF SERVICE ——— Cable and joints appear in BLACK	
ABANDONED ——— Cables and joints appear in GREY	

1:2500 view - for UK Power Networks use only - boxed red	
Notes	
1. No underground HV cables are shown on the 1:2500 view	
2. Poles and joint details are similar to the 1:500 view	
3. For cable/line information refer to the 1:500 view	

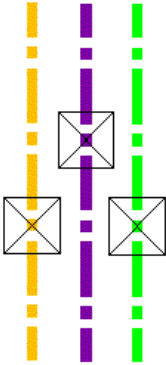Primary distribution line route (1:2500 view)		
NetMAP system	Description	
	275–400kV National Grid route 132kV cable route 33kV cable route	

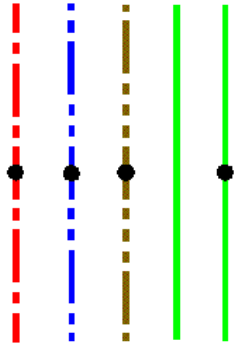Secondary distribution cables (1:2500 view)		
NetMAP system	Description	
	11kV overhead line 6.6kV overhead line <6.6kV overhead line LV underground cable LV overhead line	

Primary and secondary sites (1:2500 view)	
NetMAP system	Description
Note: EHV and HV sites are identified by a unique 6 digit number (SPENS)	
5.0 3Ph	Ground mounted substation showing capacity, phase, name and SPENS number
0.16 1Ph ● SITE NAME 521232 SITE NAME pnt 522154 SITE NAME 008590	Pole mounted substation showing capacity, phase, name and SPENS number Primary substation showing name and SPENS number (no site shown)
	2 way link box
	4 way link box
4Jxxxx	Link box identifier
	4 way link box without busbar
	6 way link box without busbar
	8 way link box without busbar
section continued on next page	

Primary and secondary sites continued (1:2500 view)	
NetMAP system	Description
	LV distribution pillar
	Voltage regulator
	Voltage balancer
	Open point
	Open point – out of phase
	Earth pin

Switch types (1:2500 view)		
NetMAP system	Description	
ABSD A/R A/S FUSE S/D PF ASL PMR PMS GVR	Air brake switch disconnecter Auto recloser Sectionaliser Fuse Surge diverter Pathfinder Automatic sectionalising links Pole mounted recloser Pole mounted sectionaliser Gas vacuum recloser	

1:10000 view - for UK Power Networks use only - boxed red		
Notes		
1. No EHV cables/overhead lines shown on 1:10000 view. 2. For congested areas print at 1:5000. 3. HV site used instead of branch joint on 1:10000 for connectivity purposes. The site is not displayed until it is selected.		

Secondary distribution cables (1:10000 view)		
NetMAP system	Description	
     	11kV underground cable 6.6kV underground cable <6.6kV underground cable 11kV overhead line 6.6kV overhead line <6.6kV overhead line	

Primary and secondary sites (1:10000 view)		
NetMAP system	Description	
Note: EHV and HV sites are identified by a unique 6 digit number (SPENS)		
SITE NAME 008590 	Primary substation showing name and SPENS number	
SITE NAME 521234 	11kV ground mounted substation showing name and SPENS number	
SITE NAME 524514 	6.6kV ground mounted substation showing name and SPENS number	
SITE NAME 523634 	<6.6kV ground mounted substation showing name and SPENS number	
SITE NAME pmt 527522 	11kV pole mounted substation showing name and SPENS number	
SITE NAME pmt 525743 	6.6kV pole mounted substation showing name and SPENS number	
SITE NAME pmt 526543 	<6.6kV pole mounted substation showing name and SPENS number	
SITE NAME 527238 	Pole mounted switching substation showing name and SPENS number	



Be Bright

Stay Safe

Stop!
Think before
you dig!



Your life can be lost within seconds if you come into contact with electricity.

Every year, people are killed or seriously injured when they come into contact with high voltage electricity.

This can have a far-reaching and devastating effect on family, friends and colleagues.

Distractions, working long hours, rushing to get the job done, can all impact on how we work and our safety.

Taking time to plan, being prepared and focusing on the way we work can help keep us safe.



WOODEN POLES CAN CARRY TELEPHONE AND ELECTRICITY WIRES. **NEVER ASSUME** THE WIRE IS A TELEPHONE WIRE



LINES CAN BE **RE-ENERGISED** AT ANY TIME

400,000 VOLTS ⚡
ELECTRICITY SYSTEMS CARRY VOLTAGE UP TO 400,000 VOLTS. **EVEN 230 VOLTS (DOMESTIC VOLTAGE) CAN BE LETHAL**




Be Bright



Stay Safe



OUR NETWORK DISTRIBUTES ELECTRICITY THROUGH UNDERGROUND CABLES, PYLONS, OVERHEAD POWER LINES, SUBSTATIONS AND OTHER EQUIPMENT

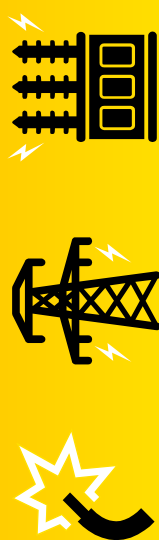

National power cut helpline
POWER CUT? CALL 105 ⚡
OR CALL US 24 HOURS A DAY ON **0800 31 63 105**

TAKE NOTICE OF ANY YELLOW 'DANGER OF DEATH' WARNING SIGNS. AND STAY WELL AWAY!



REMEMBER ELECTRICITY **CAN JUMP GAPS**



OVERHEAD POWER LINES ARE OFTEN UNINSULATED (BARE)



CARRY OBJECTS AND EQUIPMENT **HORIZONTALLY AND AT LOW LEVEL TO THE GROUND**

CABLES ARE OUT OF SIGHT ALWAYS REQUEST CABLE PLANS BEFORE STARTING WORK



TOUCHING ANYTHING IN CONTACT WITH ELECTRICAL EQUIPMENT, EVEN THE LOWEST OF VOLTAGES, CAN BE FATAL



The electricity network is designed to keep you safe. But how safe are you when you are working?

UK Power Networks is the country's biggest electricity distributor, making sure the lights stay on for more than eight million homes and businesses across London, the South East and the East of England.

The safety of our customers and staff is our top priority.

Underground cables carry a powerful electrical charge which can be conducted through machinery and equipment with fatal consequences. Anyone working close to live underground cables should take the time to read this simple leaflet and identify the precautions they should be taking.



Remember:

- The depth and location of cables and services shown on the plans may have changed because of subsequent site alterations
 - Be aware that not all cables and services may be shown on the plans
 - Cables do not run in straight lines. Underground cables may be deflected around underground obstacles and can change depth
 - Wear Personal Protective Equipment to minimise the harm of electric shock and burns
- If you are building a permanent or temporary structure within close proximity of power lines it's a legal requirement* you notify us in advance to ensure your building is kept at a safe distance from power lines, and to avoid the need to relocate our equipment in the future. This can be done by completing a simple form here www.ukpowernetworks.co.uk/notifyus
- *Regulation 18(3) of the Electricity, Quality & Continuity Regulations 2002 (ESQCR)

How can we help?

If you work or live in the UK Power Networks area contact us or look on our website. We provide free information and advice about the precautions and safe working practices to be followed when working close to electrical equipment.

Further advice and guidance is available from the Health and Safety Executive (HSE):

HSG85 - Electricity at Work – Safe Working Practices
GS6 - Avoiding Danger from Overhead Power Lines
HSG47 - Avoiding Danger from Underground Services

What to do in an emergency

If a mains electricity cable is damaged:

- **STOP WORK IMMEDIATELY**
- Notify UK Power Networks: Dial 105
- If you damage a cable, stay calm, keep clear, and call for help
- Call the emergency services if anyone is injured or there is a fire. Anyone who has received an electric shock should go to hospital as damage may have occurred to the heart
- Always treat the cable(s) as live even if they are not sparking
- Never remove anything that is stuck or in contact with the cable
- Stay clear - keep everyone away until assistance arrives



To request your FREE vehicle cab stickers visit the safety pages at www.ukpowernetworks.co.uk

If you are unsure who your network operator is then please visit www.energynetworks.org

Be Bright Stay Safe

You could be in danger when carrying out your everyday trades activities such as digging, construction and demolition.

⚡ Contact UK Power Networks or Line Search Before U Dig (LSBUD) in advance of the works to obtain relevant cable plans or to request disconnections. The cable plans will only show the indicative route and not the route into the property

⚡ Ensure the cable plans are shown to and understood by those on site BEFORE starting work

⚡ Confirm the cable location by using a Cable Avoidance Tool (CAT) before digging commences. Once found, mark cable positions with spray paint or similar

For cable plans visit
www.lsbud.co.uk or
www.ukpowernetworks.co.uk

⚡ Complete a risk assessment and ensure it covers electrical hazards

⚡ Use spades and shovels with insulated handles in preference to forks and picks

⚡ Look around for anything in the vicinity that would have an electricity service such as street lights, CCTV cameras, or meter boxes and identify where the cables are

⚡ Look for electrical wires, cables and equipment near to where you are going to work and check for warning signs and any other hazards

⚡ Contact UK Power Networks to agree a safe method of work if there is a cable encased in concrete, **DO NOT BREAK OPEN**

⚡ Make sure everyone on site is aware of the presence and location of electrical cables

⚡ Before demolishing a building make sure supplies are disconnected, preferably well clear of the work area. For guidance on how to arrange a disconnection visit www.ukpowernetworks.co.uk

NATIONAL POWER CUT HELPLINE

**POWER CUT?
CALL 105**

ADD THIS NUMBER TO YOUR
TELEPHONE CONTACTS LIST



Stop! Think before you dig!

#bebrightstaysafe



@UKPowerNetworks



/ukpowernetworks

National power cut helpline

**POWER CUT?
CALL 105**

Or call us
24 hours a day on
0800 31 63 105




what3words

To report broken or damaged electrical equipment or in an emergency call 0800 31 63 105 or 105 and use what3words to help us locate you faster.

For safety advice about overhead power lines, disconnections and general enquiries, go to:
www.ukpowernetworks.co.uk

To request your **FREE** vehicle cab stickers visit the safety pages at **www.ukpowernetworks.co.uk**

If you are unsure who your network operator is then please visit
www.energynetworks.org

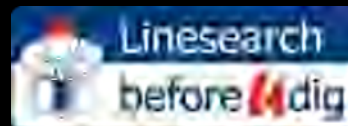

**UK
Power
Networks**
Delivering your electricity



Affected Utilities

Utility Assets

ADVISORY NOTICE

SUPPLIER UPDATE: Utility Assets

On 27/02/2026 an enquiry was sent to Utility Assets' plant record department. As of the date of issue of this Utilities Report, we have not received a formal response from Utility Assets in regards to owning any equipment on this site. Utility Assets have however advised the following:

"Thank you for recently contacting Utility Assets plant record department. We will check whether we have any plant present at your site and contact you within 5 - 7 working days ONLY if we own any plant in the vicinity.

If we do not reply, we do not have any apparatus in the area of your works. However, PLEASE TAKE CARE when excavating around electricity cables in the event that not all cables present may be accurately shown. We recommend you use detecting equipment to map the site before excavating and fully comply with HSG47. DO NOT assume that a cable is dead if you don't have a record of its presence. The cable must be treated as live unless PROVEN DEAD by the cable owner. In case of emergency please contact your local electricity distribution company.

This is an automated reply from our dedicated asset records email address. If you receive further correspondence from us it will be from asset.manager@utilityassets.co.uk quoting a site reference number.

Asset Manager - Utility Assets Ltd"


If a formal response is received within 3 months of the date of this search it will be forwarded onto you as per our usual service. However, without formal communication from Utility Assets it remains unconfirmed that your site will not be affected by their network. Utility Assets will not acknowledge receipt of this enquiry, or any subsequent chases, unless their network will be affected.

Terms and Conditions

Full Terms and Conditions can be found on the following URL:
<http://www.landmarkinfo.co.uk/Terms/Show/515>

Please note that Utilities Reports have a validity of 3 months from the date of purchase.

If you experience difficulties accessing our Terms and Conditions, please telephone our Customer Service Team on 0844 844 9966.

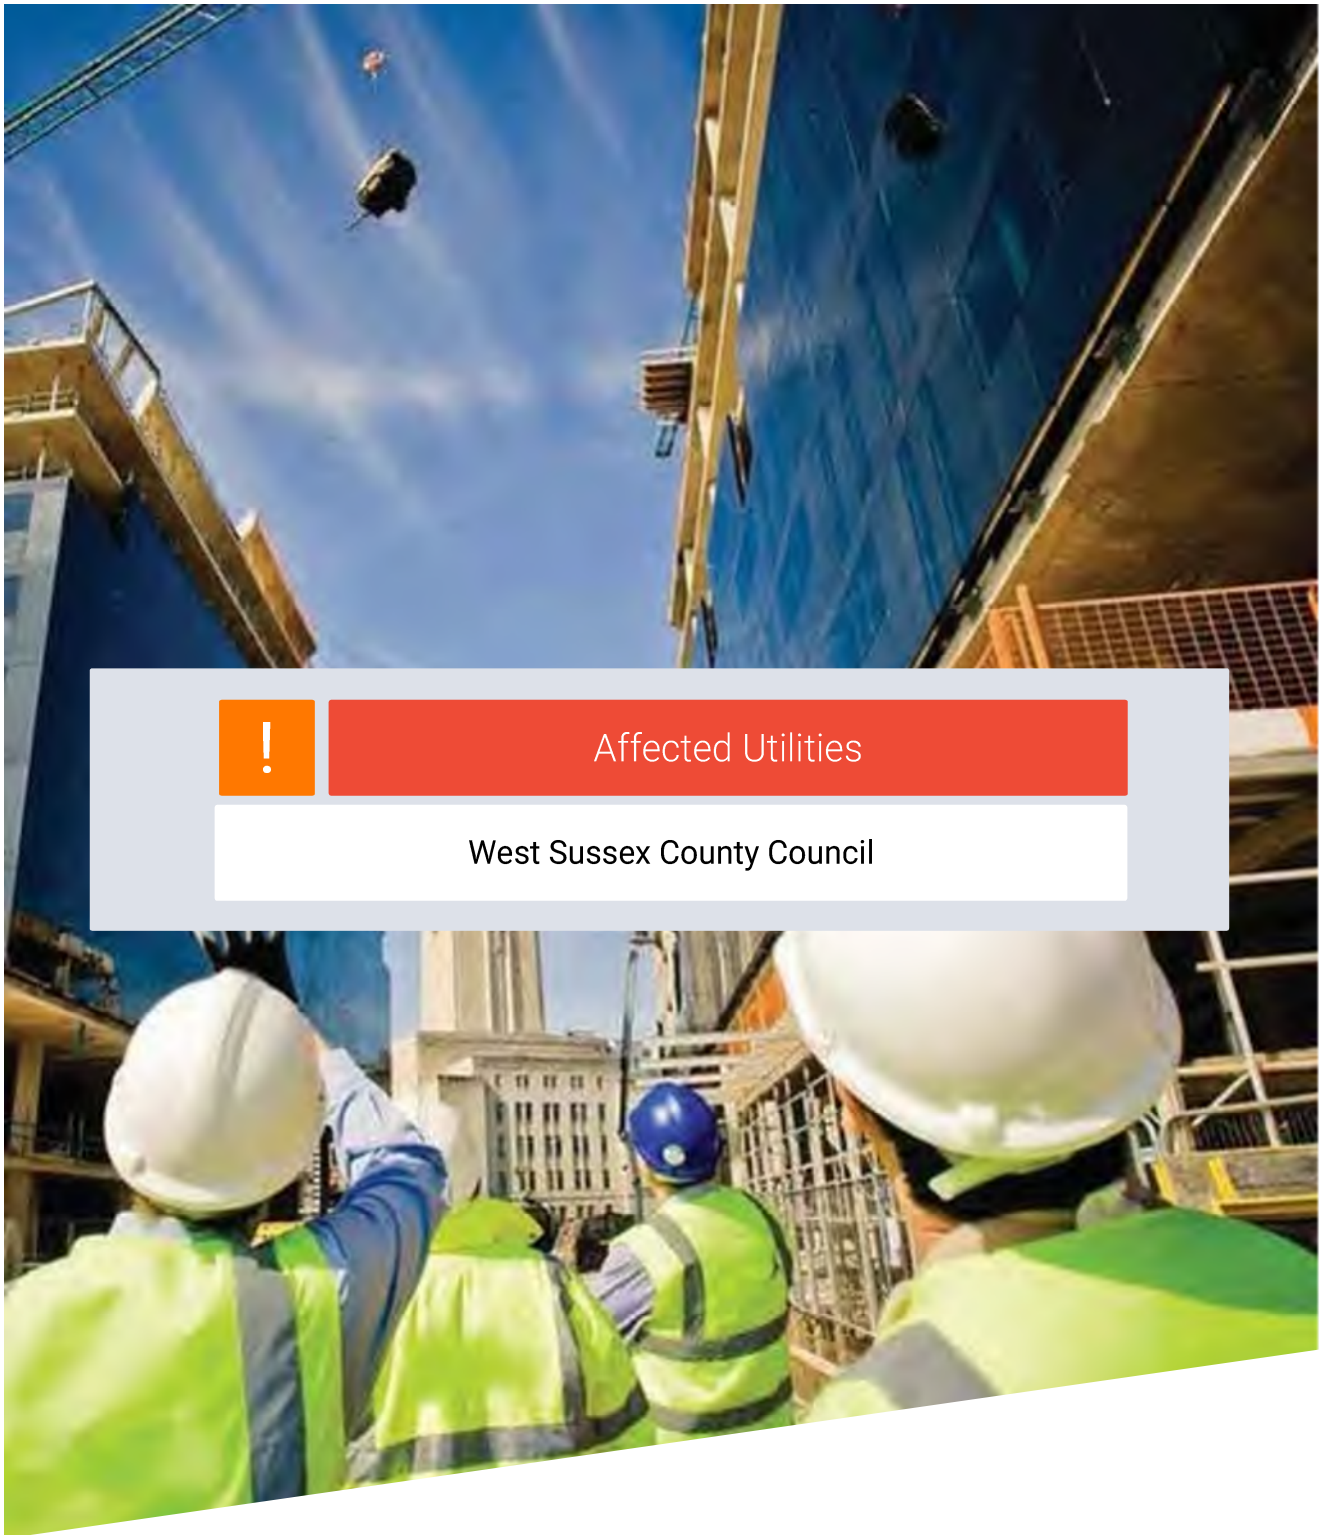

Affected Utilities

West Sussex County Council

Report a Fault

Type the name of a street below and press **Search** to find that location quickly or use the map controls to move and zoom in manually.

Search


R102 3AS

Search

Results

• Previous R102 3AS

Interactive Map

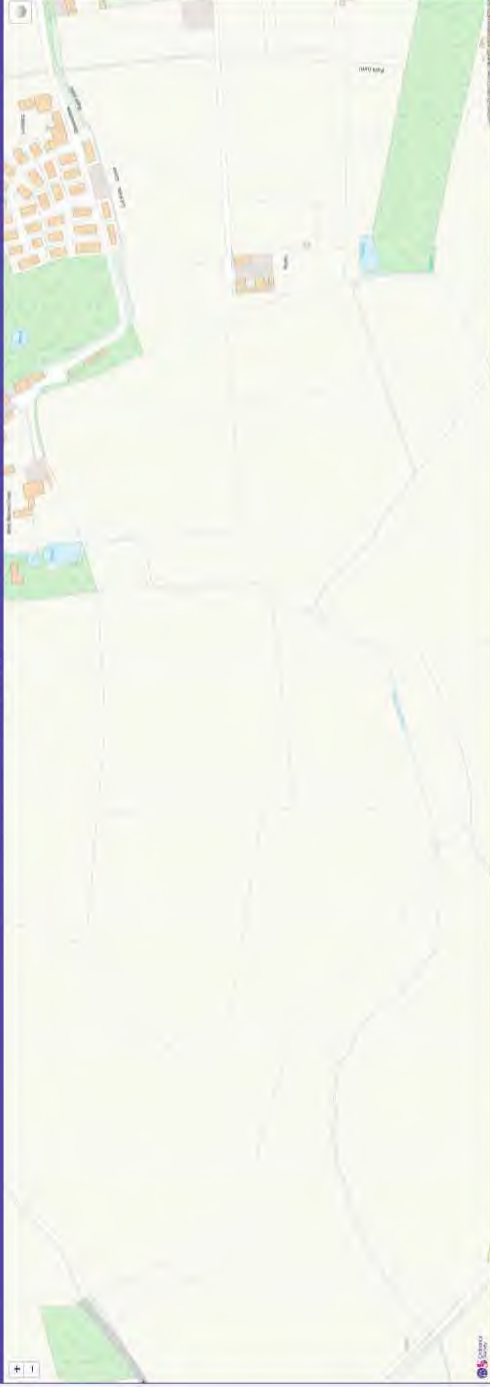

Toggle controls: ☐ Changing ☐ Details

Back to map [Close information](#) [Index](#)

Can't find the light you are looking for?

The Streetlights, Illuminated Signs and Bollards shown on the map are maintained on the West Sussex Council. If a light you are trying to report isn't there it may be either Parish Council, privately maintained or even a Developer light. If you need any assistance please phone us on 0800 0454335 or email the information to westsussex@energived.com and we will try to help.

Legend of light icons

- ☐ Beacon
- ☐ Bollard
- ☐ Floodlight
- ☐ Non Illuminated Sign
- ☐ Other
- ☐ School Crossing Light
- ☐ Sign
- ☐ Street Light
- ☐ Subway
- ☐ Tunnel Light

Having trouble?

If you are having trouble using the interactive version then use our standard tool.

Report a Fault

Type the name of a street below and press **Search** to find that location quickly. Use the map controls to move and zoom in manually.

Search


R102 3AS

Search

Results

Previous R102 3AS

Interactive Map

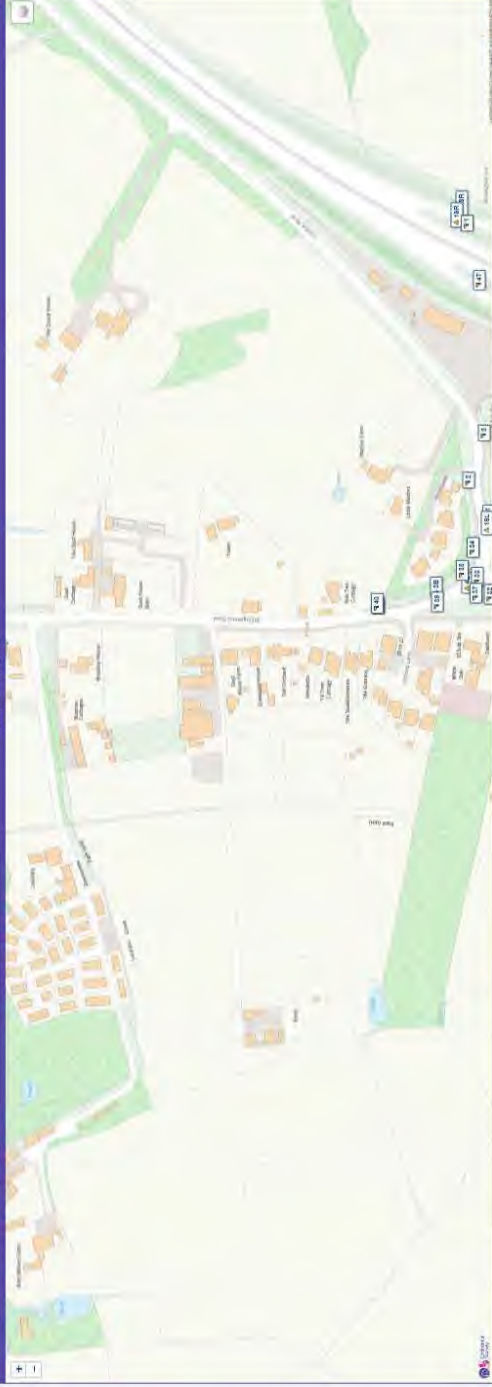

Toggle controls: ☐ Chaining ☐ Details

Back to map [Clear preferences](#) [Index](#)

Can't find the light you are looking for?

The Streetlights, Illuminated Signs and Bollards shown on the map are maintained on the West Sussex Council. If a light you are trying to report isn't there it may be either Parish Council, privately maintained or even a Developer light. If you need any assistance please phone us on 0800 0482435 or email the information to westsussex@energved.com and we will try to help.

Legend of light icons

- ☐ Beacon
- ☐ Bollard
- ☐ Floodlight
- ☐ Non Illuminated Sign
- ☐ Other
- ☐ School Crossing Light
- ☐ Sign
- ☐ Street Light
- ☐ Subway
- ☐ Tunnel Light

Having trouble?

If you are having trouble using the interactive version then use our standard tool.

Report a Fault

Type the name of a street below and press **Search** to find that location quickly. You can also manually zoom and pan the map.

Search

R102 345

Search

Results

Previous Results

Interactive Map



Map of Fault

Map of Fault

Can't find the light you are looking for?

The Streetlights, Illuminated Signs and Bollards shown on the map are maintained on the West Sussex Council. If a light you are trying to report isn't there it may be either Parish Council, privately maintained or even a Developer light. If you need any assistance please phone us on 0800 0482439 or email the information to westsussex@energived.com and we will try to help.

Legend of light icons

- Bollard
- Non Illuminated Sign
- School Crossing Light
- Street Light
- Tunnel Light
- Bollard
- Freestanding Pillar
- Other
- Sign
- Subway

Having trouble?

If you are having trouble using this interactive version then use our standard tool.

Report a Fault

Type the name of a street below and press **Search** to find that location quickly. You can also use the map controls to move and zoom in manually.

Search


R102 345

Search

Results

Previous Results

Interactive Map

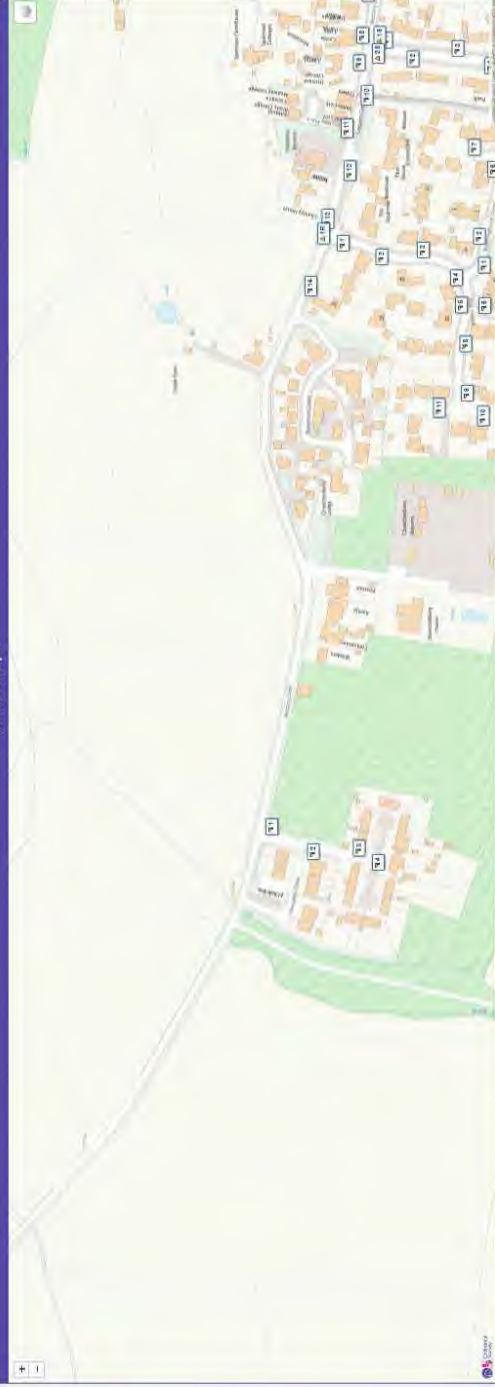

Toggle Street View

Full Screen

Close

Close

Can't find the light you are looking for?

The Streetlights, Illuminated Signs and Bollards shown on the map are maintained on the West Sussex Council. If a light you are trying to report isn't there it may be either Parish Council, privately maintained or even a Developer light. If you need any assistance please phone us on 0800 045435 or email the information to westsussex@energved.com and we will try to help.

Legend of light icons

- Bollard
- Non Illuminated Sign
- School Crossing Light
- Street Light
- Tunnel Light
- Bollard
- Freelance Pillar
- Other
- Sign
- Subway

Having trouble?

If you are having trouble using the interactive version then use our standard tool.