
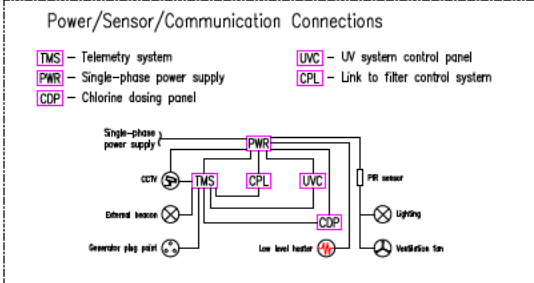


# Appendix 1

## DRAWINGS R1

To be read in conjunction with document BH1422 Arunlea Private Water Supply Management Plan R2

| Date     | Person reviewing | Actions           |
|----------|------------------|-------------------|
| 25.02.26 | Simon Parsons    | Added cover sheet |
|          |                  |                   |
|          |                  |                   |
|          |                  |                   |

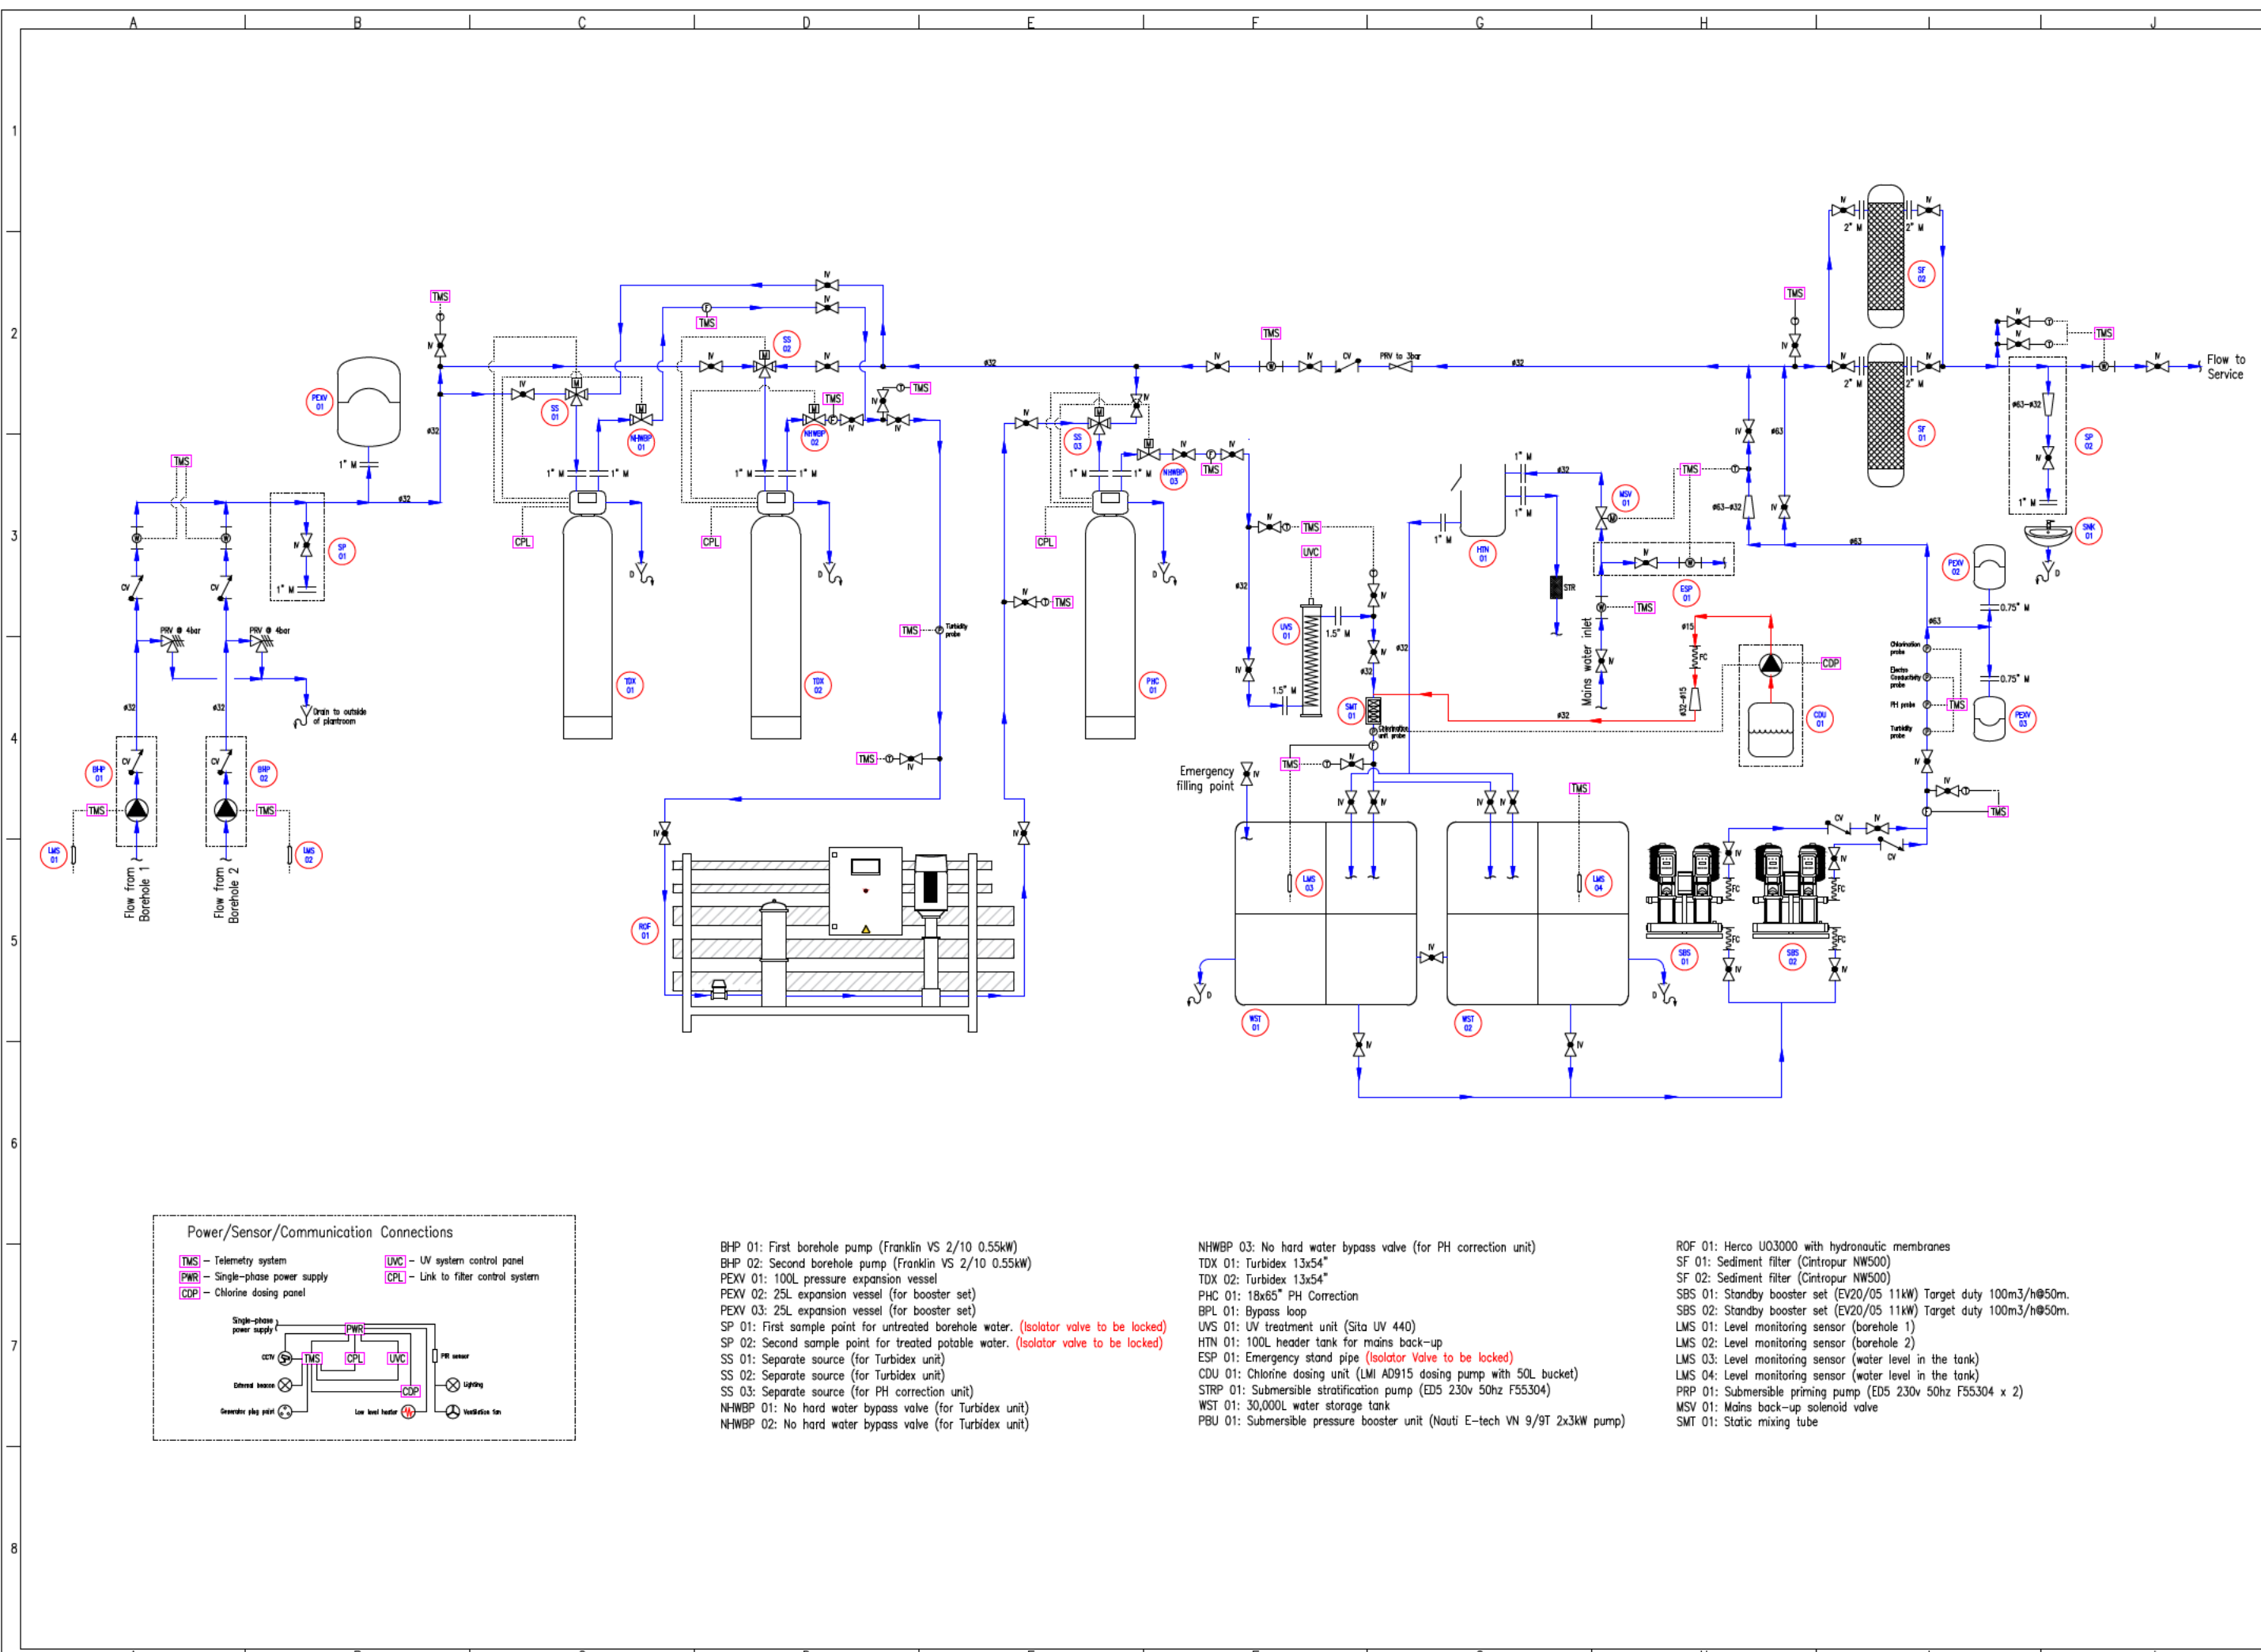

- BHP 01: First borehole pump (Franklin VS 2/10 0.55kW)  
BHP 02: Second borehole pump (Franklin VS 2/10 0.55kW)  
PEXV 01: 100L pressure expansion vessel  
PEXV 02: 25L expansion vessel (for booster set)  
PEXV 03: 25L expansion vessel (for booster set)  
SP 01: First sample point for untreated borehole water. (Isolator valve to be locked)  
SP 02: Second sample point for treated potable water. (Isolator valve to be locked)  
SS 01: Separate source (for Turbidex unit)  
SS 02: Separate source (for Turbidex unit)  
SS 03: Separate source (for PH correction unit)  
NHWP 01: No hard water bypass valve (for Turbidex unit)  
NHWP 02: No hard water bypass valve (for Turbidex unit)
- NHWP 03: No hard water bypass valve (for PH correction unit)  
TDX 01: Turbidex 13x54"  
TDX 02: Turbidex 13x54"  
PHC 01: 18x65" PH Correction  
BPL 01: Bypass loop  
UVS 01: UV treatment unit (Sita UV 440)  
HTN 01: 100L header tank for mains back-up  
ESP 01: Emergency stand pipe (Isolator Valve to be locked)  
CDU 01: Chlorine dosing unit (LMI AD915 dosing pump with 50L bucket)  
STRP 01: Submersible stratification pump (ED5 230v 50hz F55304)  
WST 01: 30,000L water storage tank  
PBU 01: Submersible pressure booster unit (Nauti E-tech VN 9/9T 2x3kW pump)

- ROF 01: Herco UO3000 with hydnraulic membranes  
SF 01: Sediment filter (Cintropur NW500)  
SF 02: Sediment filter (Cintropur NW500)  
SBS 01: Standby booster set (EV20/05 11kW) Target duty 100m3/h@50m.  
SBS 02: Standby booster set (EV20/05 11kW) Target duty 100m3/h@50m.  
LMS 01: Level monitoring sensor (borehole 1)  
LMS 02: Level monitoring sensor (borehole 2)  
LMS 03: Level monitoring sensor (water level in the tank)  
LMS 04: Level monitoring sensor (water level in the tank)  
PRP 01: Submersible priming pump (ED5 230v 50hz F55304 x 2)  
MSV 01: Mains back-up solenoid valve  
SMT 01: Static mixing tube

**General Notes**

**Labour Division**  
Unless otherwise specified in Nicholls Bill of Quantities, all ground work, brick / block work and back filling of holes and trenches are to be priced and completed by others.  
All pipe work and tanks are to be back filled with clean shingle to prevent damage to pipes.


**Mains Power**  
Unless otherwise stated, mains power is to be provided to a IP56 Rated junction box with isolation switch at or near the plant room/borehole. All electrical connections to the mains supply as well as outlets are to be priced and completed by a qualified electrician. By others.

**Water**  
Untreated borehole water is a category 5 supply and may harbour pathogens. A break gap of 30mm with header tank is required between the incoming mains and incoming borehole supplies.  
See <http://www.wras.co.uk/> for more information.

**Surface Water**  
Unless otherwise stated and agreed all well covers will be raised to prevent surface contamination. In some circumstances recessed covers would be acceptable but clients will need to be made aware of the risks involved.

**Contractors Responsibility**  
It is the contractors/Clients responsibility to protect from damage any and all bespoke components installed on site by Nicholls.

**Clients Responsibility**  
It is the clients responsibility to monitor usage and any filter equipment. This is to ensure there has been no damage by others during the surrounding works by others. Nicholls cannot be held liable for any cost incurred from damage caused by others.

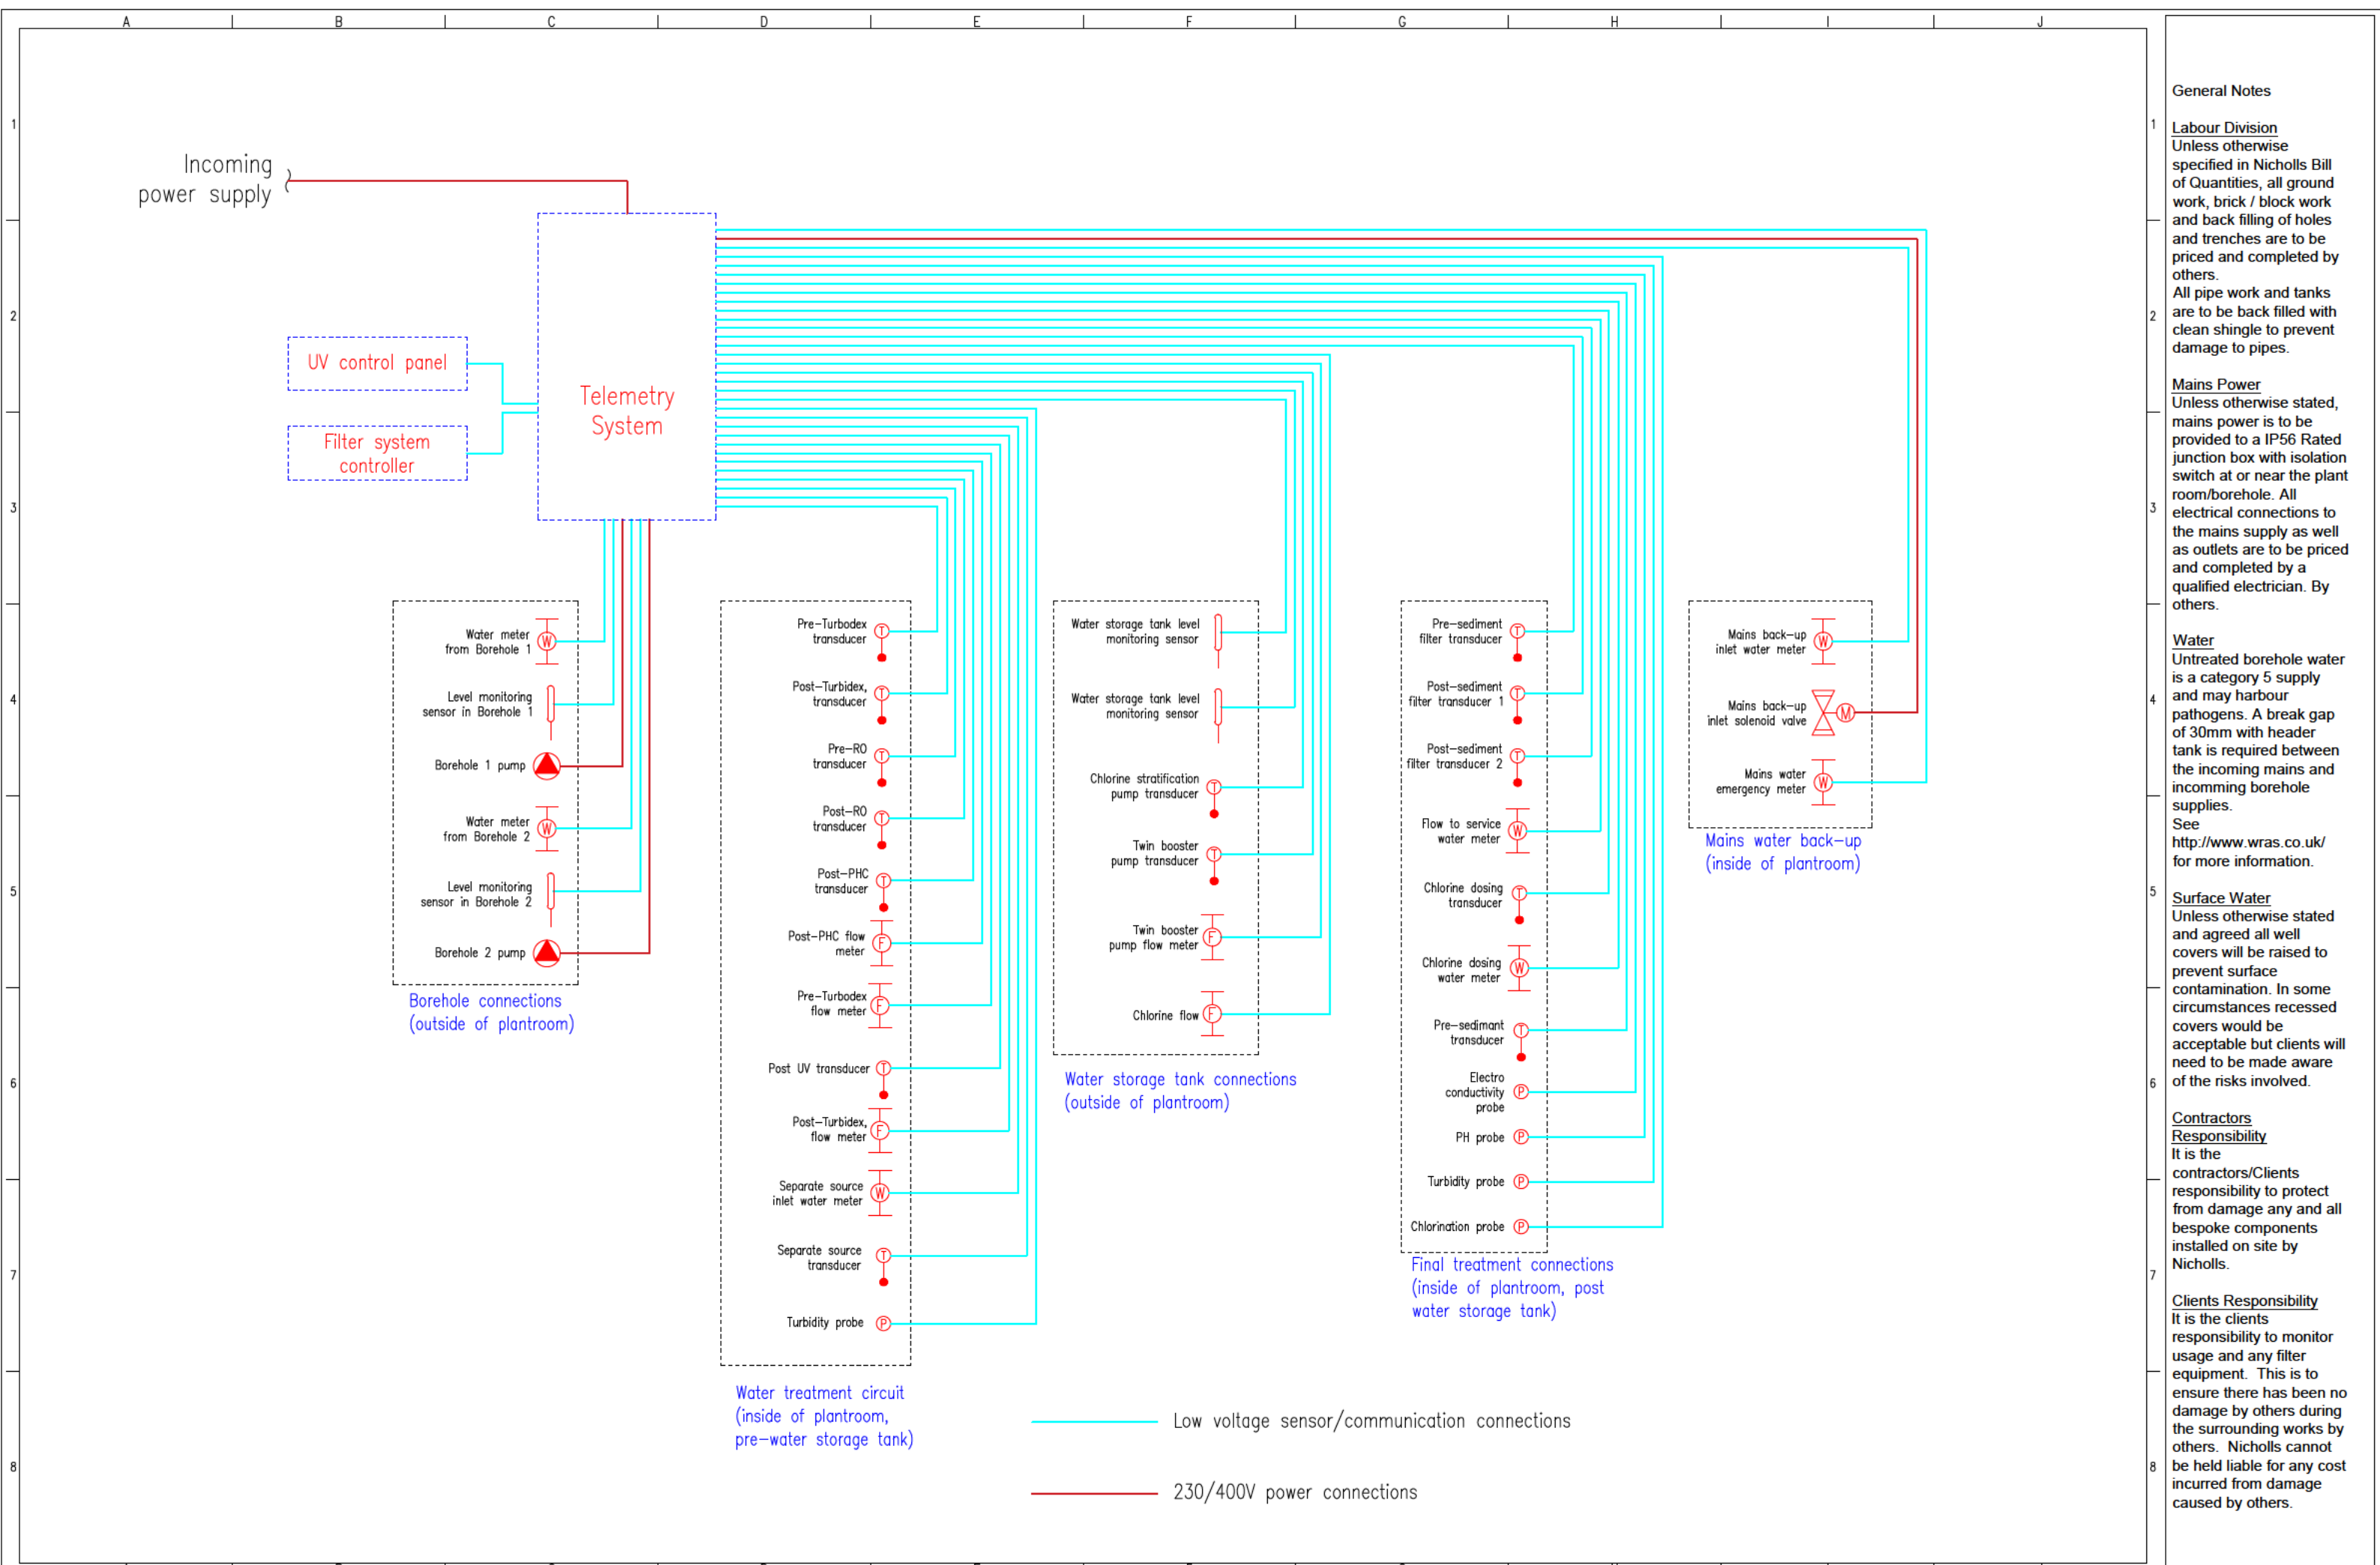

General Notes

Labour Division  
Unless otherwise specified in Nicholls Bill of Quantities, all ground work, brick / block work and back filling of holes and trenches are to be priced and completed by others.  
All pipe work and tanks are to be back filled with clean shingle to prevent damage to pipes.


Mains Power  
Unless otherwise stated, mains power is to be provided to a IP56 Rated junction box with isolation switch at or near the plant room/borehole. All electrical connections to the mains supply as well as outlets are to be priced and completed by a qualified electrician. By others.

Water  
Untreated borehole water is a category 5 supply and may harbour pathogens. A break gap of 30mm with header tank is required between the incoming mains and incoming borehole supplies.  
See <http://www.wras.co.uk/> for more information.



Surface Water  
Unless otherwise stated and agreed all well covers will be raised to prevent surface contamination. In some circumstances recessed covers would be acceptable but clients will need to be made aware of the risks involved.

Contractors Responsibility  
It is the contractors/Clients responsibility to protect from damage any and all bespoke components installed on site by Nicholls.

Clients Responsibility  
It is the clients responsibility to monitor usage and any filter equipment. This is to ensure there has been no damage by others during the surrounding works by others. Nicholls cannot be held liable for any cost incurred from damage caused by others.

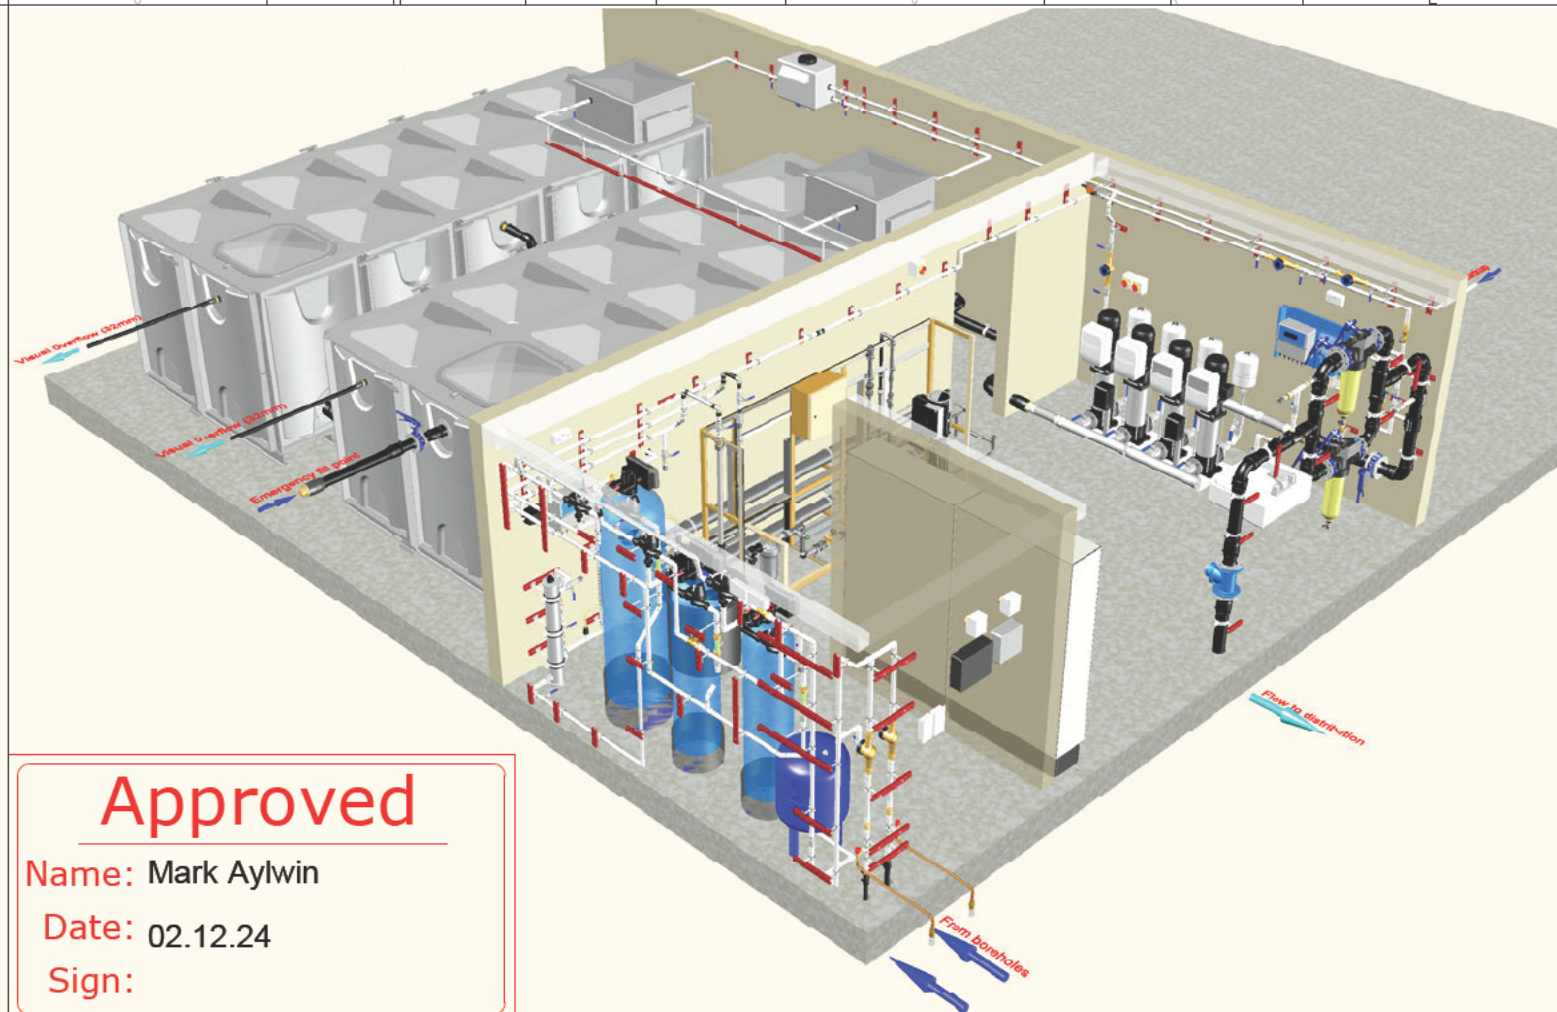

**Approved**  
Name: Mark Aylwin  
Date: 02.12.24  
Sign:

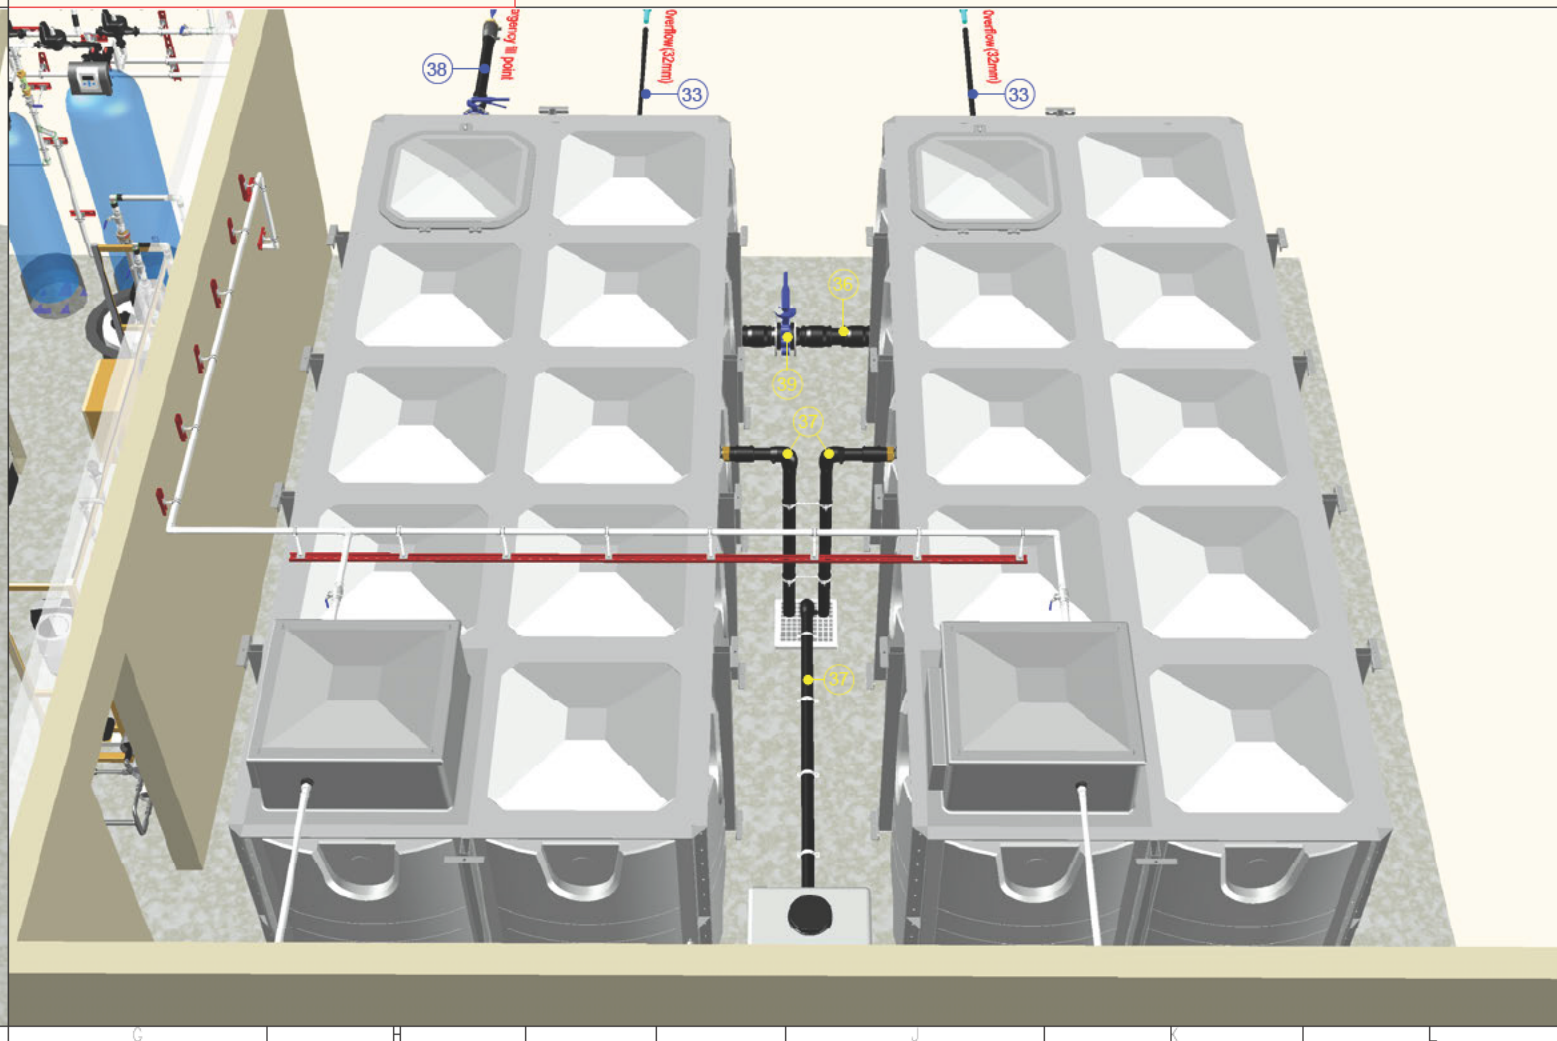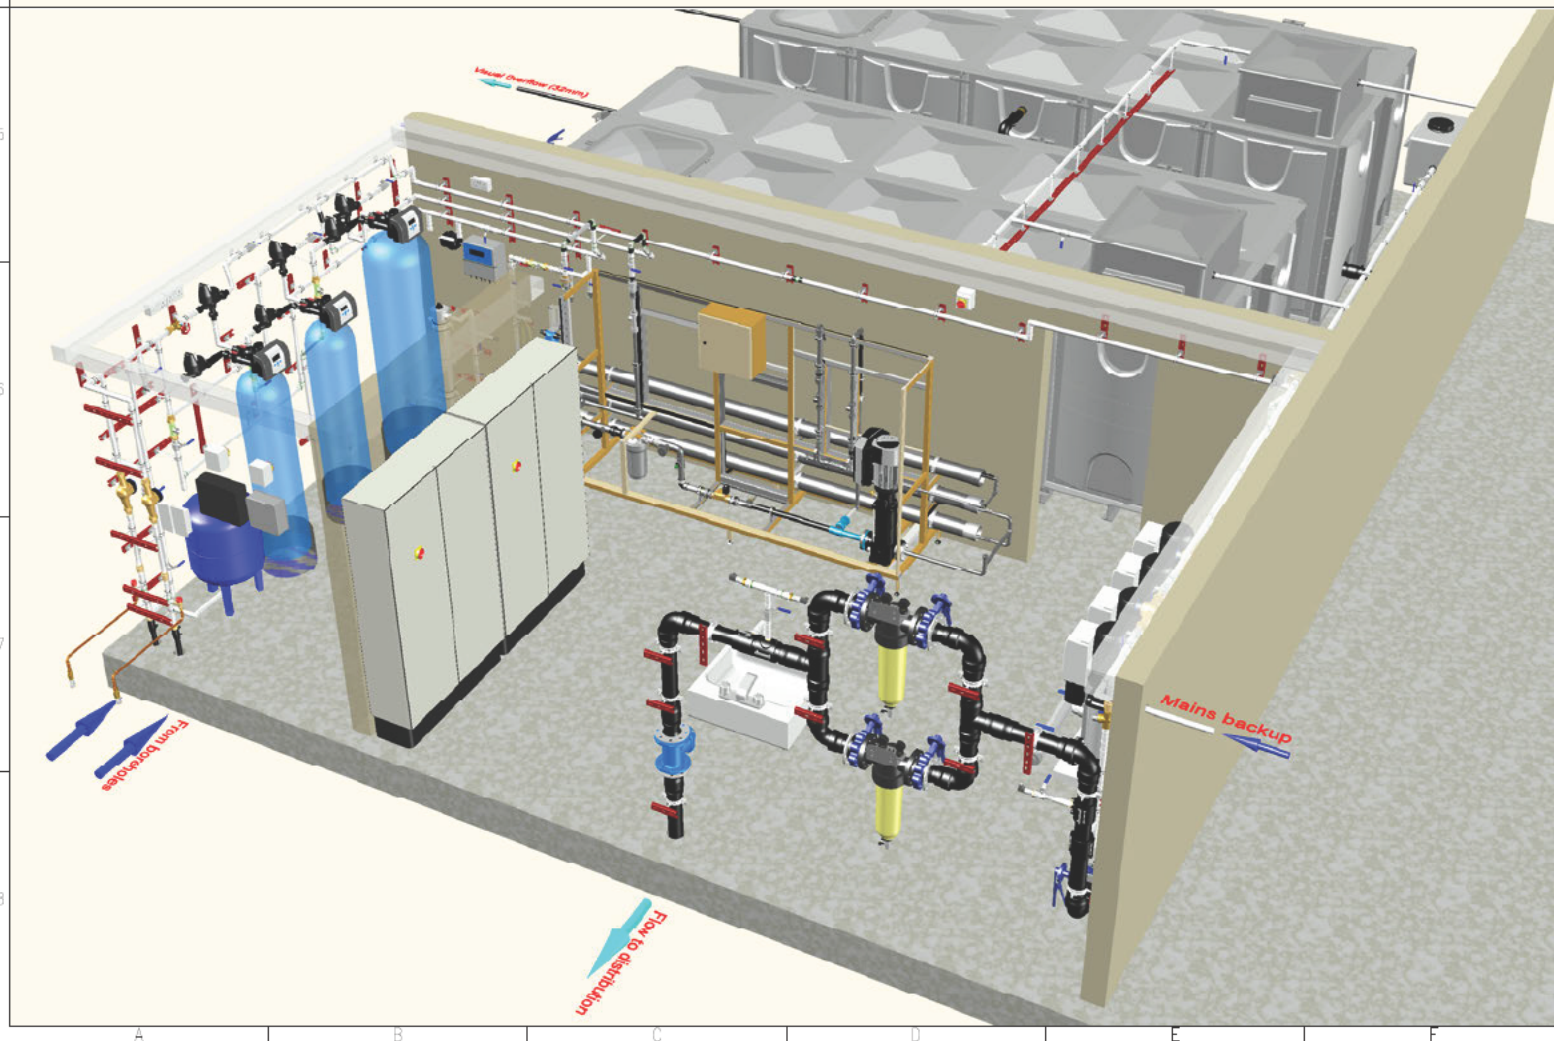

Notes:





|                                                                                                                  |                         |        |                  |  |
|------------------------------------------------------------------------------------------------------------------|-------------------------|--------|------------------|--|
| Title:                                                                                                           | BH1422 - Model overview | Drawn: | Mr Adam Hardiman |  |
| Client:                                                                                                          | Inspired Villages       |        |                  |  |
| Date:                                                                                                            | 1/11/2024               |        |                  |  |
| Revision:                                                                                                        | Rev000                  | Sheet: | 1 of 2           |  |
| Indicative layout for design purposes only. Final position to be confirmed on site. Drawing is not to be scaled. |                         |        |                  |  |

Approved

Name:

Date:

Sign:

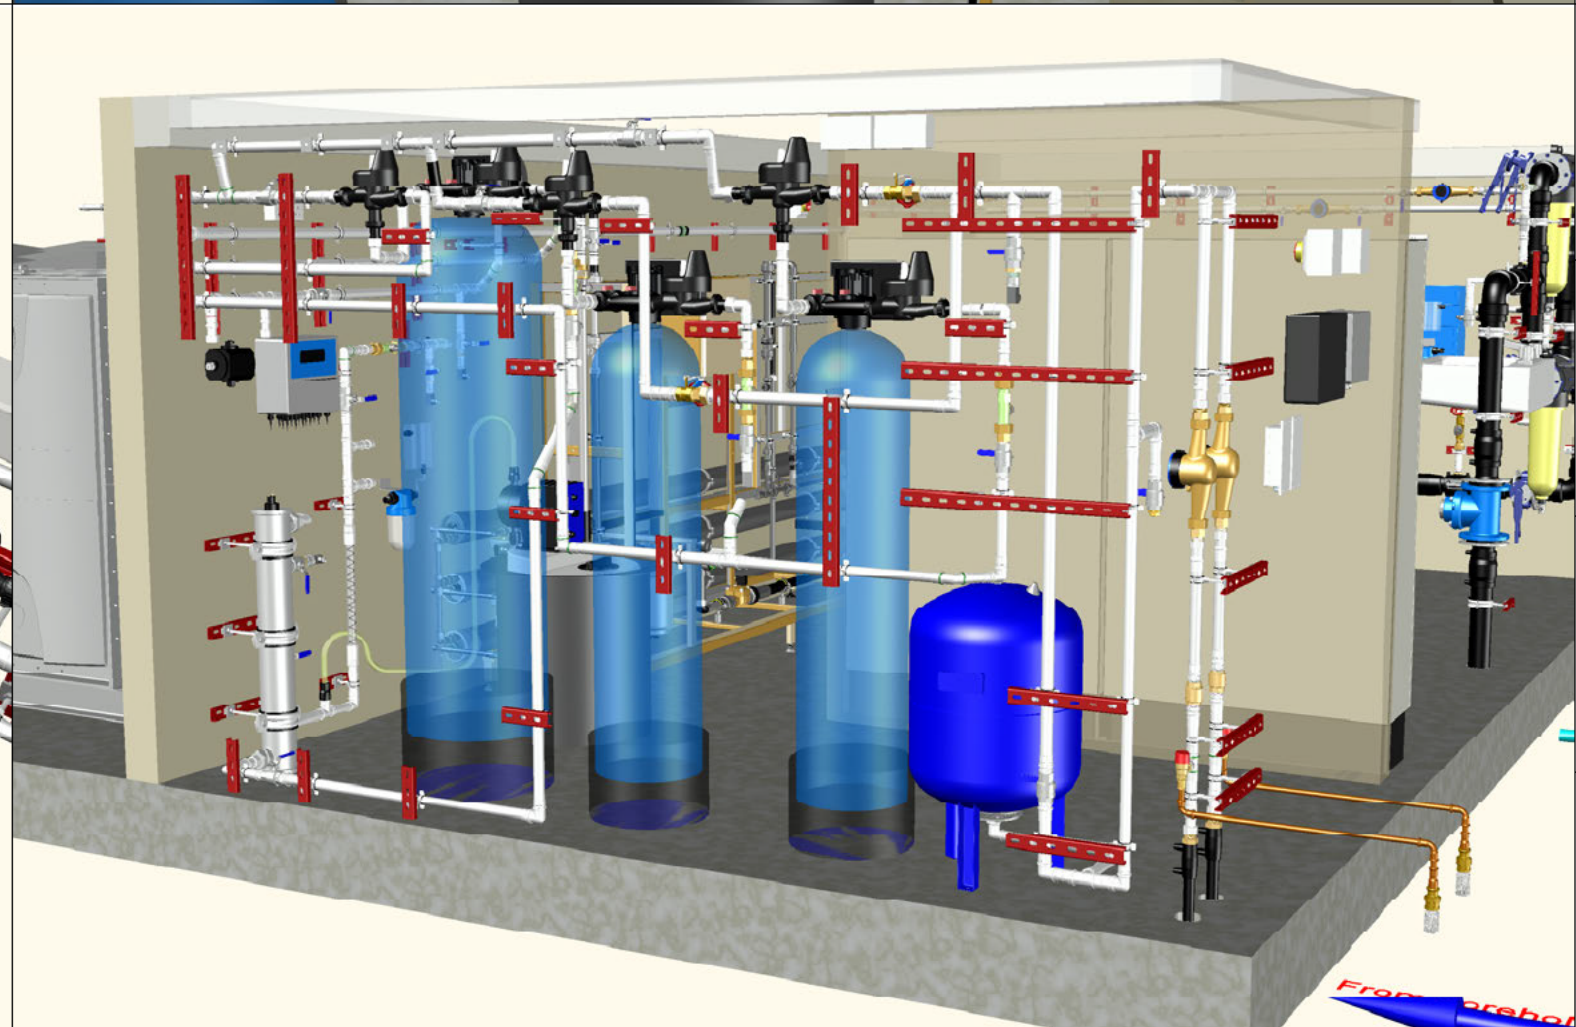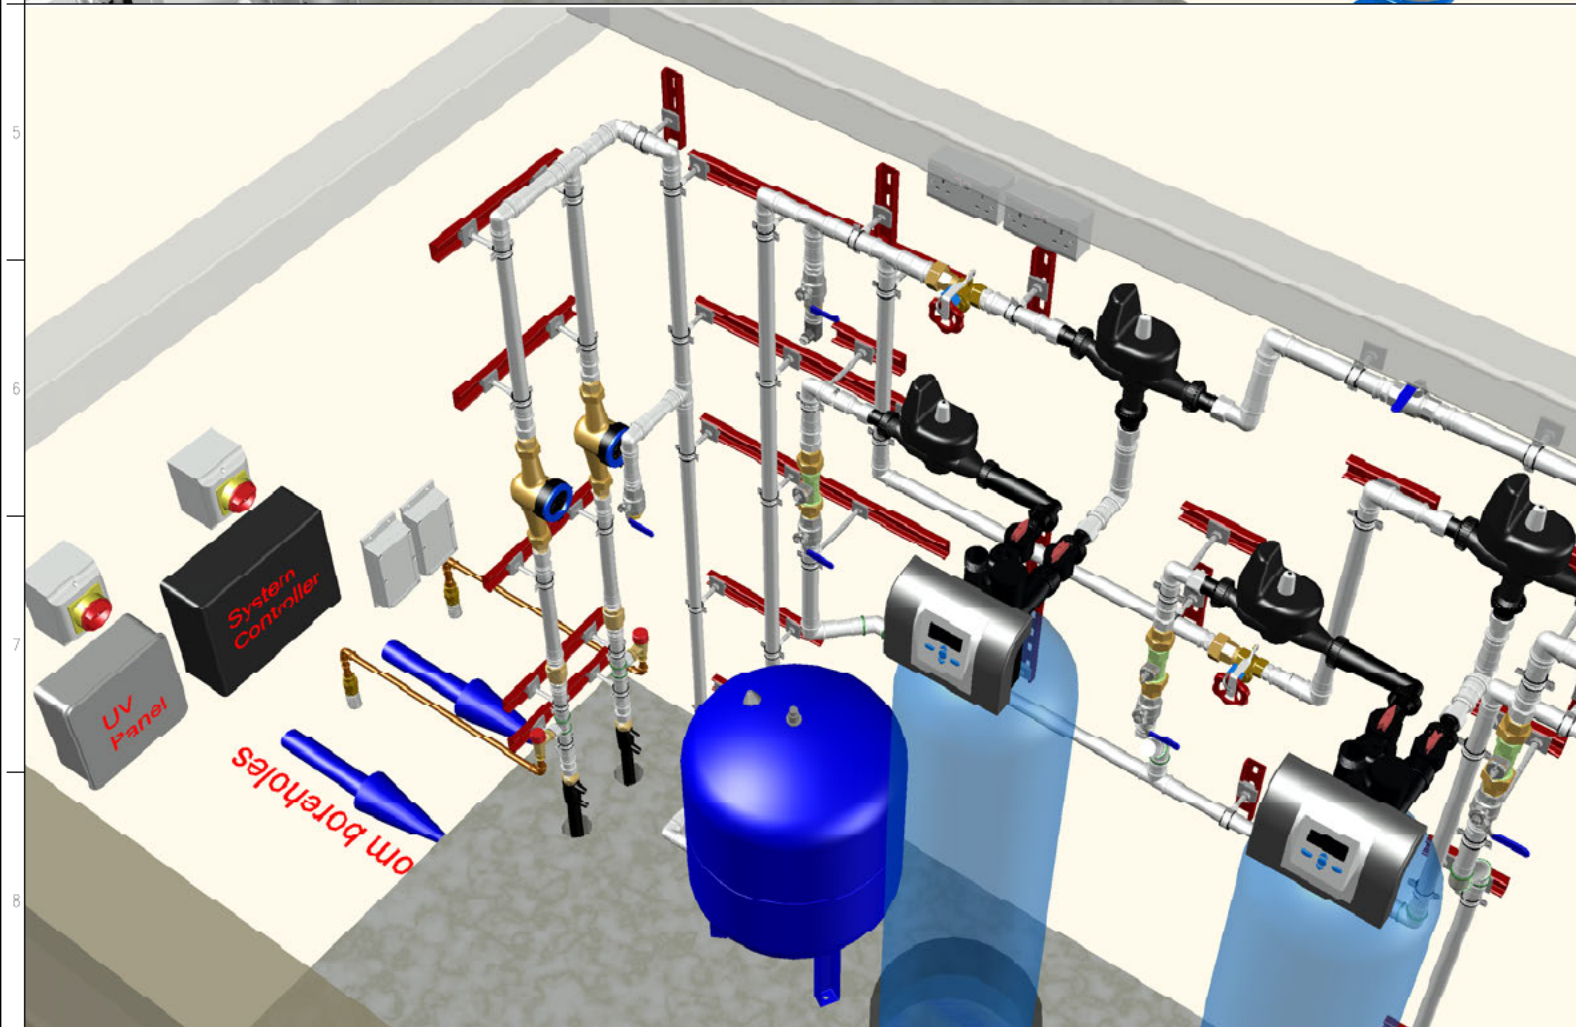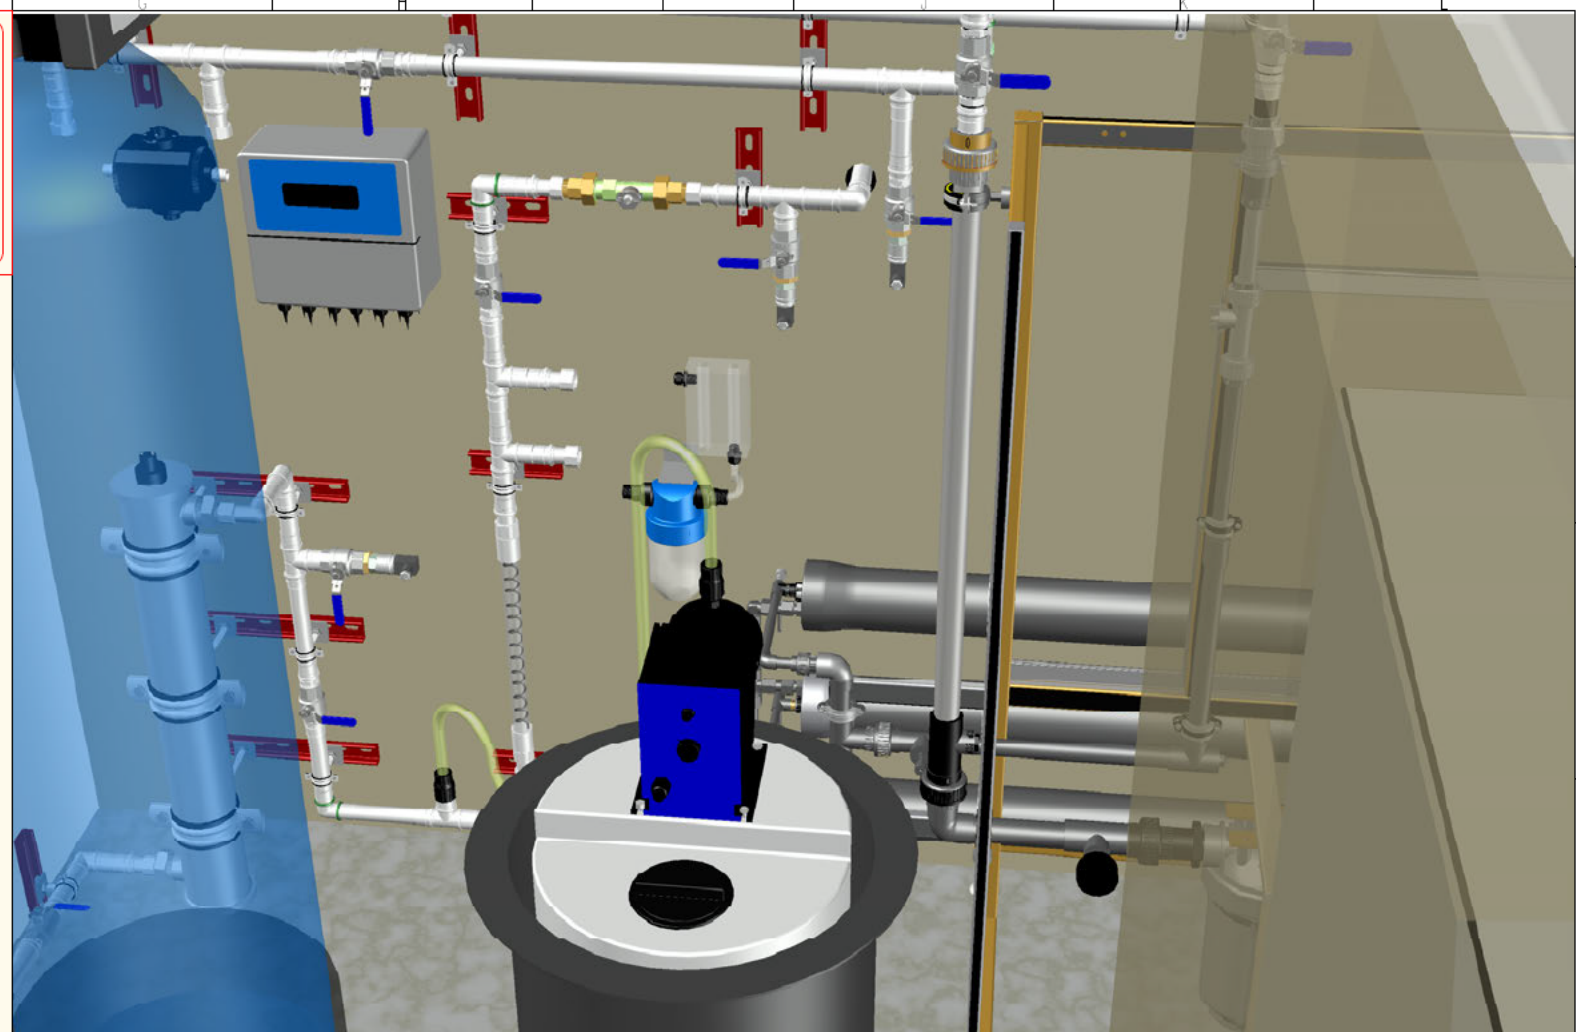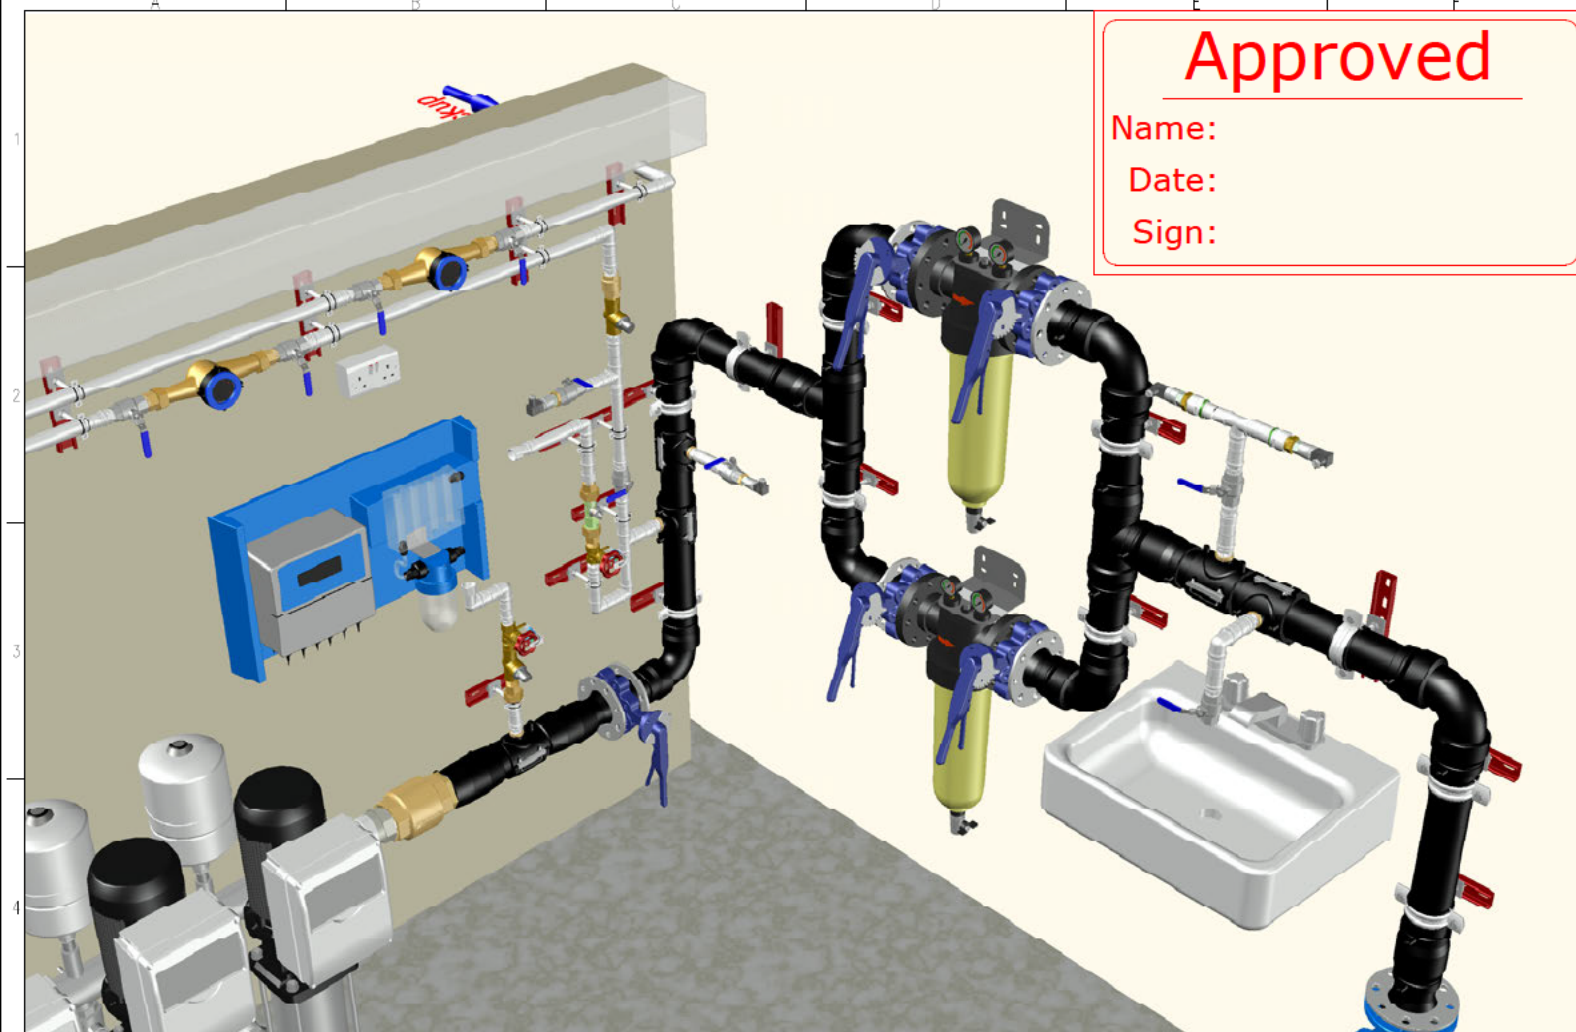


Notes:

Title: BH1422 - Model overview  
Client: Inspired Villages  
Date: 1/11/2024  
Revision: Rev000 Sheet: 2 of 2

Drawn: Mr Adam Hardiman

**NICHOLLS**  
BOREHOLES & GROUND SOURCE

Indicative layout for design purposes only. Final position to be confirmed on site. Drawing is not to be scaled.

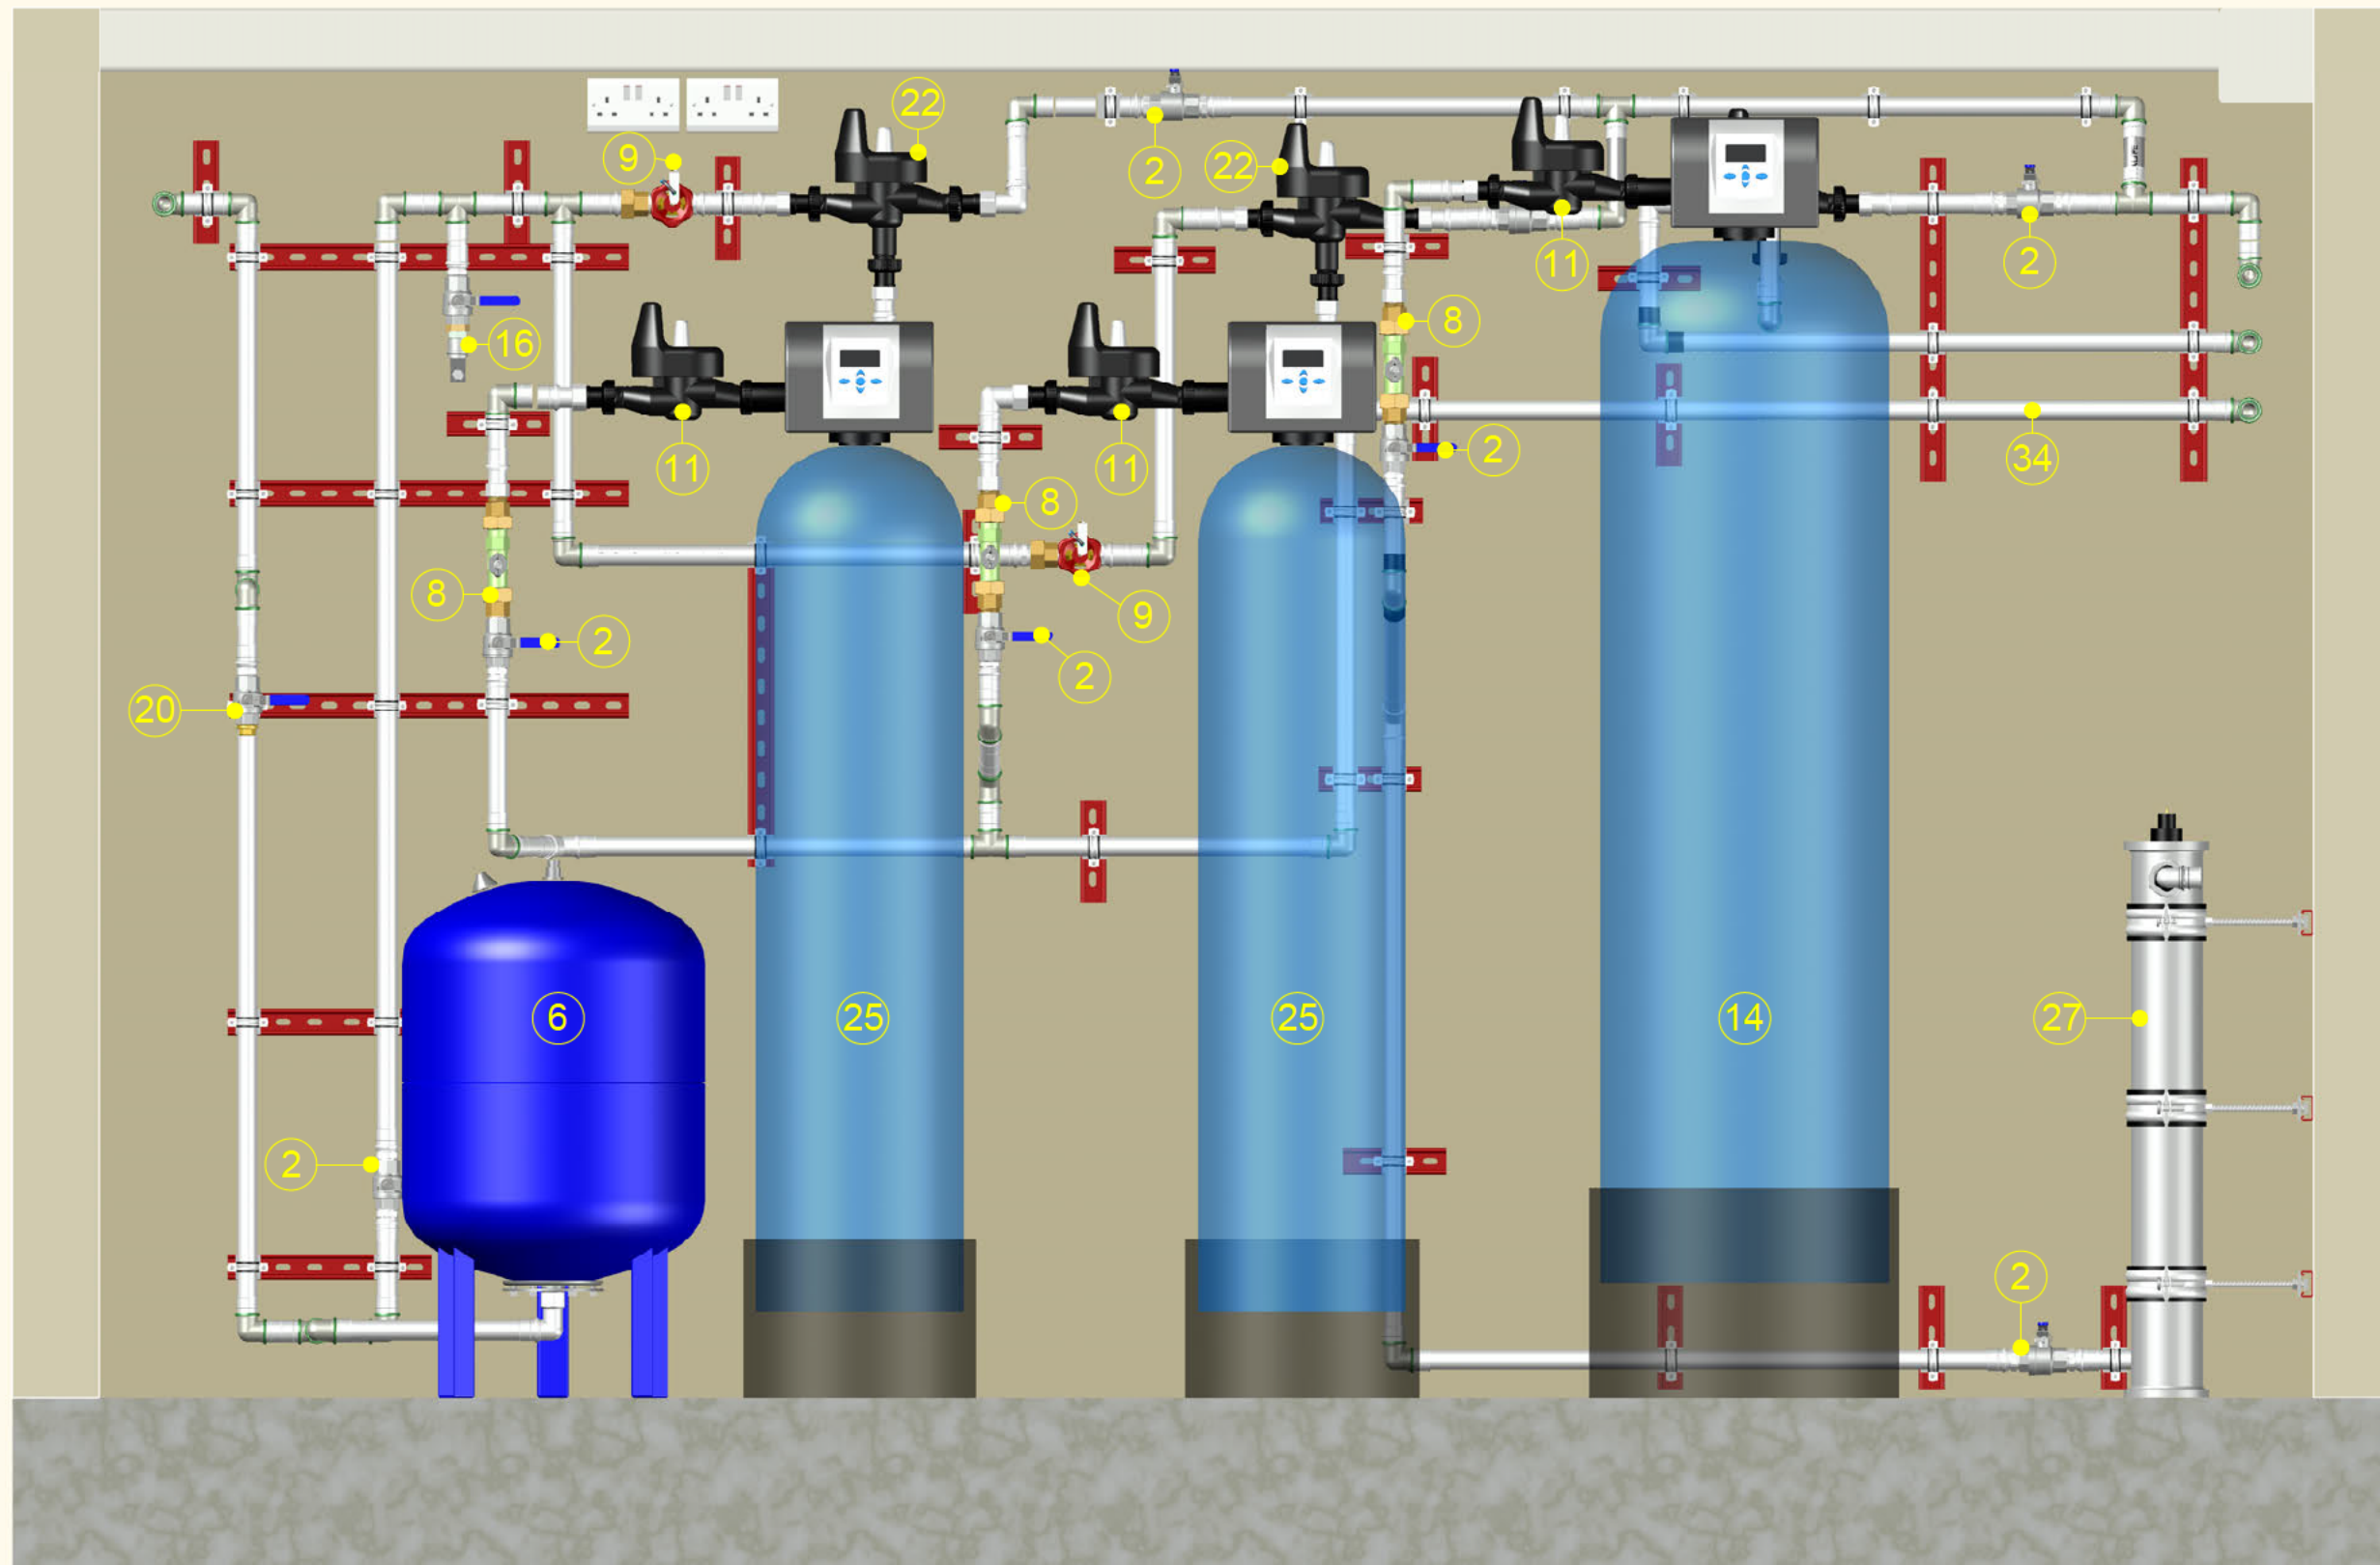

Approved

Name:

Date:

Sign

Notes:

Title: BH1422 - Elevation 1

Client: Inspired Villages

Date: 25/11/2024

Revision: Rev000

Sheet:


1 of 4

Drawn: Mr Adam Hardiman

**NICHOLLS**  
BOREHOLES & GROUND SOURCE

Indicative layout for design purposes only. Final position to be confirmed on site. Drawing is not to be scaled.



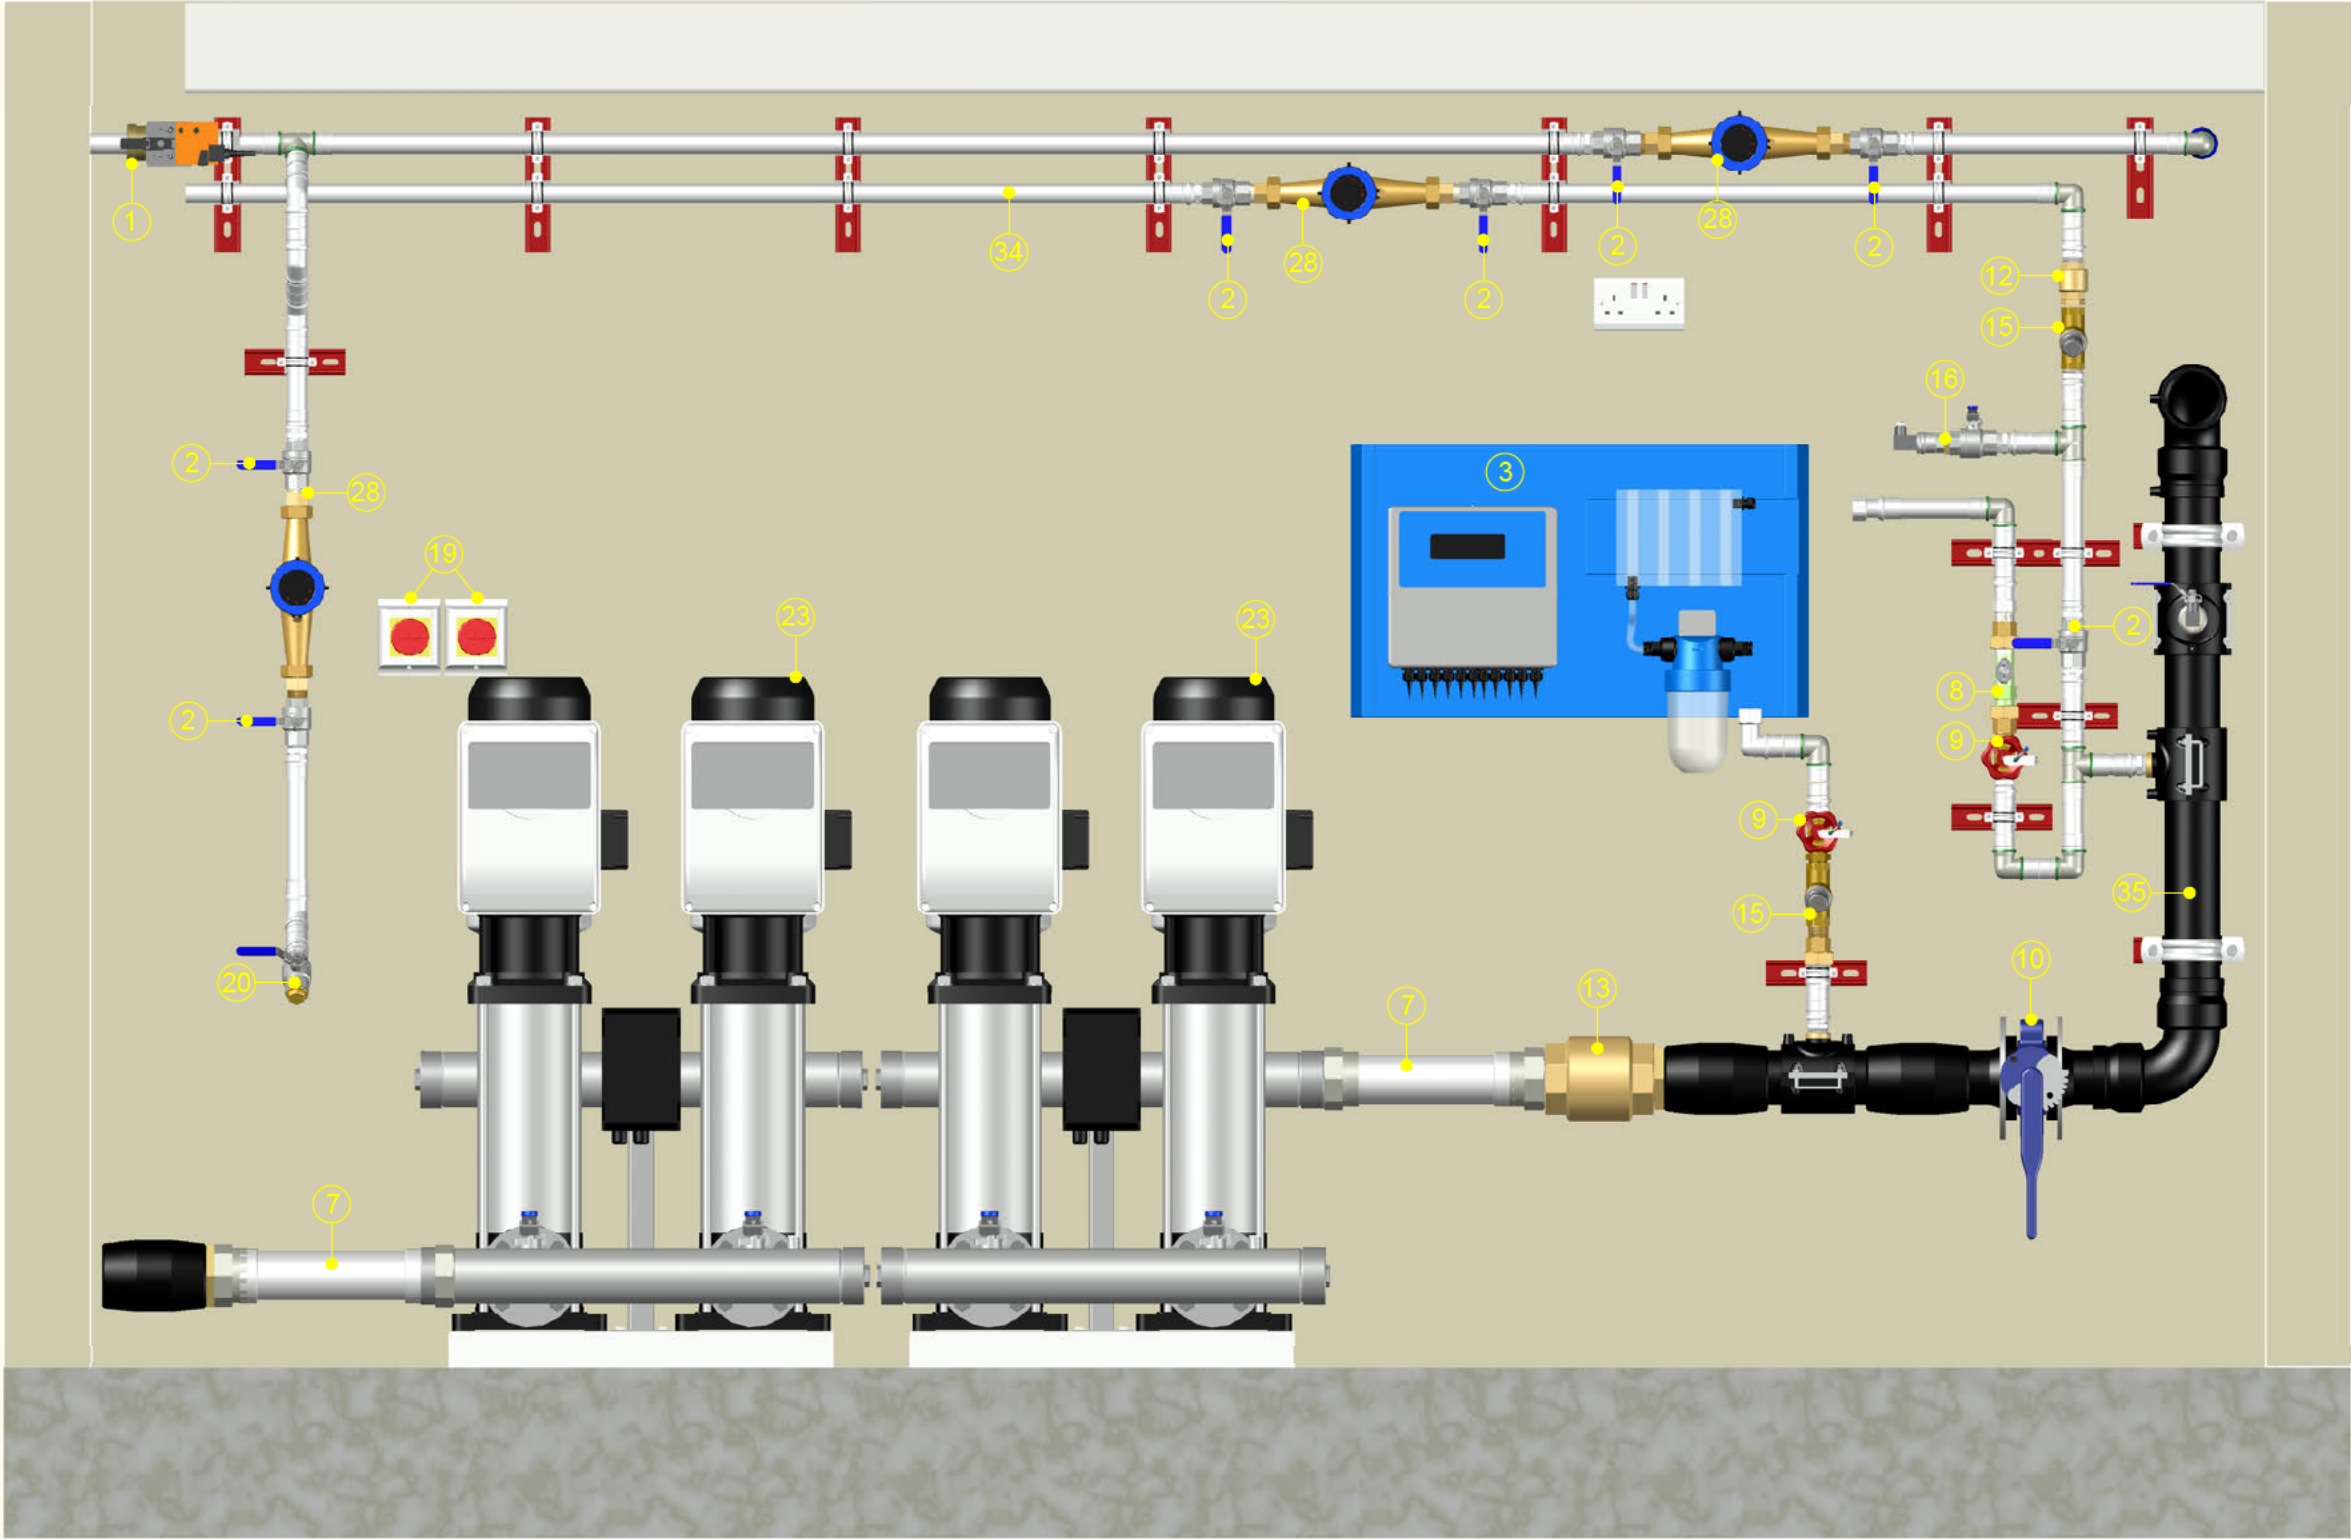

Approved

Name:  
Date:  
Sign




|           |                      |
|-----------|----------------------|
| Title:    | BH1422 - Elevation 3 |
| Client:   | Inspired Villages    |
| Date:     | 25/11/2024           |
| Revision: | Rev000               |
| Sheet:    | 3 of 4               |

Drawn: Mr Adam Hardiman



Indicative layout for design purposes only. Final position to be confirmed on site. Drawing is not to be scaled.

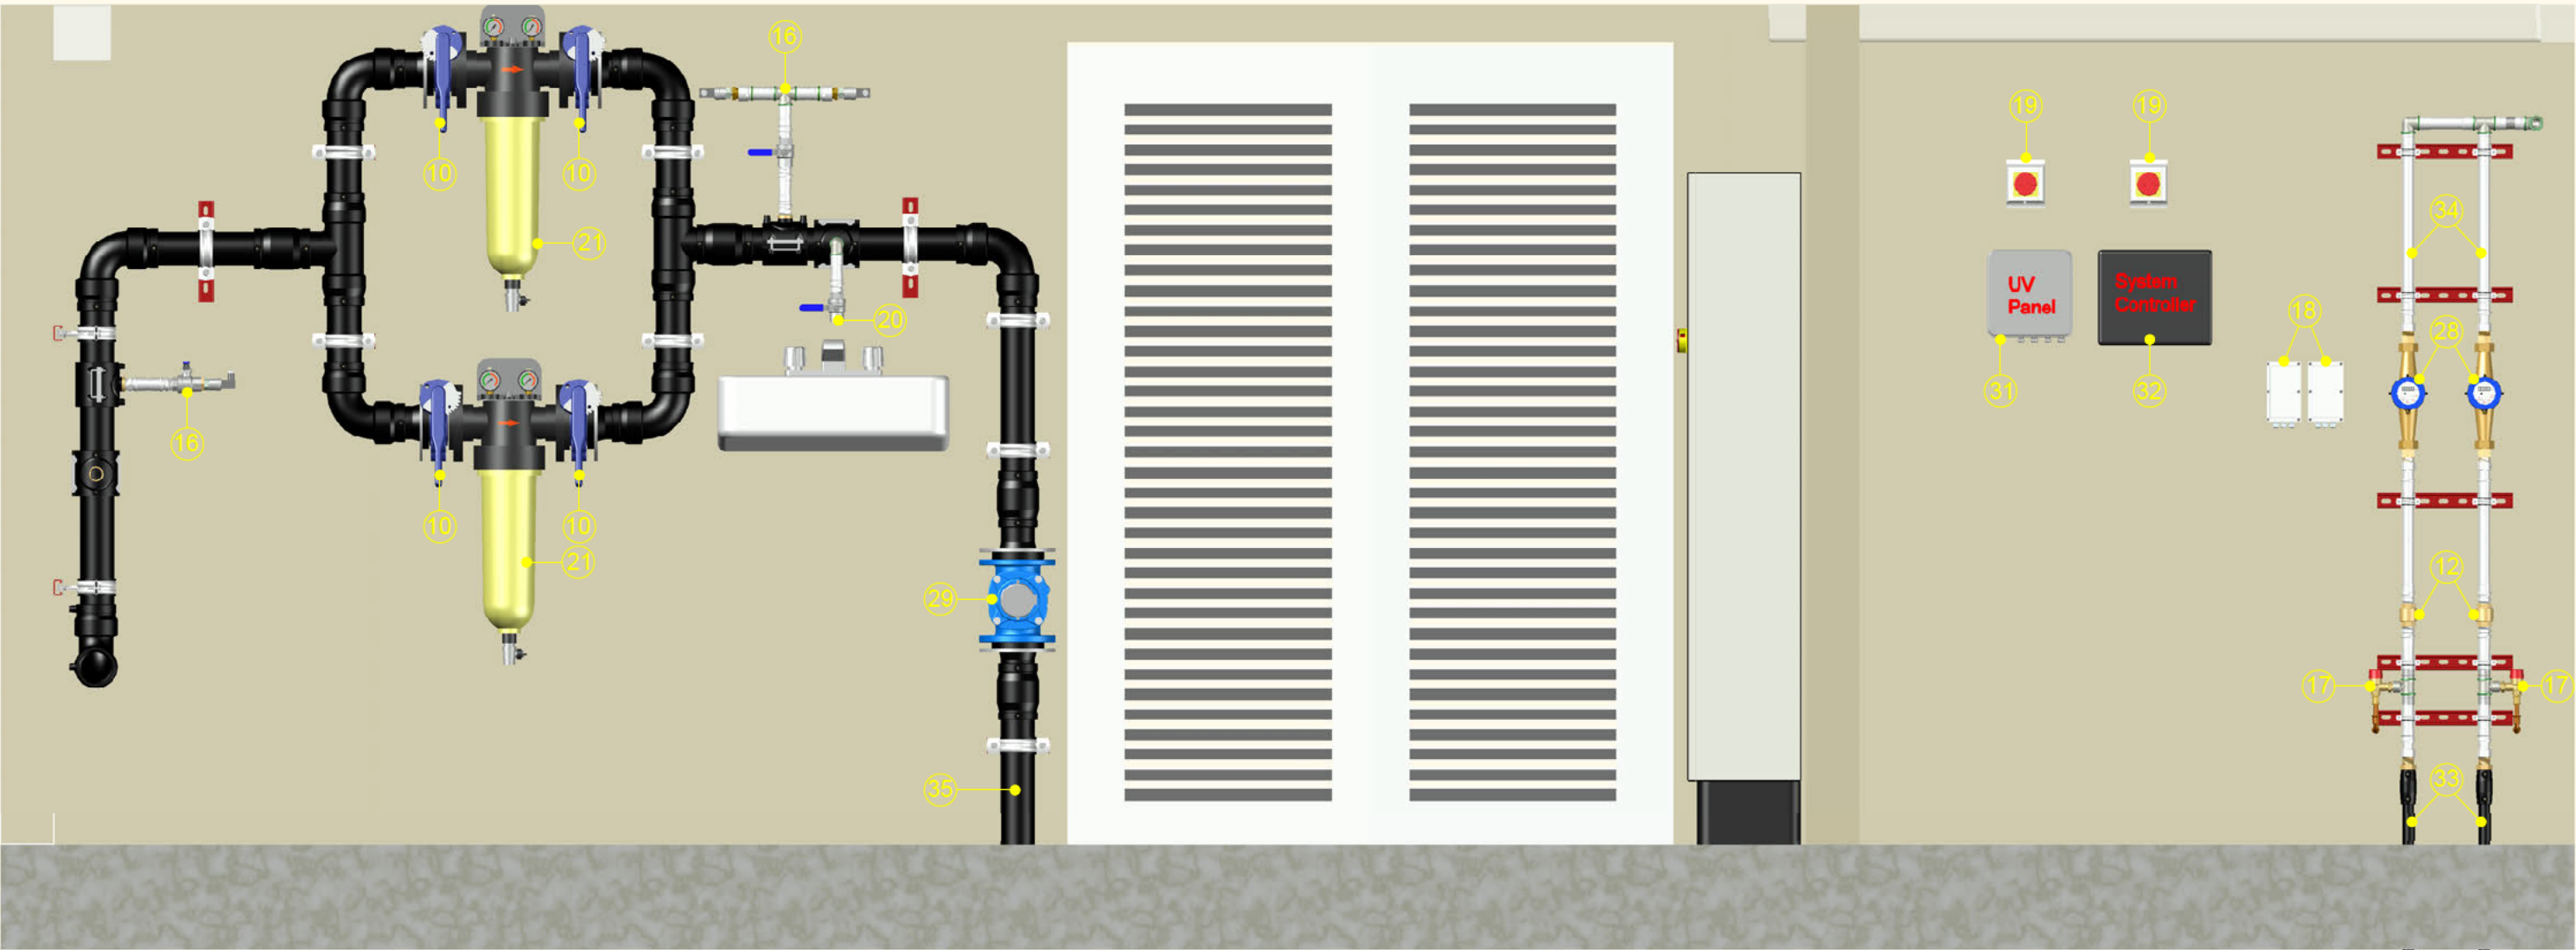

Approved

Name:

Date:

Sign

Notes:

|           |                      |        |        |
|-----------|----------------------|--------|--------|
| Title:    | BH1422 - Elevation 4 |        |        |
| Client:   | Inspired Villages    |        |        |
| Date:     | 25/11/2024           |        |        |
| Revision: | Rev000               | Sheet: | 4 of 4 |

|                                                                                                                  |                  |                                                                                                                                    |
|------------------------------------------------------------------------------------------------------------------|------------------|------------------------------------------------------------------------------------------------------------------------------------|
| Drawn:                                                                                                           | Mr Adam Hardiman |  <b>NICHOLLS</b><br>BOREHOLES & GROUND SOURCE |
|                                                                                                                  |                  |                                                                                                                                    |
| Indicative layout for design purposes only. Final position to be confirmed on site. Drawing is not to be scaled. |                  |                                                                                                                                    |